



APPLICATION EXAMPLE

Integration and Usage of the WinCC OA Panel Topology Framework

SIMATIC WinCC Open Architecture

SIEMENS

Legal Information

Use of application examples

Application examples illustrate the solution of automation tasks through an interaction of several components in the form of text, graphics, and/or software modules. The application examples are a free service by Siemens AG and/or a subsidiary of Siemens AG ("Siemens"). They are non-binding and make no claim to completeness or functionality regarding configuration and equipment. The application examples merely offer help with typical tasks; they do not constitute customer-specific solutions. You yourself are responsible for the proper and safe operation of the products in accordance with applicable regulations and must also check the function of the respective application example and customize it for your system. Siemens grants you the non-exclusive, non-sublicensable and non-transferable right to have the application examples used by technically trained personnel. Any change to the application examples is your responsibility. Sharing the application examples with third parties or copying the application examples or excerpts thereof is permitted only in combination with your own products. The application examples are not required to undergo the customary tests and quality inspections of a chargeable product; they may have functional and performance defects as well as errors. It is your responsibility to use them in such a manner that any malfunctions that may occur do not result in property damage or injury to persons.

Disclaimer of liability

Siemens shall not assume any liability, for any legal reason whatsoever, including, without limitation, liability for the usability, availability, completeness, and freedom from defects of the application examples as well as for related information, configuration and performance data and any damage caused thereby. This shall not apply in cases of mandatory liability, for example under the German Product Liability Act, or in cases of intent, gross negligence, or culpable loss of life, bodily injury or damage to health, non-compliance with a guarantee, fraudulent non-disclosure of a defect, or culpable breach of material contractual obligations. Claims for damages arising from a breach of material contractual obligations shall however be limited to the foreseeable damage typical of the type of agreement, unless liability arises from intent or gross negligence or is based on loss of life, bodily injury, or damage to health. The foregoing provisions do not imply any change in the burden of proof to your detriment. You shall indemnify Siemens against existing or future claims of third parties in this connection except where Siemens is mandatorily liable. By using the application examples you acknowledge that Siemens cannot be held liable for any damage beyond the liability provisions described.

Other information

Siemens reserves the right to make changes to the application examples at any time without notice. In case of discrepancies between the suggestions in the application examples and other Siemens publications such as catalogs, the content of the other documentation shall have precedence.

The Siemens terms of use (<https://support.industry.siemens.com>) shall also apply.

Security information

Siemens provides products and solutions with industrial cybersecurity functions that support the secure operation of plants, systems, machines and networks.

In order to protect plants, systems, machines and networks against cyber threats, it is necessary to implement – and continuously maintain – a holistic, state-of-the-art industrial cybersecurity concept. Siemens' products and solutions constitute one element of such a concept.

Customers are responsible for preventing unauthorized access to their plants, systems, machines and networks. Such systems, machines and components should only be connected to an enterprise network or the internet if and to the extent such a connection is necessary and only when appropriate security measures (e.g. firewalls and/or network segmentation) are in place.

For additional information on industrial cybersecurity measures that may be implemented, please visit www.siemens.com/cybersecurity-industry.

Siemens' products and solutions undergo continuous development to make them more secure. Siemens strongly recommends that product updates are applied as soon as they are available and that the latest product versions are

used. Use of product versions that are no longer supported, and failure to apply the latest updates may increase customer's exposure to cyber threats.

To stay informed about product updates, subscribe to the Siemens Industrial Cybersecurity RSS Feed under <https://www.siemens.com/cert>.

Contents

Legal Information	1
1. Introduction	4
1.1. Overview	5
1.2. Mode of operation	5
1.3. Components used	5
2. Engineering	5
2.1. Project integration	6
2.2. Operation	17
3. Appendix	38
Important WinCC OA specific abbreviations	39
Service and support	39
Change documentation	41

1. Introduction

1.1. Overview

This document describes the WinCC OA Panel Topology Framework and its integration with WinCC OA projects. The framework provides a structured approach to managing panel configurations and ensures seamless navigation and visualization of distributed HMI systems. By leveraging pre-configured faceplates and a modular topology-based layout, the framework simplifies the development of WinCC OA projects, enhancing usability and operational efficiency. It supports various industrial applications by offering a smart navigation mechanism, predefined visualization elements, and flexible configuration options. This document outlines the concept, application, and visualization capabilities of the framework, along with details on its implementation and benefits in SCADA environments.

1.2. Mode of operation

This document describes the WinCC OA properties of integrating the WinCC OA Panel Topology Framework.

1.3. Components used

This application example has been created with the following hard- and software components:

Component	Number	Article number	Note
WinCC OA 3.21 Server Basis	1	6AV6355-1AA50-1BA0	
WinCC OA V3.21, Para Standard	1	6AV6355-1AA50-1CH0	

Table 1-1

You can purchase these components from the [Siemens Industry Mall](#).

This application example consists of the following components:

Component	File name	Note
WinCCOAFrameworkAppExample help file	WinCCOAFrameworkAppExample_3.21.pdf	This document
Example Project WinCC OA	WinCCOAFrameworkAppExample_3.21.zip	Pre-configured project for testing the example in WinCC OA
Subproject WinCC OA (The Framework)	PT_SIE_FRAMEWORK_3_21.zip	Subproject for WinCC OA

Table 1-2

2. Engineering

2.1. Project integration

2.1.1. System requirements

- WinCC OA Version 3.21 P0 or higher installation and license (incl. Para)
- Minimal system requirements for WinCC OA (see [WinCC OA Documentation](#))

2.1.2. Installation WinCC OA

To carry out the installation of WinCC OA, please follow the steps in the WinCC OA documentation. You can find the documentation under following link: [Installation of WinCC OA](#)

2.1.3. Preparation

Unpack the supplied ZIP archive "FrameworkApplicationExample_3.21.zip" into the folder where the project is to be created.

The ZIP-archive contains the folder:

- WinCCOAFrameworkAppExample_3.21.zip:
- PT_SIE_FRAMEWORK_3_21.zip: The WinCC OA Panel Topology framework subproject

2.1.4. Create Project

Follow the steps from the documentation to create your standard project and integrate the panel topology framework as a subproject into the newly created project.

To create a standard project, please follow the steps from the WinCC OA documentation:

https://www.winccoa.com/documentation/WinCCOA/latest/en_US/GettingStarted/GettingStarted-20.html

2.1.5. Registering and integrating the framework template as a WinCC OA subproject

1. In the WinCC OA Project Administrator click on  to register a new project. From the previously created folder in the section 2.1.3 select the "PT_SIE_FRAMEWORK_3.21" folder
2. Deselect the checkbox "runnable" and click on OK.

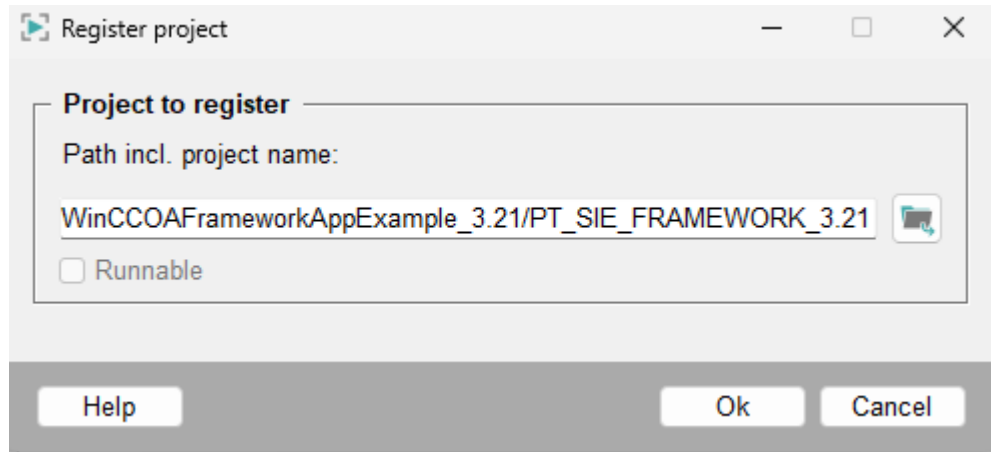


Figure 2-7 project registration dialog

The subproject is now registered.

Attention: Subprojects do not appear in the WinCC OA Project Administrator!

3. Assign the registered subproject to your project click in the WinCC OA project administrator on  to open the project properties.

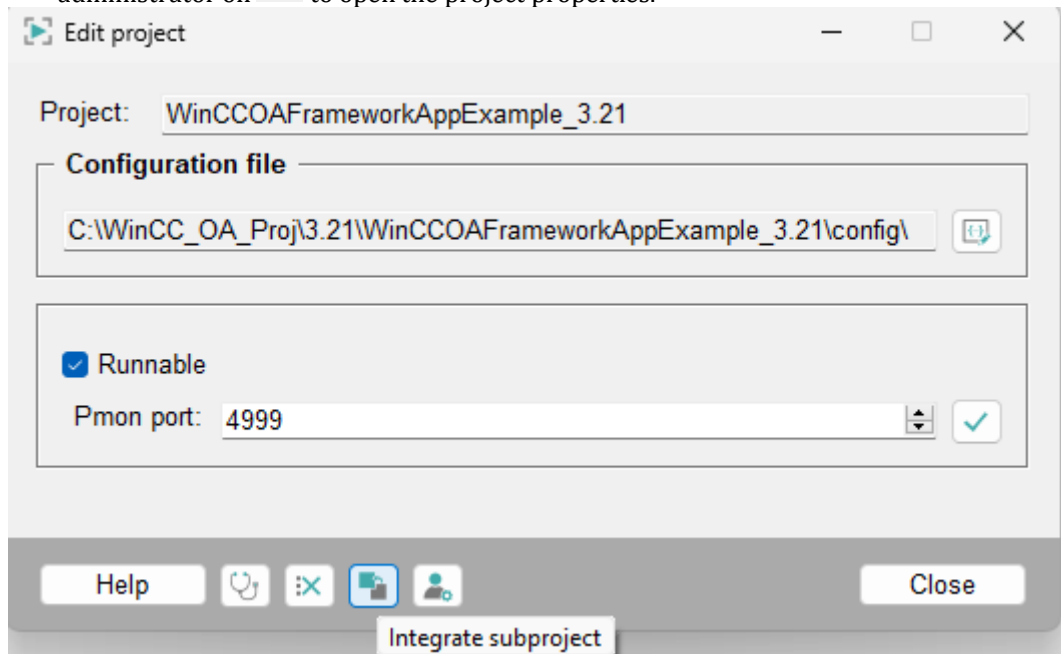


Figure 2-8 Project editing dialog

Now click on  to display the available subprojects.

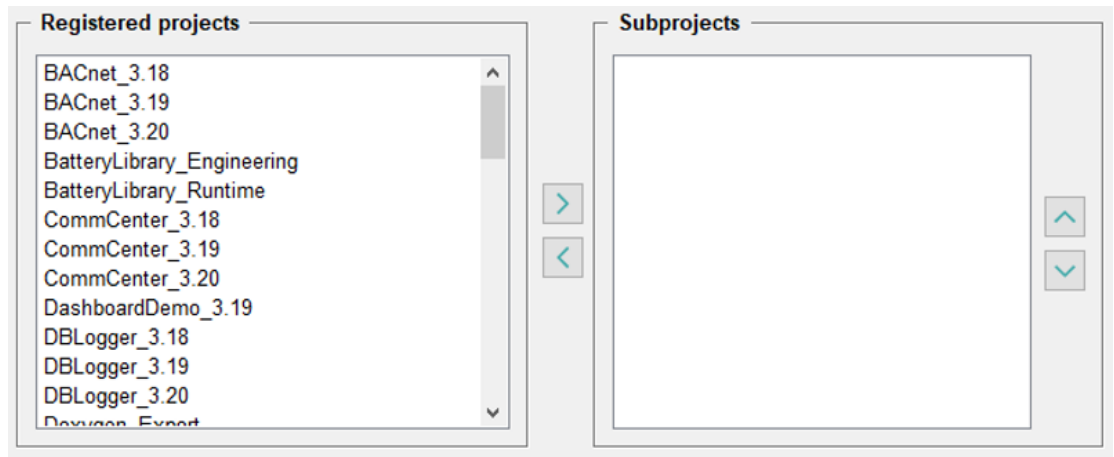


Figure 2-9 Manage subprojects

4. Select the subproject "PT_SIE_FRAMEWORK_3.21" and "Stdlib_3.21" then move them by

means of  to the right list

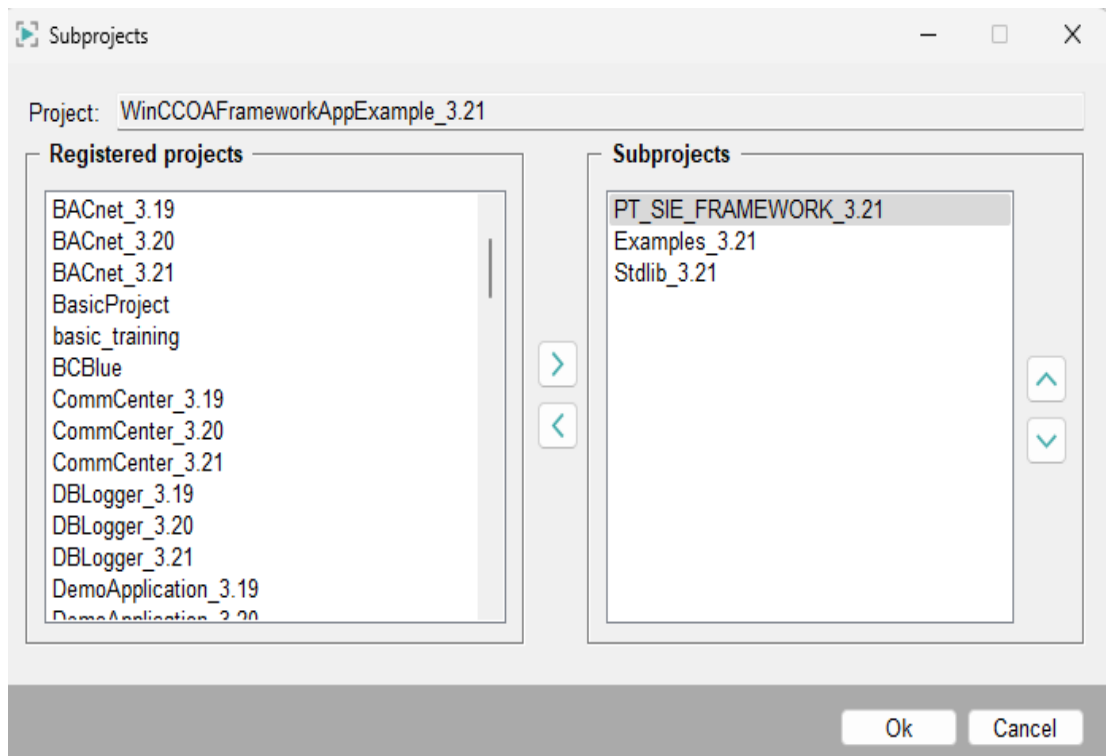


Figure 2-10 Include the subproject into the project

Click "OK" and then click "Close".

Note that:

- Be sure that this is the correct order of the subprojects in the config file of "WinCCOAFrameworkAppExample_3.21"


```

[general]
pvss_path = "C:/Program Files/Siemens/WinCC_OA/3.21"
proj_path = "C:/Program Files/Siemens/WinCC_OA/3.21/Stdlib_3.21"
proj_path = "C:/Program Files/Siemens/WinCC_OA/3.21/Examples_3.21"
proj_path = "C:/WinCC_OA_Proj/3.21/Projekt_Aktuell/PT_SIE_FRAMEWORK_3.21/PT_SIE_FRAMEWORK_3.21"
proj_path = "C:/WinCC_OA_Proj/3.21/WinCCOAFrameworkAppExample_3.21"
proj_version = "3.21"
useNGA = 1
useSQLite = 1
langs = "en_US.utf8"
pmonPort = 4999
[ui]
defaultFont = "Noto Sans"
httpServer = "https://
[webClient]
httpsPort = 443
httpPort = 0

```



 Hostname

Figure 2-11 The subprojects order in "WinCCOAFrameworkAppExample" config file

For WinCC OA 3.21, it is essential to add the **"Examples_3.21"** subproject from the installation directory to the configuration file:

"C:\Program Files\Siemens\WinCC_OA\3.21\Examples_3.21"

In the application example, this entry is already included in the configuration file. However, if you plan to use the topology framework panel within your own project, you must also add it to your project's config file.

Note:

The path above corresponds to the default WinCC OA installation directory. If WinCC OA is installed on a different drive or location, the path must be adjusted accordingly.

2.1.6. Starting and Configuring the WinCC OA project

In the WinCC OA "Project Administrator" select your created project

(WinCCOAFrameworkAppExample) and click on the "Start project" button



2.1.6.1. Loading WinCC OA Panel Topology Framework as default

1. Open the Panel Topology panel through this icon  in GEDI icon bar
Then select Template

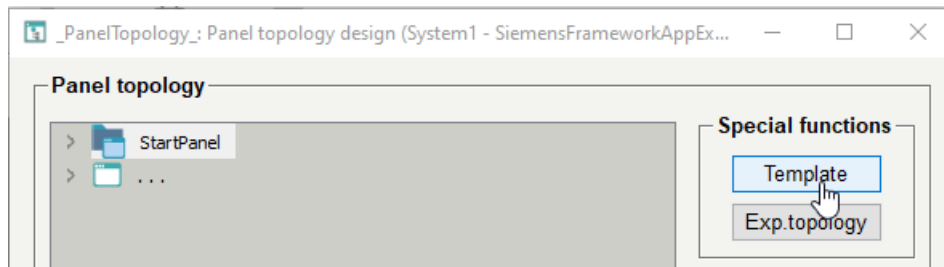


Figure 2-12 Panel topology panel

2. Choose “SIE” template, click ok, and save

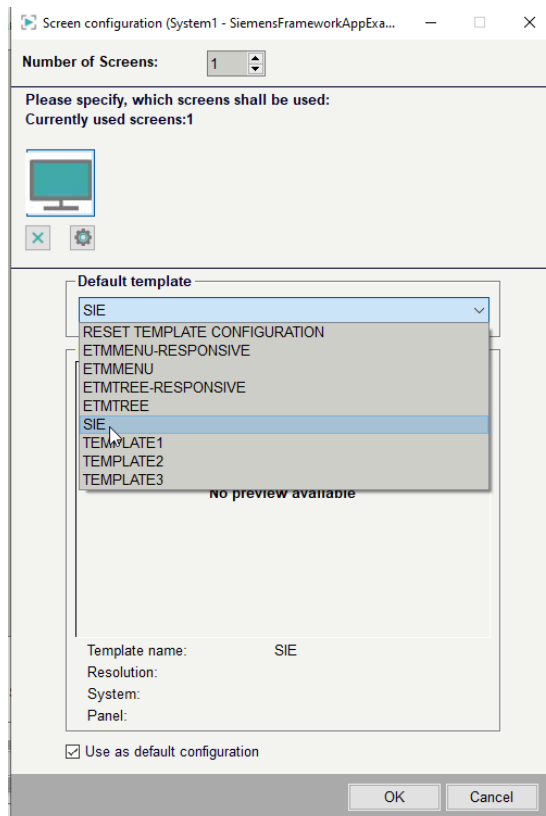


Figure 2-13 Panel Topology screen configuration panel

3. Add a new UI manager to Console with options “-p vision/login.pnl”

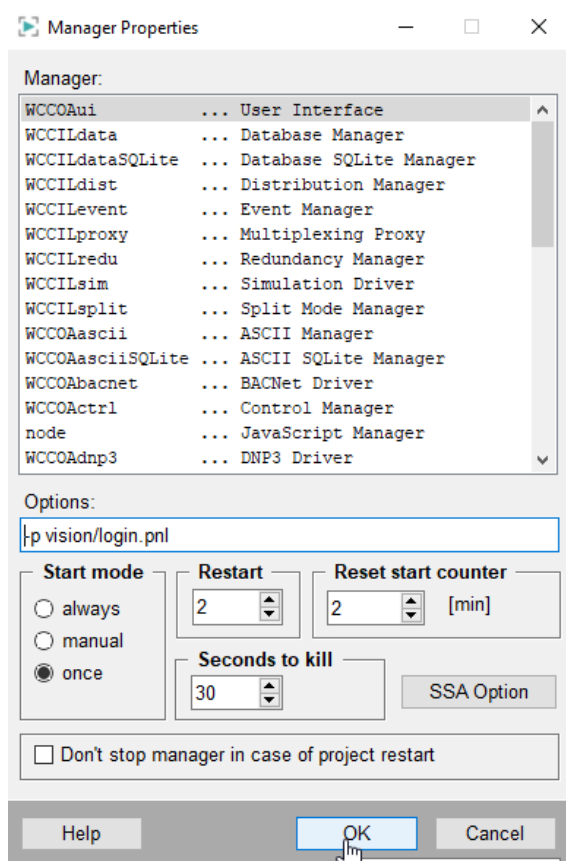


Figure 2-14 Adding a new Manager in the Console

4. Start the new Manager. A login panel will appear

Note that:

- The default credentials for login in our example project are (username: root, and no (empty) password)

5. After successful login, the new template is being used and running

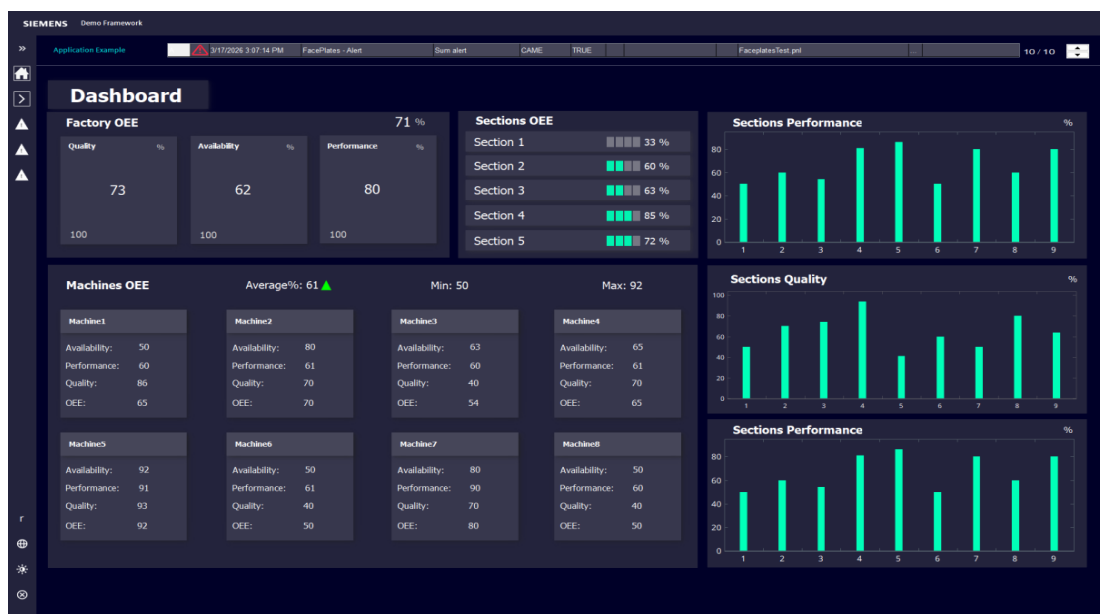


Figure 2-15 Starting screen of the template

Note that:

- All values in the previous Dashboard panel in Figure 2-15 are static (not changing), as there was no simulation or driver connectivity implemented in this example.
- The name of the project appearing in the header of Figure 2-15 (which is in our case “Application Example”) can be set up by changing the “projectTitle” keyword value in the project.cat file under the path “Message Catalogs/project.cat” in the framework project.



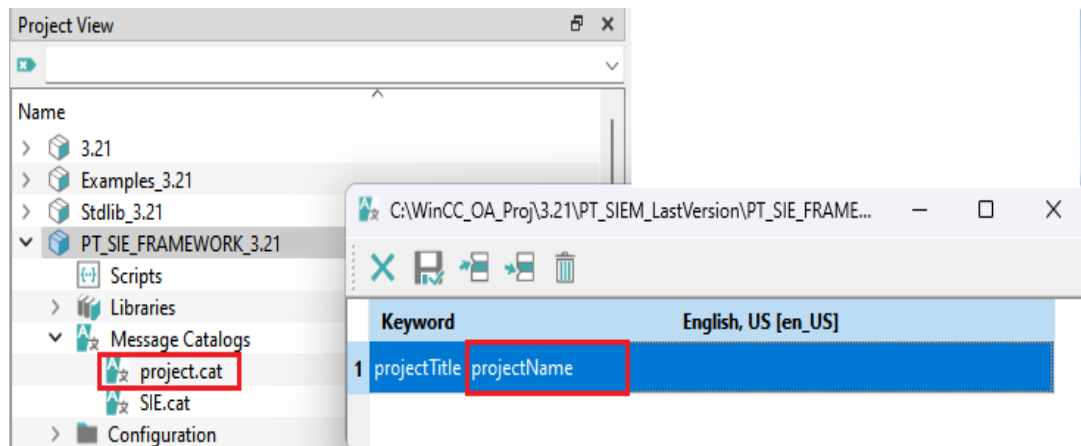


Figure 2-16 Changing the project title name

2.1.6.2. Integrate the project panels in the navigation of the template

To add your own project panels into the navigation bar of the template:

1. Open Panel Topology configuration panel must be opened via the GEDI.
2. For assigning the main starting panel double click on it  and choose the path of the panel

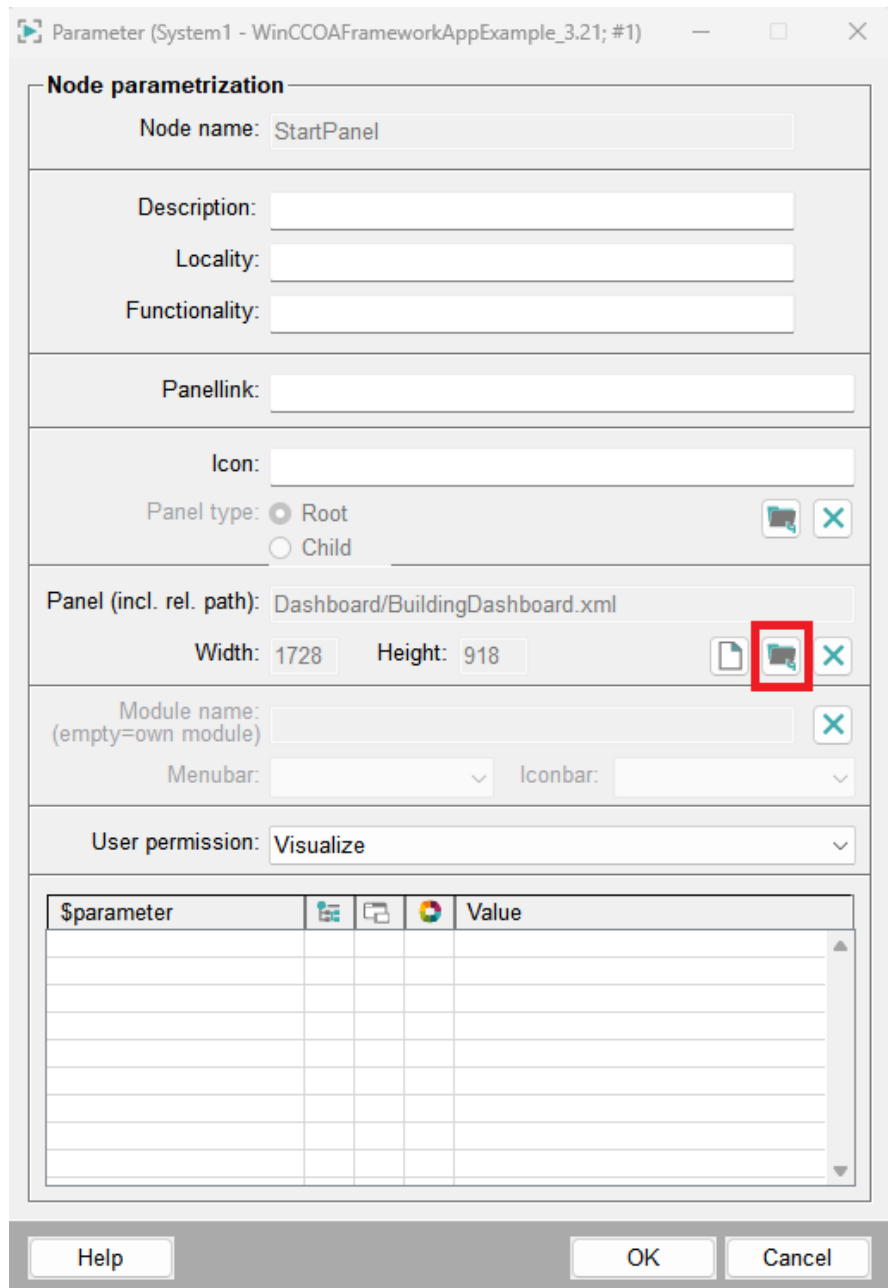

Parameter (System1 - WinCCOAFrameworkAppExample_3.21; #1)

Node parametrization

Node name: StartPanel

Description:

Locality:

Functionality:

Panel link:

Icon:

Panel type: ☒ Root ☐ Child

Panel (incl. rel. path): Dashboard/BuildingDashboard.xml

Width: 1728 Height: 918

Module name: (empty=own module)

Menubar: Iconbar:

User permission: Visualize

\$parameter				Value

Help OK Cancel

Figure 2-17 panel topology panel's properties

Note that:

- For the main panel, the icon is automatically chosen as a home icon , no need to assign it.

3. To add additional panels to the navigation bar of the template. From the Panel Topology panel right click on the main panel icon and select insert child node.

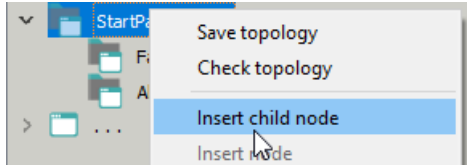


Figure 2-18 Inserting a new panel in Panel topology

4. Choose the panel name, panel path, icon path, The icon is mandatory as it will be used in the navigation bar

Panel parameter (System1 - SiemensFrameworkAppExample; #1)

Node parametrization

Node name: New panel

Description:

Locality:

Functionality:

Panellink:

Icon:

Panel type: ☒ Root ☐ Child

Panel (incl. rel. path):

Width: 1250 Height: 770

Module name: (empty=own module)

Menubar: default Iconbar: default

User permission: Visualize

\$parameter	Value	Value

Help OK Cancel

Figure 2-19 Panel properties configuration in panel topology

2.1.6.3. Color Theme notes

- The template offers two color themes: dark mode and light mode. You can switch between these themes by clicking the “Theme” button located at the bottom of the navigation bar of the template.

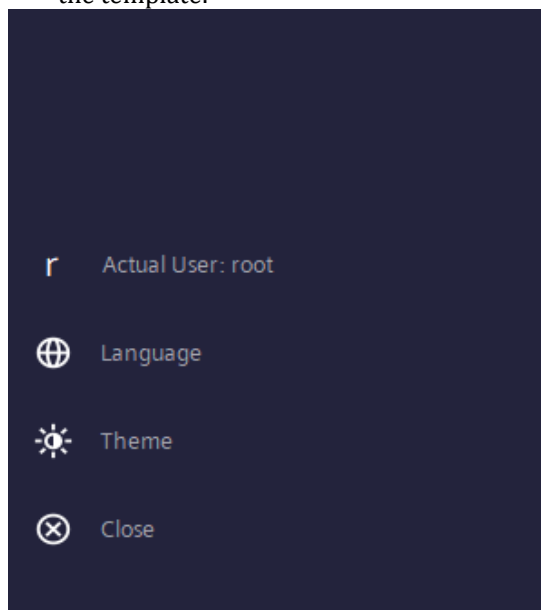


Figure 2-20 Navigation bar of the template

- During theme transitions, the template automatically adjusts colors and icons when switching between dark and light modes.
- Below is the process for configuring your project's colors and icons to respond to theme changes effectively.
 - Colors:
 - The framework project's "Color Databases" folder contains two color schemes: "Siemens_Dark" and "Siemens_Light."
 - Each scheme has its own set of color values, organized into two color databases: "Brand_Dark" and "Brand_Light."
 - While both color databases use the same color names, their actual color values differ between the schemes.

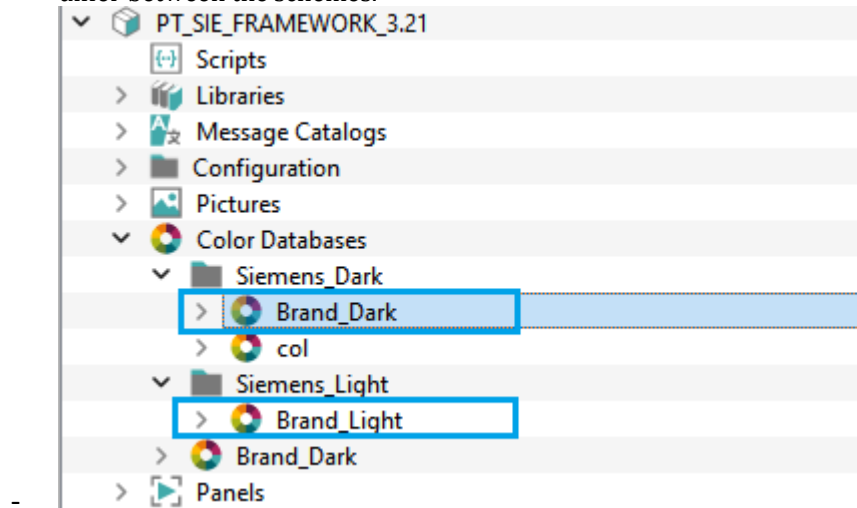


Figure 2-21 Snapshot of the color schemes' paths of the template

For example, "color-1" in the dark color scheme has the value  color-1 and "color -1" in the light color scheme has the value  color-1. When switching the theme, any object colored with color-1 will change the color to the color-value of the other scheme.

- Icons: Two icons for the same panel must be used, one for the dark color theme and one for the light color theme. There are two folders in the template to store the icons with the same name but for different color schemes. The paths are:
 - "PT_SIE_FRAMEWORK_3.21\pictures\Siemens_Dark\white"
 - "PT_SIE_FRAMEWORK_3.21\pictures\Siemens_Light\white"
 - Each icon must be put in both folders with the same name but different coloring. When choosing the panel icon in the Panel Toplogy configuration, the icon for dark coloring, in "PT_SIE_FRAMEWORK_3.21\pictures\Siemens_Dark\white" must be selected.

2.2. Operation

The operation of the WinCC OA Panel Topology Framework within WinCC OA is designed to provide a user-friendly interface for navigating and managing complex process visualizations. The framework utilizes a panel structure navigation, enabling operators to efficiently access and control various system components.

2.2.1. Startup of the Runtime project

1. Start the UI with options “-p vision/login.pnl” which was created previously in section 2.1.6.1.
2. Login with user “root” and an empty password.

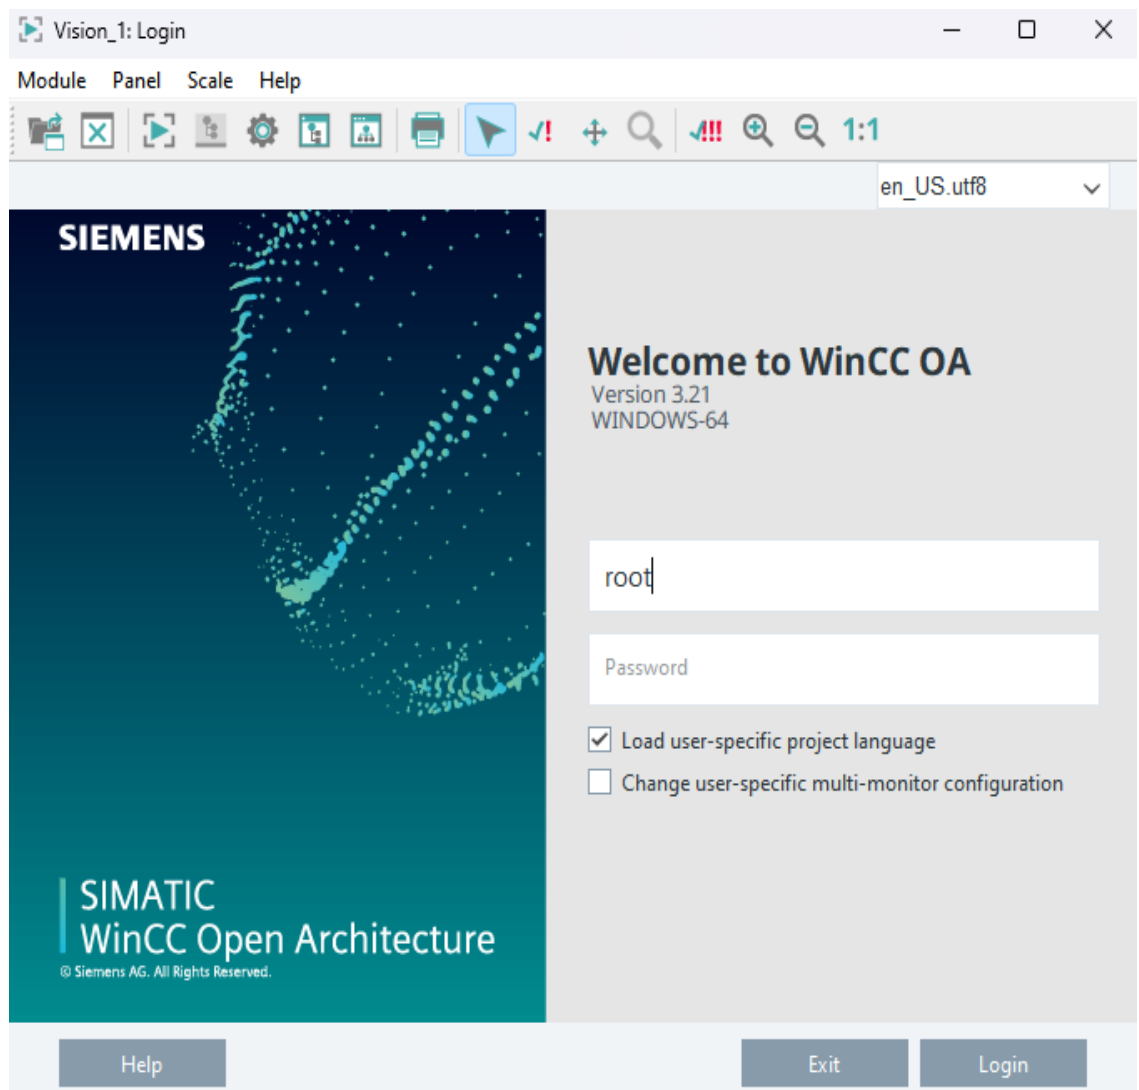


Figure 2-22 WinCC OA Login panel

- After successful authentication and login, the runtime UI is opened, using the WinCC OA Panel Topology framework as configured previously.

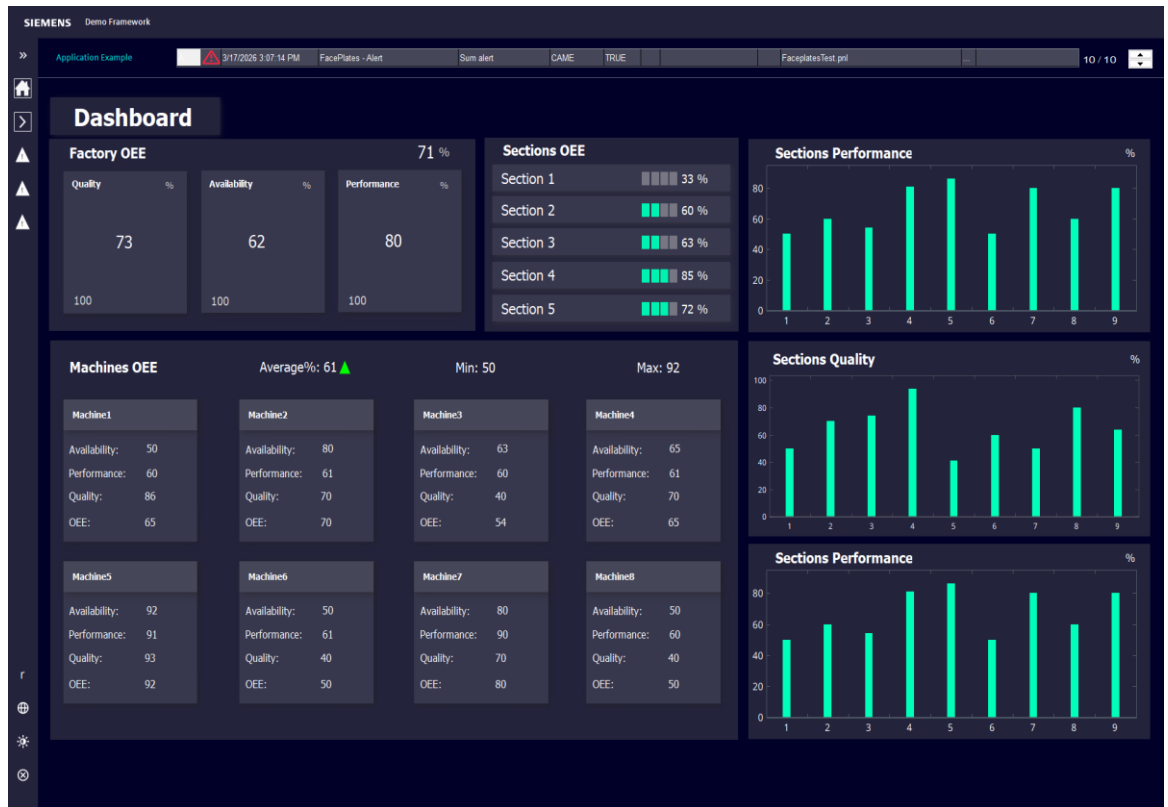


Figure 2-23 Main view of the framework in dark theme

- For navigation, the panel icons appear at the top part of the navigation bar on the left side of the window.

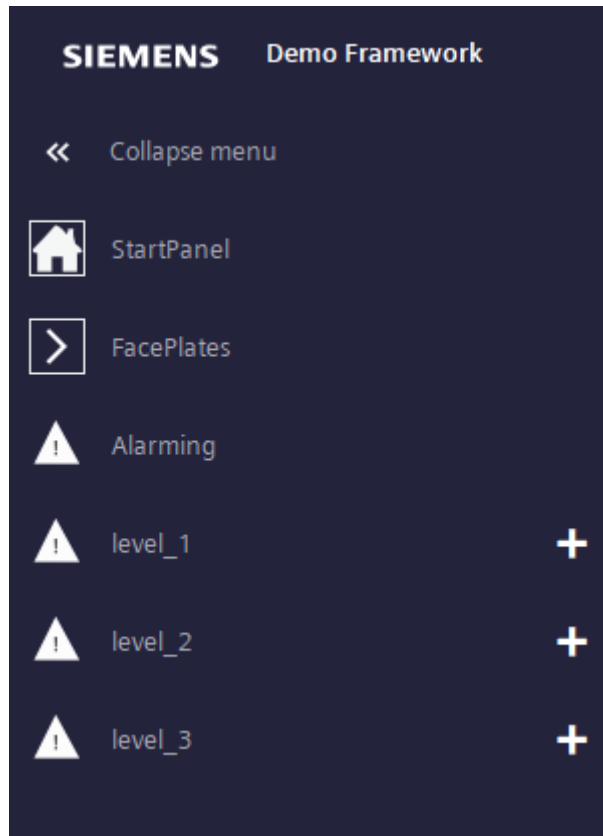


Figure 2-1

2.2.2. Navigation Behavior

If a node contains child elements, a + symbol is shown on the right side of the node.

Clicking this symbol expands the node and displays its child elements. Once expanded, the symbol changes to –, indicating that the node is currently open.

If a child node contains further sublevels, the same interaction applies. This allows multi-level navigation, where each + symbol can be used to expand the corresponding node step by step.



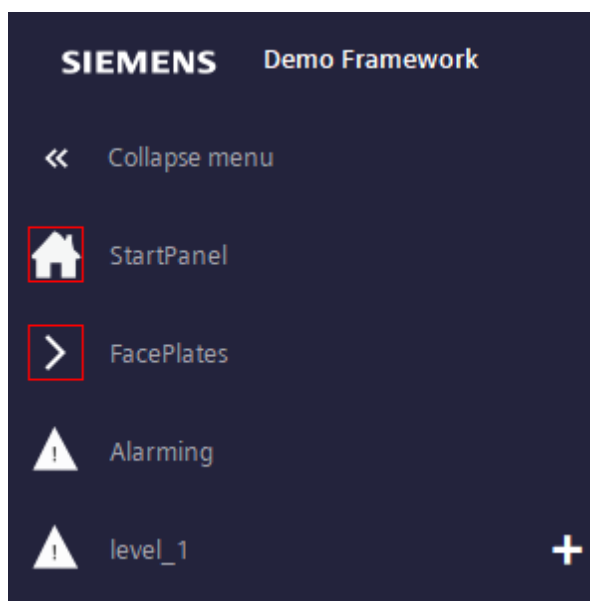


Figure 2-24 Upper part of the navigation bar

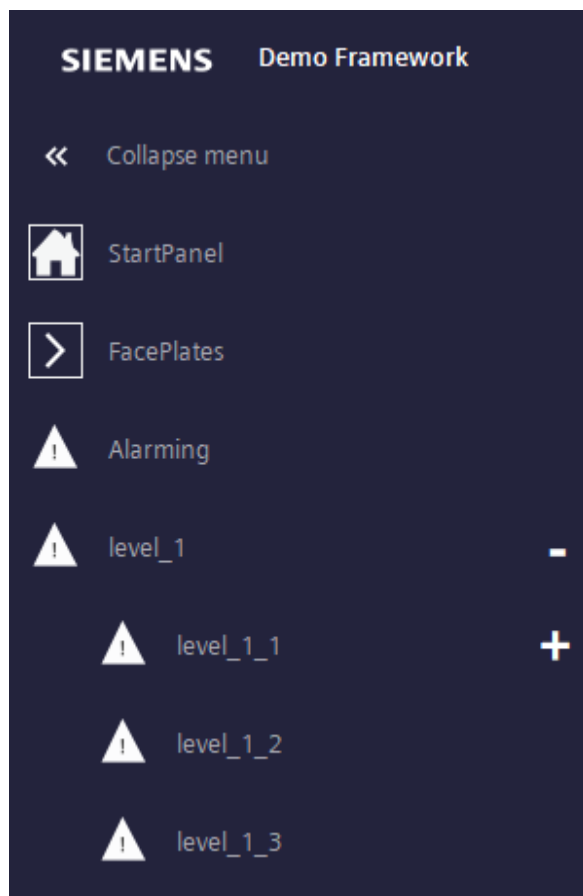

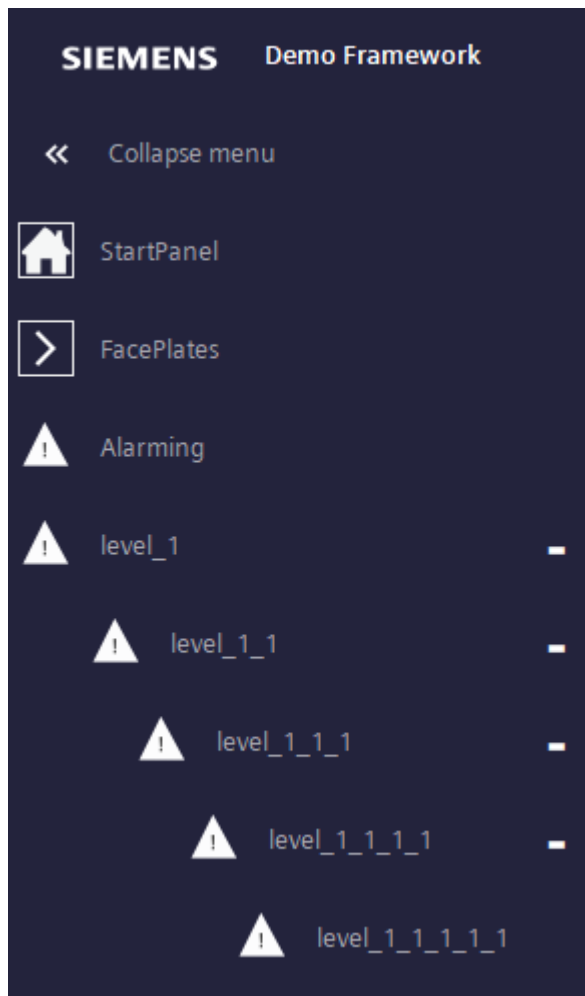

2.2.3. Scrollbar Behavior

- **Horizontal Scrollbar**

The horizontal scrollbar appears when the content exceeds the available width, for example when multiple child nodes are expanded and icons or labels are no longer fully visible.

Once the scrollbar appears, you can scroll horizontally to the right to view hidden elements such as icons or identifiers.

The horizontal scrollbar is displayed at the bottom of the navigation module.

SIEMENS

Demo Framework

<<

Collapse menu



StartPanel



FacePlates



Alarming



level_1

-



level_1_1

-



level_1_1_1

+



level_1_2



level_1_3



level_2

+



level_3

+



Actual User: root




Language




Theme



Close

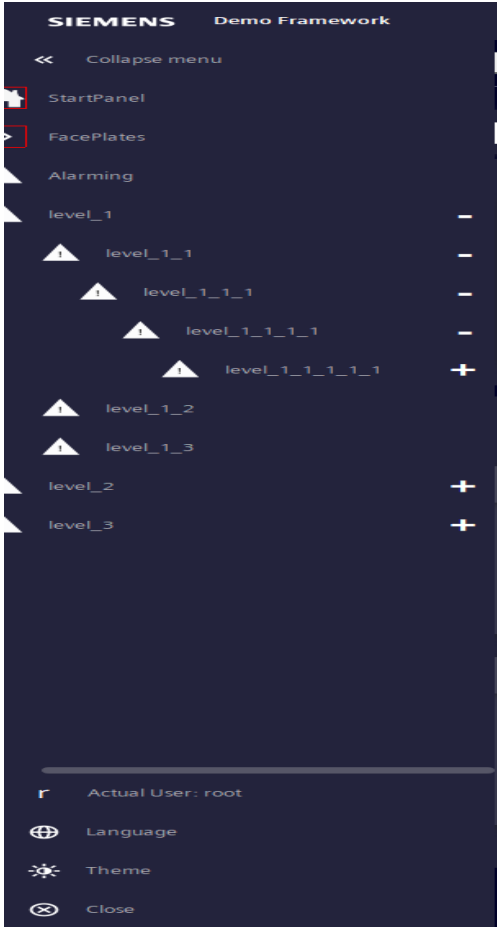

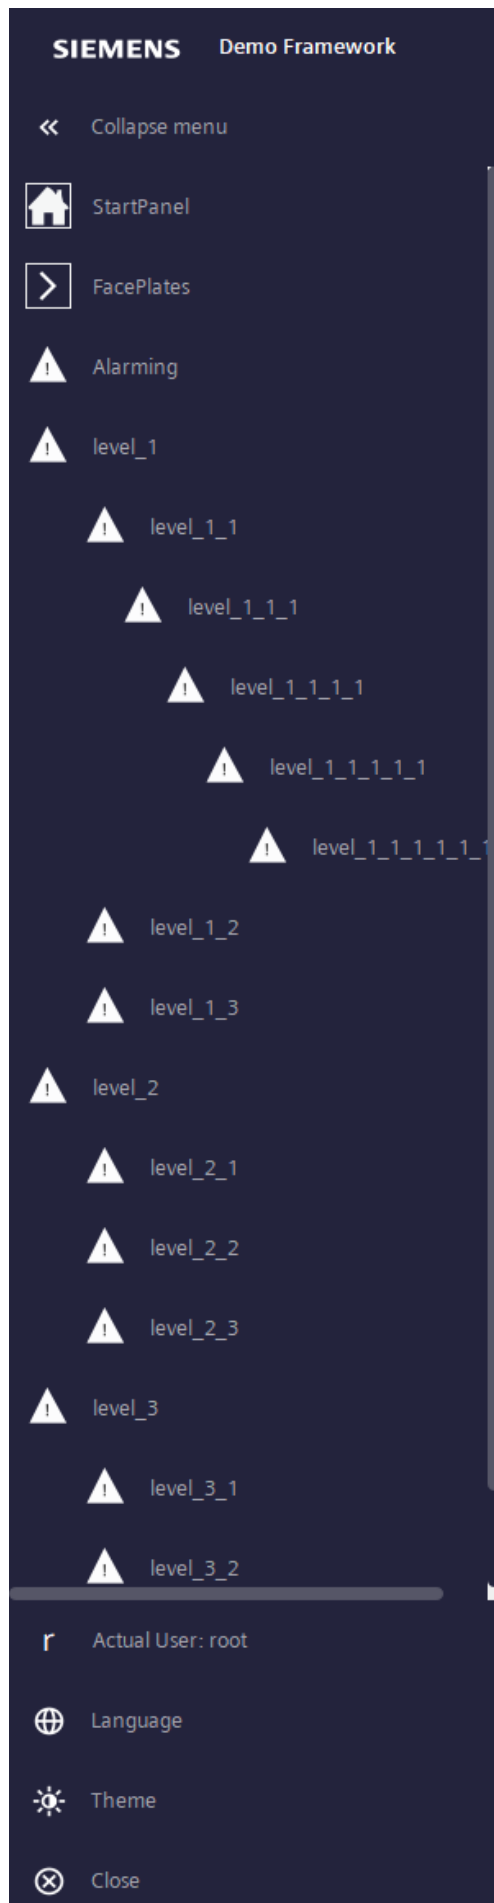

• Vertical Scrollbar

The vertical scrollbar appears when the content exceeds the available height, for example when multiple nodes are displayed and no longer fit within the visible area.

Once the scrollbar appears, you can scroll vertically to access the hidden elements.



2.2.4. User Controls

The user control icons for logging in or out, changing the language, switching the color theme, and closing the UI are located at the bottom of the navigation bar.

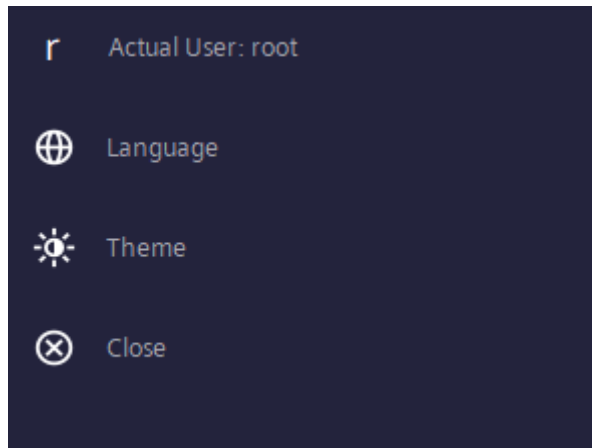


Figure 2-25 Bottom part of the navigation bar

2.2.5. Authorization Handling

If the user is logged out, all navigation buttons, including are hidden and no longer accessible.



If the required authorization is not granted, the corresponding navigation elements are not displayed. This applies both to the quick navigation buttons and to the main navigation entries.

All associated child elements are also hidden accordingly.

2.2.6. Behavior After Re-Login

If the user logs out and then logs in again, either with the same credentials or with different credentials, the panel template opens the panel assigned to the first node in the Panel Topology Framework.

This first node is assigned to the StartPanel.

SIEMENS Demo Framework

<< Collapse menu

StarPanel

FacePlates

Alarming

level_1

level_1_1

level_1_1_1

level_1_2

level_1_3

level_2

level_3

Actual User: root


Language

Theme

Close

4/9/2026 2:10:28 PM _Event License RemainingTime License expires WENT 43189 min 16 / 16

DP elementDescription	Alert text	Direction	Value	Acto	Ack time	Nunt >
StarPanel - Alert	Sum alert	CAME	TRUE			main.pnl
LED_6 alarm error	State ON	CAME	TRUE			
LED_6 alarm	Bad	WENT	TRUE			
LED_6 alarm.error	State ON	WENT	FALSE	(H)		
LED_2 alarm error	State ON	CAME	TRUE	x	2/9/2026 12:19:17 PM	
LED_2 alarm	Bad	CAME	TRUE			
LED_1 alarm error	State ON	CAME	TRUE	(H)		
LED_1 alarm	Bad	CAME	TRUE			
StarPanel - Alert	Sum alert	CAME	TRUE			DashboardBuildingDashboard.xml
FacePlates - Alert	Sum alert	CAME	TRUE			FaceplatesTest.pnl
_MemoryCheck.FreeKB	RAM nearly full!	CAME	2169196			
_MemoryCheck.FreeKB	RAM full!	CAME	2169196			
_MemoryCheck.FreeKB	RAM full!	WENT	7719216	(H)		
_MemoryCheck.FreeKB	RAM nearly full!	WENT	7719216	(H)		
_Event License RemainingTime	License expires	CAME	120 min			
_Event License RemainingTime	License expires	WENT	43189 min	(H)		

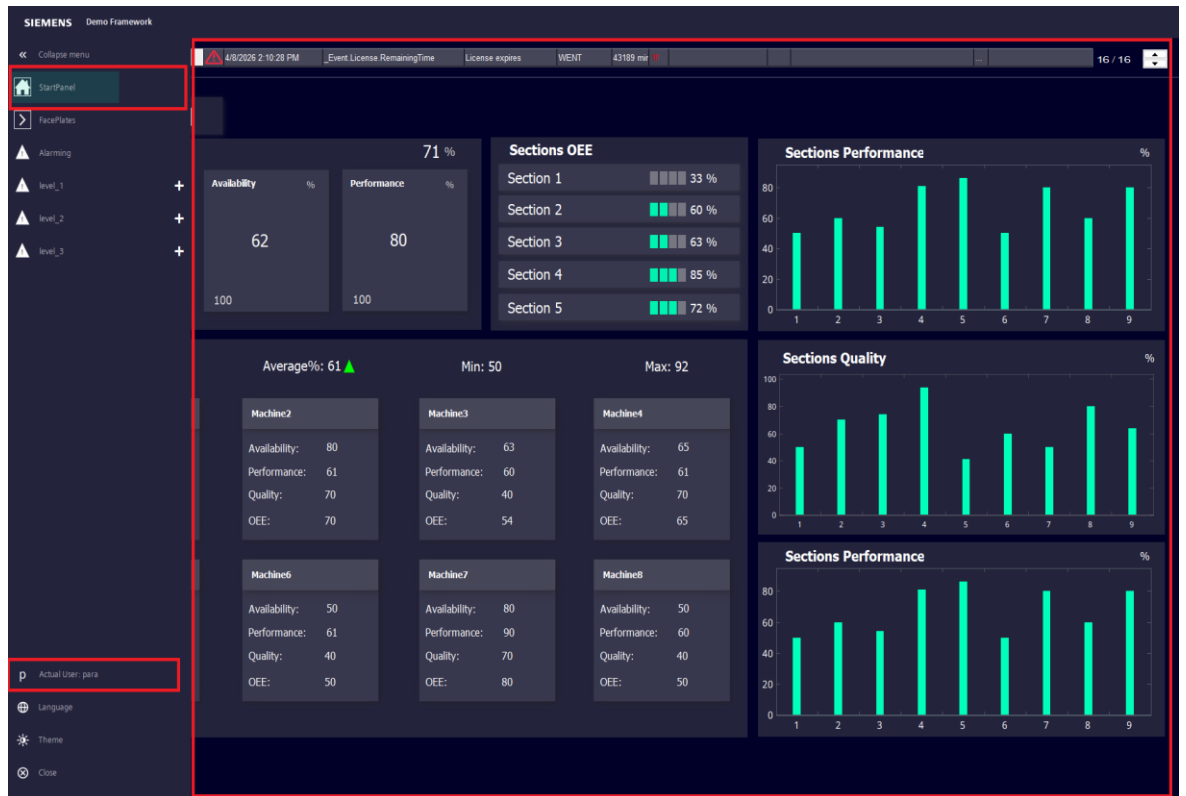






[illegible]

[illegible]

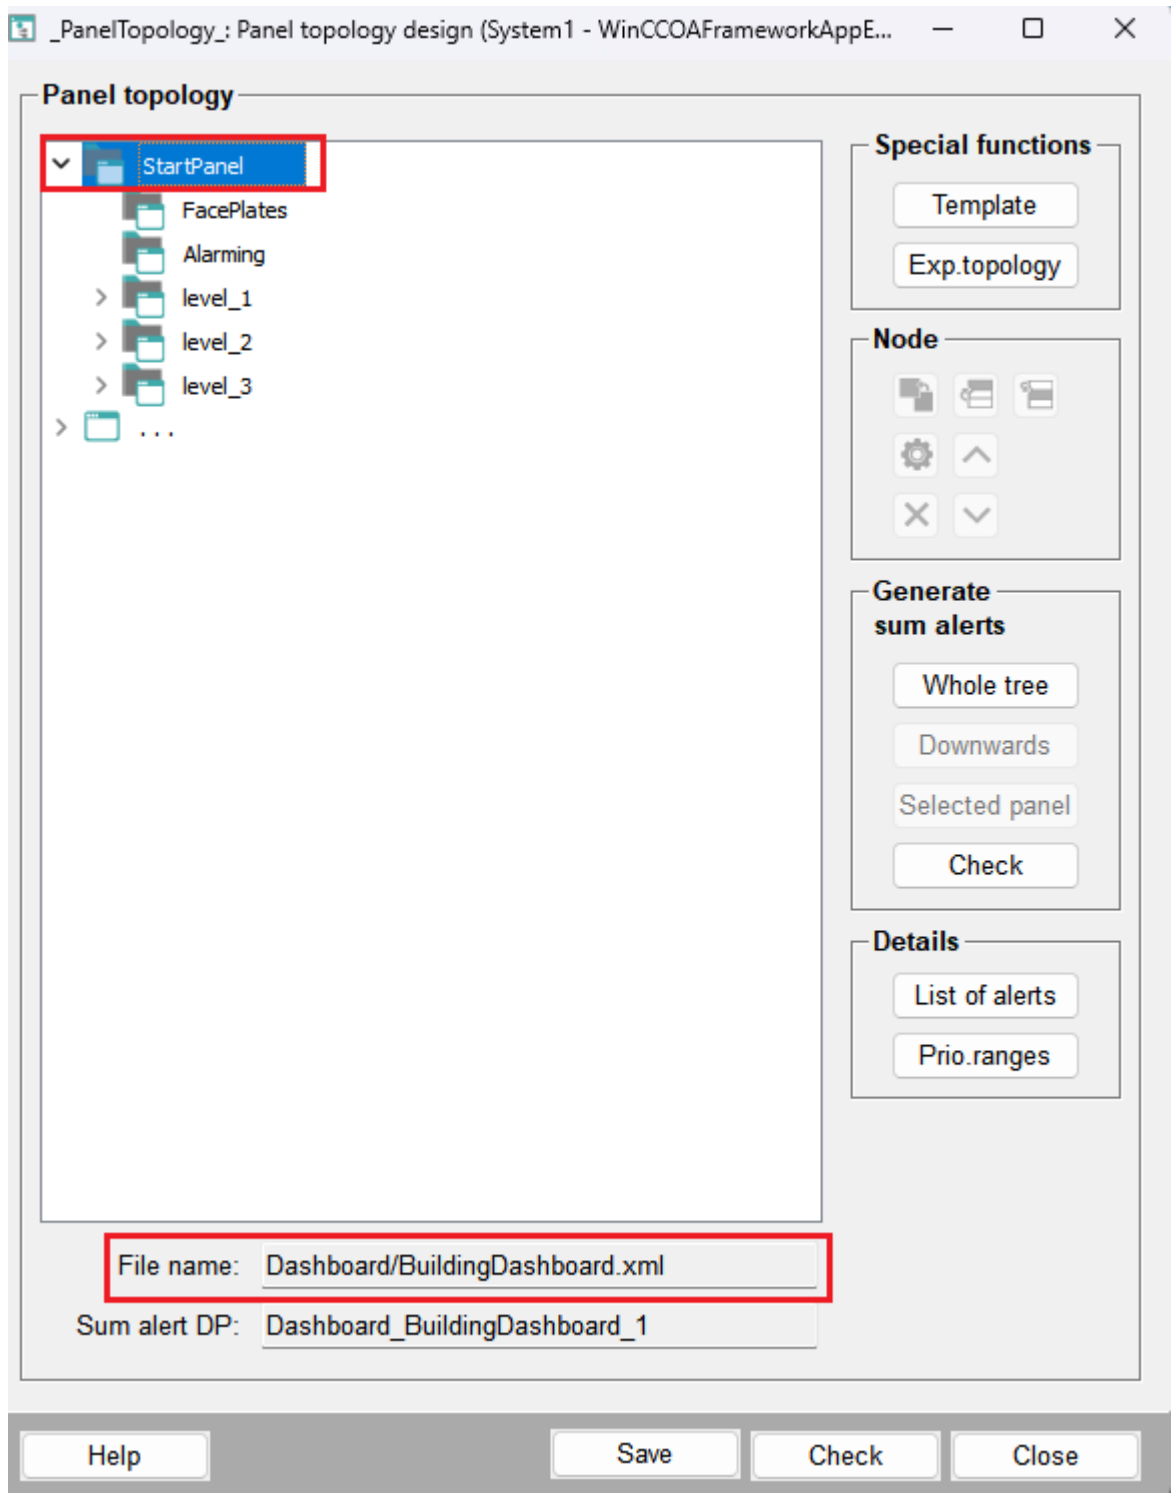

[illegible]

2.2.7. Using the faceplates mechanism with the standard objects

By default, the standard library template and symbols are working out of the box with the framework faceplates mechanism. The path of these symbol templates is "Stdlib_3.21\panels\objects\STDLIB_template"

If you create a non-standard symbol using your own faceplates, logic, and dollar parameters,

the faceplate mechanism will not work automatically with this new symbol. To integrate it with the framework, you need to implement additional code to pass the new symbol's structure and data. (not working out of the box with the non-standard symbols)

For more info about loading and configuring the standard library, please refer to the [WinCC OA Documentation](#)

the use of standard library objects with the faceplates are prepared on a dedicated panel in the Application example project.

You can navigate to it using the second navigation button .

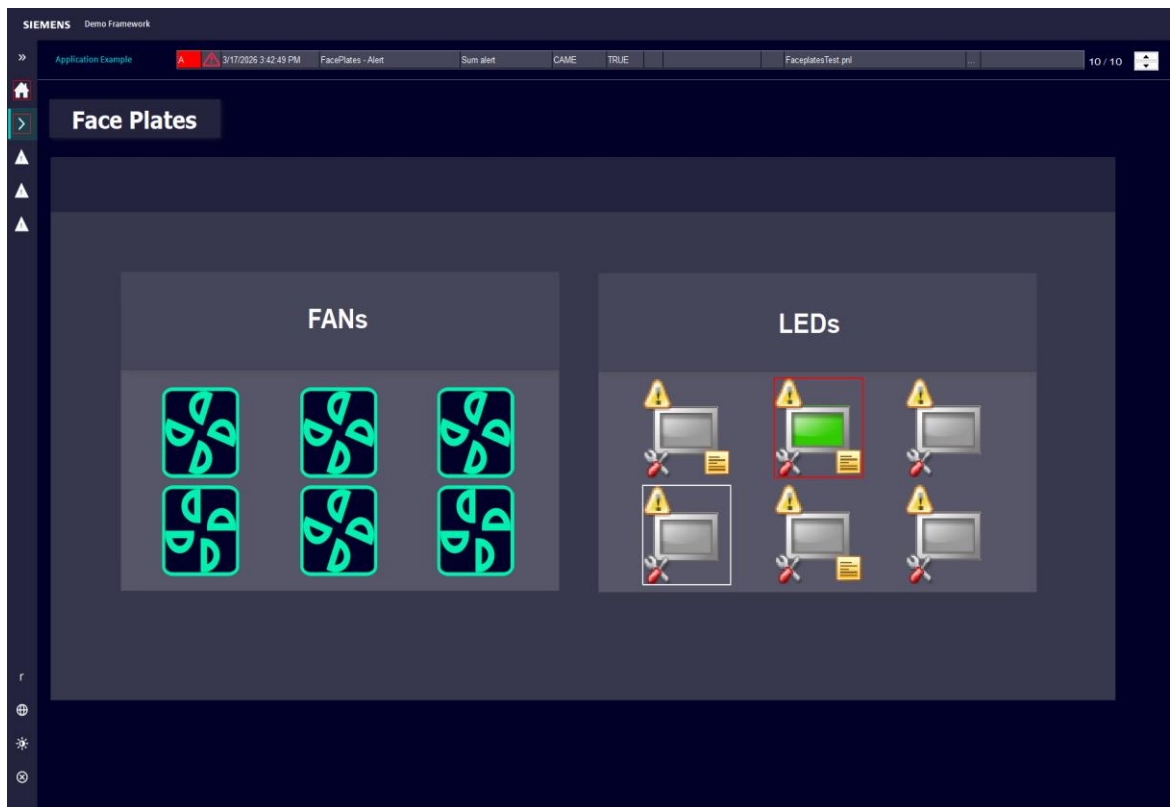


Figure 2-26 Faceplates panel

To open a face plate: A left click on the symbol can be done. E.g., one left click on a Fan and one left click on an LED. The faceplate opens on the right side of the window.

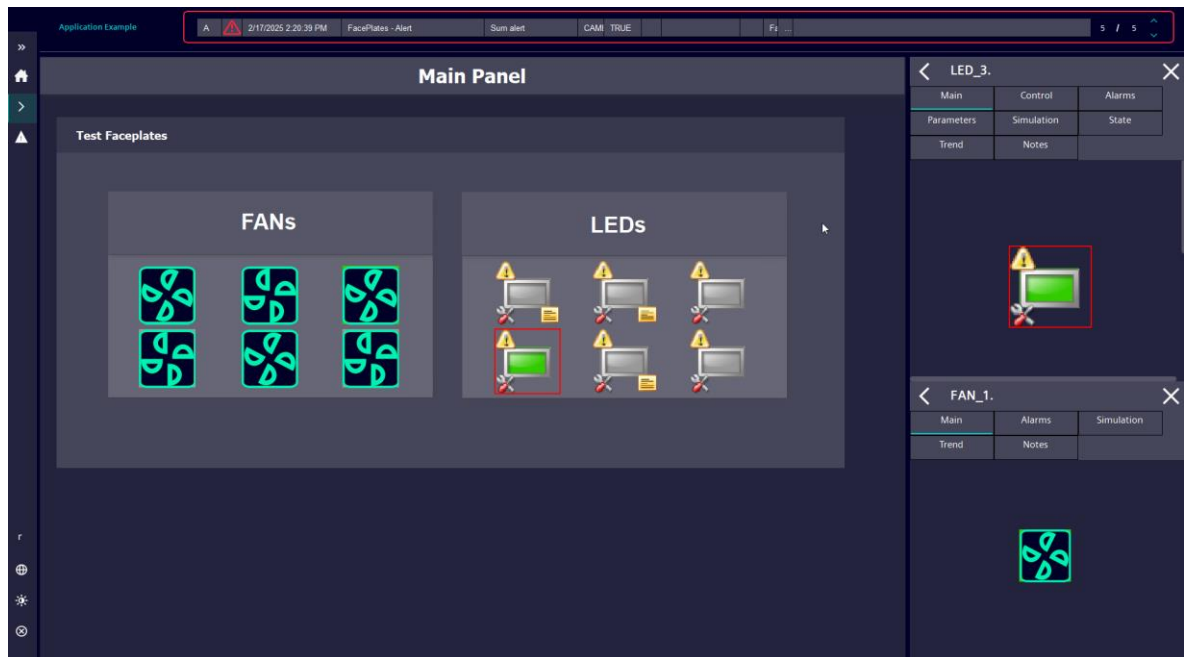


Figure 2-27 Faceplates panel with faceplates open

3. Appendix

Important WinCC OA specific abbreviations

Acronym	Long form	Meaning
WinCC OA	Simatic WinCC Open Architecture	A SCADA system for visualizing and operating of processes, production flows, machines and plants in all lines of business. Distributed systems enable any number of stand-alone systems, from 2 to 2048, to be linked via a network. Each subsystem can be configured either as a single-user or multi-user system, redundant or not, in each case.
DPT	Data point type	Object definition (class) of a structured data object as mapping of a real device. Single data points (instances) are derived from the DPT. Therefore, the data point type is a form of template.
DP	Data point	Structured, device-oriented data object as representation of a real device within the control system. A data point contains one or more data point elements (process variables).
DPE	Data point element	Single process information within a device-oriented data point. Each DPE corresponds to a value/state. In addition to the value, there are DPE attributes like time stamp, quality information or origin.
GEDI	Graphic Editor GEDI	Graphic Editor. It is used both for drawing of process images ("panels") as well as for designing of symbols, dialogs, and scripting.
PARA	Configuration Tool	Editor for the creation and configuration of data point types, data points, and data point elements as well as their configs.
ASCII	American Standard Code for Information Interchange	Standardized protocol for storage and transfer of characters/text. In WinCC OA, the acronym also refers to the database import/export manager. It is a module to export and import configurations as ASCII files. Mass configuration can therefore be carried out in a spread sheet program (for example MS Excel), file editor, or in an external database.
D	Driver Manager ("Driver")	Interface for connecting controllers (PLC, DDC, ...) fieldbuses and telecontrol systems. A driver handles the communication via an external protocol and enables the exchange of information with WinCC OA. The processing of data from the "field" to WinCC OA contains event orientation, old/new comparison, transformation, conversion, and smoothing. The protocol of the Driver must be the same as the protocol of the "field" device. Furthermore, the connection (how to reach the device) must be configured in WinCC OA. For exchanging data, a periphery address must be configured on a corresponding DPE.
CTRL	Control Manager ("Scripting")	Processing unit that allows to process user specific logic / business logic (control scripts). Control possesses an easy to learn syntax (similar to ANSI-C) and is processed by an interpreter (CTRL Manager).

Table 3-1 WinCC OA specific abbreviations

Service and support

WinCC OA Extended Services

Do you have questions about WinCC OA projects, need additional features, or require technical assistance? ETM provides 24/7 access to our complete service and support expertise for WinCC OA.

Our range of services includes the following:

- Extended Services provide tailored support for your evolving needs
- All kind of analysis/troubleshooting for older WinCC OA versions than our current mainline
- Project startup workshop
- Architecture definition
- Project engineering assistance with dedicated contact person
- Special project developments (special requirements, web widgets, gateways, etc.)
- WinCC OA library development assistance
- Project or architecture reviews with report
- Project-specific problem or performance analysis
- Project upgrade (analysis with report, assistance during upgrade, etc.)
- Assistance for complex error reproduction scenarios
- On-site assistance for any tasks related to WinCC OA and their components
- 24/7 on-duty assistance or priority callback for certain time range
- Database support Oracle®, InfluxDB®, PostgreSQL® and MS SQL®
- Raima/HDB to SQLite/NGA migration
- Setup and consulting for WinCC OA Add-ons e.g., APM, AMS, DRS, ...
- WinCC OA Security services (as per the WinCC OA Security Guideline, NIS2)
- Tests on unsupported platforms (e.g., unsupported OS)
- Individual Workshops (driver workshop, UI workshop, business logic, etc.)
- Factory Acceptance Test (FAT)/Site Acceptance Test (SAT) assistance
- Creating of prototypes, proof of concepts, demos, etc.
- Project tender analysis and evaluation of projects

You can find detailed information on our range of services in the service catalog web page:

www.winccoa.com/documentation/WinCCOA/latest/en_US/Support/topics/support_extendedServices.html

SiePortal

The integrated platform for product selection, purchasing and support - and connection of Industry Mall and Online support. The SiePortal home page replaces the previous home pages of the Industry Mall and the Online Support Portal and combines them.

- **Products & Services**
In Products & Services, you can find all our offerings as previously available in Mall Catalog.
- **Support**
In Support, you can find all information helpful for resolving technical issues with our products.
- **mySieportal**
mySiePortal collects all your personal data and processes, from your account to current orders, service requests and more. You can only see the full range of functions here after you have logged in.

You can access SiePortal via this address:

sieportal.siemens.com

Technical Support

The Technical Support of Siemens Industry provides you fast and competent support regarding all technical queries with numerous tailor-made offers.

– ranging from basic support to individual support contracts. Please send queries to Technical Support via Web form:

siemens.com/SupportRequest

WinCC OA – Training and Certification

To fully leverage the flexibility and openness of WinCC OA, we offer a wide range of training courses, from beginner to expert levels. Our modules cover various topics, with options for individual training. For WinCC OA partners, completing specific courses is required to obtain or maintain partner status, ensuring the highest level of expertise and support.

For more information on our offered trainings and courses, as well as their locations and dates, refer to our web page:

www.winccoa.com/support/training.html

Change documentation

Version	Date	Modifications
V1.0	4/2025	First version
V1.1	5/2025	Format Changes, Typos, General Content Adaptions

Table 3-2

Published by
Siemens AG
DI FA HMI ISW ETM

Marktstrasse 3
7000 Eisenstadt
Austria

E-mail: wincc_oa.at@siemens.com

Web: www.siemens.com/wincc-open-architecure

For the U.S. published by
Siemens Industry Inc

100 Technology Drive
Alpharetta, GA 30005
United States

Subject to changes and errors. The information given in this document only contains general descriptions and/or performance features which may not always specifically reflect those described, or which may undergo modification in the course of further development of the products. The requested performance features are binding only when they are expressly agreed upon in the concluded contract.