


(A) Landmark-mask design ablation



(B) Cycle-consistency weight sensitivity

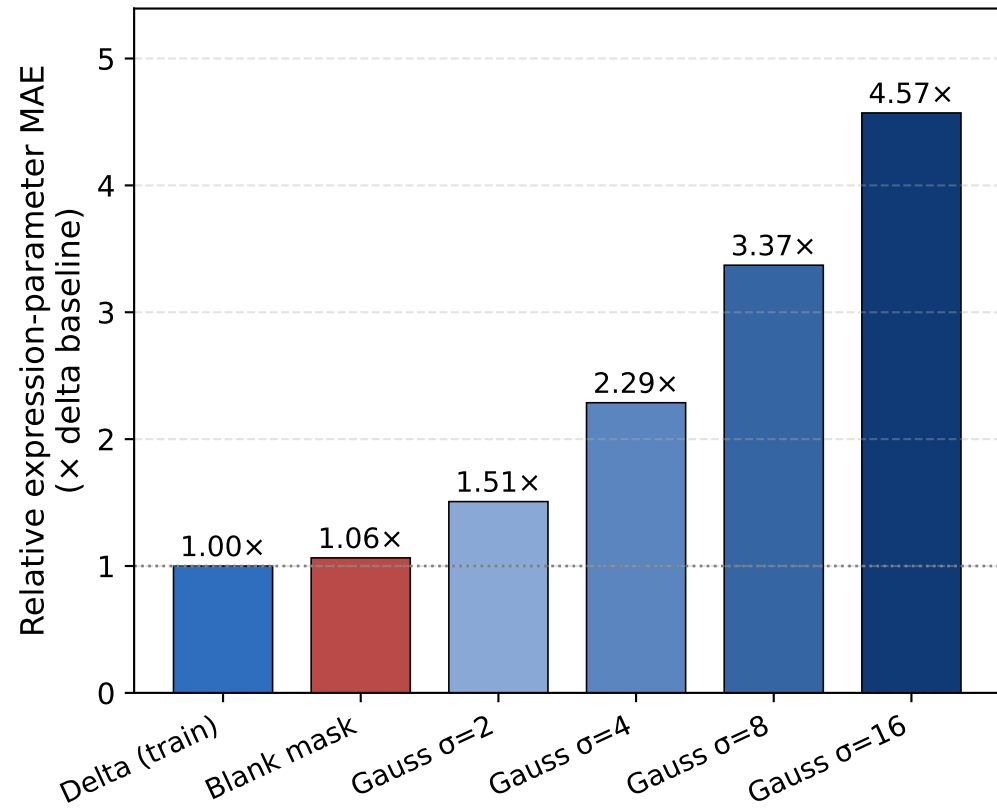