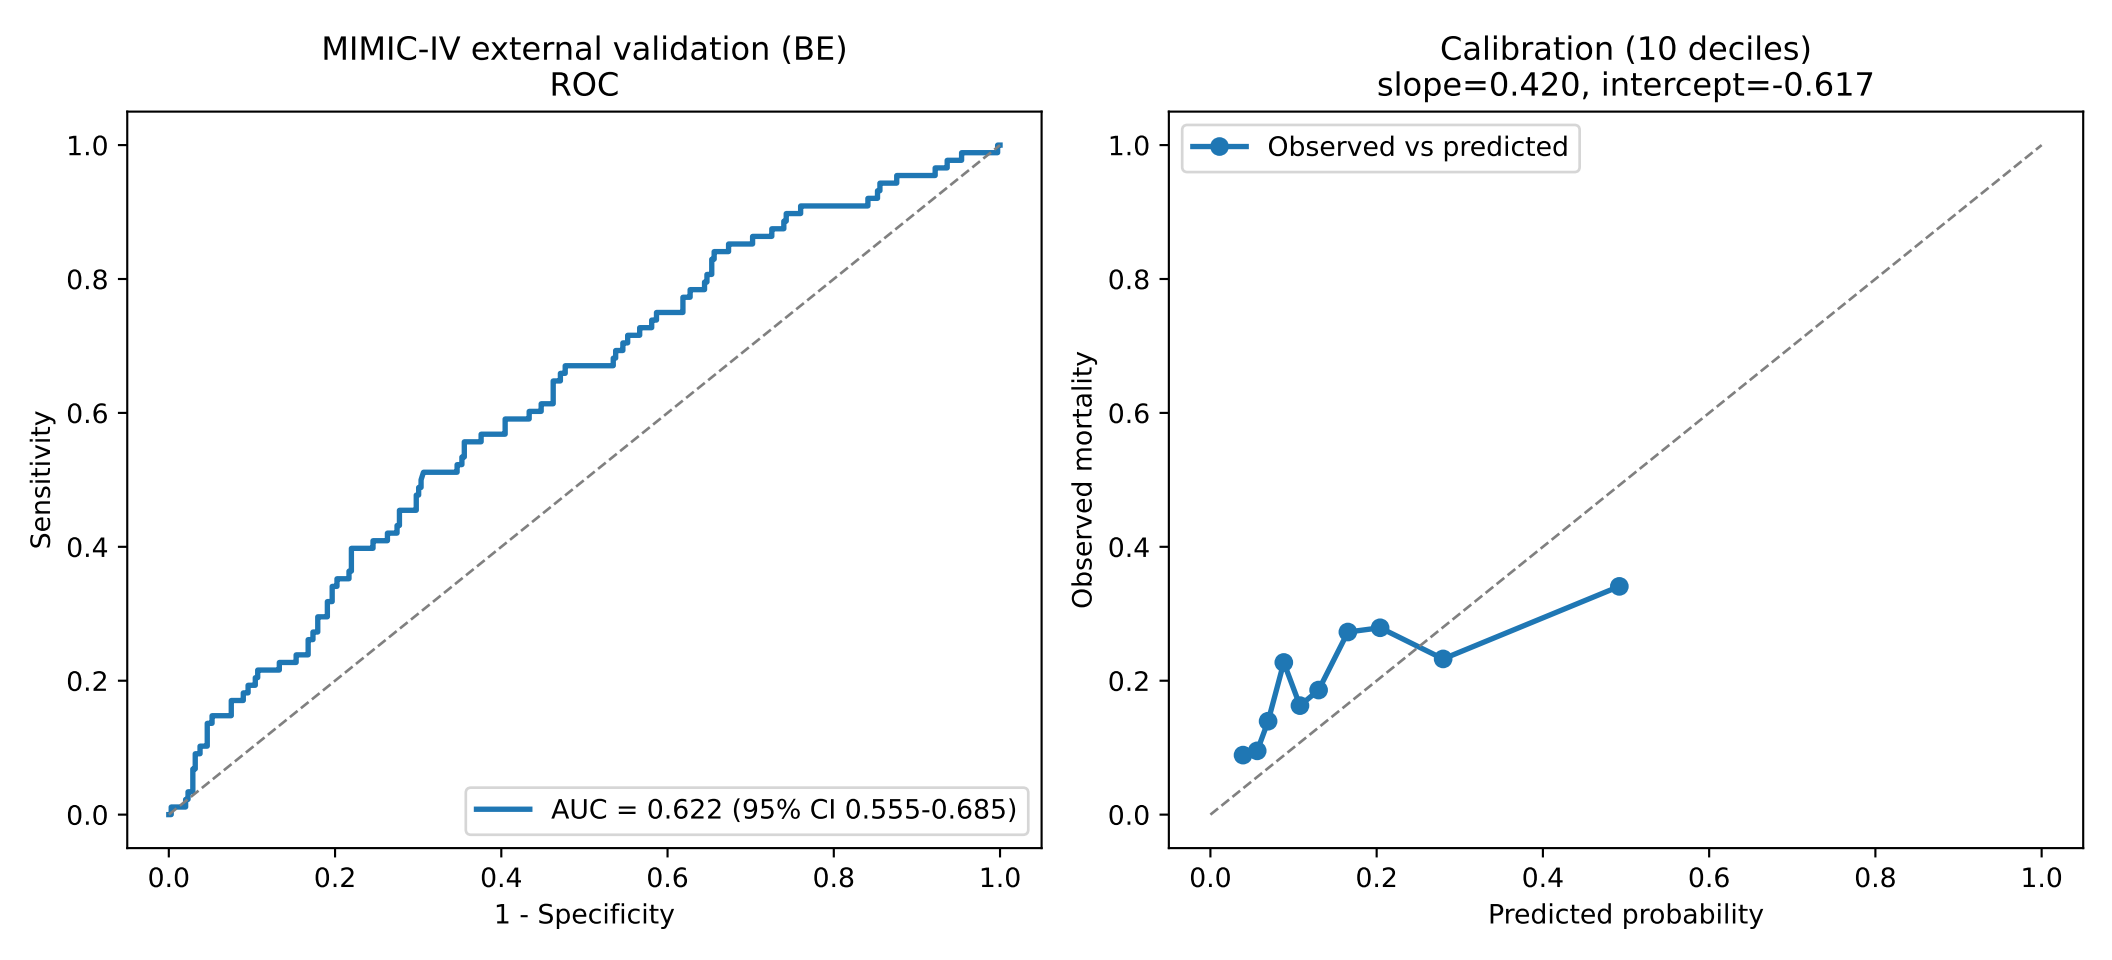
MIMIC-IV external validation (BE)
ROC
Sensitivity
1 - Specificity
AUC = 0.622 (95% CI 0.555-0.685)
Calibration (10 deciles)
slope=0.420, intercept=-0.617
Observed vs predicted
Observed mortality
Predicted probability