



Preliminary and Primary Wastewater Treatment

from Trunk Sewer

SC-1 SC-2 SC-3 GC SW EQ PST

Sewage: After Primary Sedimentation

Secondary Treatment

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Preliminary and Primary Wastewater Treatment

Primary Sedimentation for Wastewater/Sewage Treatment

Exactly same as secondary sedimentation for water treatment in most respects

However,

1. Particles removed in this case are mostly organic particles of density 1200 kg/m^3
2. $\text{SOR} = 32 \text{ m}^3/\text{m}^2/\text{d}$, organic particles: $60 \text{ }\mu\text{m}$, inorganic particles: $20 \text{ }\mu\text{m}$
3. $\text{SOR} = 48 \text{ m}^3/\text{m}^2/\text{d}$, organic particles: $75 \text{ }\mu\text{m}$, inorganic particles: $25 \text{ }\mu\text{m}$
4. Type II settling, hence smaller particles are also removed
5. SS removal: 50 – 70 %; BOD_5 removal: 25 – 40 %

Lecture 1


CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Preliminary and Primary Wastewater Treatment

Primary Sedimentation Tank

(To remove organic particles up to 60 mm size completely)

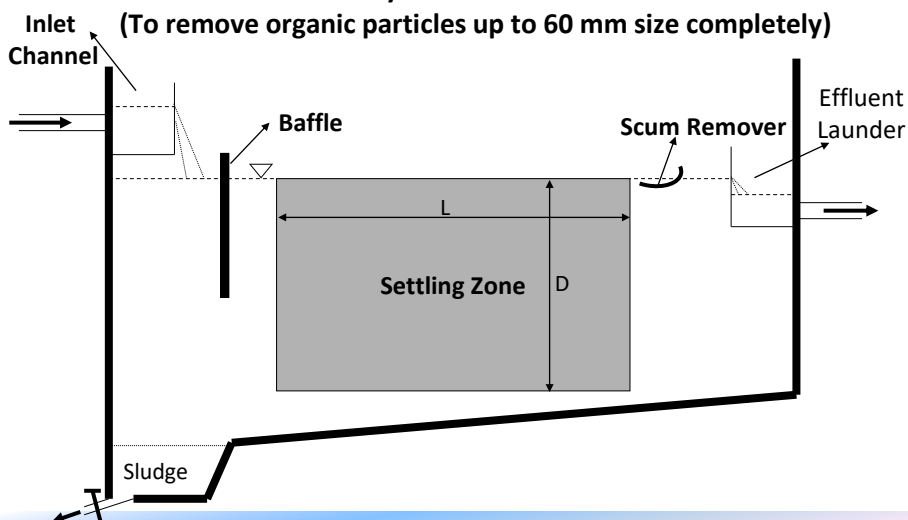

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Biological Wastewater Treatment

Secondary Treatment: Aerobic Biological Treatment

Sewage: After Primary Sedimentation




Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Biological Wastewater Treatment

Microbial Consumption of Biodegradable Organic Carbon

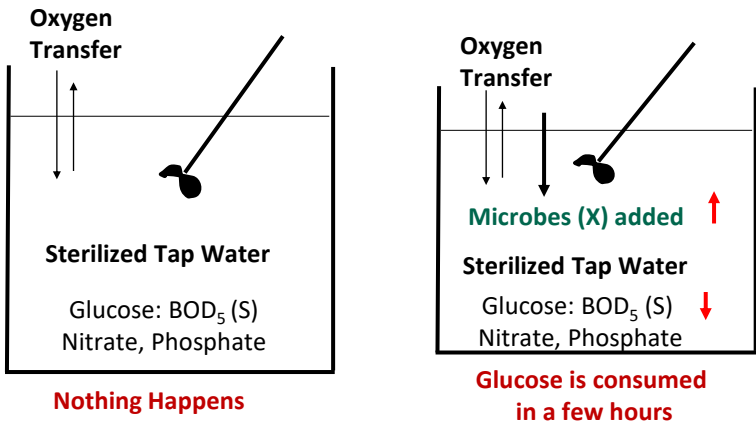


Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Microbial Growth Curve

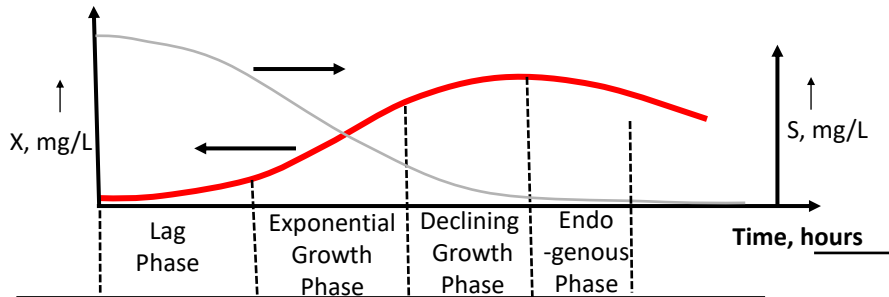

Slope of X vs t curve is $\left[\frac{dX}{dt} \right]_G$

Slope of S vs t curve is $\left[\frac{dS}{dt} \right]$




Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Biological Wastewater Treatment



Microbial Consumption of Biodegradable Organic Carbon

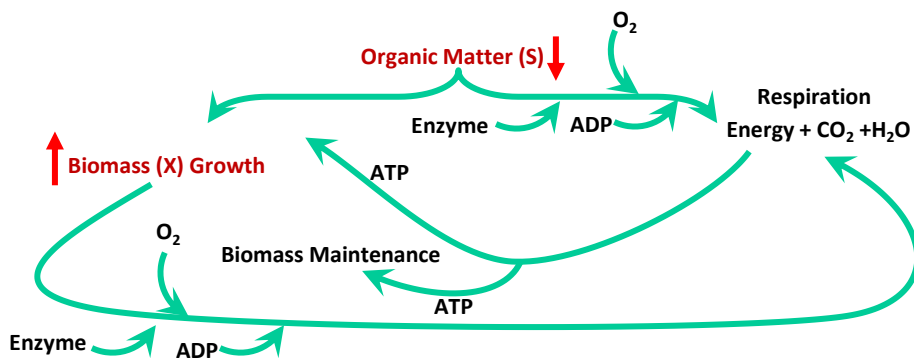

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

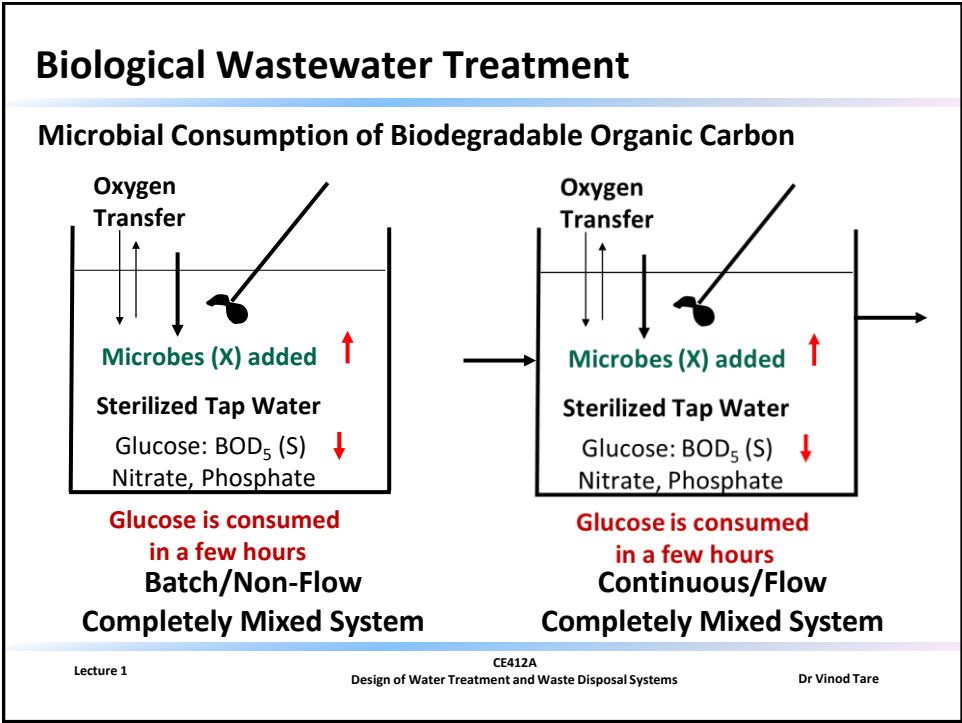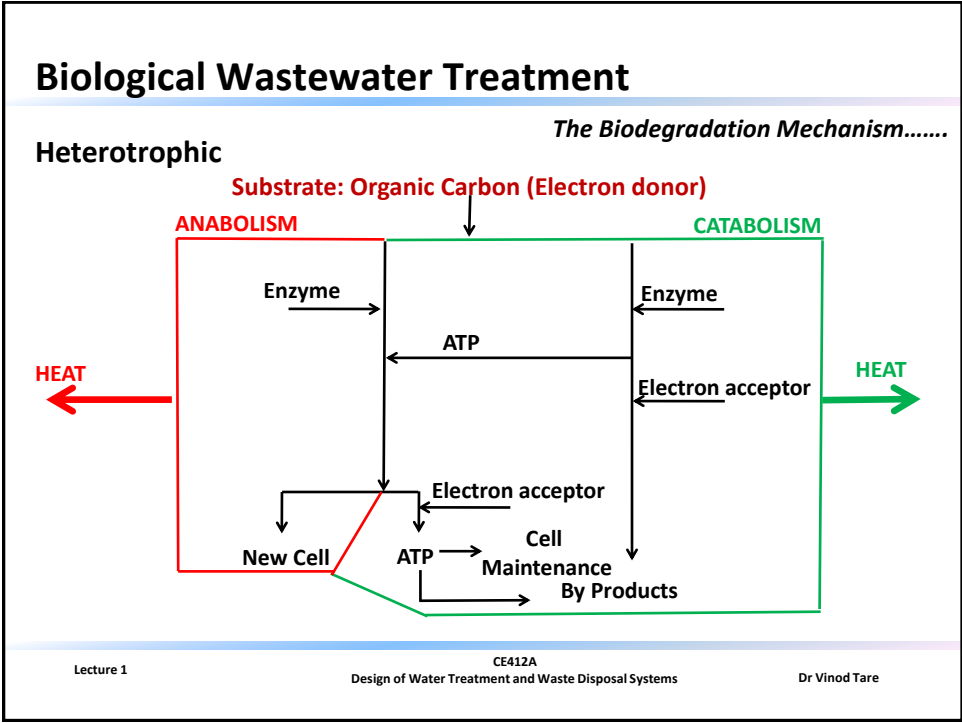

Microbial Growth: Definitions and Relations

X = Biomass Concentration, mg/L

S = Substrate Concentration, mg/L

$\frac{dS}{dt}$ = Substrate Utilization Rate, mg/L/d

$\left[\frac{dS}{dt}\right] / X = q$ = Specific Substrate Utilization Rate, (–ve)

$\left[\frac{dX}{dt}\right]_T$ = Gross Biomass Growth Rate, mg/L/d

$\left[\frac{dX}{dt}\right]_G$ = Net Biomass Growth Rate, mg/L/d

$\left[\frac{dX}{dt}\right]_G / X = \mu$ = Specific Net Biomass Growth Rate, /d

$\left[\frac{dX}{dt}\right]_E$ = Biomass Decay Rate, mg/L/d

$\left[\frac{dX}{dt}\right]_E / X = k_d$ (–ve)

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Microbial Growth: Definitions and Relations

S = Substrate Concentration, mg/L

X = Biomass Concentration, mg/L

$\frac{dS}{dt}$ = Substrate Utilization Rate, mg/L/d

$\left[\frac{dS}{dt}\right] / X = q$ = Specific Substrate Utilization Rate, /d

$\left[\frac{dX}{dt}\right]_T$ = Gross Biomass Growth Rate, mg/L/d

$$\left[\frac{dX}{dt}\right]_G = \left[\frac{dX}{dt}\right]_T + \left[\frac{dX}{dt}\right]_E$$

$$\left[\frac{dX}{dt}\right]_T = Y_T \cdot \left[\frac{dS}{dt}\right]$$

Y_T = Yield Coefficient

$$\left[\frac{dX}{dt}\right]_G / X = Y_T \cdot \left[\frac{dS}{dt}\right] / X - \left[\frac{dX}{dt}\right]_E / X$$

$$\mu = Y_T \cdot q - k_d$$

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Microbial Growth: Definitions and Relations

$\left[\frac{dX}{dt}\right]_G$ = Net Biomass Growth Rate, mg/L/d

$$\left[\frac{dX}{dt}\right]_G = Y_{obs} \cdot \left[\frac{dS}{dt}\right]$$

$\left[\frac{dX}{dt}\right]_G / X = \mu$ = Specific Net Biomass Growth Rate, /d

Y_{obs} = Observed Yield Coefficient

$\left[\frac{dX}{dt}\right]_E$ = Biomass Decay Rate, mg/L/d

$$\left[\frac{dX}{dt}\right]_G / X = Y_{obs} \cdot \left[\frac{dS}{dt}\right] / X$$

$\left[\frac{dX}{dt}\right]_E / X = k_d$ = Specific Biomass Decay Rate, /d (- ve)

$$\mu = Y_{obs} \cdot q$$

$$Y_{obs} = Y_T - \frac{K_d}{q}$$

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Microbial Growth Curve

Slope of X vs t curve is $\left[\frac{dX}{dt}\right]_G$

Slope of S vs t curve is $\left[\frac{dS}{dt}\right]$

Lag Phase: X is low, S is high;

$$\left[\frac{dX}{dt}\right]_G \text{ is low; } \left[\frac{dS}{dt}\right] \text{ is low;}$$

Exponential Growth phase: X is higher, S is sufficient, μ is high;

$$\left[\frac{dX}{dt}\right]_G \text{ is high; } \left[\frac{dS}{dt}\right] \text{ is high;}$$

Declining Growth phase: X is high, S is low, μ is decreasing;



$$\left[\frac{dX}{dt}\right]_G \text{ is lower; } \left[\frac{dS}{dt}\right] \text{ is lower;}$$


Endogenous Phase: X is declining, S is zero, μ is negative; $\left[\frac{dX}{dt}\right]_G$ is negative; $\left[\frac{dS}{dt}\right]$ is zero;

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

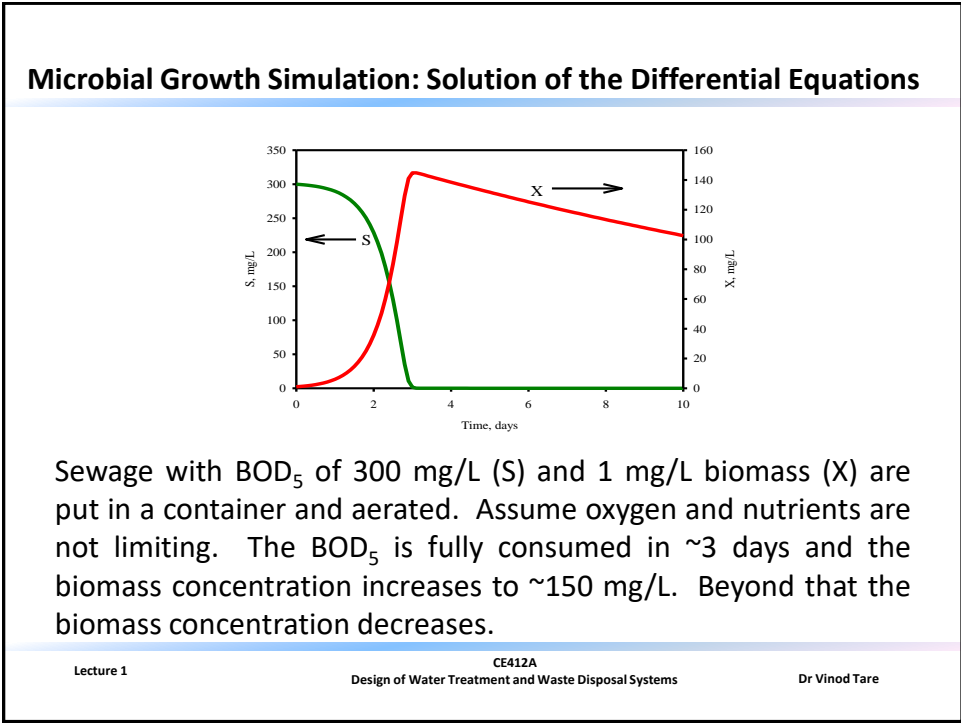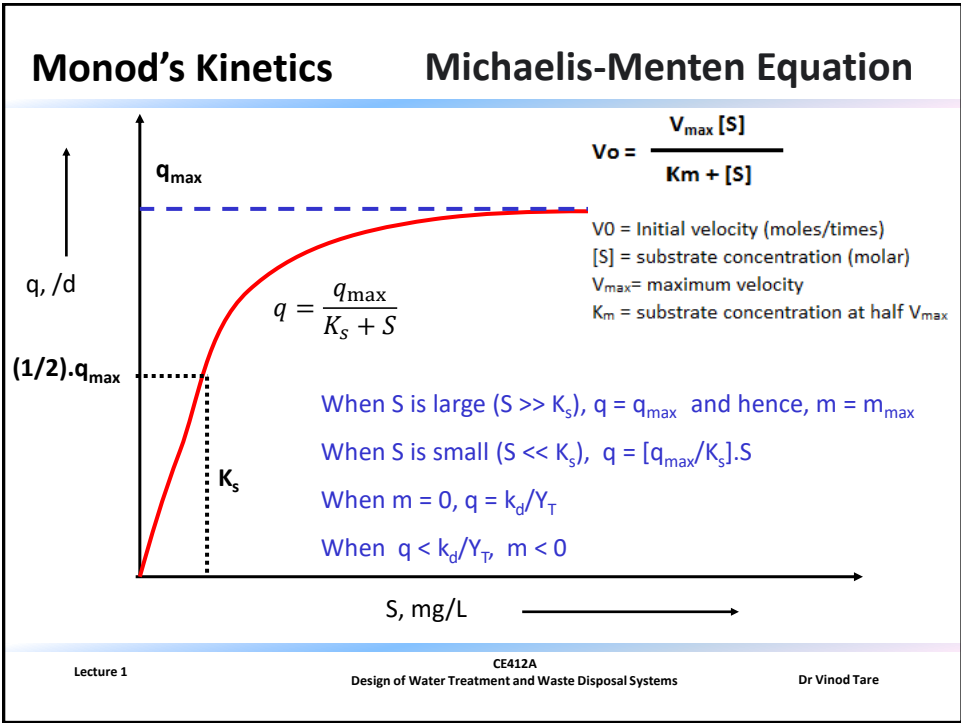

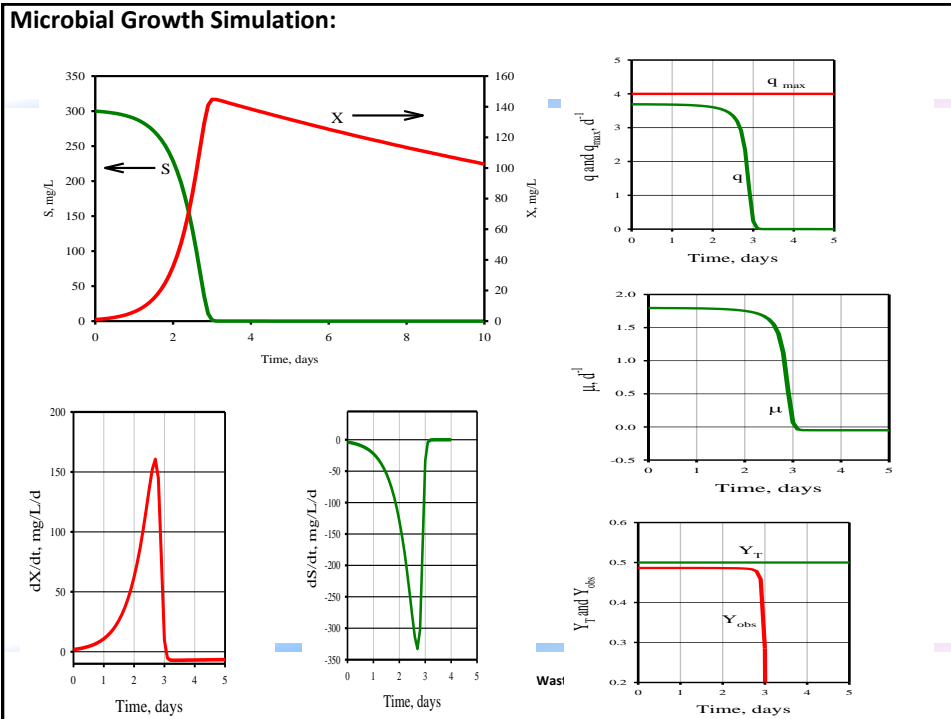

Microbial Growth Simulation:

$$q = \frac{q_{\max} S}{K_s + S}$$


$$\mu = Y_T \cdot q - k_d; \quad \frac{dX}{dt} = Y_T \cdot \left[-\frac{dS}{dt} \right] - K_d \cdot X$$

Initial Conditions:

At, $t = 0$, $S = S_0 = 300 \text{ mg/L}$
 $X = X_0 = 1 \text{ mg/L}$


$$\begin{aligned} q_{\max} &= 4 \text{ d}^{-1} \\ K_s &= 25 \text{ mg L}^{-1} \\ Y_T &= 0.5 \text{ mg mg}^{-1} \\ K_d &= 0.05 \text{ d}^{-1} \end{aligned}$$

Process dynamics of a continuous flow bioreactor.....

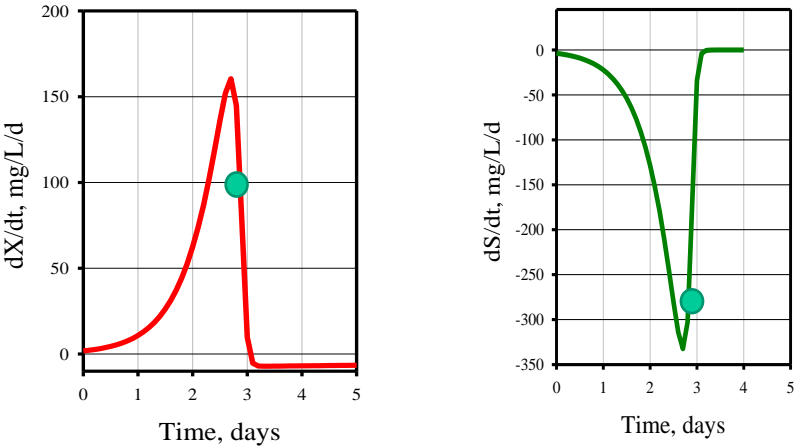

Lecture 1 CE412A Design of Water Treatment and Waste Disposal Systems Dr Vinod Tare

Process dynamics of a continuous flow bioreactor.....

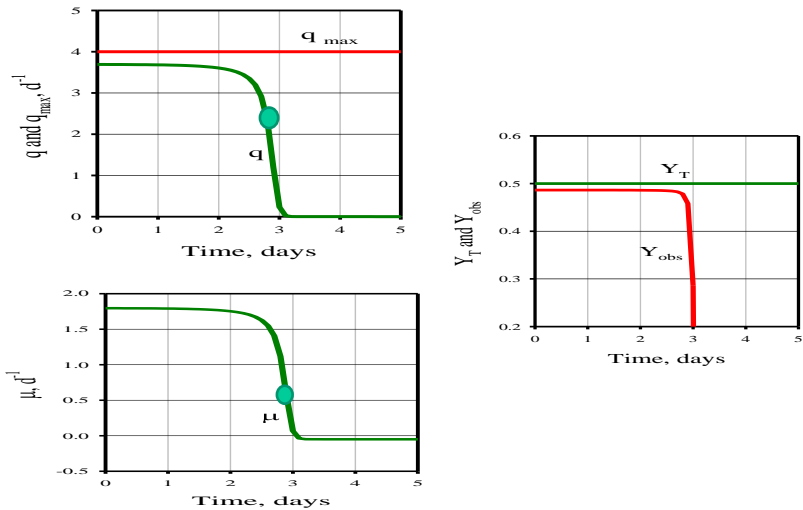

Lecture 1 CE412A Design of Water Treatment and Waste Disposal Systems Dr Vinod Tare

Determination of Bio-Kinetic Constants

Volume = V; S, X

Completely Mixed Reactor

Q	Q	V	θ	
mL/min	Liters/day	Liters	day	
2.31	3.33	10	3	R1
3.47	5.00	10	2	R2
6.94	10.00	10	1	R3

Hydraulic Retention Time (q)
= V/Q

$\mu = Y_T \cdot q - k_d$

$q = \frac{q_{\max}}{K_s + S}$

Substrate Mass Balance:

$Q \cdot S_o = Q \cdot S + \left[\frac{dS}{dt}\right] \cdot V$

$Q \cdot \frac{(S_o - S)}{V} = q \cdot X$

Biomass Mass Balance:

$Q \cdot X_o + \left[\frac{dX}{dt}\right]_G \cdot V = Q \cdot X$

$\mu \cdot X \cdot V = Q \cdot X; \quad \mu = Q/V$
= 1/θ

Influent BOD (S_o) = 250 mg/L


	θ, days	S, mg/L	X, mg/L
R1	3	10	120
R2	2	17	115
R3	1	45	110

q	μ	1/S	1/q	Y _{obs}	
/ day	/ day	L/mg	d		
0.67	0.33	0.10	1.50	0.492	R1
1.01	0.50	0.06	0.99	0.495	R2
1.86	1.00	0.02	0.54	0.538	R3


The reactor is operated under three conditions as above and the reactor performance is shown in the table to the left

$Q \cdot \frac{(S_o - S)}{V \cdot X} = q$

$\mu = Q/V = 1/\theta$

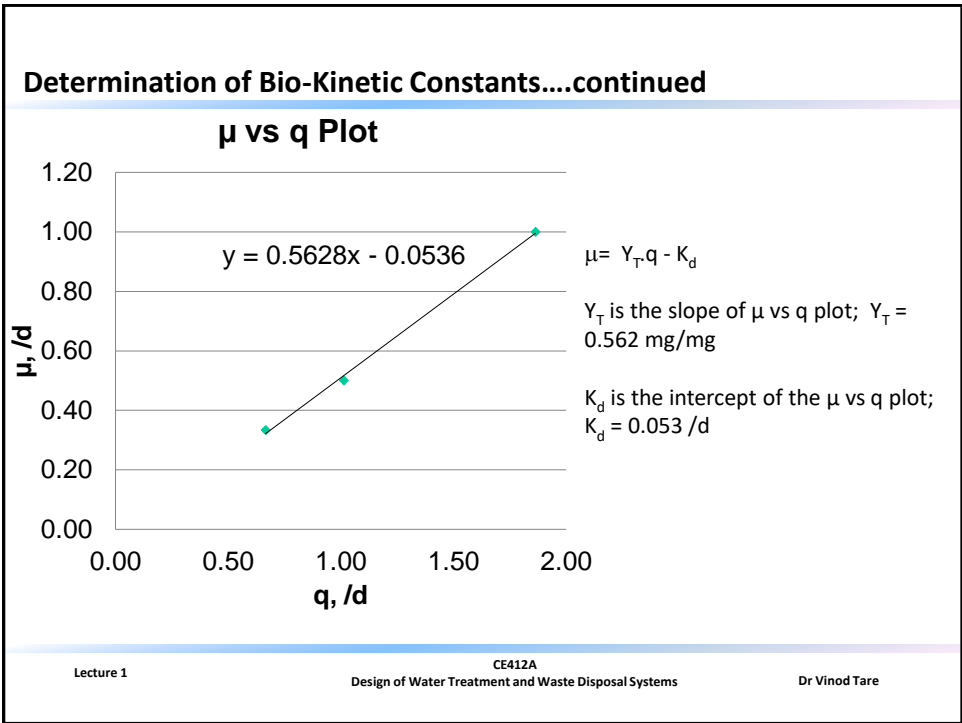

Determination of Bio-Kinetic Constants....continued

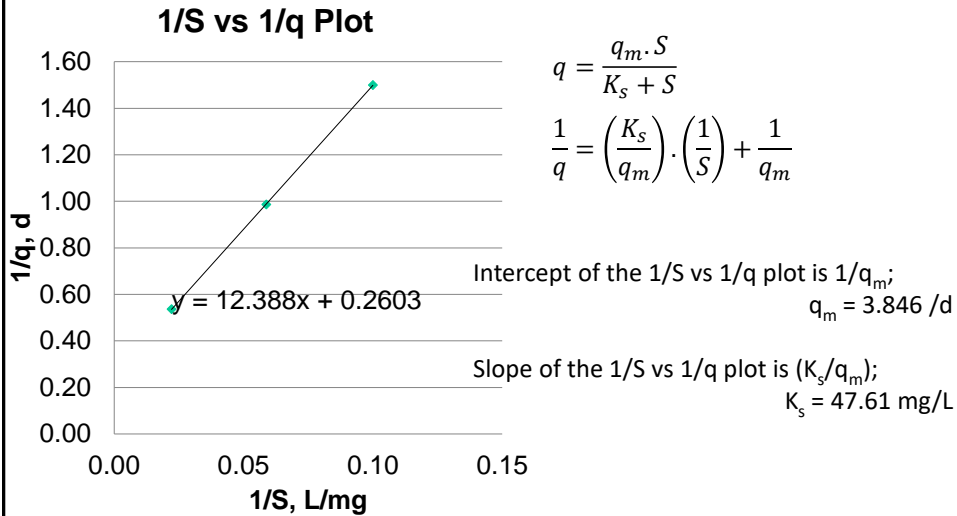


Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Example Problem....Biodegradation of Domestic Sewage

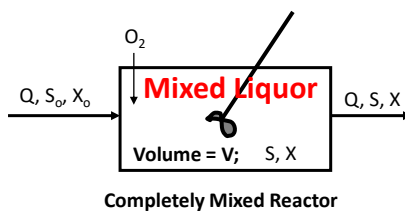

Microbial Kinetic Constants:

$$q_{\max} = 4 \text{ /d}$$

$$K_s = 25 \text{ mg/L}$$

$$K_d = 0.05 \text{ /d}$$

$$Y_T = 0.50 \text{ g biomass / g BOD}_5$$

$$\text{Hydraulic Retention Time } (\theta) = V/Q = \frac{M}{\frac{\Delta M}{\Delta t}} = X / \left(\frac{\Delta X}{\Delta t} \right)$$

$$\mu = Y_T \cdot q - k_d \quad q = \frac{q_{\max}}{K_s + S} \quad Q \cdot \frac{(S_o - S)}{V \cdot X} = q \quad \mu = \frac{Q}{V} = \frac{1}{\theta}$$

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Example Problem....Biodegradation of Domestic Sewage

Example Problem

$$Q = 1 \text{ MLD}; \quad V = 1000 \text{ m}^3; \quad S_o = 300 \text{ mg/L} \quad q = V/Q = 1 \text{ day};$$

$$\mu = 1/q = 1 \text{ / d}$$

$$q = \frac{\mu + k_d}{Y_T} = \frac{1 + 0.05}{0.5} = 2.1 \text{ /d} \quad Y_{obs} = \frac{\mu}{q} = \frac{1.0}{2.1} = 0.476 \text{ g biomass/g BOD}_5$$


$$S = \frac{q \cdot K_s}{(q_{max} \frac{(2.1) \cdot (25)}{(4 - 2.1)} \text{ mg/L})} \quad X = \frac{(S_o - S)}{\theta \cdot q} = \frac{(300 - 27.63)}{1 \cdot (2.1)} = 129.7 \text{ mg/L}$$

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Activated Sludge Process → Wastewater/Sewage Aerated in Presence of Microbes and then Separated

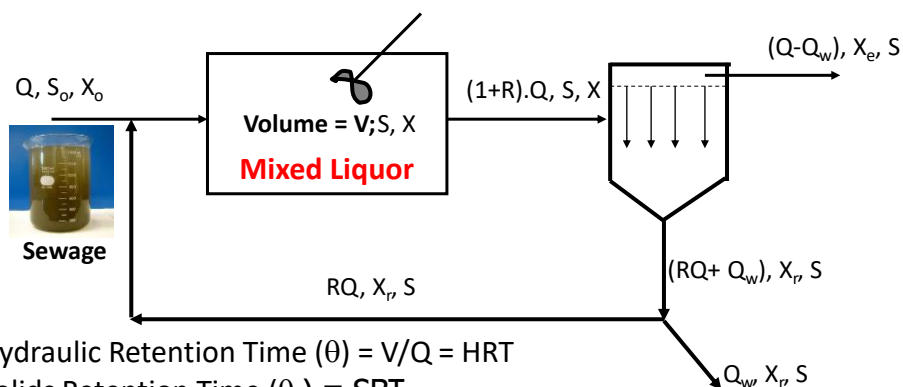

Hydraulic Retention Time (θ) = V/Q = HRT

Solids Retention Time (θ_c) = SRT

Biological Solids Retention Time = BSRT = $\frac{M}{\frac{\Delta M}{\Delta t}} = X / (\frac{\Delta X}{\Delta t})$

Suspended Solids (SS) in Mixed Liquor (ML) are referred as MLSS


Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Activated Sludge Process

→ Wastewater/Sewage Aerated in Presence of Microbes and then Separated

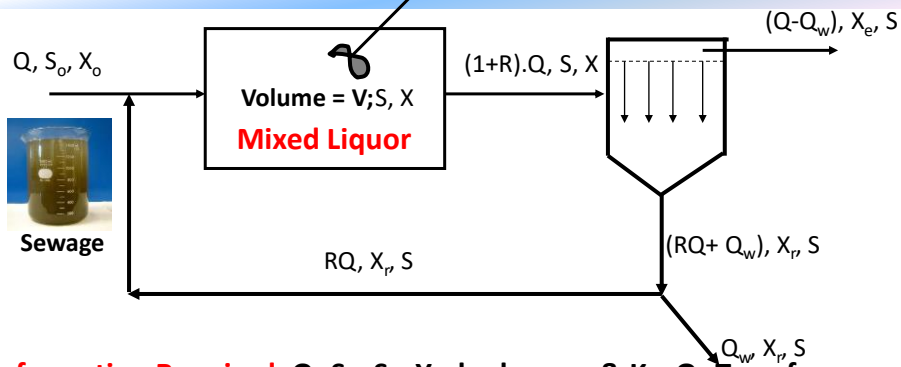

Information Required: $Q; S_o; S_e; Y_T; k_d; k$ or q_m & $K_s; O_2$ Transfer

Capacity & Mixing Power

Choices to make: $\theta; \theta_c; X; X_r; R$

Design → Specifications: Aeration Tank (AT); Secondary Clarifier (SC); Recirculation System & Sludge Wasting Line

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare



Activated Sludge Process



Aeration Tank



Secondary Sedimentation Tank

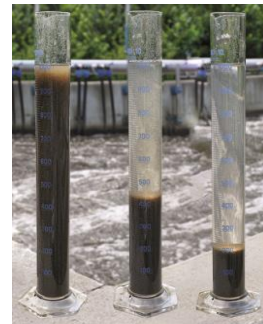


Secondary Sedimentation

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Microbial Kinetics in a Reactor with Recycle

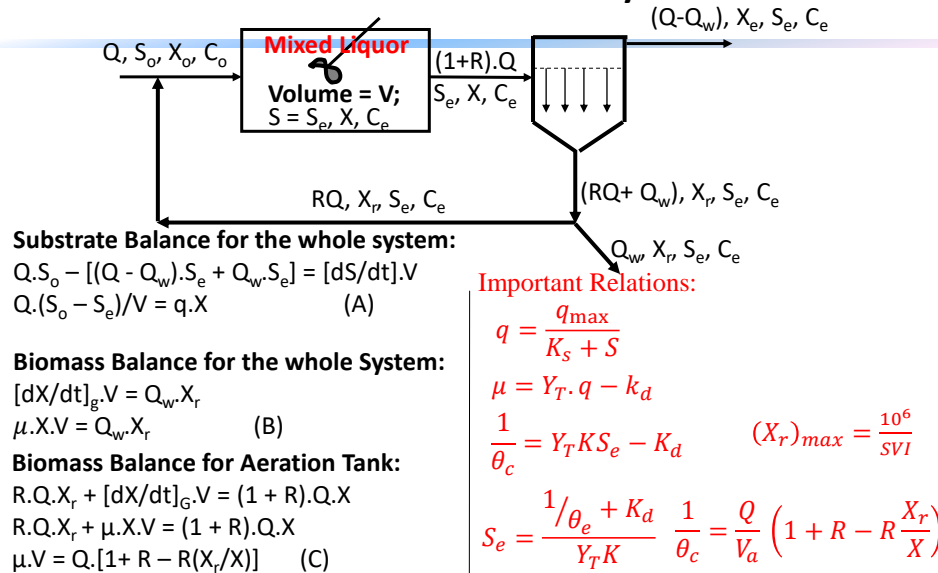


Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Oxygen Requirement

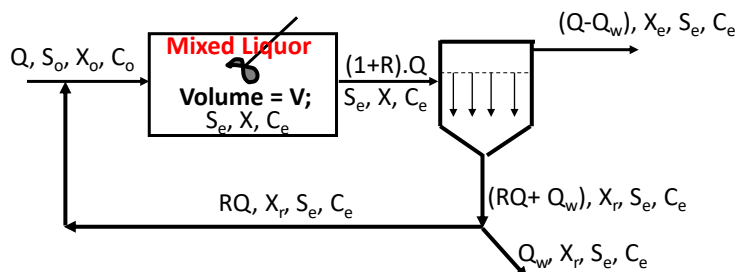

Organic carbon compounds consumed by microorganisms and converted to carbon dioxide (catabolism) and biomass (anabolism). Part of this biomass is oxidized by microorganisms to carbon dioxide (endogenous respiration). Energy produced through oxidation of organic carbon to carbon dioxide is the driving force for sustenance of the microorganisms and production of new biomass. Oxygen is required as the terminal electron acceptor for this process.

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Oxygen Requirement

Amount of Oxygen Required:

Biomass formula (dry basis): $C_5H_7O_2N$; Formula weight = 113

Respiration Equation:



This, if 1 g of biomass is produced, $\{(32 * 5)/113\}$ 1.42 g of oxygen requirement is saved.

[Oxygen Required in Aeration Tank, kg/d] = [BOD_u Removed, in kg/d] – 1.42.[Sludge Wasted, kg/d]

Where, BOD_u ~ 1.5.BOD₅ ; So, O₂ Reqd, kg/d = 1.5.Q (S_o – S_e) – 1.42.[ΔX]


Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Theory of Aeration:

$P_{O_2} \xrightleftharpoons[k_2]{k_1} [O_2]_l$ $[O_2]_l$ in moles/L P_{O_2} in atm.



Rate of oxygen input to liquid phase = $V \cdot \frac{d[O_2]_l}{dt}$

= Rate of Oxygen Absorption – Rate of Oxygen Stripping =

At equilibrium: $[O_2]_l = [O_2]_l^s$; $k_1 \cdot P_{O_2} = k_2 \cdot [O_2]_l^s$; $k_1 \cdot P_{O_2} - k_2 \cdot [O_2]_l$

$P_{O_2} = \left(\frac{k_2}{k_1}\right) \cdot [O_2]_l^s$; $k_2 = k_1 \cdot H$ k_1 in moles/atm.-s
 k_2 in L/s

$$V \cdot \frac{d[O_2]_l}{dt} = k_1 \cdot (H \cdot [O_2]_l^s) - k_1 \cdot H \cdot [O_2]_l$$

$$= k_1 \cdot H \cdot ([O_2]_l^s - [O_2]_l);$$

$$k_1 \cdot H = (k_a \cdot H) \cdot A = k_L \cdot A$$

$$V \cdot \frac{d[O_2]_l}{dt} = k_L \cdot A \cdot ([O_2]_l^s - [O_2]_l);$$

k_L = Mass transfer coefficient;

A


= contact area between liquid–gas phases

$$\frac{d[O_2]_l}{dt} = k_L \cdot \left(\frac{A}{V}\right) \cdot ([O_2]_l^s - [O_2]_l)$$

$$= k_L \cdot a \cdot ([O_2]_l^s - [O_2]_l)$$

a = Specific Surface Area (m^2/m^3)


Henry's Law: $P_{O_2} = H \cdot [O_2]_l^s$
 H is the Henry's Constant in atm–L/mole

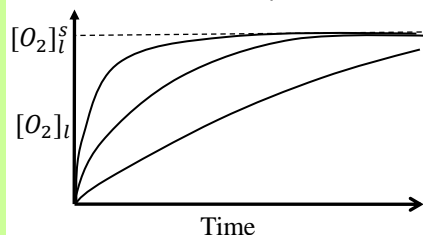


The oxygen transfer rate from the gas to the liquid phase can be increased by increasing the value of 'a'.

The value of 'a' may be increased by using mechanical aerators

Two types of aerators are commonly used: 1) Surface Aerators & 2) Diffused Aerators

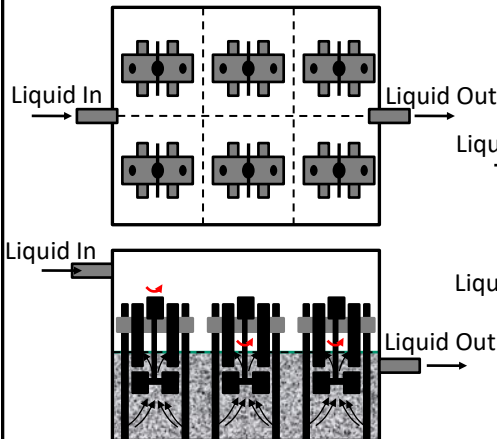

The diagram shows two types of surface aerators. The top one is a mechanical surface aerator with six vertical shafts, each with a horizontal disc at the surface. Liquid enters from the left and exits to the right. The bottom one is a vertical shaft aeration system with three vertical shafts, each with multiple horizontal discs. Liquid enters from the left and exits to the right.

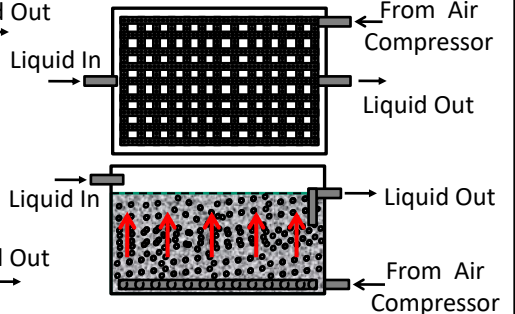

The diagram shows two types of diffused aerators. The top one is a fine-bubble diffuser with a grid of small holes. Air from a compressor enters from the right, and liquid enters from the left and exits to the right. The bottom one is a coarse-bubble diffuser with larger holes. Air from a compressor enters from the right, and liquid enters from the left and exits to the right.

1) Surface Aerators

2) Diffused Aerators or Bubble Aerators

Lecture 1

CE412A

Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

1) Surface Aerators



The photograph shows a large wastewater treatment plant with several rectangular aeration tanks. In the foreground, a large surface aerator is in operation, creating a significant amount of white foam and splashing water. Blue metal walkways and railings are visible around the tanks. In the background, there are more tanks and several large blue storage tanks. The area is surrounded by green grass and trees.

Lecture 1

CE412A

Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

1) Surface Aerators



Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Surface Aerator: Design Procedure

Aerator Rating: 1, 2, 5 KW ; Area of Influence: 5m x 5m x 3m (depth)

Aerator Rating: 10, 25, 50 KW; Area of Influence: 6m x 6m x 4m (depth)

Standard O_2 transfer efficiency (SOT) is given by the manufacturer as,
kg O_2 transferred per hour per KW under standard conditions

Standard Conditions: $T = 20^\circ\text{C}$; $[O_2]_I = 0.0$; In tap water

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

SOT calculation: (Generally specified by the manufacturer)

Fill up a 5x5x3 m or 6x6x4 m tank (depending on aerator size) with tap water

Aerate overnight. Measure DO in the morning. This is $[O_2]_l^s$. Measure temp.

Add sodium sulfite to de-aerate water, i.e., $[O_2]_l = 0.0$

Aerate from $t = 0$ to $t = t$. Measure $[O_2]_l$ at various times during aeration.

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Surface Aerator: Design Procedure (Continued)

$$\frac{d[O_2]_l}{dt} = K_L \cdot a \{ [O_2]_l^s - [O_2]_l \}$$

Integrating,


$$\int_{[O_2]_l}^0 \frac{d[O_2]_l}{\{ [O_2]_l^s - [O_2]_l \}} = \int_t^0 K_L \cdot a \cdot dt$$

$$\ln \left\{ \frac{[O_2]_l^s}{[O_2]_l^s - [O_2]_l} \right\} = K_L \cdot a \cdot t$$

$$\frac{d[O_2]_l}{dt} = k_L \cdot a \cdot ([O_2]_l^s - [O_2]_l)$$

$$V \cdot \frac{d[O_2]_l}{dt} = k_L \cdot a \cdot ([O_2]_l^s - [O_2]_l) \cdot V$$

$$SOT = (K_L \cdot a)_{20} \cdot [O_2]_l^{s_{20}} \cdot (V)$$

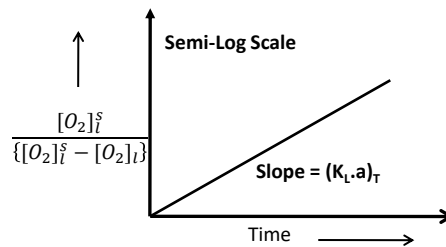

$$(K_L \cdot a)_{20} = \frac{(K_L \cdot a)_T}{(1.02)^{T-20}}$$

T in celsius

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Energy requirements for maintaining completely mixed conditions in the aeration tank

For an aeration tank of volume V , the P/V ratio for maintaining completely mixed conditions is $15 - 20 \text{ W/m}^3$

Hence in actual design power requirement in an aeration tank must be calculated both from O_2 requirement and mixing perspectives, and the larger value adopted.

In many cases, the mixing requirement becomes the controlling factor for provision of power to the aeration tank

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Example Problem: Aerator Design

Given the oxygen requirement of 8400 kg/d , design the aeration system for an ASP using turbine aerators. Assume that two aeration tanks will be provided in parallel and depth of the tanks will be 4 m . Total volume of aeration tanks is 4320 m^3 . No nitrification occurs in the aeration tank. Turbine Aerators are available with power rating $10, 25, 50 \text{ KW}$ with area of influence being 36 m^2 . Manufacturers specify that the oxygen transfer capacity of these aerators is $2.0 \text{ Kg } O_2/\text{kW-h}$ under standard conditions. Based on this information, design an adequate aerator arrangement for each aeration tank. The operating temperature of the aeration tank is expected to be 30°C . Saturation concentration of oxygen in water at 20°C is 9.1 mg/L and at 30°C is 7.5 mg/L .

$$\alpha = \frac{(K_L \cdot a)_T^W}{(K_L \cdot a)_T^F} = 0.8 \quad \beta = \frac{C_s(\text{wastewater})}{C_s(\text{tapwater})} = 0.9 \quad (K_L \cdot a)_T^F = (K_L \cdot a)_{20}^F \cdot \gamma, \quad \gamma = 1.02^{(T-20)}$$

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Given SOT: To Find the Actual Oxygen Transfer Efficiency (AOT)

both $K_L \cdot a$ and $[O_2]_l^s$ depend on temperature

$$\alpha = \frac{(K_L \cdot a)_T^W}{(K_L \cdot a)_T^F} = 0.8; \quad \beta = \frac{[O_2]_l^W}{[O_2]_l^F} = 0.9 \quad \text{Impact of wastewater}$$

$$(K_L \cdot a)_{20} = \frac{(K_L \cdot a)_T}{(1.02)^{T-20}}; \quad T \text{ in celcius}$$

$[O_2]_l^s$ decreases with tempearture, obtained from tables

$[O_2]_l = 1 \text{ mg/L or } 3 \text{ mg/L (in case of nitrification)}$

$$SOT = (K_L \cdot a)_{20}^F \cdot [O_2]_l^{S_{20}} \cdot (V) \quad \text{Generally } 1.5 - 2.0 \text{ kg } O_2 / \text{h/KW}$$

$$AOT = (K_L \cdot a)_T^W \cdot \{[O_2]_l^{S_T} - [O_2]_l\} \cdot (V)$$

$$AOT = (K_L \cdot a)_{20}^F \cdot (\alpha \cdot [1.02]^{T-20}) \{ \beta \cdot [O_2]_l^{S_T} - [O_2]_l \} \cdot (V)$$

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Solution

$$c/s \text{ area of each tank} = 4320/4/2 = 540 \text{ m}^2$$

$$\text{Area of influence of each aerator} = 36 \text{ m}^2$$

Let length of each tank be 30 m and breadth be 18 m.

Hence aerators are provided in a 5x3 grid

$$SOT = 2.0 \text{ kg } O_2 / \text{h/KW}; \quad \text{Find AOT at } 30^\circ\text{C}$$

$$[O_2]_l^{S_{20}} = 9.1 \text{ mg/L} \quad [O_2]_l^{S_{30}} = 7.5 \text{ mg/L} \quad [O_2]_l = 1.0 \text{ mg/L}$$

$$SOT = (K_L \cdot a)_{20}^F \cdot [O_2]_l^{S_{20}} \cdot (V) \quad 2 = (K_L \cdot a)_{20}^F \cdot (V) \cdot 9.1$$

$$AOT = (K_L \cdot a)_{20}^F \cdot ([0.8] \cdot [1.02]^{30-20}) \{ [0.9] \cdot [7.5] - 1 \} \cdot (V)$$

$$AOT = (K_L \cdot a)_{20}^F \cdot (V) \cdot (5.607) = \frac{2}{9.1} \cdot (5.607) \\ = 1.232 \text{ kg } O_2 / \text{h/KW}$$

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Solution continued

$$AOT = (K_L \cdot a)_{20}^F \cdot (V) \cdot (5.607) = \frac{2}{9.1} \cdot (5.607) = 1.232 \text{ kg O}_2/\text{h/KW}$$

Oxygen transfer per aerator = $4200/15/24 = 11.67 \text{ kg/hr}$;

Hence, Power Req'd. = $11.67/1.232 = 9.56 \text{ KW}$; Provide 15 no. aerators@10KW/tank

Power Req'd. for mixing/tank = $540 \cdot (4) \cdot (20)/1000 = 43.2 \text{ KW}$

Power provided for aeration/tank = $15 \cdot (10) = 150 \text{ KW}$. Hence, completely mixed conditions will prevail.

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Nutrient (N and P) Requirement:

Nitrogen in wastewater is generally expressed as TKN (mg/L as N) .

TKN (as N, mg/L) = Organic-N (as N, mg/L) + Ammonia-N (as N, mg/L)

Phosphorus in wastewater is generally expressed as total – P (mg/L as P)

Total P (as P, mg/L) = Org-P (as P, mg/L) + Condensed P (as P, mg/L) + Ortho-P (as P, mg/L)

The BOD₅ (in mg/L) : TKN (in mg/L as N) : Total-P (in mg/L as P) ratio
in domestic wastewater is ~ 100 : 5 : 1

During BOD degradation: Organic –N is converted to Ammonia-N

Organic-P and Condensed-P are converted to Ortho-P

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Nutrient (N and P) Requirement:

In addition to organic carbon and oxygen, all microorganisms require N and P to grow.

Wastewater generally contains sufficient nutrients (in fact excess) from microorganism growth.

Biomass formula (dry basis): $C_{60}H_{87}O_{23}N_{12}P$; Formula Weight: 1382
For the growth of 1382 g biomass, 168 g N and 31 g P is required

Nutrient Requirement: 0.121 g N and 0.022 g P per g biomass produced (or wasted).

Hence the N and P concentration will decrease by this amount in the aeration tank

$$\Delta N \text{ (kg/d)} = 0.122 \Delta X \text{ (kg/d)} = Q \text{ (m}^3\text{/d)} * \text{TKN (kg/m}^3\text{)}$$

$$\Delta P \text{ (kg/d)} = 0.022 \Delta X \text{ (kg/d)} = Q \text{ (m}^3\text{/d)} * \text{TP (kg/m}^3\text{)}$$

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Settleability of Activated Sludge Solids

One of the factors essential to the performance of the activated sludge process is effective flocculation of the sludge, with subsequent rapid settling and compaction. Two types of bacteria are found in ASP sludge: 1) floc-forming, and 2) filamentous bacteria

Normal flocs: A balance between floc-forming and filamentous bacteria results in strong flocs that keep their integrity in the aeration basin and settle well in the sedimentation tank (High BSRT).

Pin-point flocs: In these flocs, filamentous bacteria are absent or occur in low numbers. This results in small flocs that do not settle well (Low BSRT).


Filamentous bulking: Filamentous bulking is caused by the predominance of filamentous organisms. The filaments interfere with sludge compaction. (very high BSRT)

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Activated Sludge: High Growth, Standard and Extended Aeration process

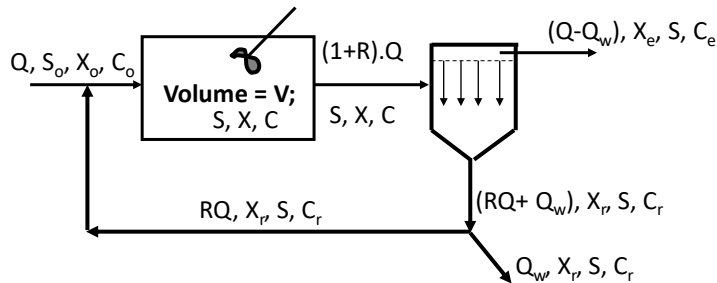

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

High-growth (Aerated Lagoon) versus Low-growth (Extended Aeration) System

What are the characteristics of a high-growth ASP system ??

In such a system, q_c is low. Hence μ and q are high, S is relatively high. ΔX is high, hence O_2 requirement is low, but nutrient requirement is high. Chance of forming pin-point flocs with poor settling characteristics.

What are the characteristics of an extended growth ASP system??


In such a system, q_c is high. Hence μ and q are low, S is relatively low. ΔX is low, hence O_2 requirement is high, but nutrient requirement is low. The inert matter concentration (C) in the aeration tank may be high. Chance of forming filamentous bulking sludge with poor settling characteristics.

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Settling of Activated Sludge

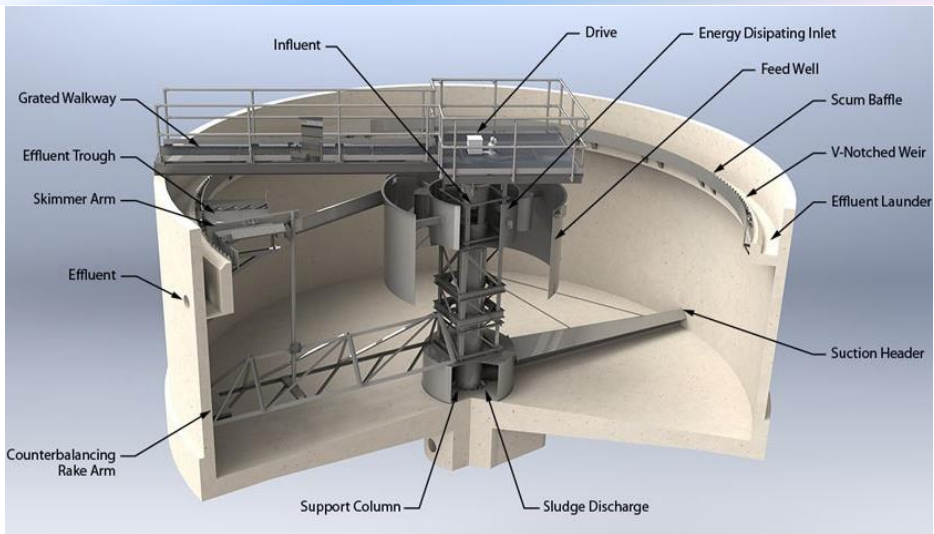


Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Settling of Activated Sludge

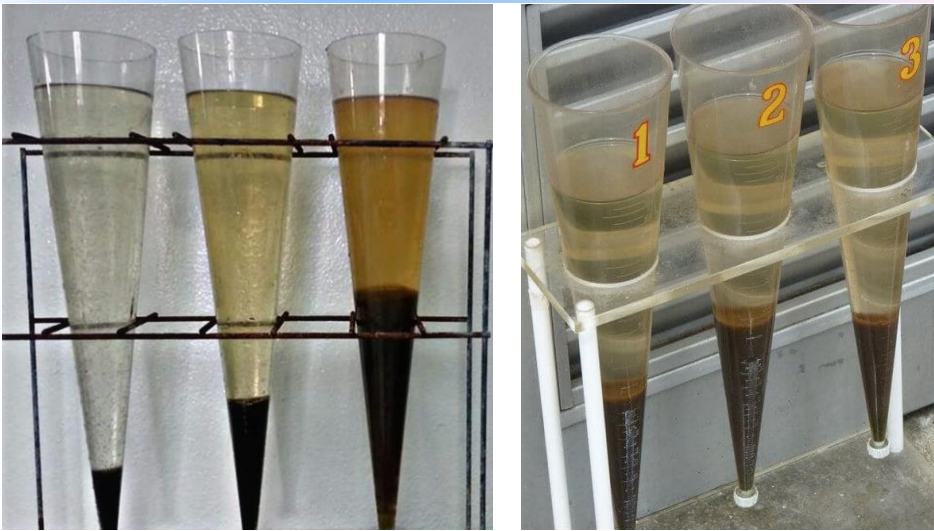

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Sludge Volume Index (SVI):

Sludge settleability is determined by measuring the sludge volume index (SVI), which is given by:


$$SVI \text{ (mL/g)} = \frac{SV \times 1000}{MLSS} \quad (X_r)_{max} = \frac{10^6}{SVI}$$

where SV = volume of settled sludge after 30 min (mL/L);

and MLSS = mixed liquor suspended solids (mg/L).

Low SVI (< 100) means good sludge settleability

High SVI (> 150) means bad settleability


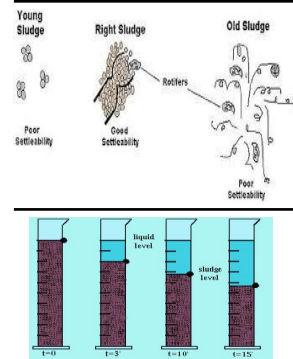


Lecture 1


CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Type III / Hindered / Zone Settling

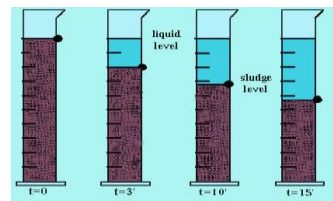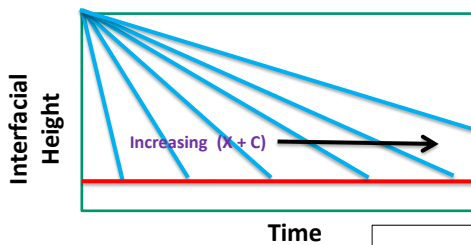

$$u = g c^{-h}$$

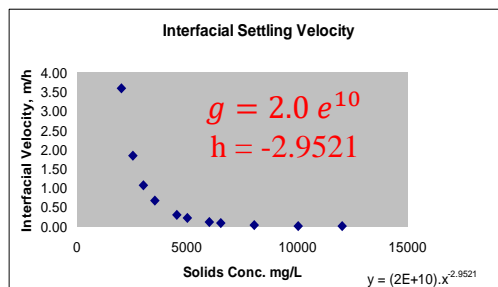

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Type III / Hindered / Zone Settling

Interfacial Velocities of Sludge Solids

Solids (C+X) mg/L	u, m/hr
2000	3.60
2500	1.86
3000	1.09
3500	0.69
4500	0.33
5000	0.24
6000	0.14
6500	0.11
8000	0.06
10000	0.03
12000	0.02

$$u = g c^{-h}$$

u = Interfacial settling velocity (in m/hr);

C = Mixed Liquor Suspended Solids Concentration (in mg/L)

$$= X + C_o * (\theta_c / \theta)$$

X = Biomass Concentration in Aeration Tank (AT), mg/L

C_o = Fixed Suspended Solids Concentration in inlet to AT, mg/L

$$g = 2 \times 10^{10}$$

$$h = 2.9521$$

Lecture 1

CE412A

Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

Concept of Solid Flux

Solid Flux (SF) =

Mass of solids passing through unit surface area of the clarifier in unit time, kg/m²/hr

At any depth ,

Gravity/Batch Flux (SF_G) = (C_i + X_i).u_i

u_i is the interfacial velocity

Underflow Flux (SF_u) = (C_i + X_i).v

C_i, X_i, v_i

Total Flux (SF_T) = SF_G + SF_u

Under steady state conditions,

SF_T is same at all depths

(C_i + X_i) increases with depth

$$C = \frac{\theta_c}{\theta}; C_o = C + X$$

$$\text{Flow} = Q(1 + R)$$

$$\text{Solids} = (C + X)$$

$$\text{Flow} = Q - Q_w$$

$$\text{Solids} = 0$$

$$\text{Flow} = RQ + Q_w$$

$$\text{Solids} = (C_r + X_r)$$

$$\text{Underflow Velocity (u)} = \frac{RQ + Q_w}{A_s}$$

Lecture 1


CE412A

Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

SST or SC Design – SOR for Limiting Solid Flux

Solids Concentration, C (g/L)	Gravity Flux (kg/m ² /h)	Underflow Flux (kg/m ² /h)	Total Flux (kg/m ² /h)
2.0	7.196	0.200	7.396
2.5	4.655	0.250	4.905
3.0	3.261	0.300	3.561
3.5	2.414	0.350	2.764
4.5	1.478	0.450	1.928
5.0	1.203	0.500	1.703
6.0	0.843	0.600	1.443
6.5	0.721	0.650	1.371
8.0	0.481	0.800	1.281
10.0	0.311	1.000	1.311
12.0	0.218	1.200	1.418

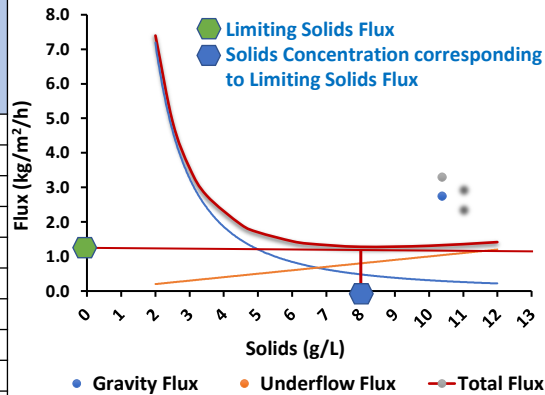

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare

SST or SC Design

Area and Depth Choice:

$$1. \text{ Clarification Criteria } \rightarrow u = g c^{-h} \quad \begin{aligned} g &= 2 \times 10^{10} \\ h &= 2.9521 \end{aligned}$$

2. Solids Concentration in Under Flow

3. Retention Time < 2.5 to 3 h

SOR for Limiting Solids Flux is given by following expression:

$$\frac{Q}{A} = \frac{g(h-1)\left(\frac{h}{h-1}\right)^h (R)^{h-1}}{(C_0)^h (1+R)^h}$$

Lecture 1

CE412A
Design of Water Treatment and Waste Disposal Systems

Dr Vinod Tare