
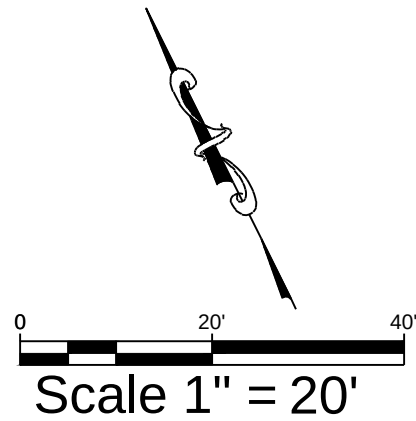


ORIGINAL LAYOUT SIZE: 24x36
©2026 H:\BLESIR\3133 BUILDING GROUP\133 70496 VALLEY VIEW TOWNHOMES SP104 CAD\PILOT SHEET\UTILITY TAP PLAN.DWG 2/27/2026 10:11 AM Chris Shaleesh

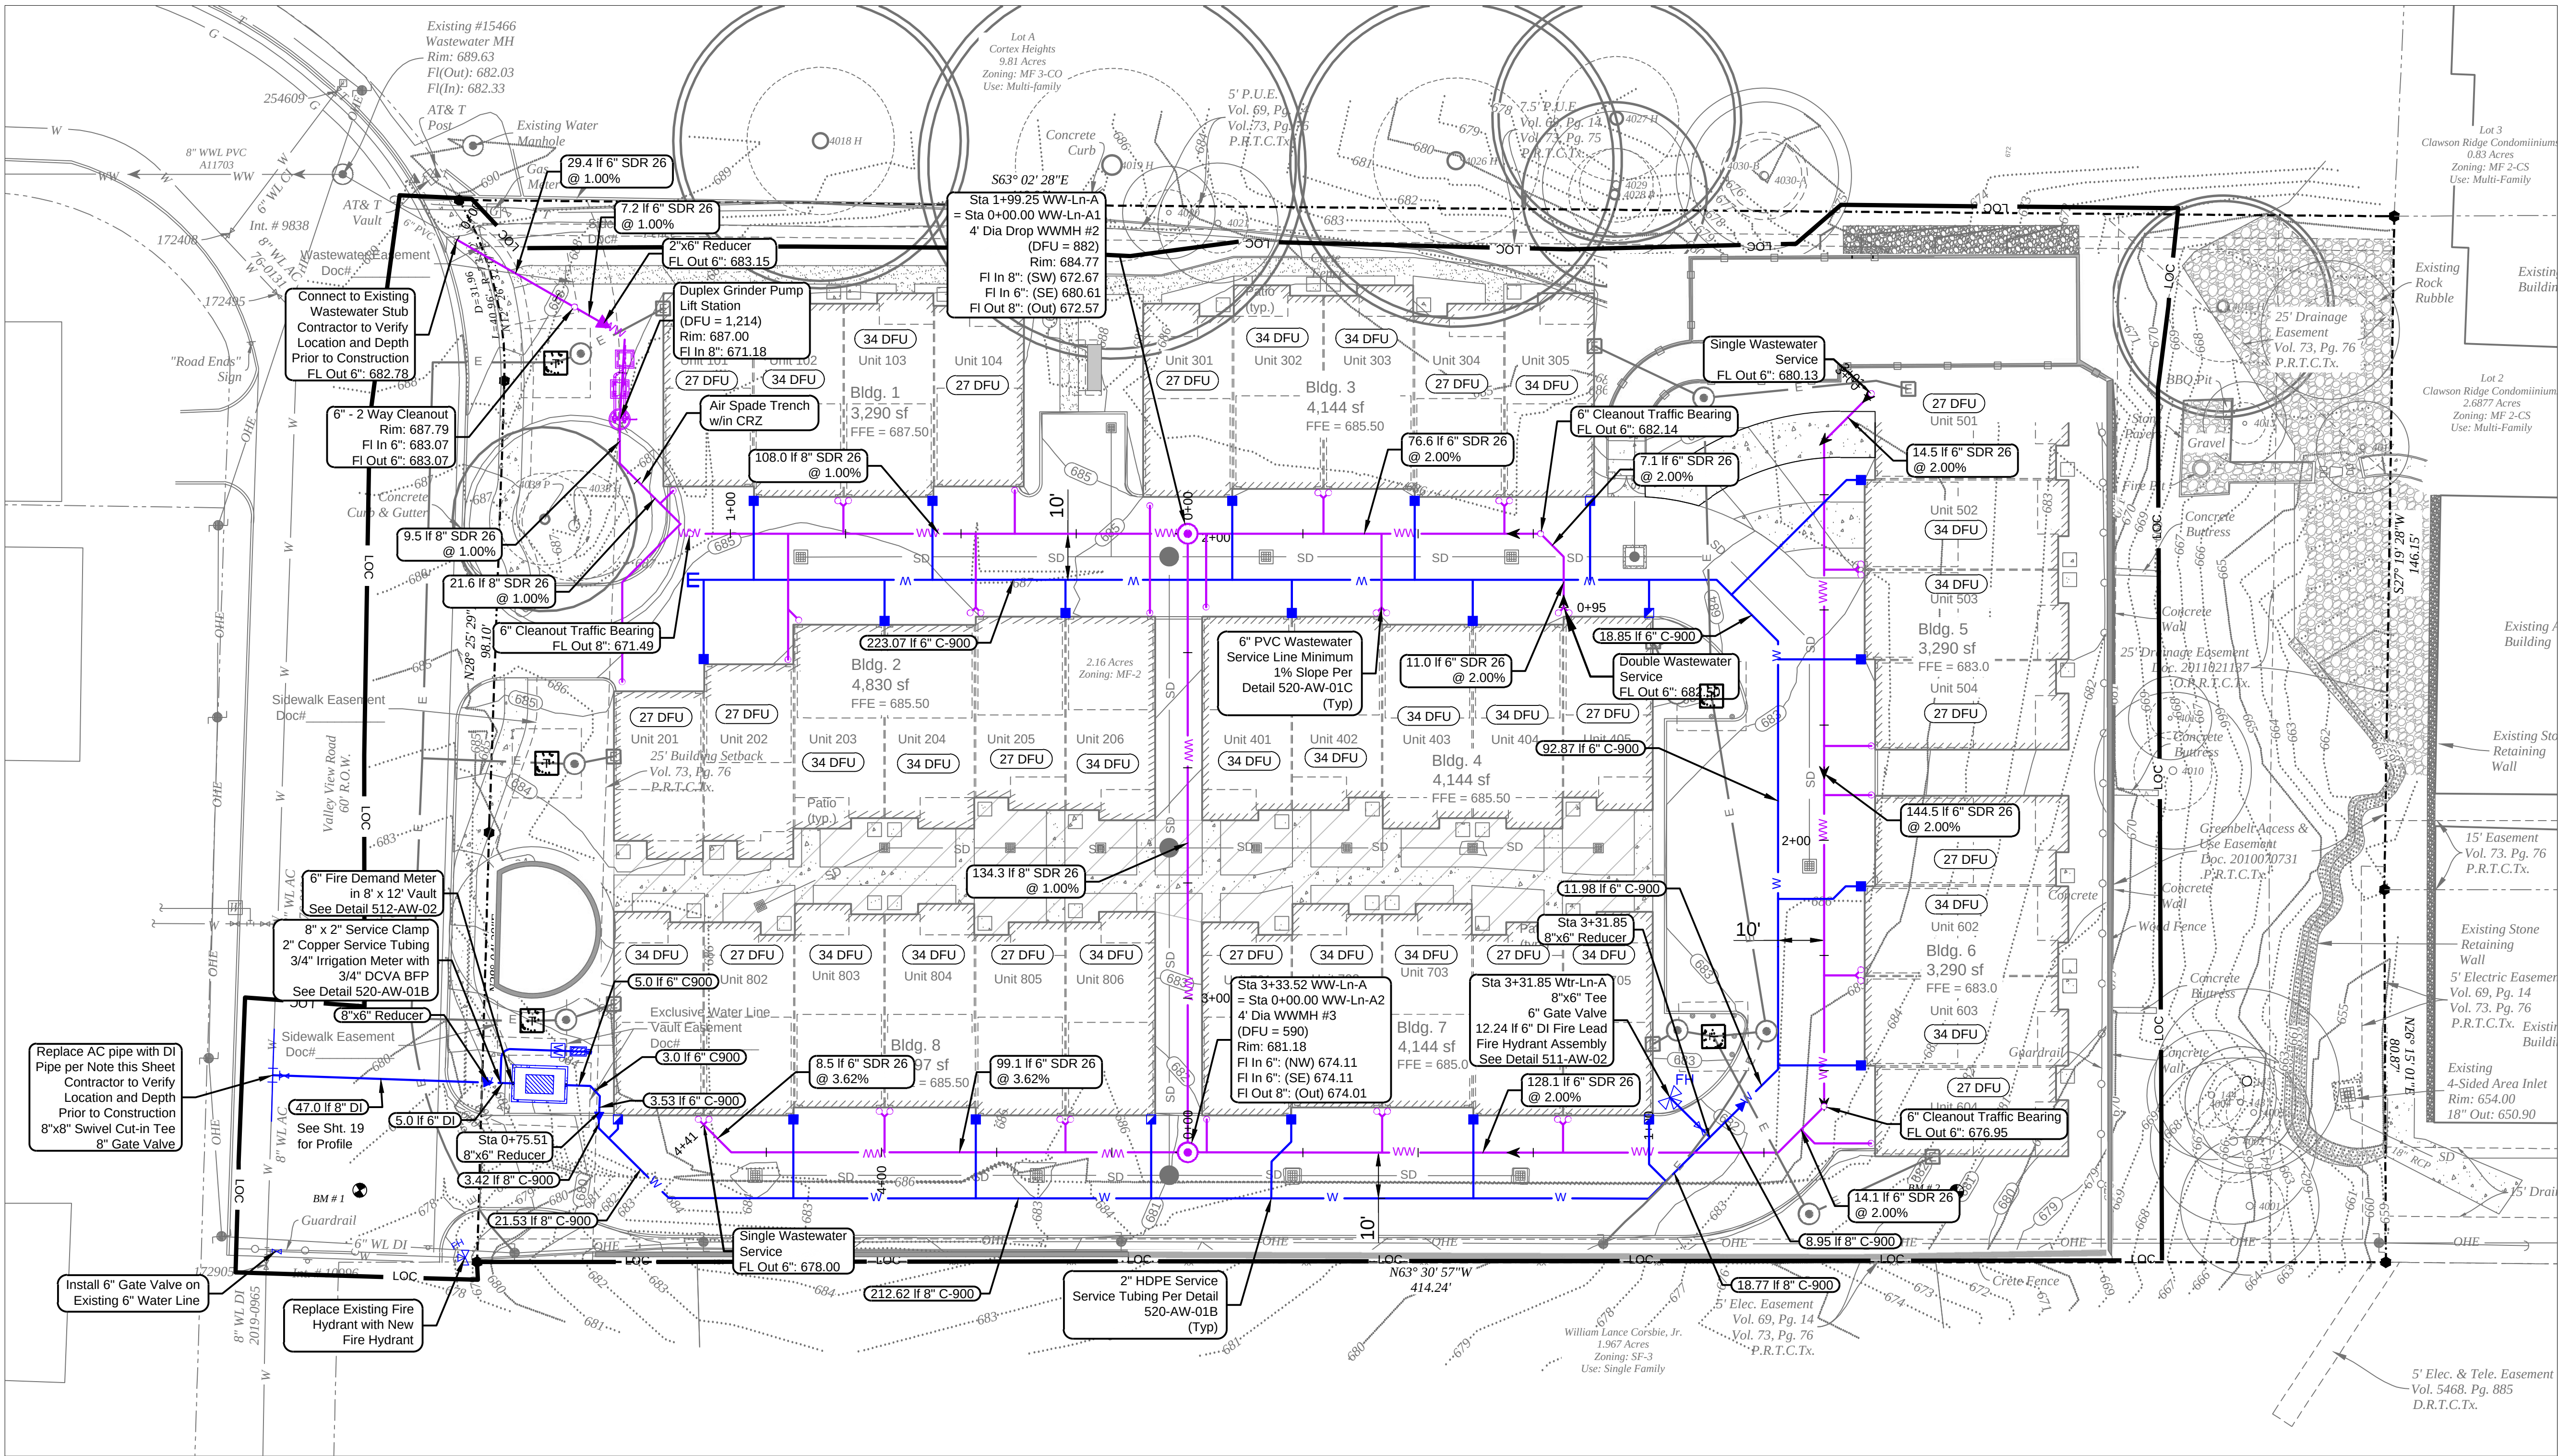

Legend	
— W —	Existing Water Line
— W —	Proposed Water Line
— W —	Single Water Service
— W —	Double Water Service
— WW —	Existing Wastewater Line
— WW —	Proposed Wastewater Line
— W —	Wastewater Service
— RW —	Existing Reclaimed Water Line
— RW —	Proposed Reclaimed Water Line
— E —	Proposed Underground Electric
— SD —	Proposed Storm Drain
⊕	Fire Hydrant
⊕	Gate Valve
⊕	AARV
⊕	Transformer Pad

Replace AC pipe with DI Pipe per Note this Sheet Contractor to Verify Location and Depth Prior to Construction 8"x8" Swivel Cut-in Tee 8" Gate Valve

6" Fire Demand Meter in 8' x 12' Vault See Detail 512-AW-02

8" x 2" Service Clamp 2" Copper Service Tubing 3/4" DCVA BFP See Detail 520-AW-01B

6"x6" Reducer

47.0 If 8" DI See Sht. 19 for Profile

5.0 If 6" DI

3.42 If 8" C-900

21.53 If 8" C-900

Install 6" Gate Valve on Existing 6" Water Line

Replace Existing Fire Hydrant with New Fire Hydrant

Water Tap Note
The existing AC pipe must be replaced with DI pipe and a Tee cut into the DI pipe. The AC pipe must be worked on by a certified company that is licensed to handle AC pipes and the pipe disposed of in a pre-approved landfill for Asbestos pipe. Dispose of AC pipe per STATE regulations.

City of Austin - Water and Wastewater Utility - Special Services Division (512) 972-1060
This project has private hydrants located within the property. The property owner is required to comply with Austin Fire Code. Failure to comply may result in civil and/or criminal remedies available to the City. The performance of this obligation shall always rest with the owner or record. Fire hydrants on private property are required to be serviced, maintained and flowed annually, using a contractor registered with the City to provide this service. This project includes 1 private hydrants.

Note
This project is subject to the Void and Water Flow Mitigation Rule (COA ECM 1.12.0 and COA Item No. 658S of the SSM) provision that all trenching greater than 5 feet deep must be inspected by a geologist (Texas P.G.) or a geologist's representative.

- Utility Notes**
- Contractor shall verify horizontal and vertical location of existing utilities prior to construction.
 - Contractor shall verify location of existing line, point of connection and notify engineer of any conflicts/discrepancies prior to installation of improvements.
 - All Private Domestic Water Branches to the buildings are to be 2" HDPE service tubing. See Detail 520-AW-01B
 - All Private Wastewater Branches to the buildings are to be 6" PVC @ 2.0% min. See Detail 520-AW-01C

Benchmarks
B.M. #1 - Mag Nail Set in Asphalt
Elevation = 678.52' NAVD 88 (GEOID 18)

B.M. #2 - Mag Nail Set in Asphalt
Elevation = 681.08' NAVD 88 (GEOID 18)

Legal Description
Lot 1, Mecey Subdivision Volume 73, Page 76, Plat Records of Travis County, Texas.



Tree List
Refer to landscape plan sheet 32 for the tree list.

Restrained Joints for all Water Line Bends, Tees, Gate Valves & Ends
All horizontal and vertical water line bends, tee's, gate valves and dead ends shall be restrained to the water main using factory restrained joint pipe as approved in SPL WW-27F, or, mechanical joint restraint devices as approved in SPL WW-27A.

Release of this application does not constitute a verification of all data, information and calculations supplied by the applicant. The engineer of record is solely responsible for the completeness, accuracy and adequacy of his/her submittal, whether or not the application is reviewed for Code compliance by City engineers.

The location of all existing utilities shown on these plans has been based upon record information only and may not match locations as constructed. The contractor shall contact Texas 811 for assistance in determining existing utility locations prior to beginning construction. Contractor shall field verify locations of utility crossings prior to beginning construction.

PRV Note
Lots/Structure with 65 psi or greater require a pressure reducing valve, set at 65 psi, to be installed on the property owner's side of the right of way.

Drainage Fixture Unit Table		
Building #	Building Type	DFU's
1	4Plex	136
2	6Plex	204
3	5Plex	170
4	5Plex	170
5	4Plex	136
6	4Plex	136
7	5Plex	170
8	6Plex	204

Bleyl Engineering
Planning • Design • Management
7701 San Felipe Blvd., Suite 200, Austin TX 78729
Texas Firm Registration No. F-678
Tel. 512-454-2400
www.bleylengineering.com

Austin Bryan Conroe Houston

Utility Tap Plan
Valley View Townhomes
3759 Valley View Road
Austin, Texas 78704
Travis County



Design: CS, JR
CAD: JW, CS Review: JKR
Project No: RJ3 70496
Sheet: **19** of **39**
SP-2025-0126C