
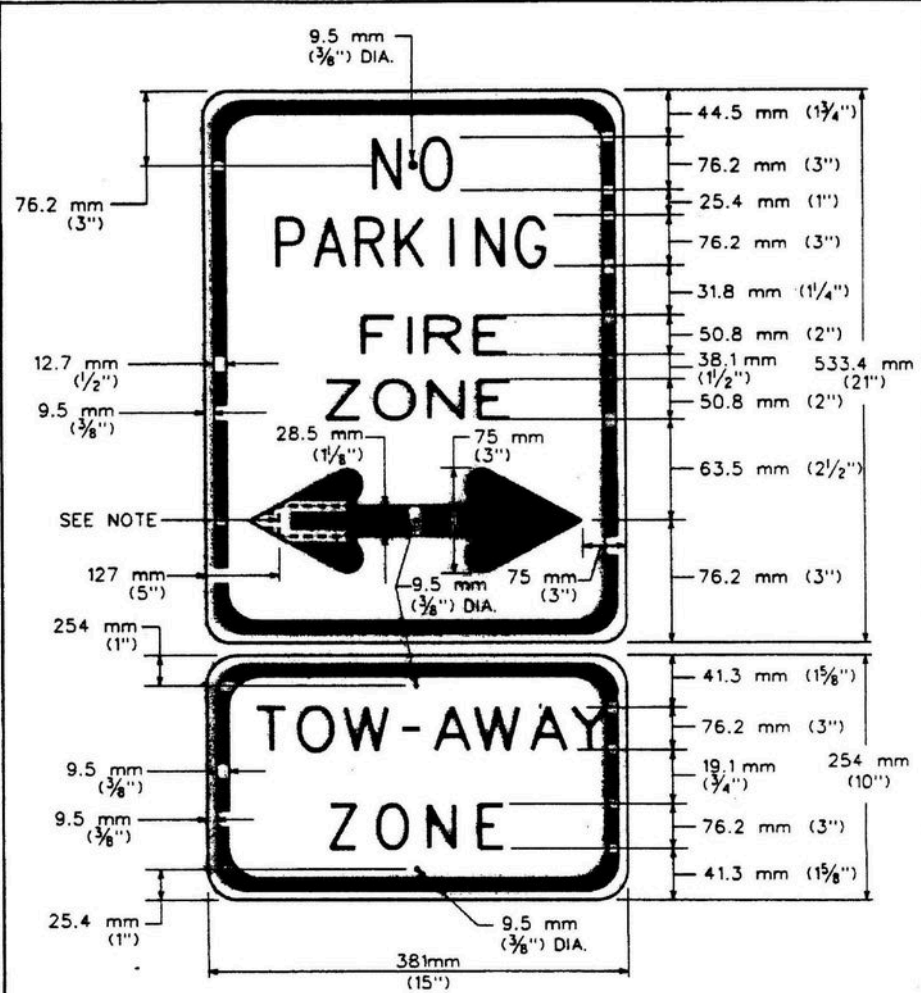


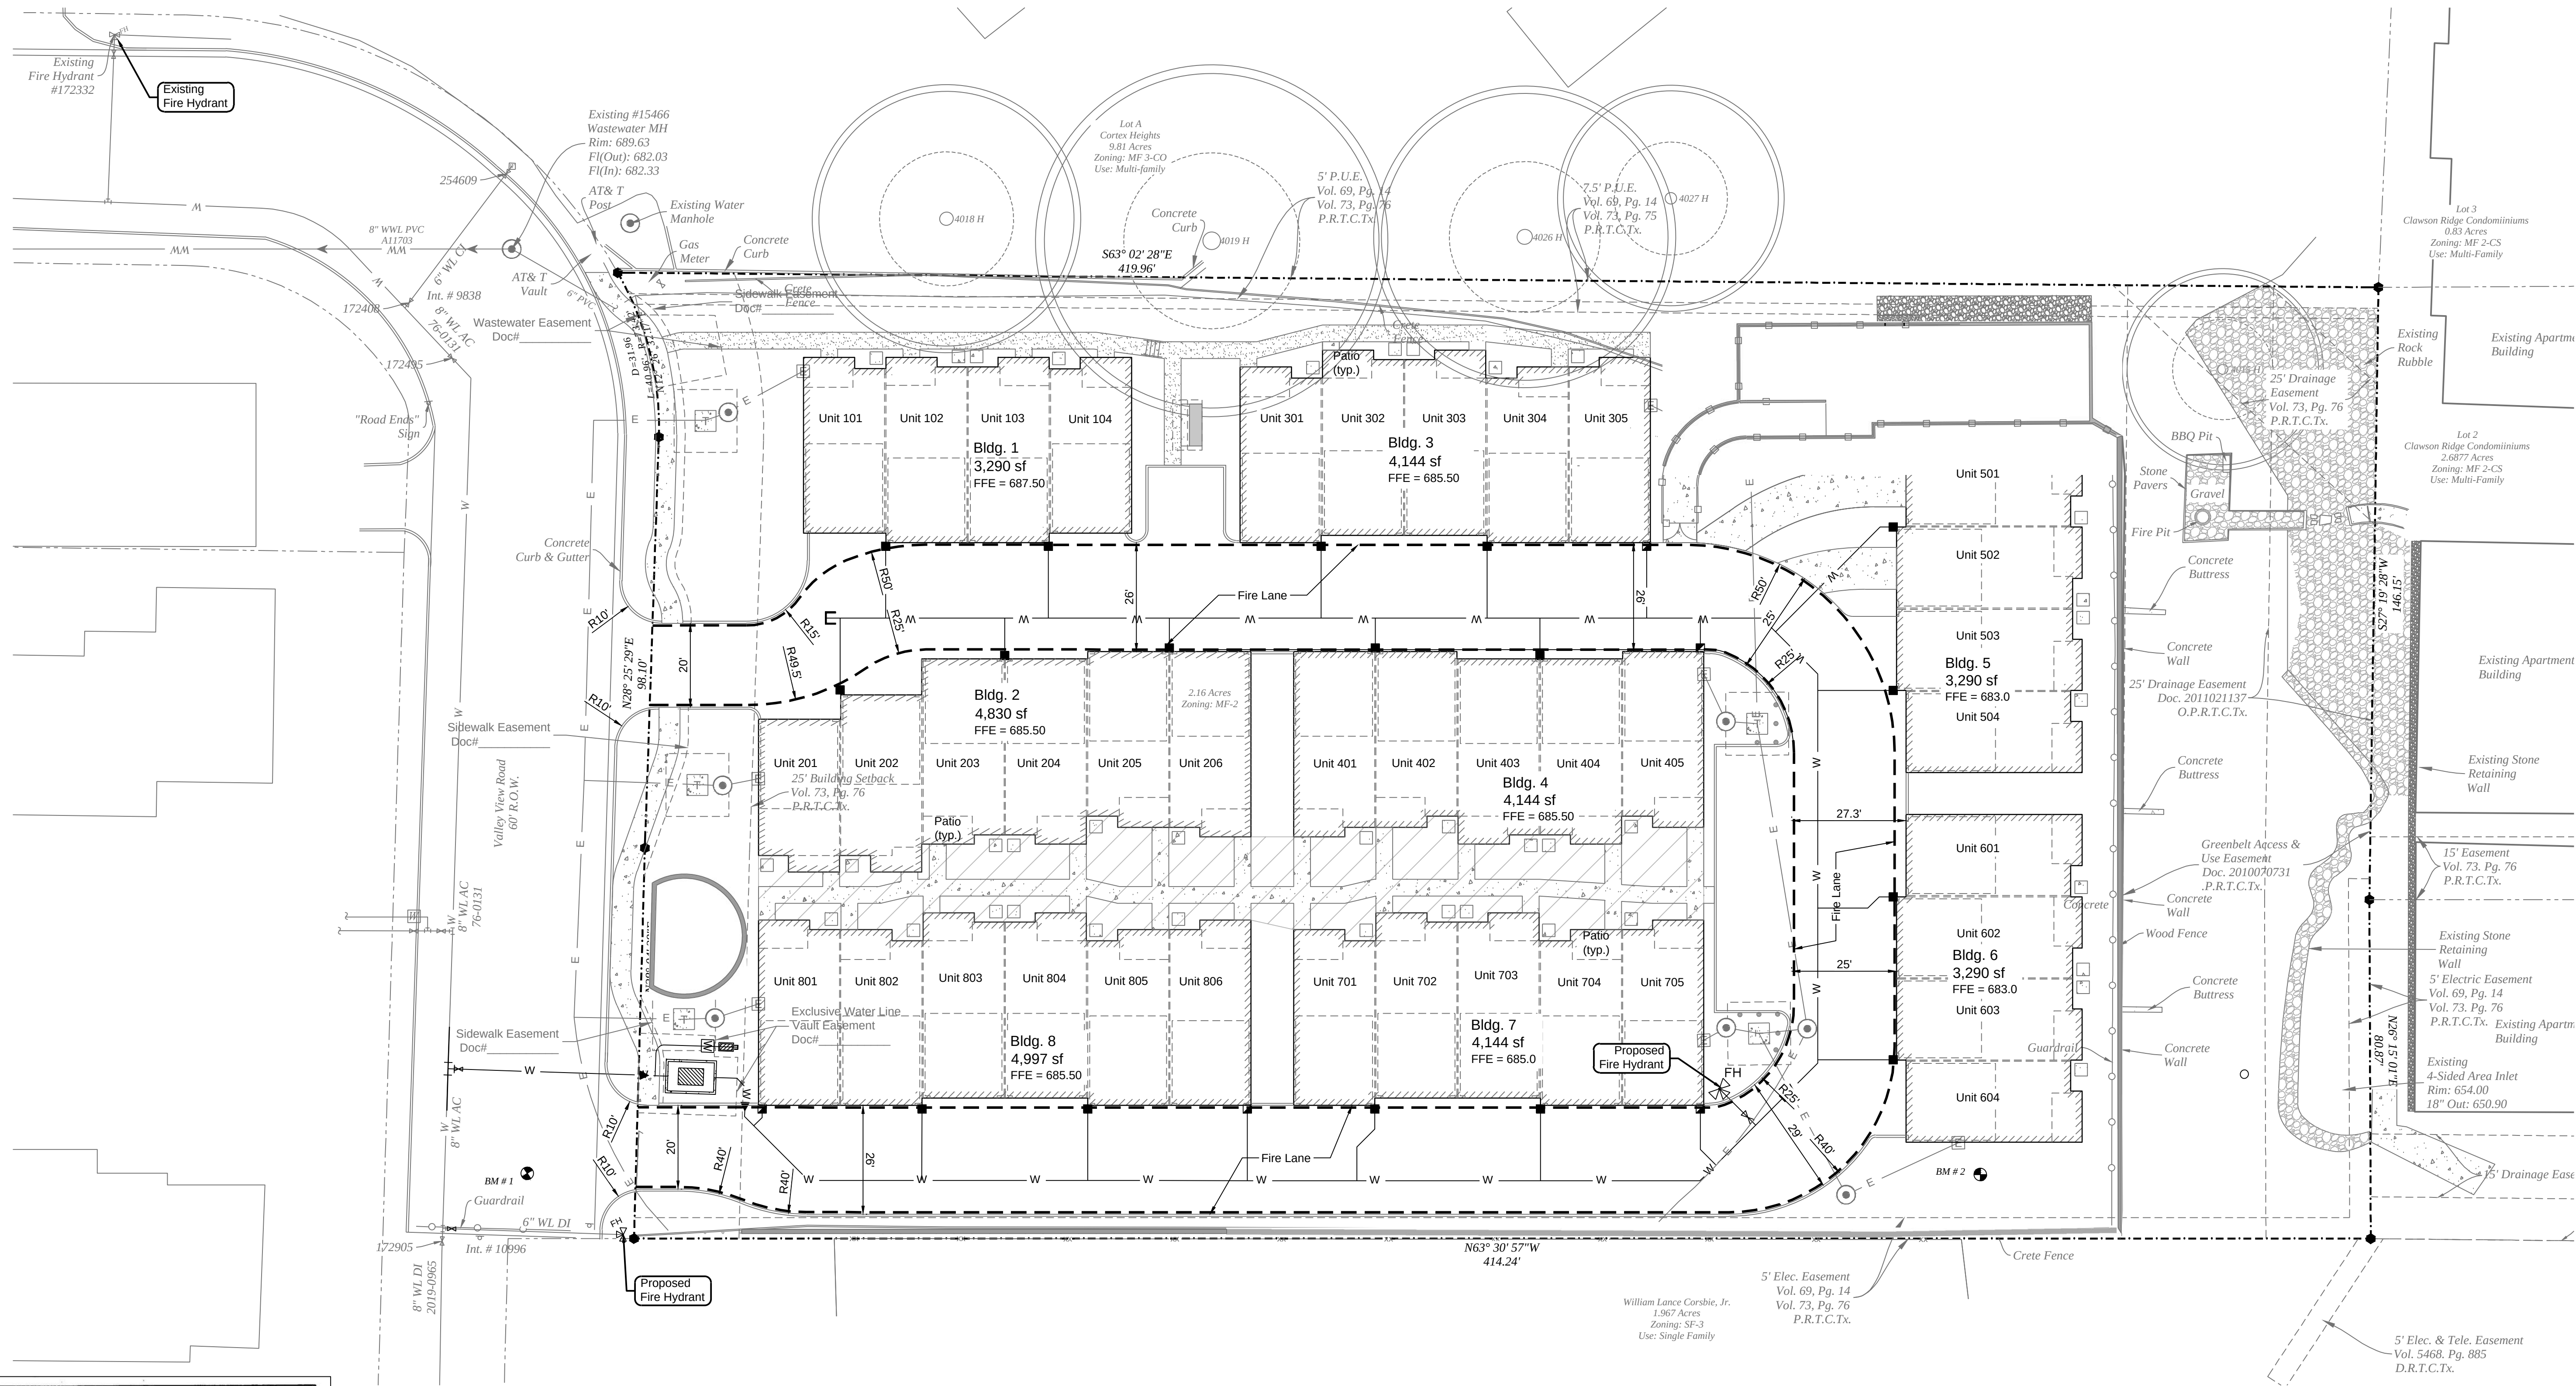

City of Austin - Water and Wastewater Utility - Special Services Division (512) 972-1060
This project has private hydrants located within the property. The property owner is required to comply with Austin Fire Code. Failure to comply may result in civil and/or criminal remedies available to the City. The performance of this obligation shall always rest with the owner or record. Fire hydrants on private property are required to serviced, maintained and flowed annually, using a contractor registered with the City to provide this service. This project includes 1 private hydrants.

Fire Zone Notes

1. Restricted Zone signage to be placed on front of lockers and along boat slip retaining walls as necessary or required.
2. Stencil the words "FIRE ZONE/ TOW-AWAY ZONE" in white letters at least 4" high at 30 foot intervals along the curb and the entire curb shall be painted red to serve as the background for the white letters.
3. Signs stating "FIRE ZONE/ TOW-AWAY ZONE" shall be posted at both ends of a fire zone and at each entry and exit point which constitutes a portion of the fire zone or fire lane. Signs shall comply with Standard City of Austin Detail 901S-6.
4. All fire zone mainlines feeding private hydrants must be installed and tested in accordance with NFPA-24, and the Fire Code, by a licensed contractor with a plumbing permit. The entire main must be hydrostatically tested at one time, unless isolation valves are provided between tested sections.
5. All private hydrants shall be painted red.

Notes

- Underground mains feeding NFPA 13 sprinkler systems must be installed and tested in accordance with NFPA 13, and the Fire Code, by a licensed sprinkler contractor with a plumbing permit. The entire main must be hydrostatically tested at one time, unless isolation valves are provided between tested sections.
- Underground mains feeding private hydrants must be installed and tested in accordance with NFPA 24, and the Fire Code, by a licensed contractor with a plumbing permit. The entire main must be hydrostatically tested at one time, unless isolation valves are provided between tested sections.
- The Knox-box is to be located at exterior fire riser room door (non-hanging side).

Tree List

Refer to landscape plan sheet 32 for the tree list.


Benchmarks

B.M. #1 - Mag Nail Set in Asphalt
Elevation = 678.52' NAVD 88 (GEOID 18)

B.M. #2 - Mag Nail Set in Asphalt
Elevation = 681.08' NAVD 88 (GEOID 18)

Legal Description

Legal Description
Lot 1, Mecey Subdivision Volume 73, Page 76, Plat Records of Travis County, Texas.

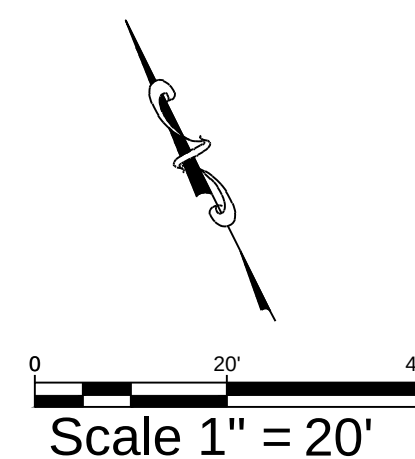

Fire Flow Test

See Sheet 18, Austin Water General Notes, for the fire flow test results.

Fire Riser Room Note

All buildings are to have a NFPA 13D fire suppression system.

Release of this application does not constitute a verification of all data, information and calculations supplied by the applicant. The engineer of record is solely responsible for the completeness, accuracy and adequacy of his/her submittal, whether or not the application is reviewed for Code compliance by City engineers.

The location of all existing utilities shown on these plans has been based upon record information only and may not match locations as constructed. The contractor shall contact Texas 811 for assistance in determining existing utility locations prior to beginning construction. Contractor shall field verify locations of utility crossings prior to beginning construction.

Bleyl Engineering

Planning • Design • Management
77701 San Felipe Blvd., Suite 200, Austin TX 78729
Texas Firm Registration No. F-678
Tel. 512-454-2400
www.blevlengineering.com

Revision	Date	By	App	Comment

Fire Protection Plan

Valley View Townhomes
3759 Valley View Road
Austin, Texas 78704
Travis County



Design: CS, JR	
CAD: JW, CS	Review: JKR
Project No: RJ3 70496	
Sheet: 10 of 39	
SP-2025-0126C	