


INSPECTIONS

INSPECTION	DATE	BY	P/F

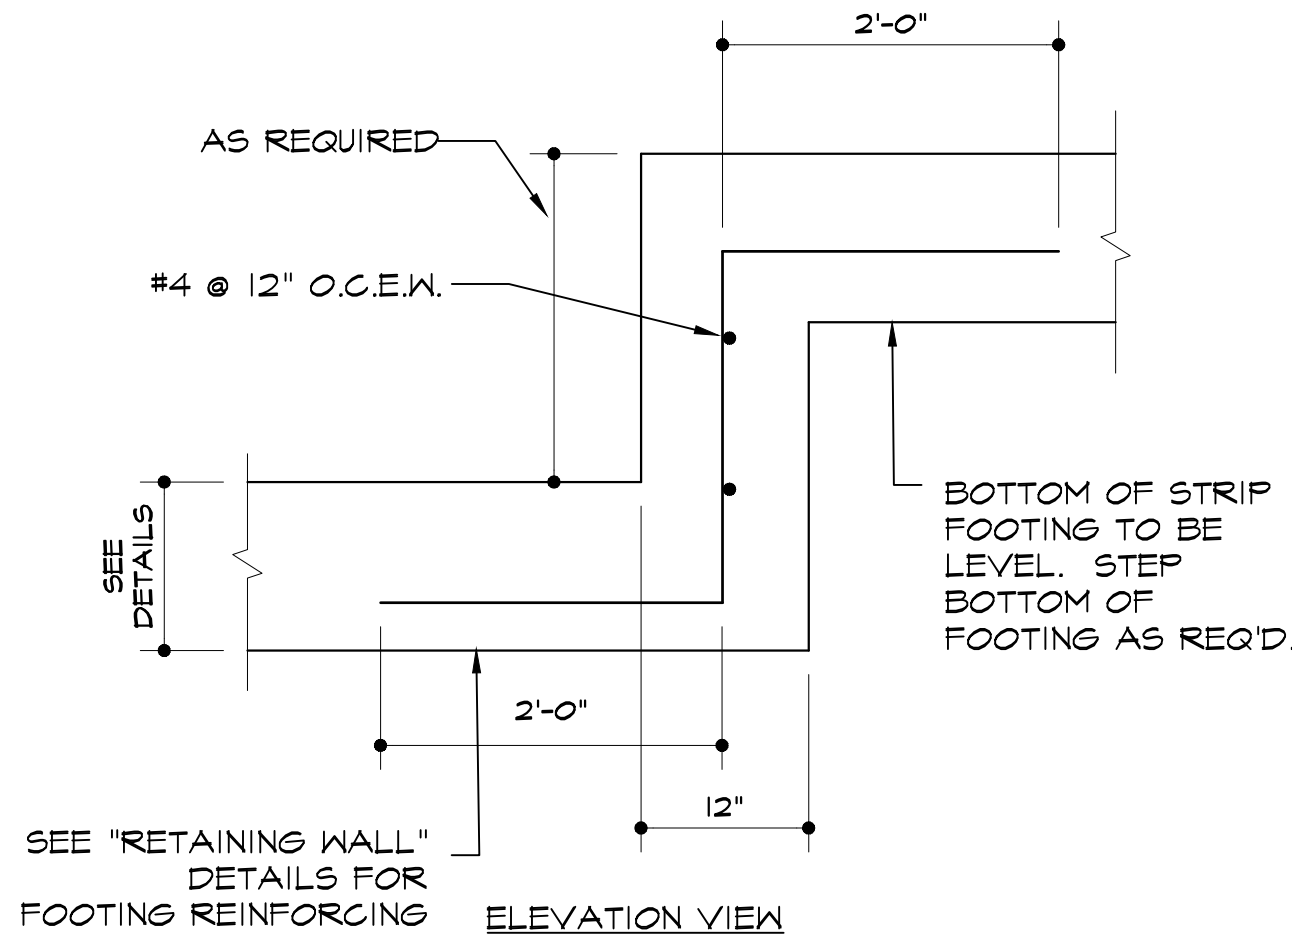

TYPICAL STEP IN FOOTING

NOTES:

1. THE CONTRACTOR IS RESPONSIBLE FOR OBTAINING ALL PERMITS NECESSARY TO LEGALLY COMMENCE WITH THIS WORK.
2. OBTAIN LOCATION AND DEPTH OF EXISTING UTILITY LINES PRIOR TO BEGINNING CONSTRUCTION.
3. CONTRACTOR SHALL DISPOSE OF ALL SPOILS LEGALLY AT AN OFFSITE LOCATION OR AS DIRECTED BY OWNER.
4. SHOULD CONDITIONS ARISE THAT ARE NOT COVERED BY DETAILS ON THIS PLAN, CONTACT ENGINEER AT ONCE FOR ADDITIONAL INSTRUCTIONS.

CONCRETE:

1. CONCRETE TO HAVE A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 3000 PSI.
2. CONCRETE SHALL BE WELL CONSOLIDATED USING PROPER MECHANICAL VIBRATION.
3. MINIMUM CONCRETE CLEAR COVER SHALL BE IN SLABS:

- 3/4" ADJACENT TO INTERIOR SLAB SURFACES
- 1 1/2" ABOVE SUB-GRADE

IN STIFFENING BEAMS, WALLS AND FOOTINGS:

- 1 1/2" ADJACENT TO EXTERIOR OR INTERIOR SURFACES
- 3" FROM SURFACES IN CONTACT WITH EARTH

AT PIPE PENETRATION IN BEAM OR SLAB:

- 2" FOR REBAR

REINFORCEMENT:

1. REINFORCING STEEL TO BE GRADE 60 FOR #4 AND LARGER AND GRADE 40 FOR #3.
2. ADD 24"x24" CORNER BARS EQUAL TO SIZE AND SPACING OF DISCONTINUOUS HORIZ. STEEL.

REQUIRED INSPECTIONS:


1. PRIOR TO CONCRETE PLACEMENT OF FOOTINGS.
2. PRIOR TO CONCRETE PLACEMENT OF WALLS.
3. PRIOR TO BACKFILL PLACEMENT TO VERIFY FILTER FABRIC AND DRAINAGE GRAVEL.

DESIGN CRITERIA:


REQUIREMENTS OF IBC 2015

*ALLOWABLE SOIL BEARING	: 4,000 PSF
*LATERAL PRESSURE METHOD	: E.F.P.
*ACTIVE SOIL PRESSURE - HEEL	: 45.5 PSF
*PASSIVE PRESSURE	: 290 PSF
*SOIL WEIGHT	: 130 PSF


NOTE:
THIS IS A SCHEMATIC PLAN FOR THE PURPOSE OF LOCATING AND IDENTIFYING FOUNDATION REINFORCING ELEMENTS ONLY. VERIFY ALL DIMENSIONS, DROPS, OFFSETS AND FEATURES WITH THE ARCHITECTURAL PLANS BEFORE FORMING THE FOUNDATION. MLAW CANNOT BE HELD LIABLE FOR ANY CONTRACTOR OVERSIGHT IN THIS REGARD. DO NOT FORM FOUNDATION USING THESE PLANS. DIMENSIONAL CONTROL IS THE RESPONSIBILITY OF THE ARCHITECT. USE THESE PLANS FOR THE PLACEMENT OF THE GRADE BEAMS AND REINFORCEMENT.

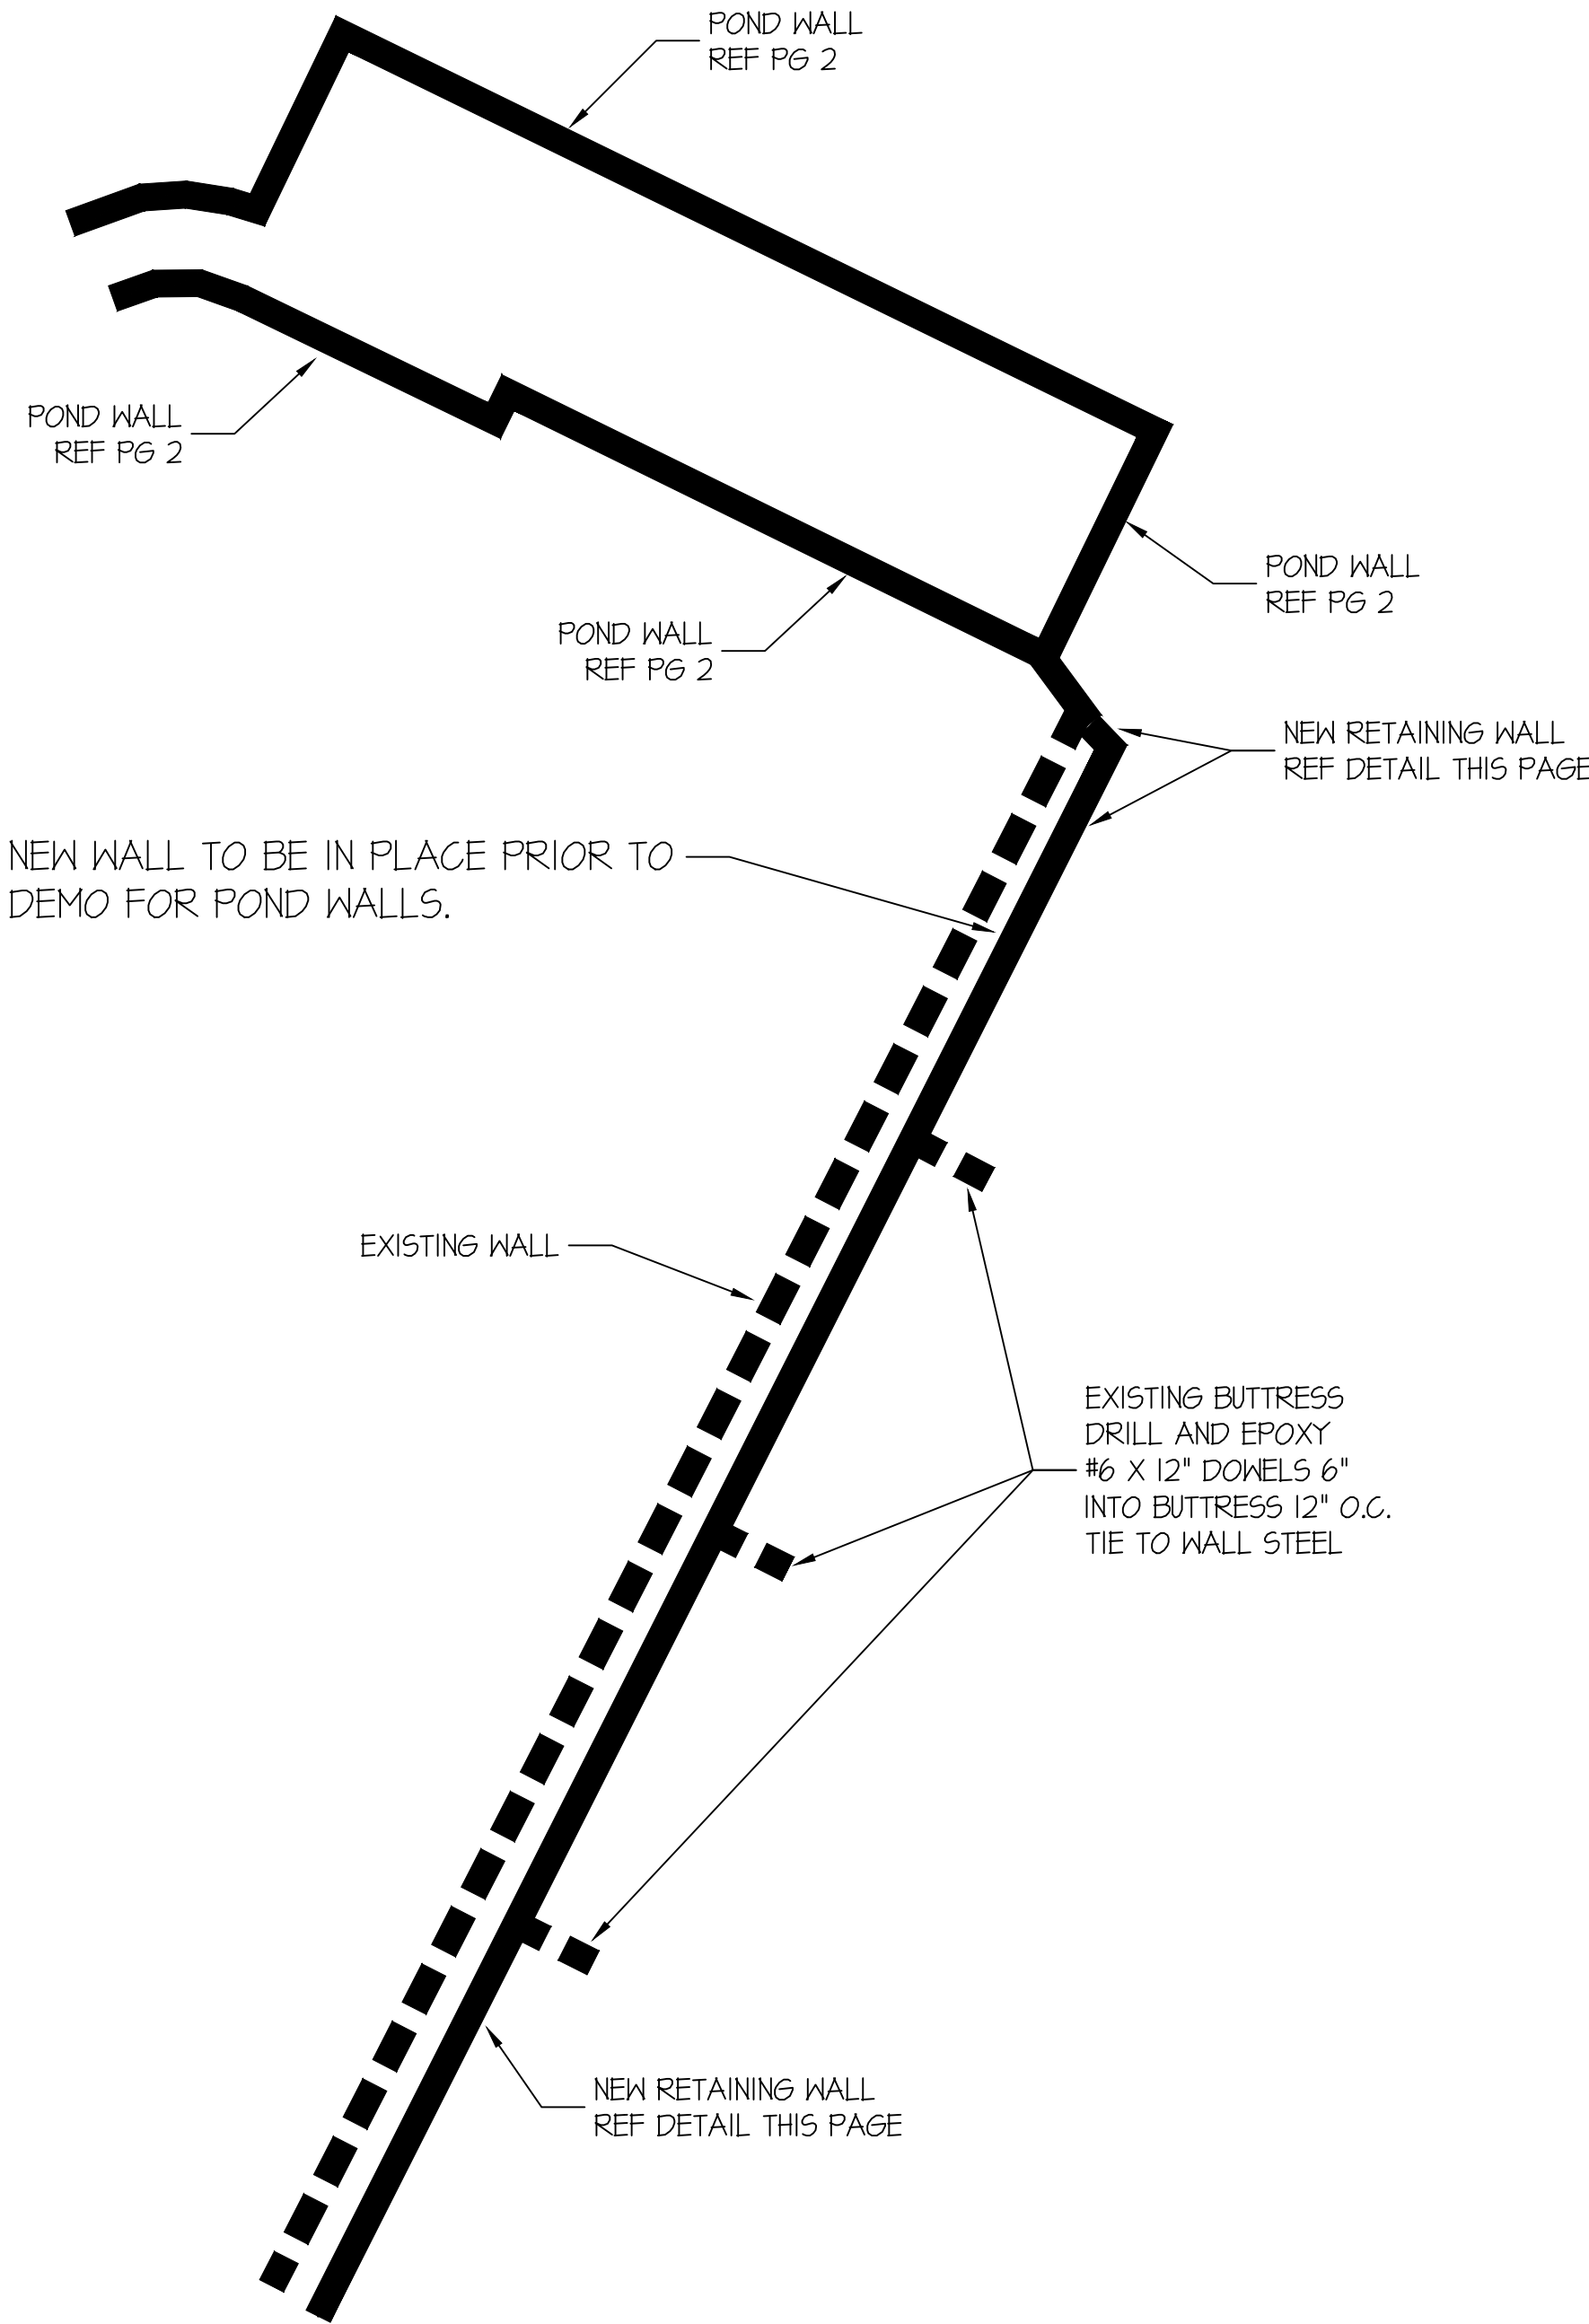

PLAN VIEW

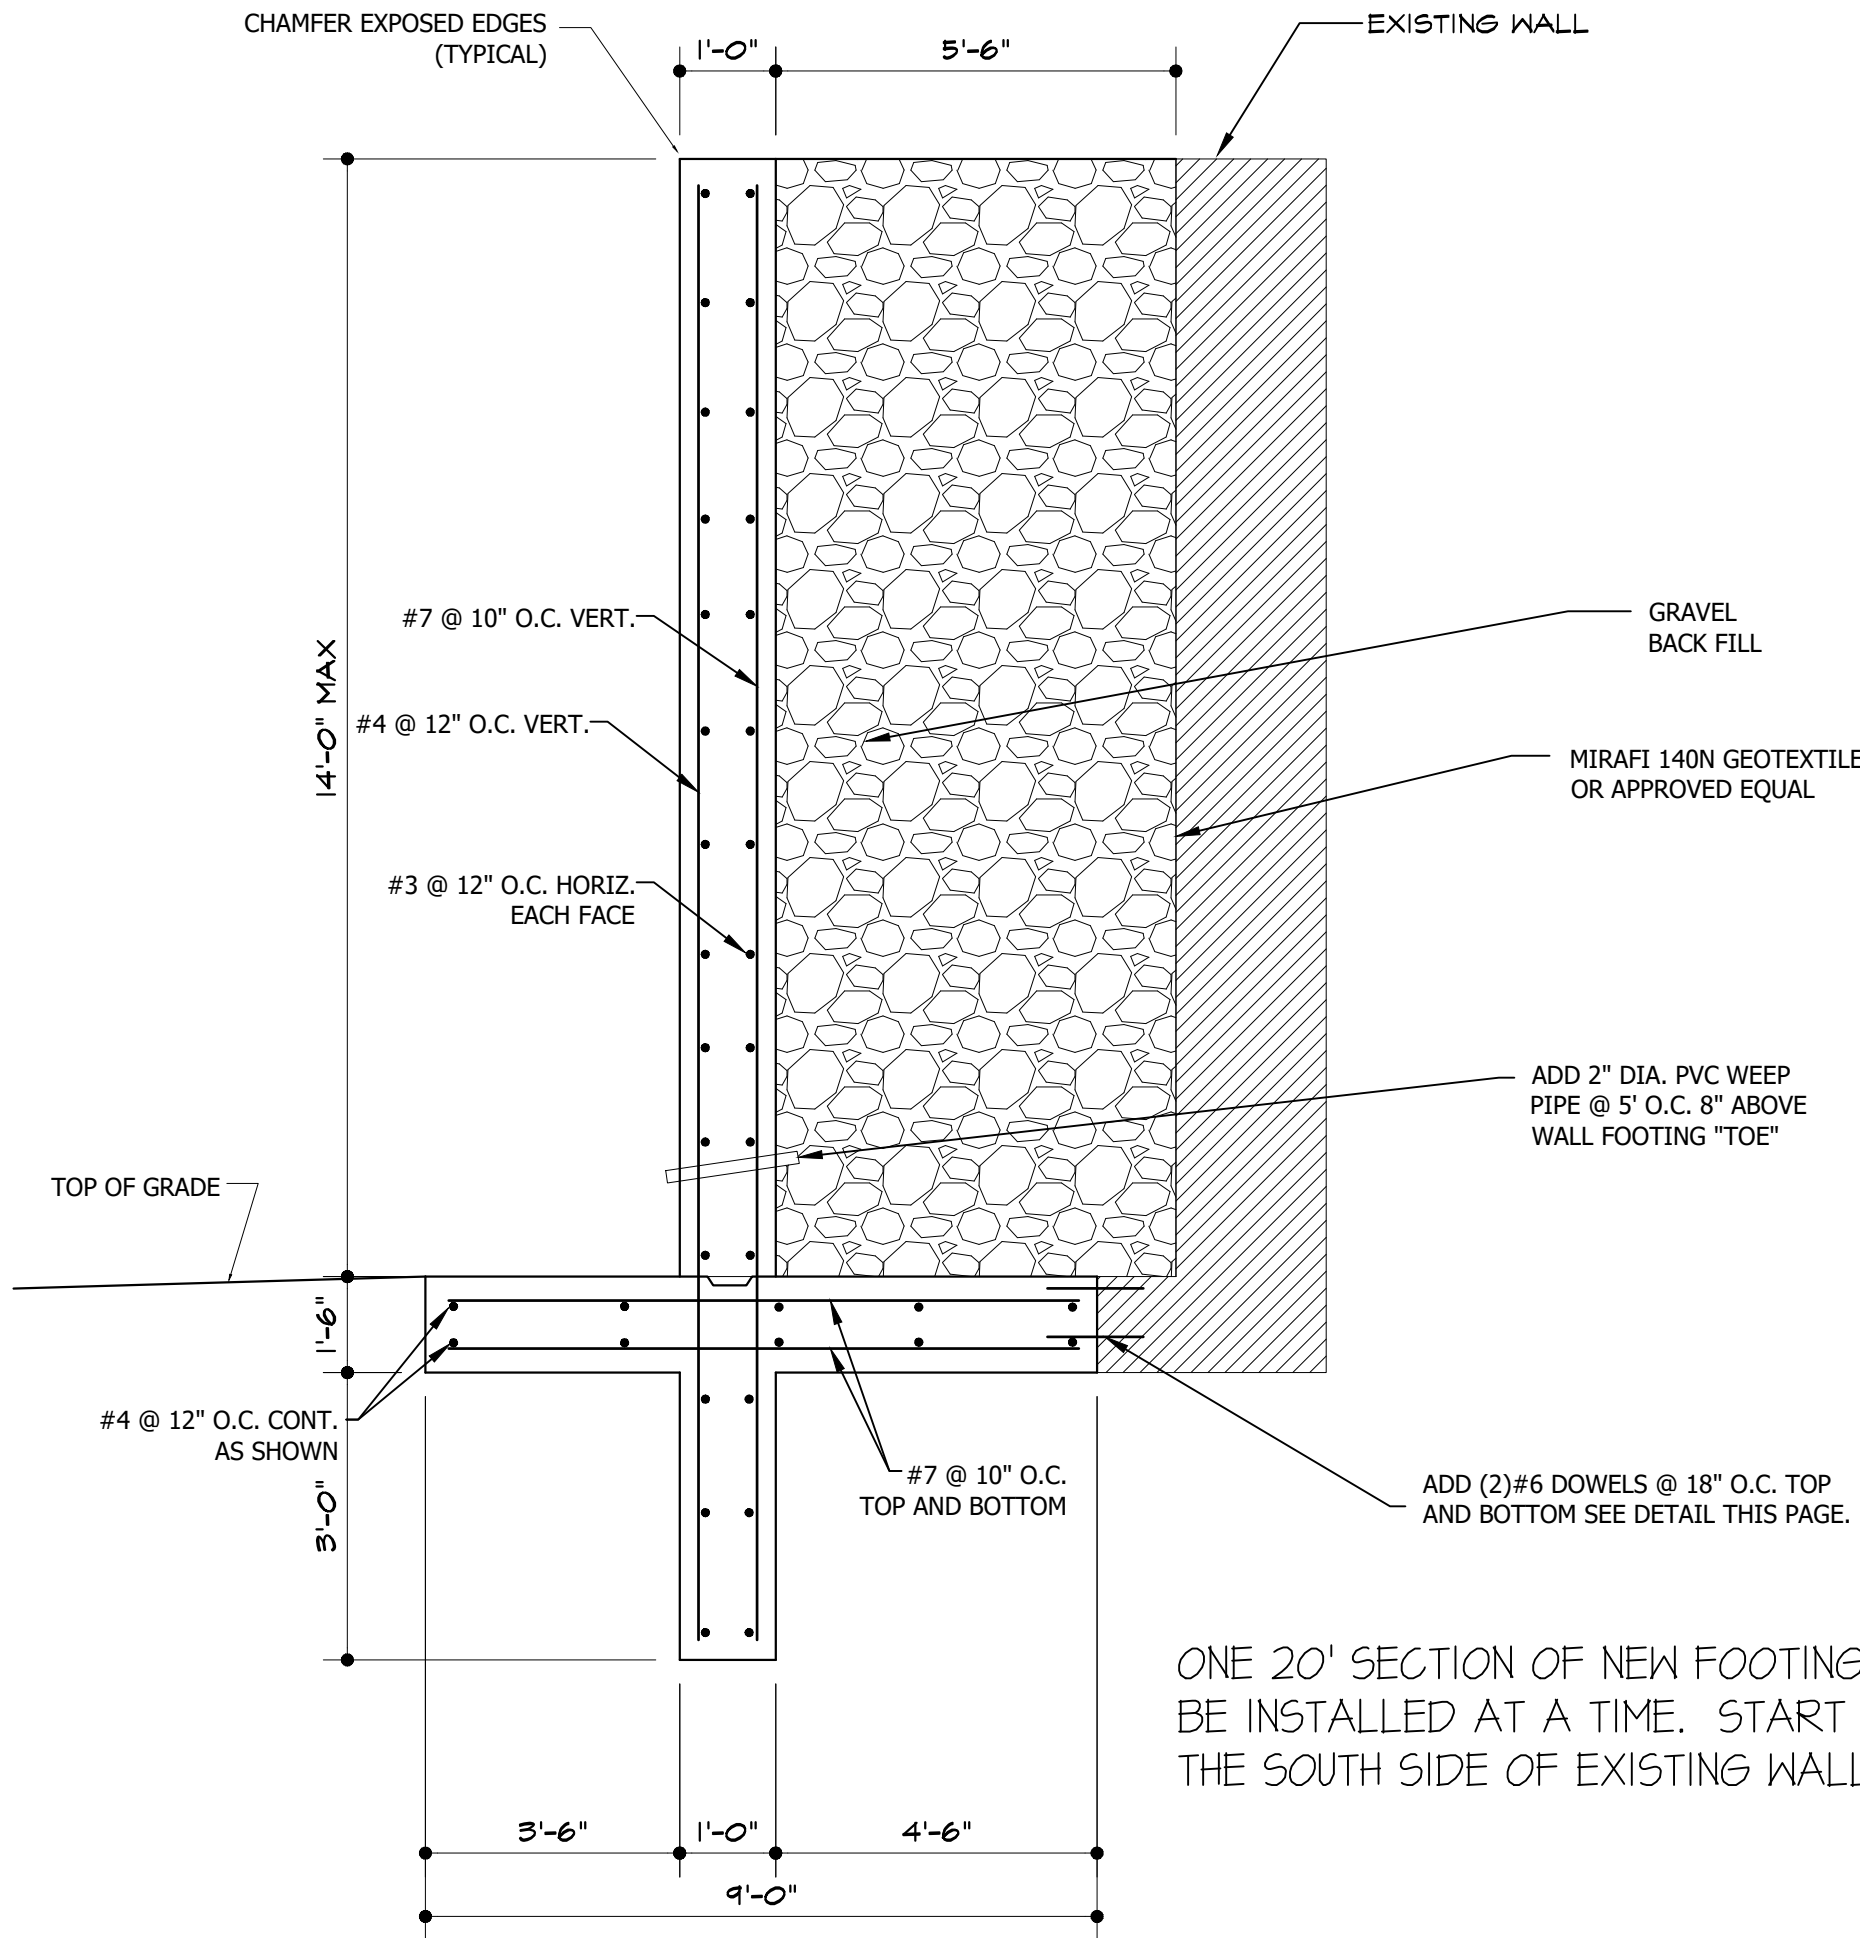

14'-0" MAX. RETAINING WALL

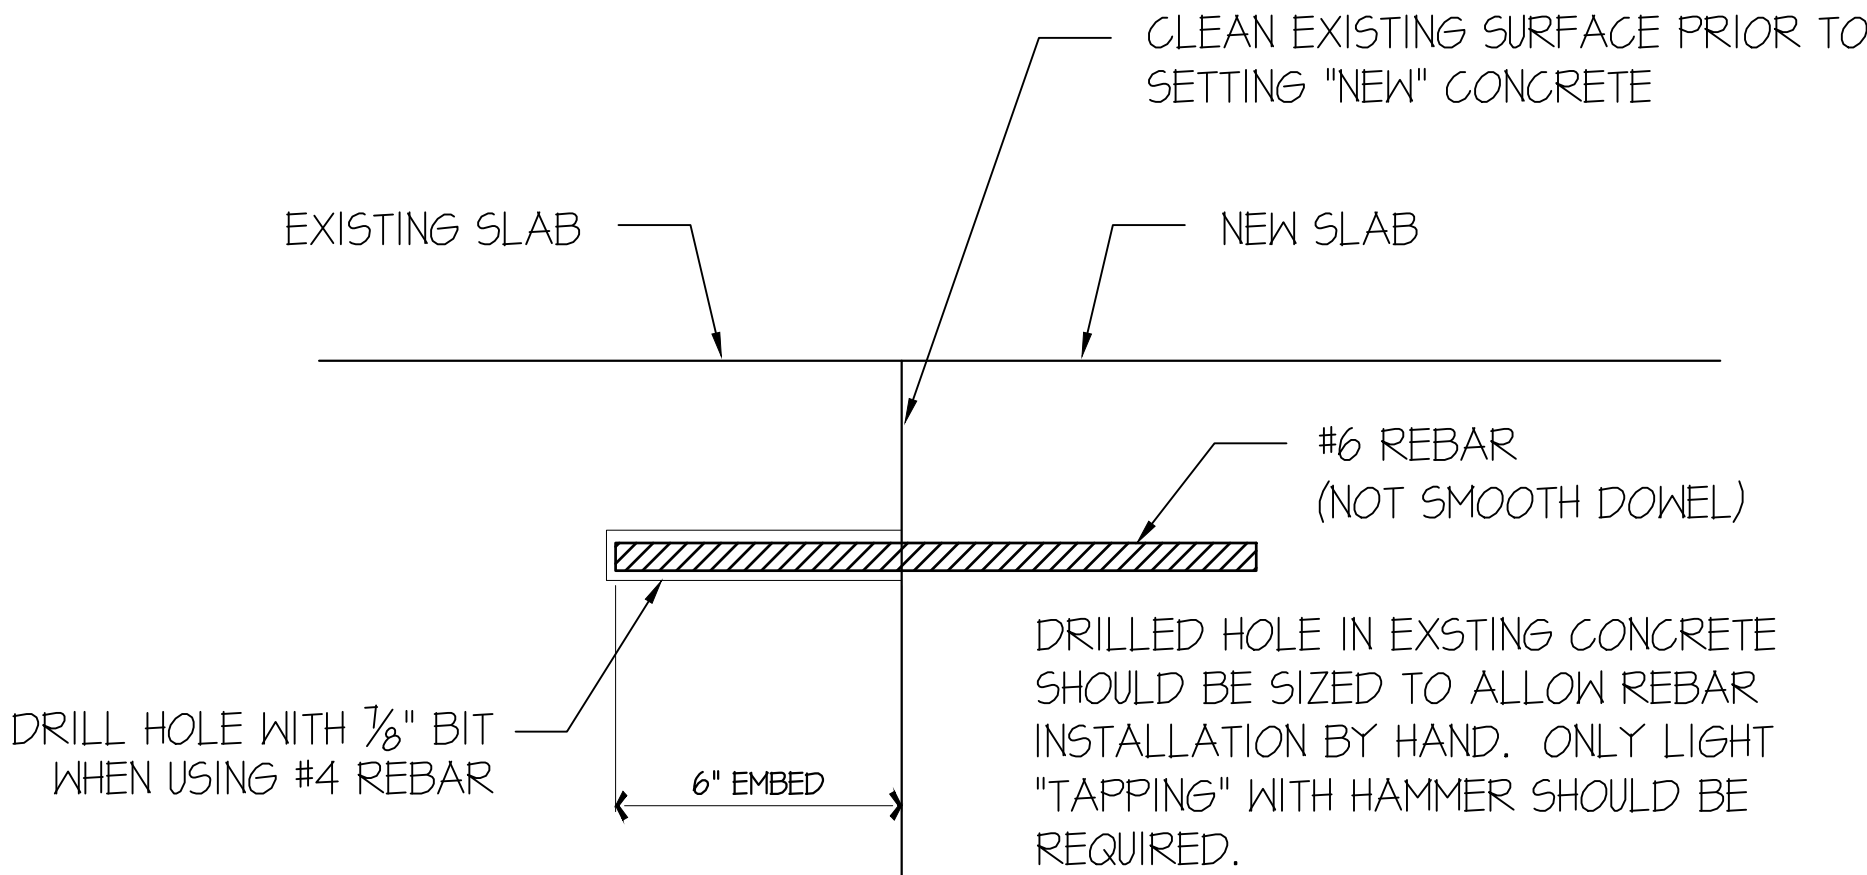

DOWEL DETAIL

CLEAR HOLE WITH COMPRESSED AIR PRIOR TO INSERTING EPOXY.

DRILL HOLE WITH 7/8" BIT WHEN USING #4 REBAR