


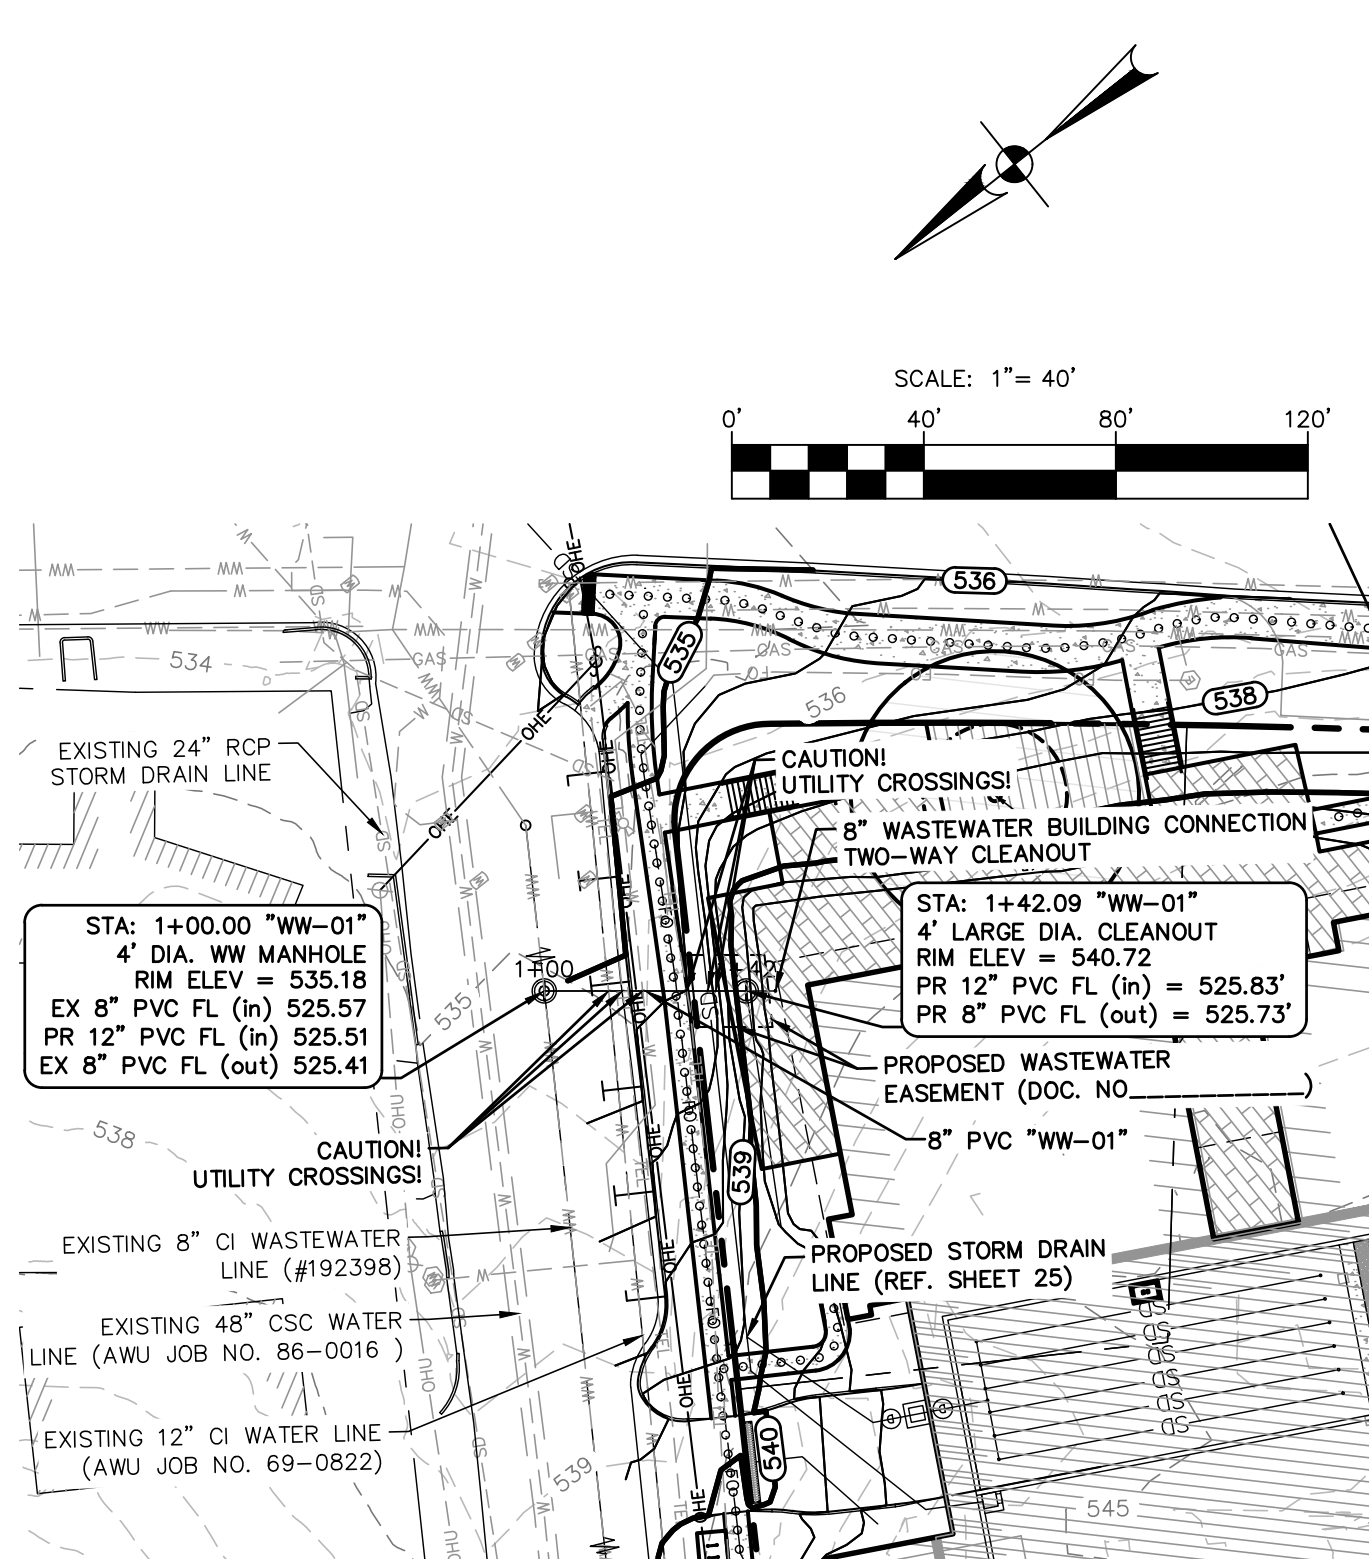
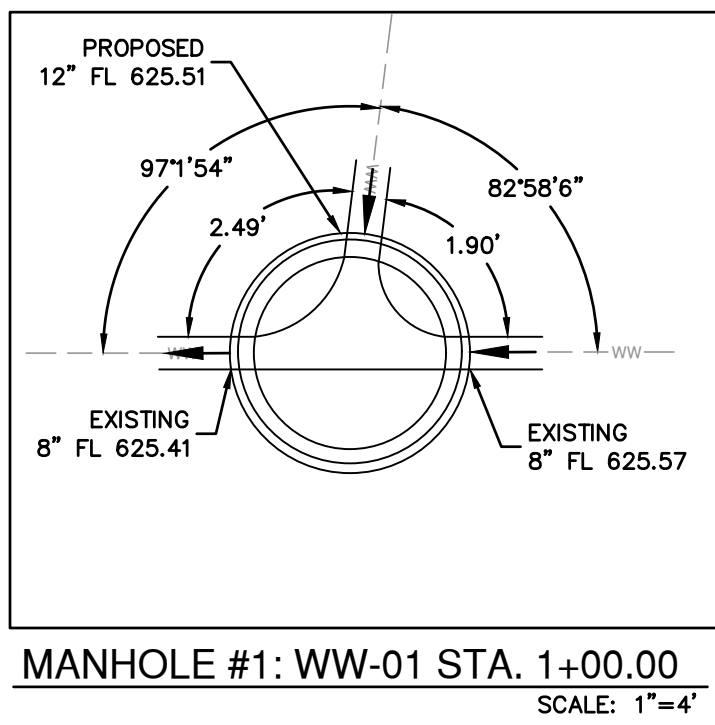
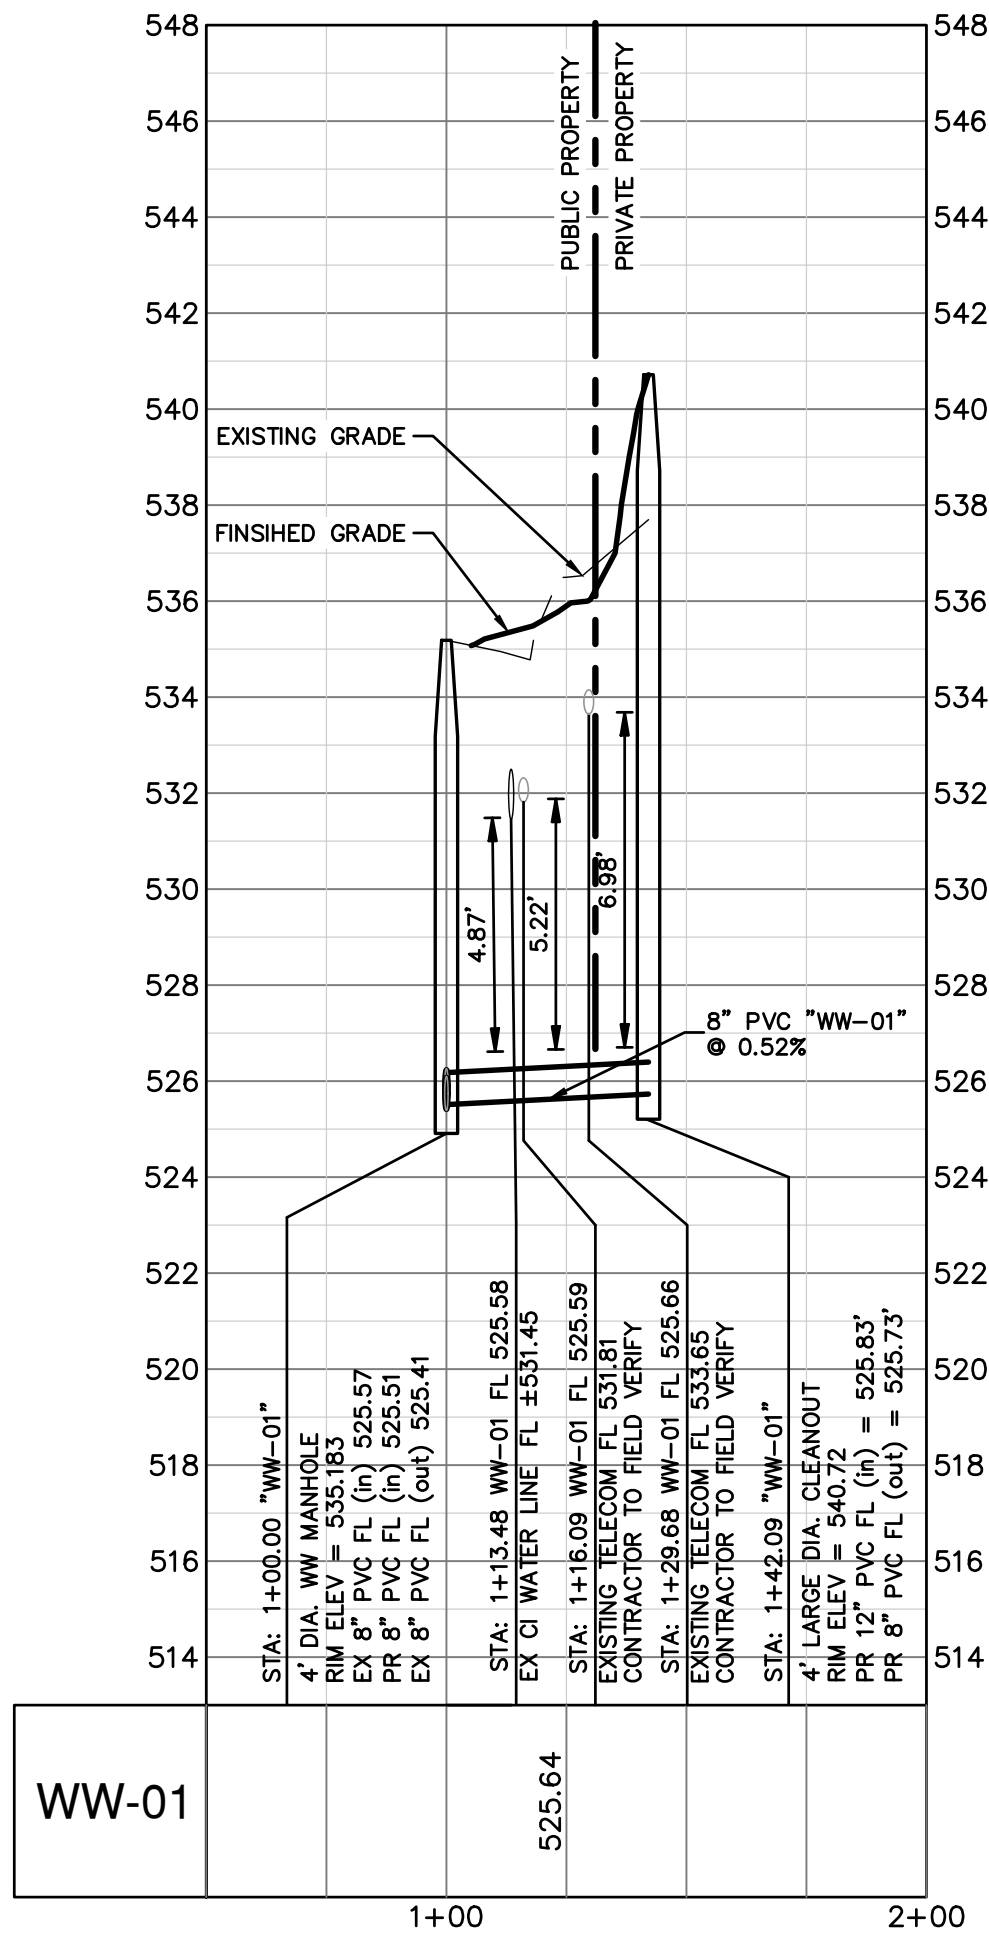


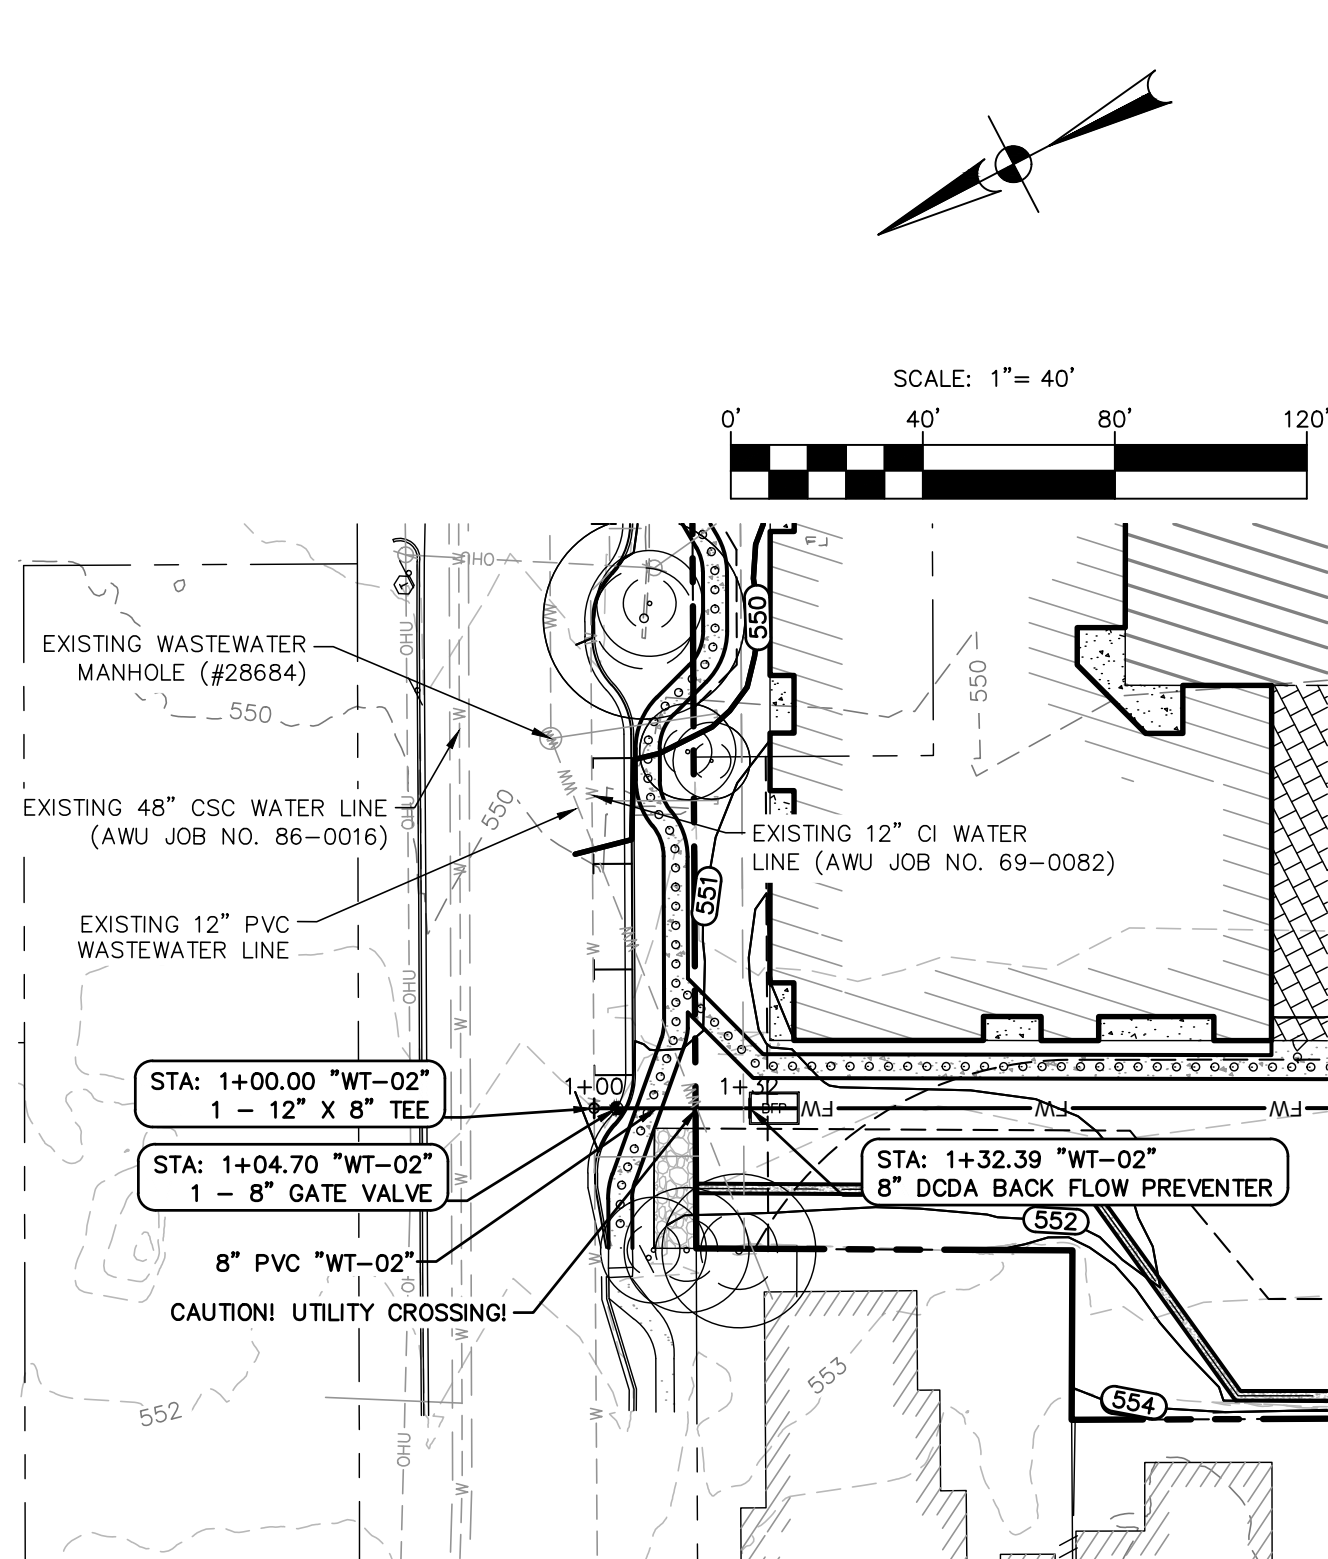


12" PVC WASTEWATER - "WW-01"

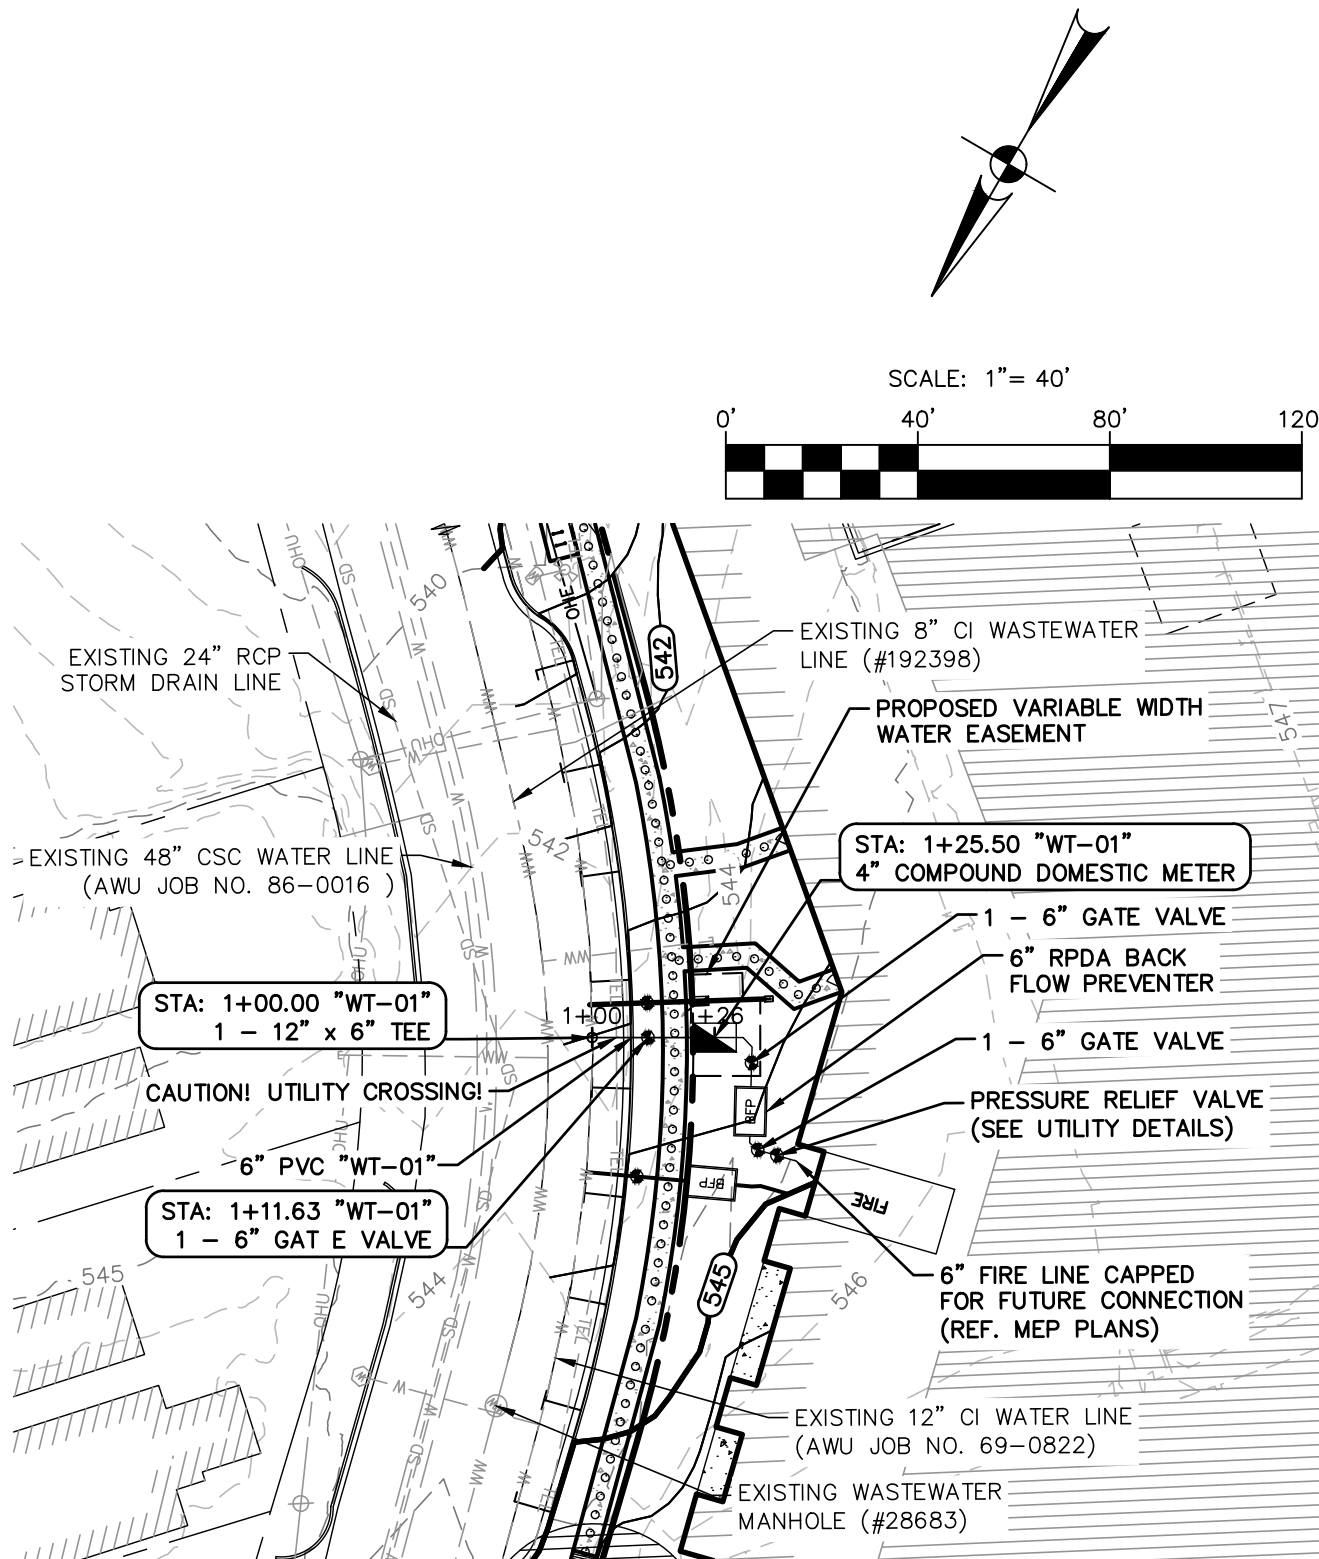

6" PVC DOMESTIC WATER - "WT-01"

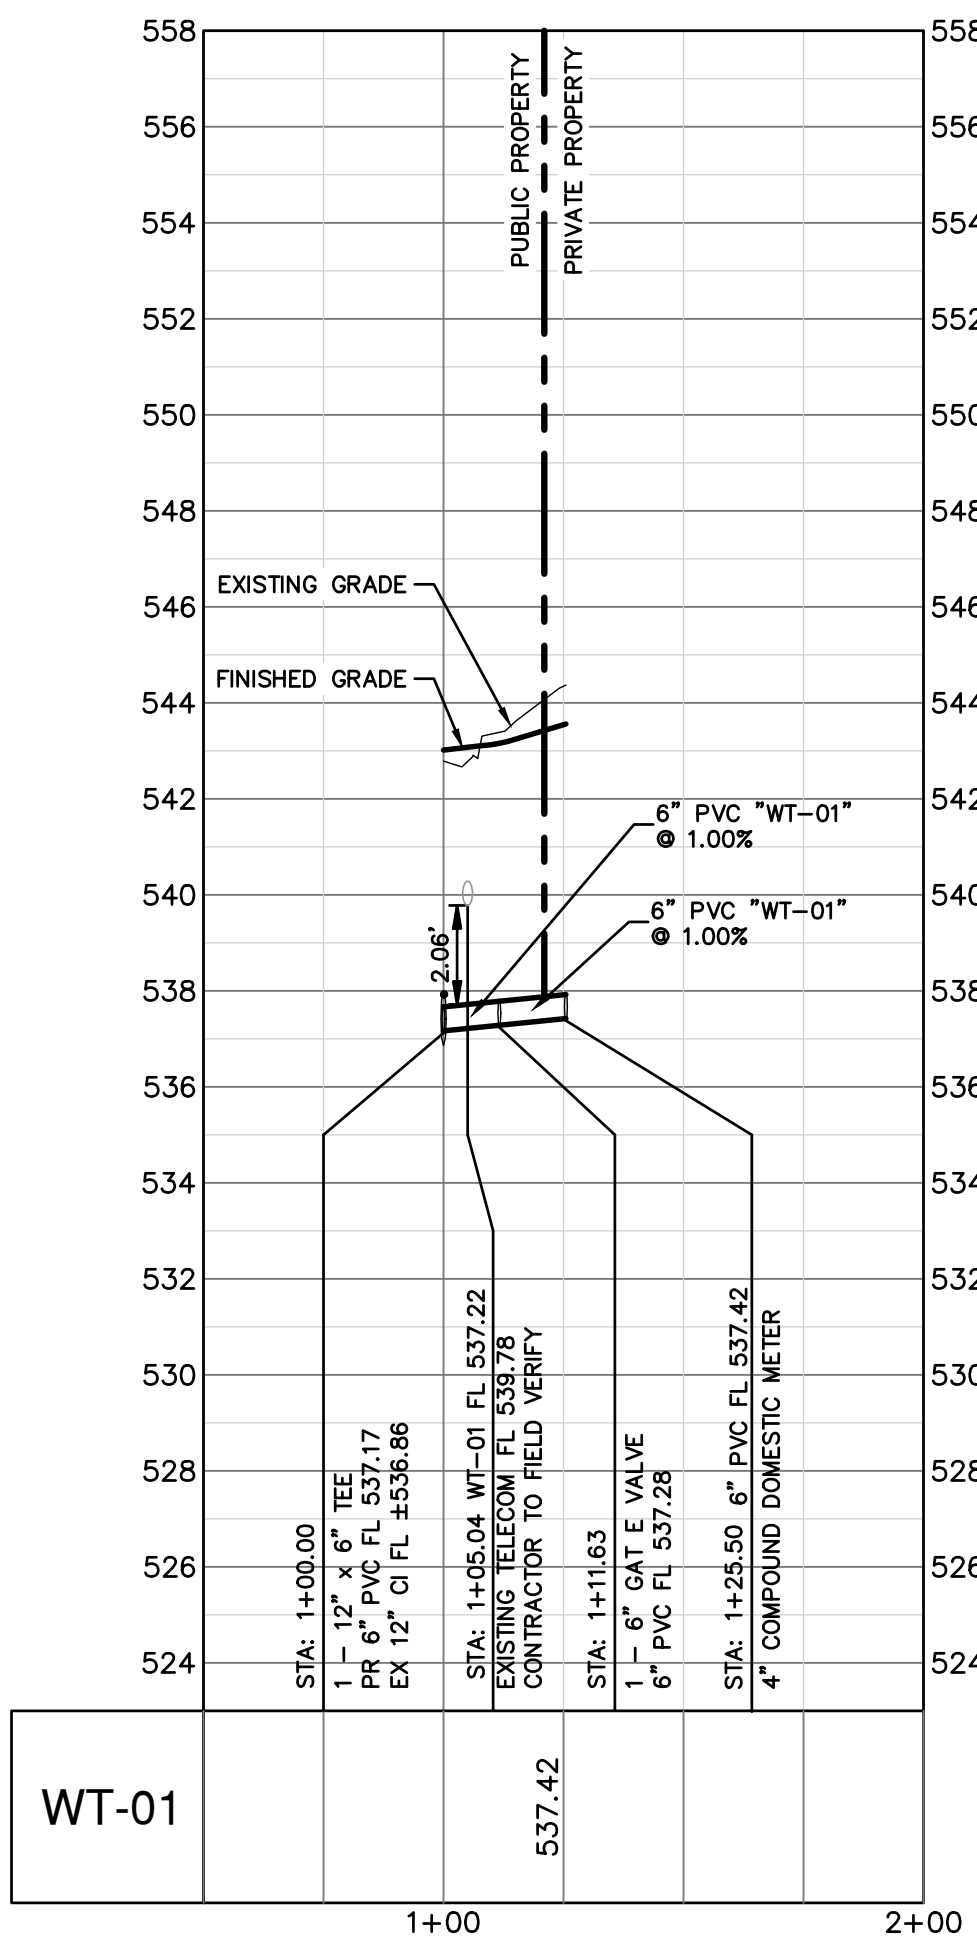

8" PVC FIRE - "WT-02"

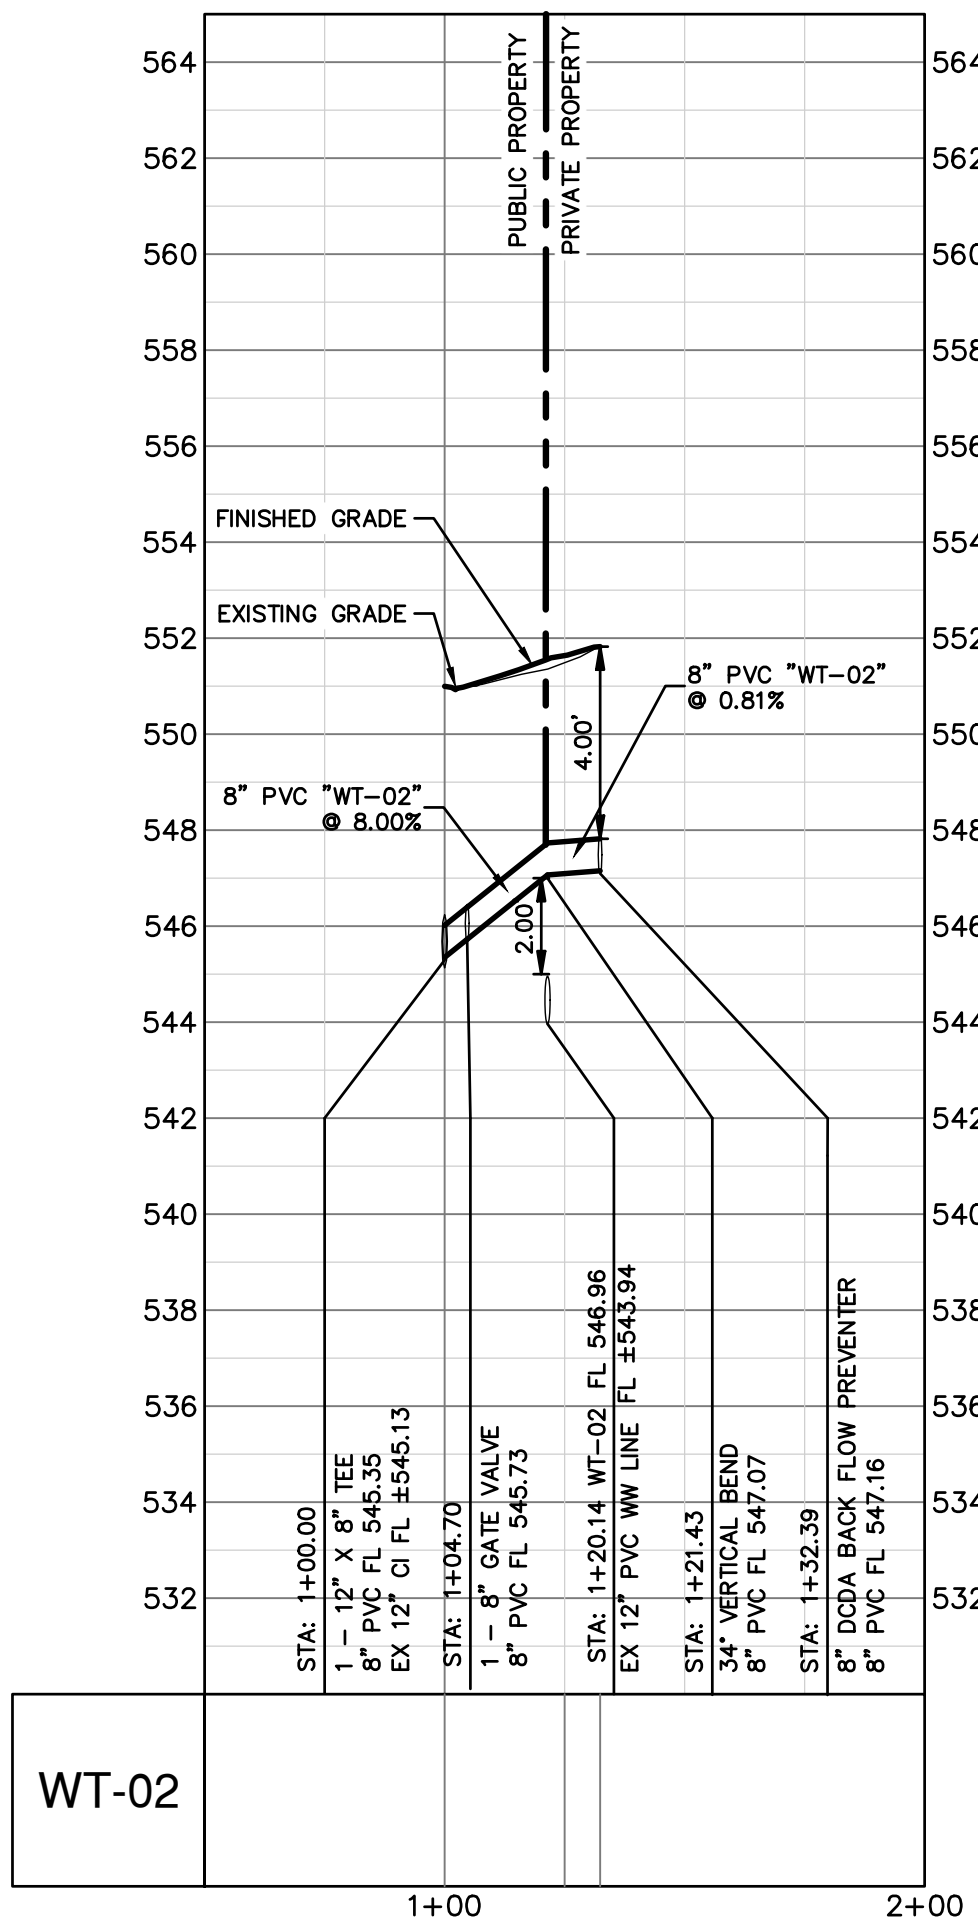

LEGEND

	PROPERTY LINE
	EXISTING CONTOUR LINE
	PROPOSED CONTOUR LINE
	PROPOSED ELECTRIC EASEMENT
	PROPOSED STORM EASEMENT
	PROPOSED WATER LINE
	PROPOSED WASTEWATER LINE
	PROPOSED STORM DRAIN LINE
	EXISTING WATER LINE
	EXISTING WASTEWATER LINE
	EXISTING STORM LINE
	PROPOSED WASTEWATER MANHOLE
	PROPOSED FDC CONNECTION
	PROPOSED BACK FLOW PREVENTOR
	PROPOSED WATER METER
	PROPOSED FIRE HYDRANT
	PROPOSED IRRIGATION METER
	EXISTING FIRE HYDRANT
	EXISTING WATER VALVE
	EXISTING WATER METER
	EXISTING CURB INLET
	EXISTING ELECTRIC MANHOLE
	EXISTING GAS METER
	EXISTING GAS VALVE
	EXISTING WASTEWATER MANHOLE
	EXISTING STORM DRAIN MANHOLE
	EXISTING SIGN
	PROPOSED BUILDING
	EXISTING BUILDING
	PROPOSED SIDEWALK
	EXISTING TREE TO REMAIN
	EXISTING HERITAGE TREE TO REMAIN
	PROPOSED RELOCATED HERITAGE TREE

NOTES:

- THE LOCATIONS OF EXISTING UNDERGROUND UTILITIES ARE SHOWN IN AN APPROXIMATE WAY ONLY AND HAVE NOT BEEN INDEPENDENTLY VERIFIED BY THE OWNER OR ITS REPRESENTATIVE. THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION OF ALL EXISTING UTILITIES BEFORE COMMENCING WORK, AND AGREES TO BE FULLY RESPONSIBLE FOR ANY AND ALL DAMAGES WHICH MIGHT BE ASSOCIATED BY THE CONTRACTOR'S FAILURE TO EXACTLY LOCATE AND PRESERVE ANY AND ALL UNDERGROUND UTILITIES.
- ALL 8" WATERLINES ARE AWWA C900 DR 14, CLASS 200 PVC PIPE UNLESS OTHERWISE NOTED.
- ALL WATERLINES AND SERVICE LINES WILL BE INSTALLED WITH TRACER TAPE.
- NO WATER METERS SHALL BE LOCATED IN SIDEWALK OR DRIVEWAY AREAS.
- FIRE HYDRANTS ARE SHOWN FOR SCHEMATIC PURPOSES ONLY. SEE DETAIL SHEET FOR PLACEMENT OF APPURTENANCES. FIRE HYDRANTS ASSEMBLY CONSISTS OF, BUT NOT LIMITED TO, 5/8" FIRE HYDRANT, 6" GATE VALVE, 6" D.I. FIRE LEAD.
- ALL HORIZONTAL AND VERTICAL WATERLINE BENDS, TEE'S AND DEADEND'S SHALL BE RESTRAINED TO THE WATER MAIN USING MECHANICAL JOINT RESTRAINT DEVICES AS APPROVED IN SPL WW-27-A. THE CALCULATED RESTRAINT LENGTH(S) SHALL BE INCLUDED AS CALL OUT NOTES IN THE PLAN VIEW AND/OR PROFILE, CALLED OUT FROM BEGINNING STATION TO END STATION PER UCM SECTION 2.9.2.B.9.
- ALL WATERLINE P.I.'S BOTH HORIZONTAL AND VERTICAL SHALL BE ACHIEVED BASED UPON THE PIPE MANUFACTURER'S SPECIFIED MAXIMUM ALLOWABLE JOINT DEFLECTION. P.I.'S LESS THAN OR EQUAL TO 80% OF THE MANUFACTURER'S MAXIMUM SHALL BE CONSTRUCTED AS A SINGLE JOINT DEFLECTION. P.I.'S IN EXCESS OF 80% OF THE MANUFACTURER'S MAXIMUM ALLOWABLE JOINT DEFLECTION ANGLE SHALL BE CONSTRUCTED AS A SERIES OF EVENLY DISTRIBUTED DEFLECTIONS OVER MULTIPLE JOINTS, SO THAT NO SINGLE DEFLECTION IS GREATER THAN 80% OF THE MAXIMUM.
- ALL FILL AREAS SHALL BE COMPACTED TO 95% PRIOR TO UTILITY INSTALLATION.
- UNDERGROUND MAINS FEEDING NFPA 13 SPRINKLER SYSTEMS MUST BE INSTALLED AND TESTED IN ACCORDANCE WITH NFPA 13 AND THE FIRE CODE. BY A LICENSED SPRINKLER CONTRACTOR WITH A PLUMBING PERMIT. THE ENTIRE MAIN MUST BE HYDROSTATICALLY TESTED AT ONE TIME, UNLESS ISOLATION VALVES ARE PROVIDED BETWEEN TESTED SECTIONS.
- ALL EXISTING AND PROPOSED AUSTIN WATER UTILITY APPURTENANCE ACCESS POINTS ARE NOT TO BE PAVED. REFER TO DETAIL S11-AW-01 FOR INSTALLATION OF CONCRETE PAD AROUND EXISTING AND PROPOSED AUSTIN WATER UTILITY APPURTENANCES.

PROFILE SCALES:

1" = 40' HORIZONTAL

1" = 4' VERTICAL

PROFILE LEGEND:

NATURAL GROUND

FINISHED GRADE

PROPOSED WASTEWATER

1-JOINT OF PRESSURE PIPE WITH SPACERS SEE SHEET.
STEEL ENCASEMENT CONSTRUCTION DETAILS

NO.	REVISION	DATE



PAPE-DAWSON
10801 N MOPAC EXPY, BLDG 3, STE 200 | AUSTIN, TX 78759 | 512.454.8711
TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM #10028600

1700 SOUTH LAMAR
1700 SOUTH LAMAR BLVD.
AUSTIN, TEXAS 78704

WATER & WASTEWATER PNP (1 OF 2)

PLAT NO.	51554-00
JOB NO.	51554-00
DATE	APRIL 2026
DESIGNER	MW
CHECKED	EAL
DRAWN	JM
SHEET	19 OF 52