



ORIGINAL LAYOUT SIZE - 24x36

@2026 H:\JOBFILES\RJ3\RJ3 BUILDING GROUP\RJ3 70496 VALLEY VIEW TOWNHOMES SP\04 CADPLOT SHEETS\DETAILS.DWG 2/27/2026 10:11 AM Chris Shalleesh

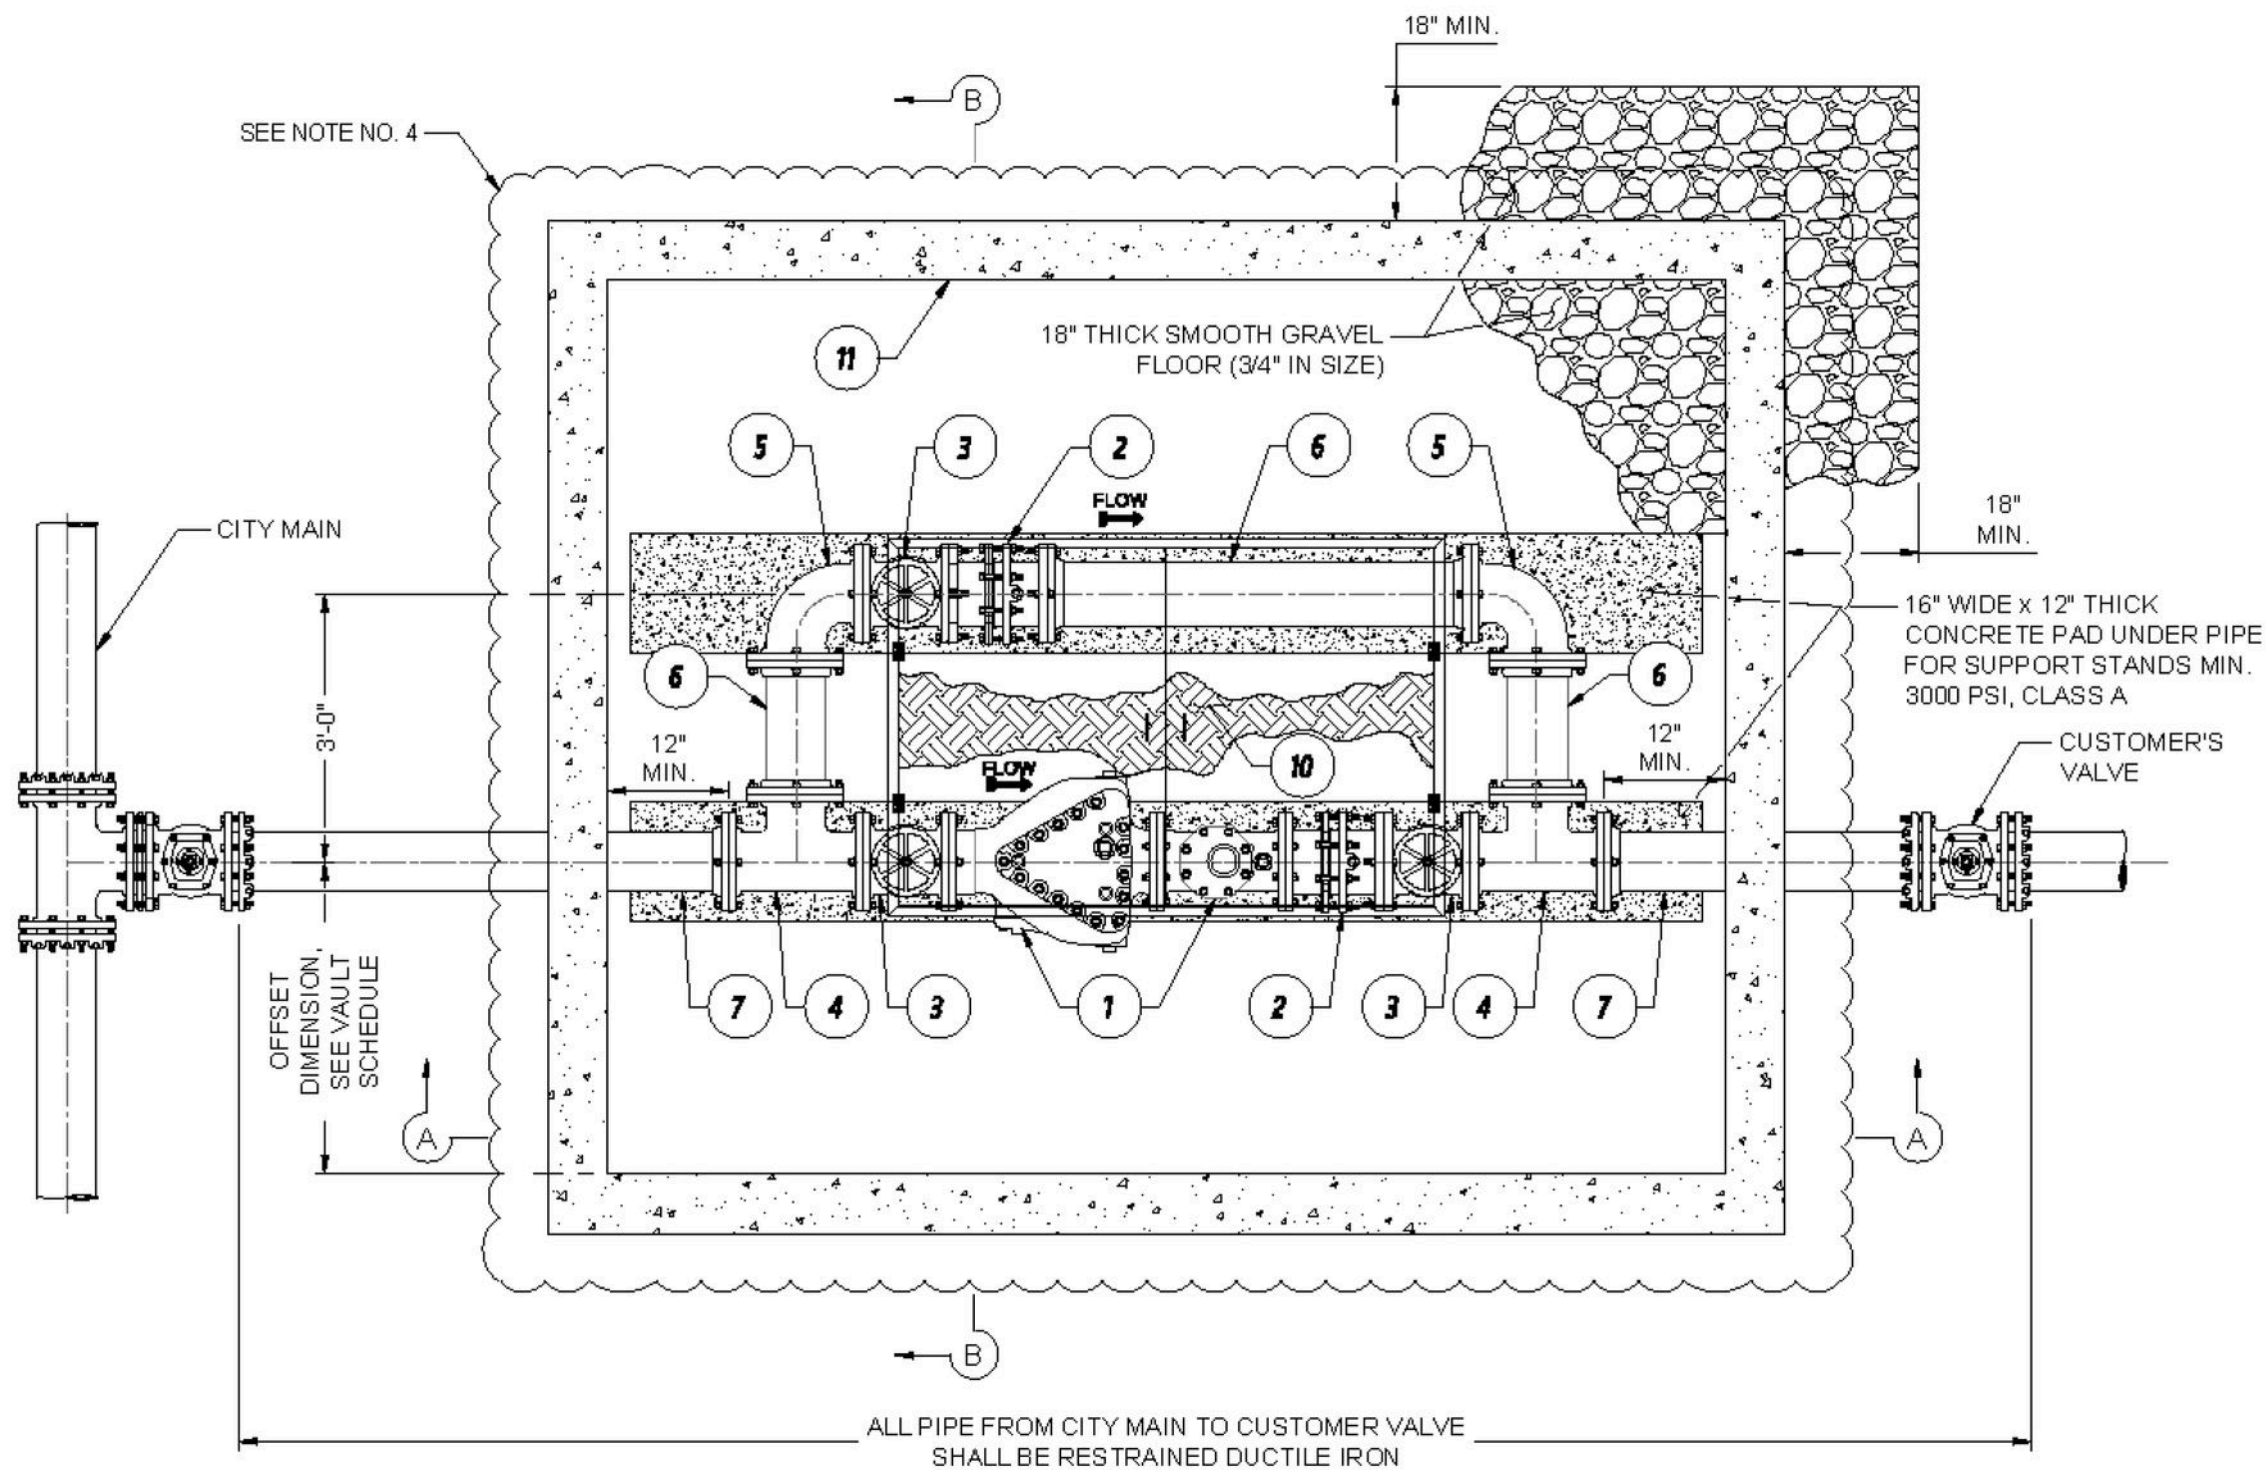


PLAN VIEW

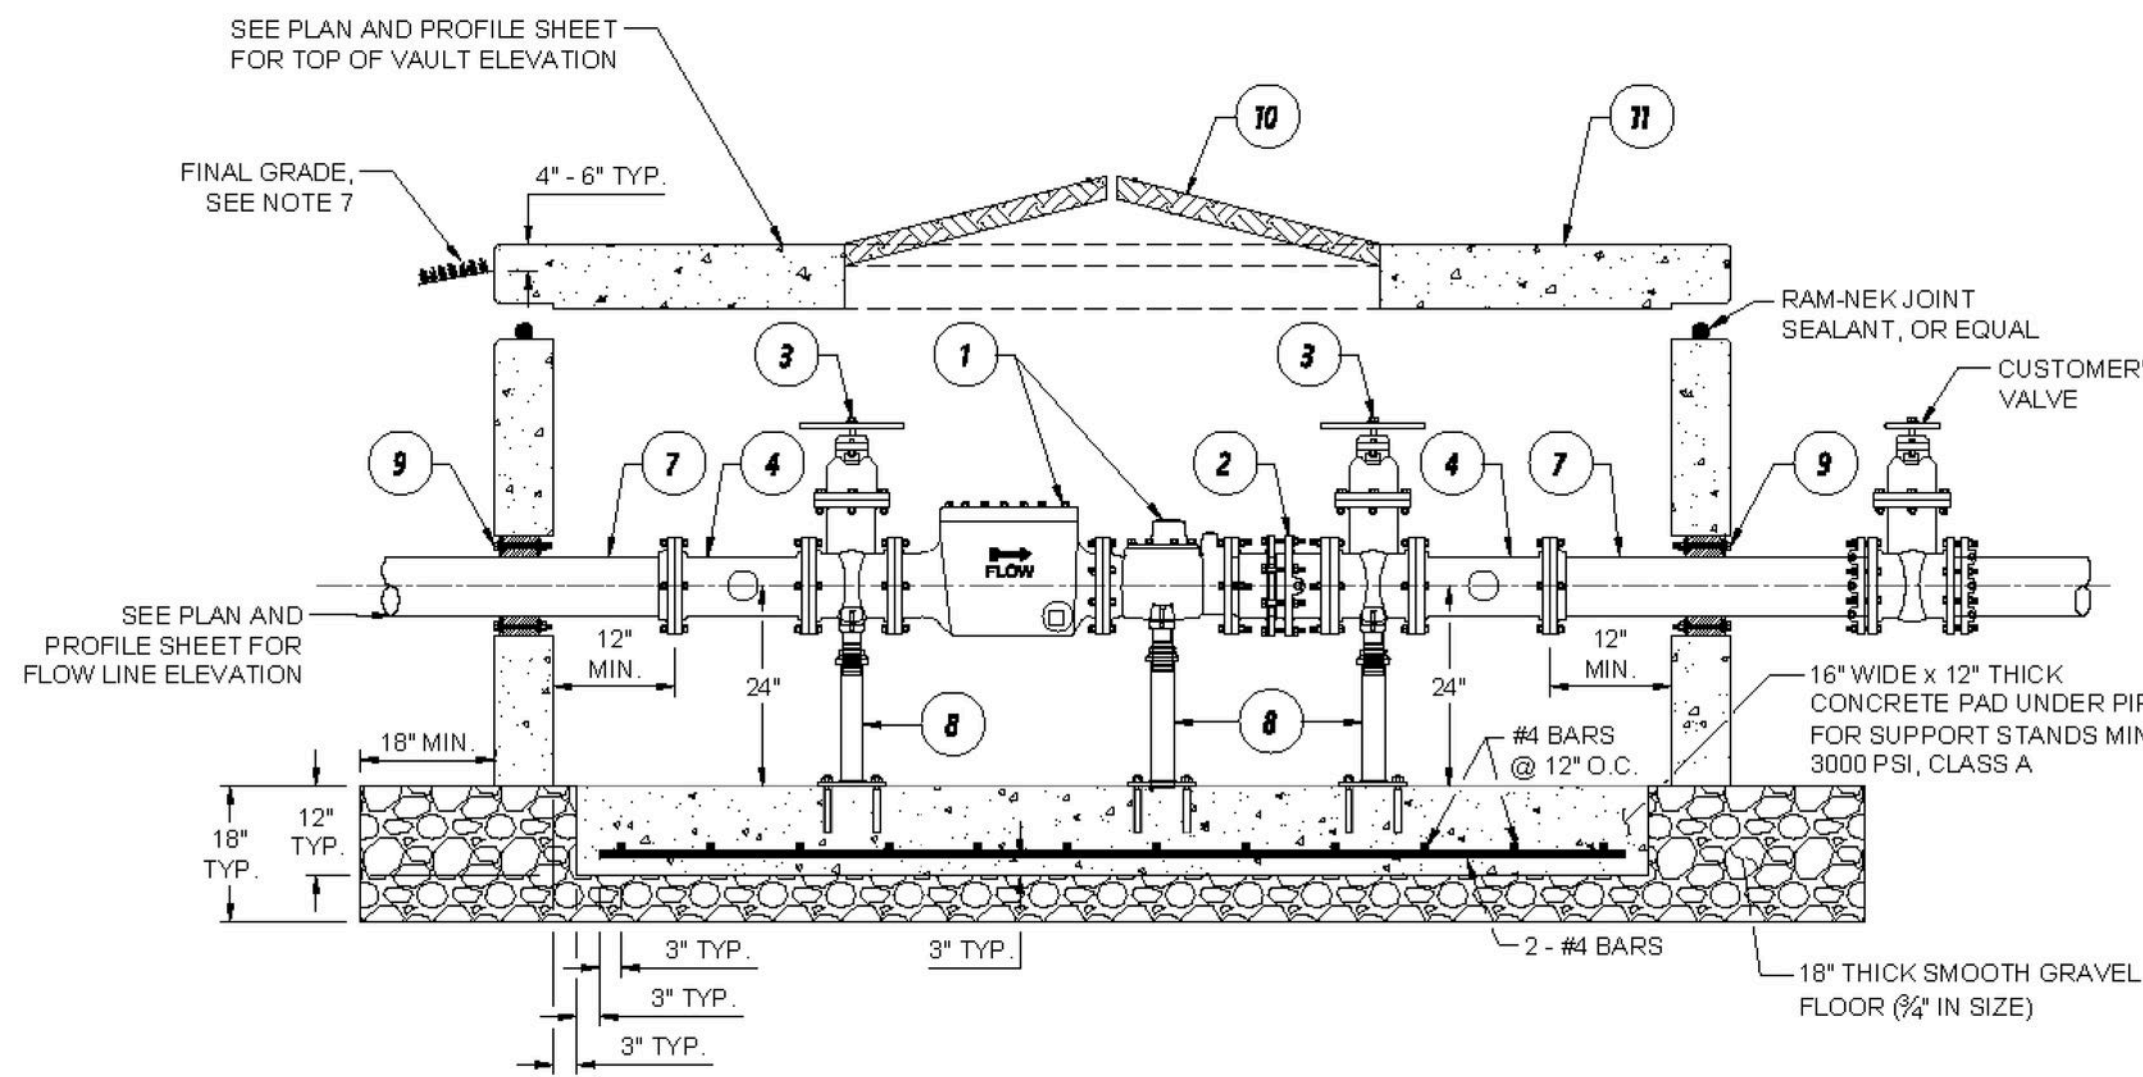

SECTION A-A VIEW

6", 8" OR 10" SENSUS OMNI F2 FIRE LINE METER MATERIAL LIST			
ITEM	DESCRIPTION	SIZE	TYPE
1	FIRE LINE METER AND STRAINER (PROVIDED BY AUSTIN WATER)	6", 8" OR 10"	FLG x FLG
2	DISMANTLING JOINT PER COA SPL WW-27J	6", 8" OR 10"	FLG x FLG
3	RESIUENT-SEATED GATE VALVE (W/HAND WHEEL) PER COA SPL WW-700	6", 8" OR 10"	FLG x FLG
4	TEE PER COA SPL WW-27C	6", 8" OR 10"	FLG x FLG
5	90° BEND PER COA SPL WW-27C	6", 8" OR 10"	FLG x FLG
6	DUCTILE IRON CLASS 53 PIPE PER COA SPL WW-27E	6", 8" OR 10"	FLG x FLG
7	DUCTILE IRON CLASS 53 PIPE PER COA SPL WW-27E	6", 8" OR 10"	FLG x PE
8	PIPE SADDLE SUPPORT AND STANCHION PER COA SPL WW-614B (USE 5/8" DIA. x 6" LONG STAINLESS STEEL WEDGE-ALL ANCHOR, TYP.)	NA	NA
9	LINK-SEAL MODULAR SEALS SERIES LS-525 FOR 6" PIPE, LS-500 FOR 8" PIPE AND LS-650 FOR 10" PIPE W/STAINLESS STEEL HARDWARE, OR EQUAL	NA	NA
10	48" x 72" ACCESS HATCH PER COA SPL WW-614A	NA	NA
11	CONCRETE VAULT PER COA SPL WW-298 (SEE VAULT SCHEDULE)	NA	NA

VAULT SCHEDULE		
FIRE LINE METER SIZE	VAULT SIZE (INSIDE DIMENSION)	OFFSET DIMENSION
6"	8' x 12'	3'-0"
8"	10' x 12'	3'-6"
10"	10' x 15'	3'-6"

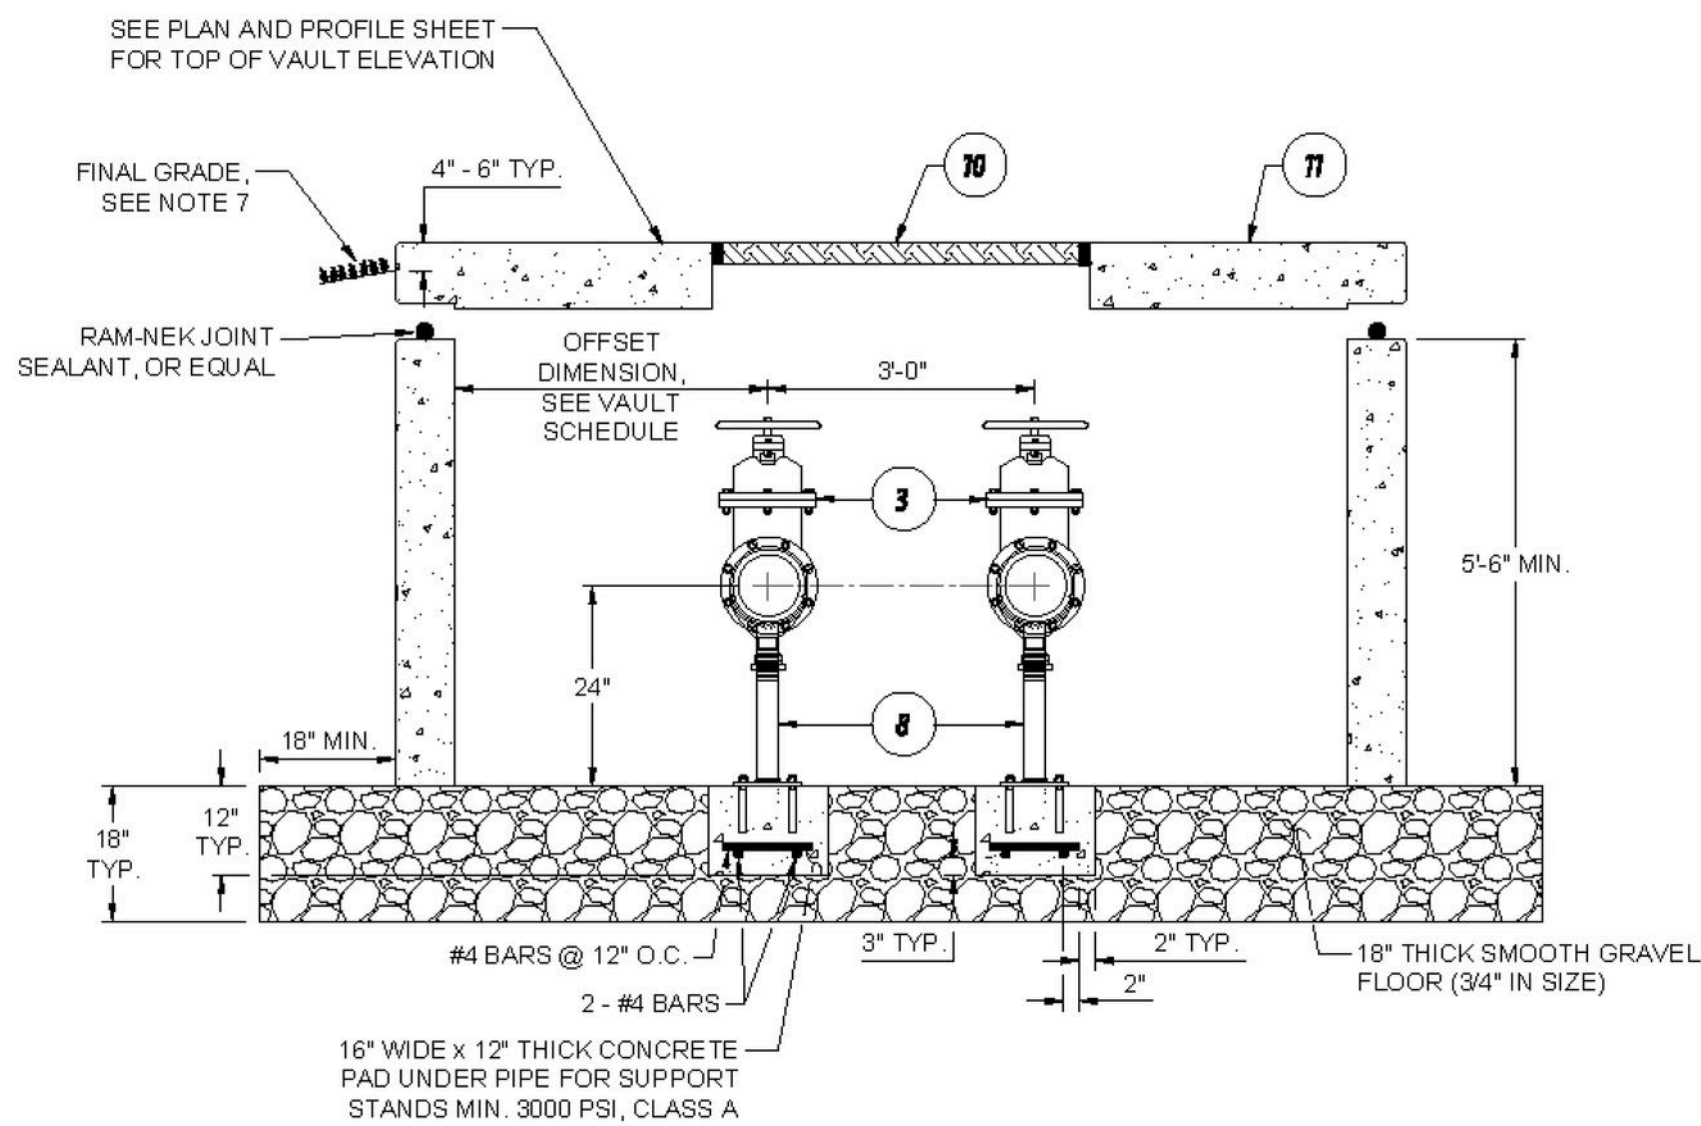

SECTION B-B VIEW

NOTES:

- CONCRETE VAULT SHALL NOT BE INSTALLED IN A TRAFFIC AREA.
- NUTS AND BOLTS USED TO CONNECT PIPE, FITTINGS AND VALVES SHALL BE STAINLESS STEEL (SS304 OR SS316) OR HIGH-STRENGTH LOW-ALLOY STEEL WITH A BLUE FLUOROPOLYMER FINISH.
- FULL FACE 1/8" THICK RED RUBBER GASKETS USED THROUGHOUT ASSEMBLY.
- ALL ITEMS IN MATERIAL LIST, INCLUDING VAULT AND ALL COMPONENTS WITHIN VAULT, TO BE IN COMPLIANCE WITH ITEM NO. 512, PRE-CAST WATER UTILITY VAULTS. ALL PIPING, VALVES AND APPURTENANCES OUTSIDE VAULT TO BE SHOWN IN PLAN AND PROFILE SHEET, AND SHALL BE IN COMPLIANCE WITH ITEM NOS. 510 AND 511.
- IF NECESSARY, WALL PENETRATION LOCATION IS ALLOWED TO MOVE HORIZONTALLY IN ACCORDANCE WITH SPL WW-298. MINIMUM 18" CLEARANCE SHALL BE PROVIDED BETWEEN VAULT WALL AND BYPASS PIPING OR FIRE LINE METER COMPONENTS, UNLESS NOTED OTHERWISE.
- ALL BURIED PIPE AND FITTINGS SHALL BE BEDDED, BACKFILLED, AND WRAPPED IN POLYETHYLENE ENCASMENT IN ACCORDANCE WITH COA STANDARDS.
- THE TOP OF THE VAULT SHALL BE AT AN ELEVATION SUCH THAT THE SURROUNDING GROUND SLOPES AWAY FROM THE VAULT. ADDITIONAL DRAINAGE CONSIDERATIONS SUCH AS CONNECTION OF VAULT DRAINAGE TO STORM SEWER, LATERAL DRAIN LINES FROM GRAVEL FLOOR, OR OTHER MEANS SHALL BE REQUIRED IF CONDITIONS CAUSE WATER TO COLLECT IN VAULT.
- BYPASS AND MAIN PIPE SHALL BE SAME DIAMETER.

USE OF THIS STANDARD

THIS STANDARD DRAWING ONLY APPLIES TO FIRE LINE METER VAULTS SATISFYING BOTH OF THE FOLLOWING STIPULATIONS; OTHERWISE, A PROJECT-SPECIFIC DESIGN MUST BE PREPARED. THE VAULT ITSELF MUST BE DESIGNED BY A TEXAS-LICENSED PROFESSIONAL ENGINEER (STRUCTURAL).

- THE CONDITIONS AT THE SITE OF THE PROPOSED FIRE LINE METER, THE LOADS AFFECTING A PRE-CAST CONCRETE VAULT AT THAT SITE, AND THE COMPONENTS AND PHYSICAL FEATURES OF THE VAULT FOR THAT SITE ARE ALL ADEQUATELY AND RELIABLY REPRESENTED BY THE STRUCTURAL DESIGN CRITERIA, DESIGN LOADS, AND DETAILS INCLUDED WITH SPL WW-298.
- THE PIPING AND VALVES FOR THE PROPOSED FIRE LINE METER ARE THE SAME MATERIAL, TYPE, SIZE, AND ORIENTATION AS THOSE SHOWN IN THIS STANDARD.

CITY OF AUSTIN
AUSTIN WATER

JEFF A. KYLE

03/10/2025
ADOPTED

6", 8" AND 10" FIRE LINE METER

THE ENGINEER/ARCHITECT ASSUMES
RESPONSIBILITY FOR APPROPRIATE USE OF THIS
STANDARD. MODIFICATIONS TO THIS STANDARD
ARE PROHIBITED.

STANDARD NO.
512-AW-02
1 OF 1

Construction Details 4

Valley View Townhomes
3759 Valley View Road
Austin, Texas 78704
Travis County

Bleyl Engineering

Planning • Design • Management
7701 San Felipe Blvd., Suite 200, Austin TX 78729
Texas Firm Registration No. F-678
Tel. 512-454-2400
www.bleylengineering.com

Austin Bryan Conroe Houston



Design: CS, JR
CAD: JW, CS | Review: JKR
Project No: RJ3 70496

Sheet: 25 of 39
SP-2025-0126C