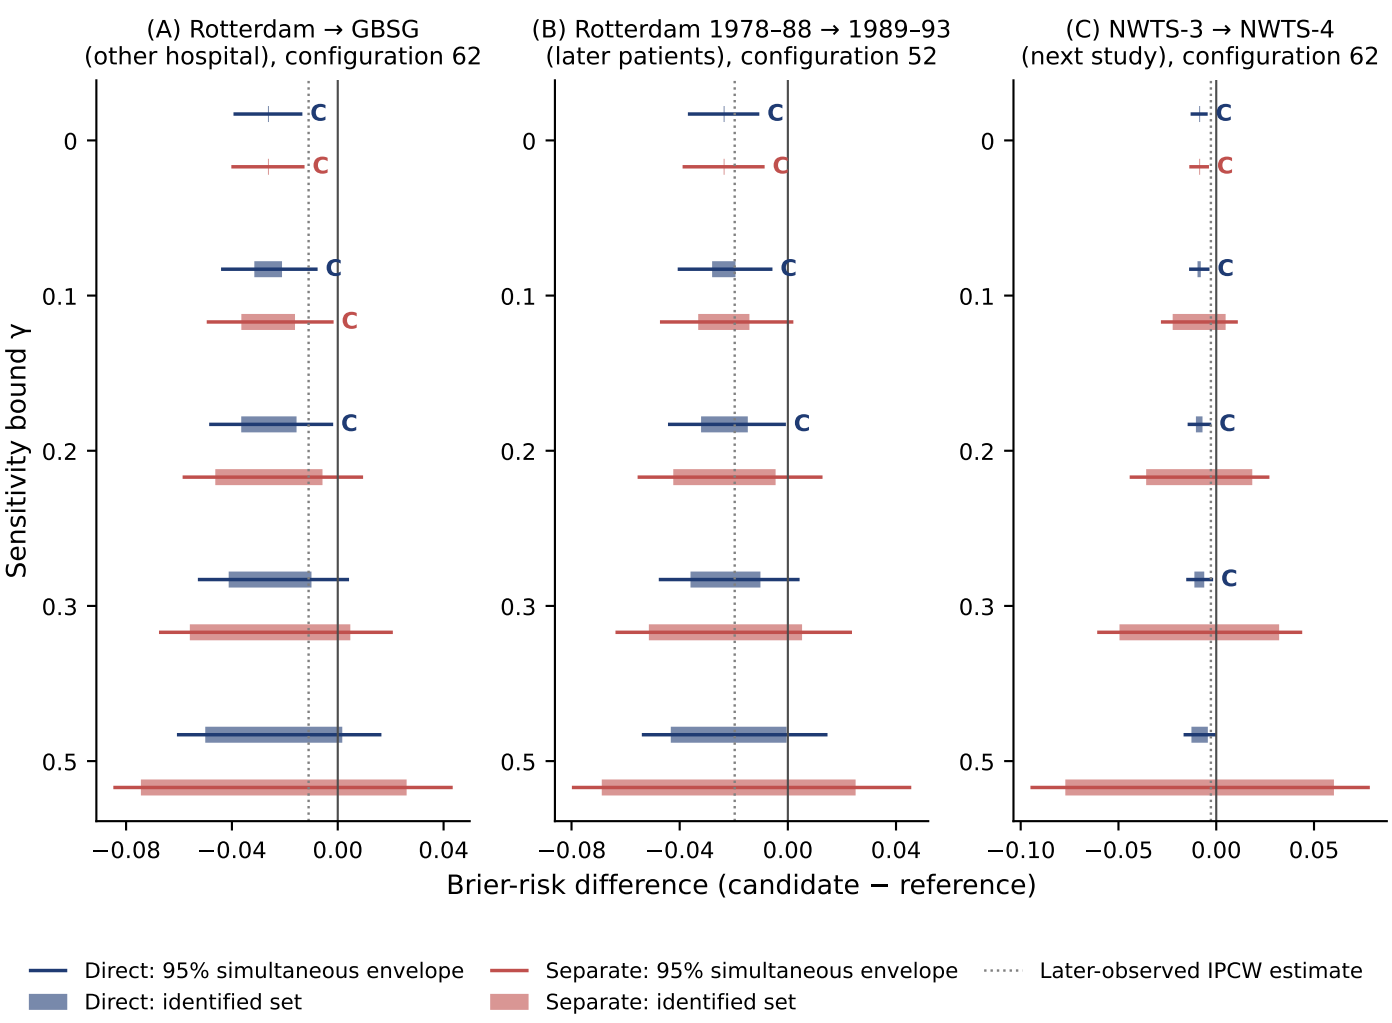
(A) Rotterdam → GBSG
(other hospital), configuration 62
(B) Rotterdam 1978–88 → 1989–93
(later patients), configuration 52
(C) NWTS-3 → NWTS-4
(next study), configuration 62
Sensitivity bound γ
0
0.1
0.2
0.3
0.5
C
−0.08
−0.04
0.00
0.04
−0.10
−0.05
0.05
Brier-risk difference (candidate − reference)
Direct: 95% simultaneous envelope
Direct: identified set
Separate: 95% simultaneous envelope
Separate: identified set
Later-observed IPCW estimate