
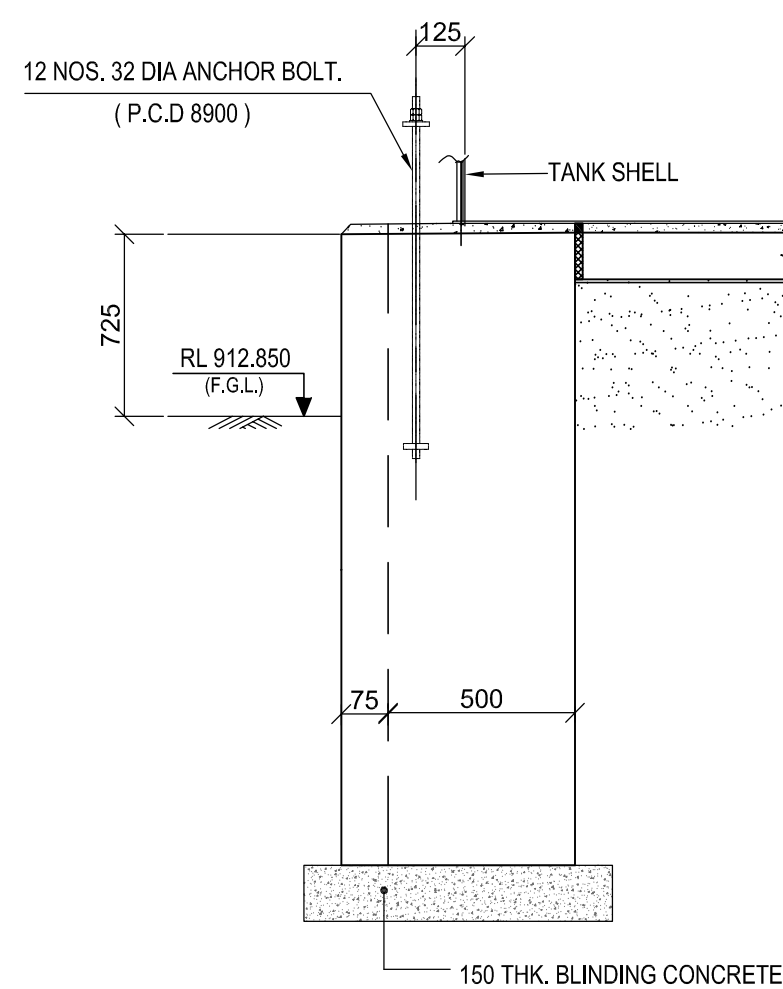
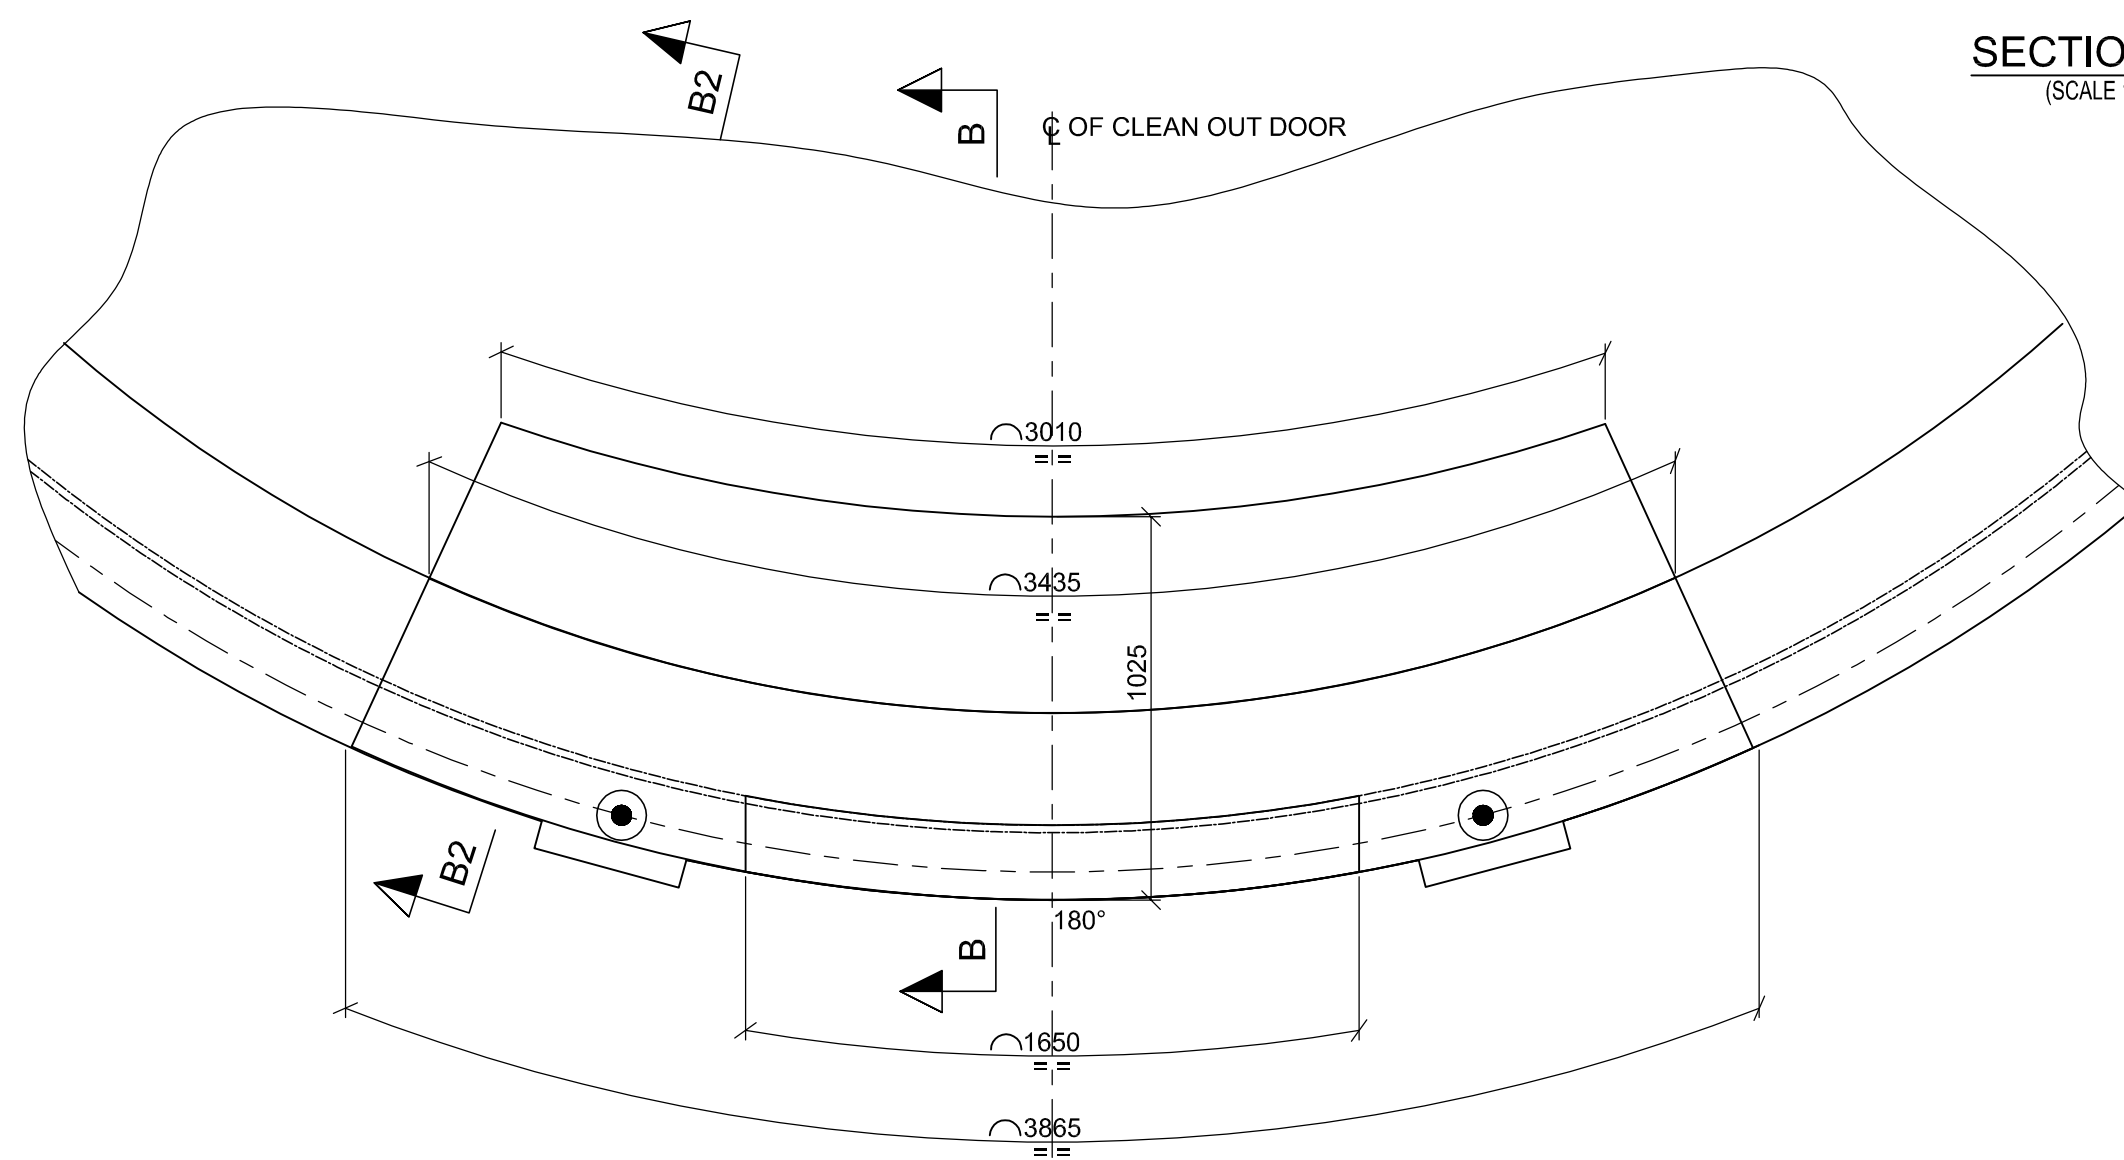
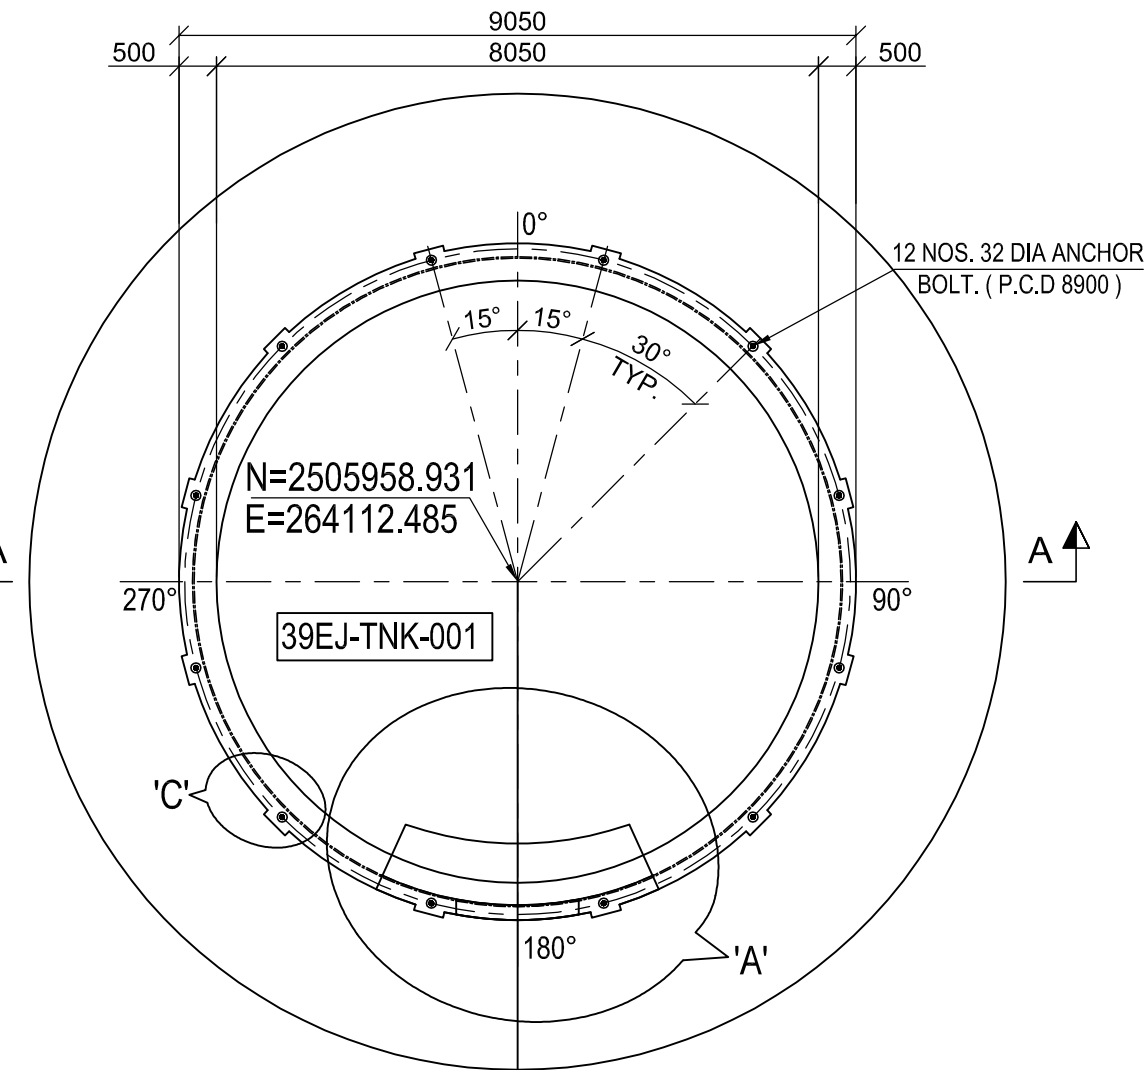
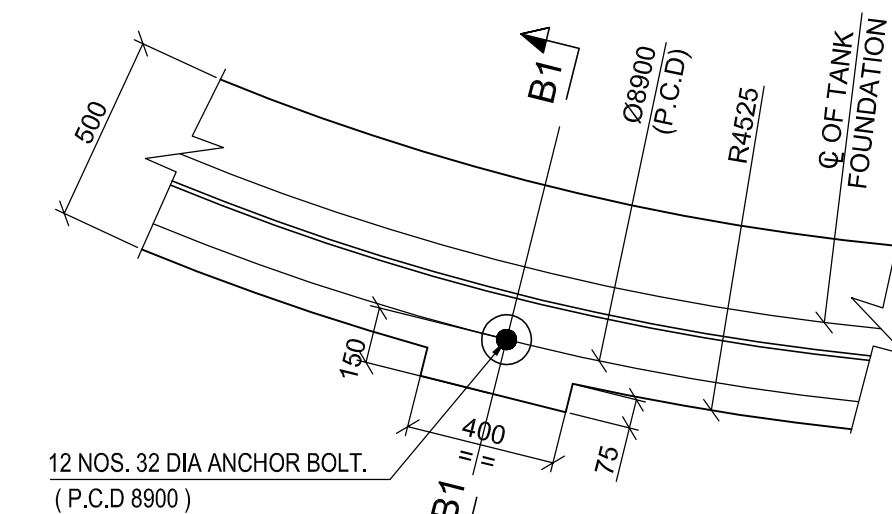
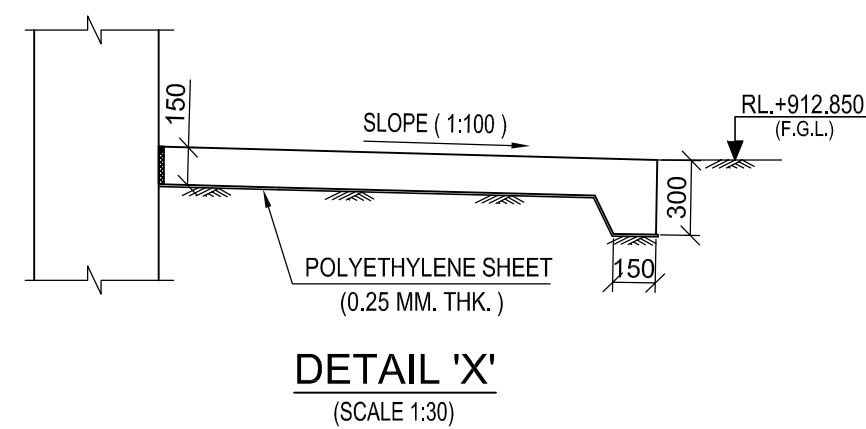


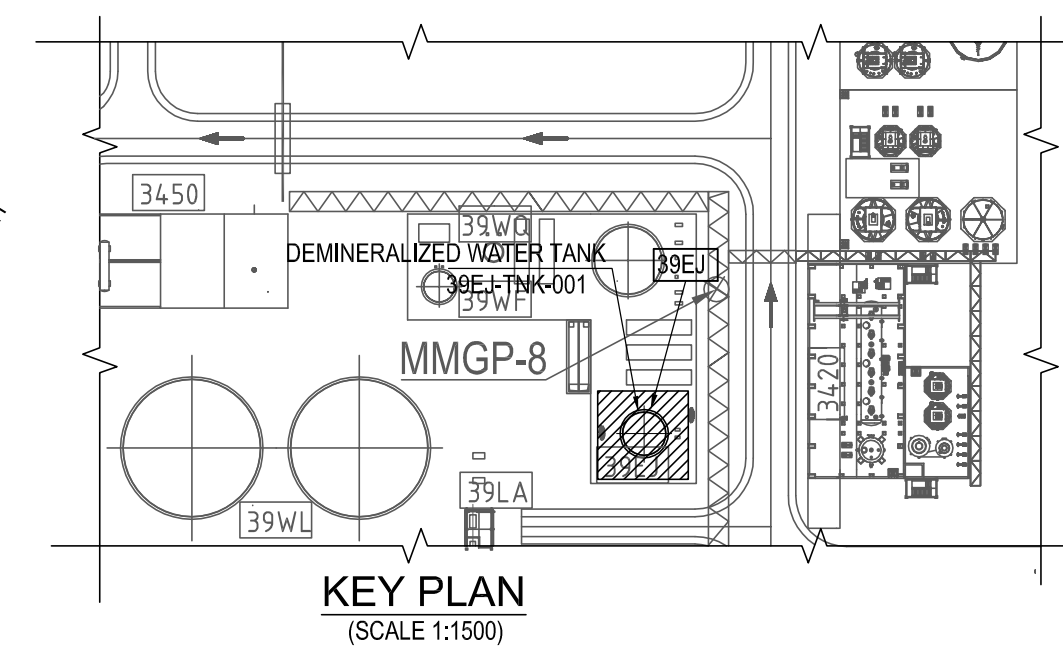

T.O.C - TOP OF CONCRETE
F.G.L - FINISHED GROUND LEVEL
B.O.T - BOTTOM OF TANK
FDN. - FOUNDATION
TYP. - TYPICAL
RL - REDUCED LEVEL
P.C.D - PITCH CIRCLE DIAMETER
P.C.C- PLAIN CEMENT CONCRETE
DIA - DIAMETER
THK. - THICK
CL - CENTRE LINE
MKD. - MARKED
GA - GENERAL ARRANGEMENT
HEX. - HEXAGONAL
Ø - DIAMETER

1. ALL DIMENSIONS ARE IN MILLIMETRES. LEVELS & COORDINATES ARE IN METRES UNLESS OTHERWISE STATED.
2. GRADE OF CONCRETE SHALL BE 35 MPa FOR WALL & 15 MPa FOR BLINDING CONCRETE.
3. NET SAFE BEARING CAPACITY AT THE FOUNDING LEVEL CONSIDERED 375KN / SQ. M
4. IF ANY PART OF FOUNDATION COMES ON BACKFILLED ZONE OF ADJACENT FOUNDATION OR ANY LOOSE POCKETS ARE ENCOUNTERED BELOW FOUNDATION LEVEL THE SAME SHALL BE REMOVED AND FILLED WITH PCC (15 MPa).
5. THE CONTENT OF THIS DRAWING SHALL CONFORM TO THE PROVISIONS OF CIVIL, STRUCTURAL AND ARCHITECTURAL DESIGN CRITERIA DOCUMENT NO. MD-216-1000-EG-SCT-1001.
6. 2M WIDE APRON OUTSIDE THE TANK FOUNDATION ABOVE COMPACTED FILLING TO BE CAST BEFORE INSIDE COMPLETION .
7. TOP OF SCREED / GRADE SLAB TOLERANCE SHALL BE WITHIN +/- 10MM OF DESIGN LEVEL.
8. 100 MM GROUT TO BE PLACED FOR PLACEMENT OF SEALANT.

RESERVED FOR VENDOR LOGO AND DRAWING NUMBER

The content of these documents are the sole property of Outotec Oyj. Any rights not expressly granted herein are reserved. Reproduction, transfer or distribution of part or all of the contents in any form without prior written permission of Outotec is prohibited.



This document and the information contained herein is Ma'aden proprietary know-how. This document or any part thereof should not be reproduced, stored in a retrieval system or transmitted by any means, electronic or otherwise, or divulged without prior written permission of Ma'aden.

MANSOURAH - MASSARAH GOLD PROJECT
GENERAL ARRANGEMENT DRAWING
DEMINERALIZED WATER TANK
GA & DETAILS OF FDN. FOR TANK MKD 39EJ-TNK-001