
DRAWING NUMBER: MD-216-49PQ-EG-CV-GAD-1631 | REV: D01


CONDUIT MARKING TABLE	
CONDUIT TAG	CL. OF ELEVATION
C100	RL. 911.800
C101	RL. 911.500
C102	RL. 911.800
C103	RL. 911.800
C104	RL. 911.500
C105	RL. 911.500
C106	RL. 911.200
C107	RL. 911.200
C108	RL. 910.900
C109	RL. 911.800
C110	RL. 911.500
C111	RL. 911.800
C112	RL. 911.800
C113	RL. 911.500
C114	RL. 911.500
C115	RL. 911.200
C116	RL. 911.200


CONDUIT MARKING TABLE	
CONDUIT TAG	CL. OF ELEVATION
C117	RL. 910.900
C118	RL. 911.800
C119	RL. 911.500
C120	RL. 911.800
C121	RL. 911.800
C122	RL. 911.500
C123	RL. 911.500
C124	RL. 911.200
C125	RL. 911.200
C126	RL. 910.900
C129	RL. 911.800
C130	RL. 911.500
C131	RL. 911.800
C132	RL. 911.800
C133	RL. 911.500
C134	RL. 911.500
C135	RL. 911.200

CONDUIT MARKING TABLE	
CONDUIT TAG	CL. OF ELEVATION
C136	RL. 911.200
C137	RL. 910.900
C140	RL. 911.800
C141	RL. 911.800
C142	RL. 911.800
C143	RL. 911.800
C144	RL. 911.800
C145	RL. 911.800
C146	RL. 911.800
C147	RL. 911.800
C148	RL. 911.800
C149	RL. 911.800
C150	RL. 911.500
C151	RL. 911.500
C152	RL. 911.500
C153	RL. 911.200
C154	RL. 911.200

CONDUIT MARKING TABLE	
CONDUIT TAG	CL. OF ELEVATION
C155	RL. 911.200
C156	RL. 910.900
C157	RL. 910.900
C158	RL. 910.900
C159	RL. 911.800
C160	RL. 911.800
C161	RL. 911.800
C162	RL. 911.800
C163	RL. 911.800
C164	RL. 911.800
C165	RL. 911.500
C166	RL. 911.500
C167	RL. 911.500
C168	RL. 911.800
C169	RL. 911.800
C170	RL. 911.800
C171	RL. 911.500
C172	RL. 911.500
C173	RL. 911.500

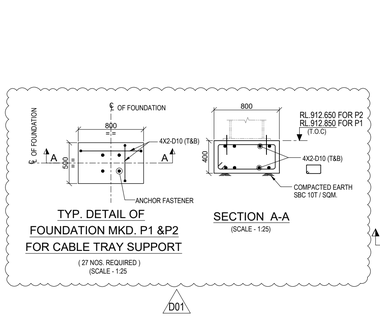

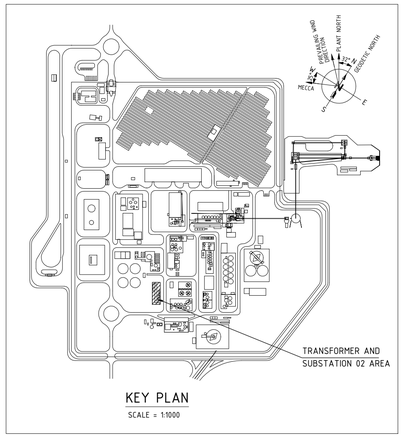

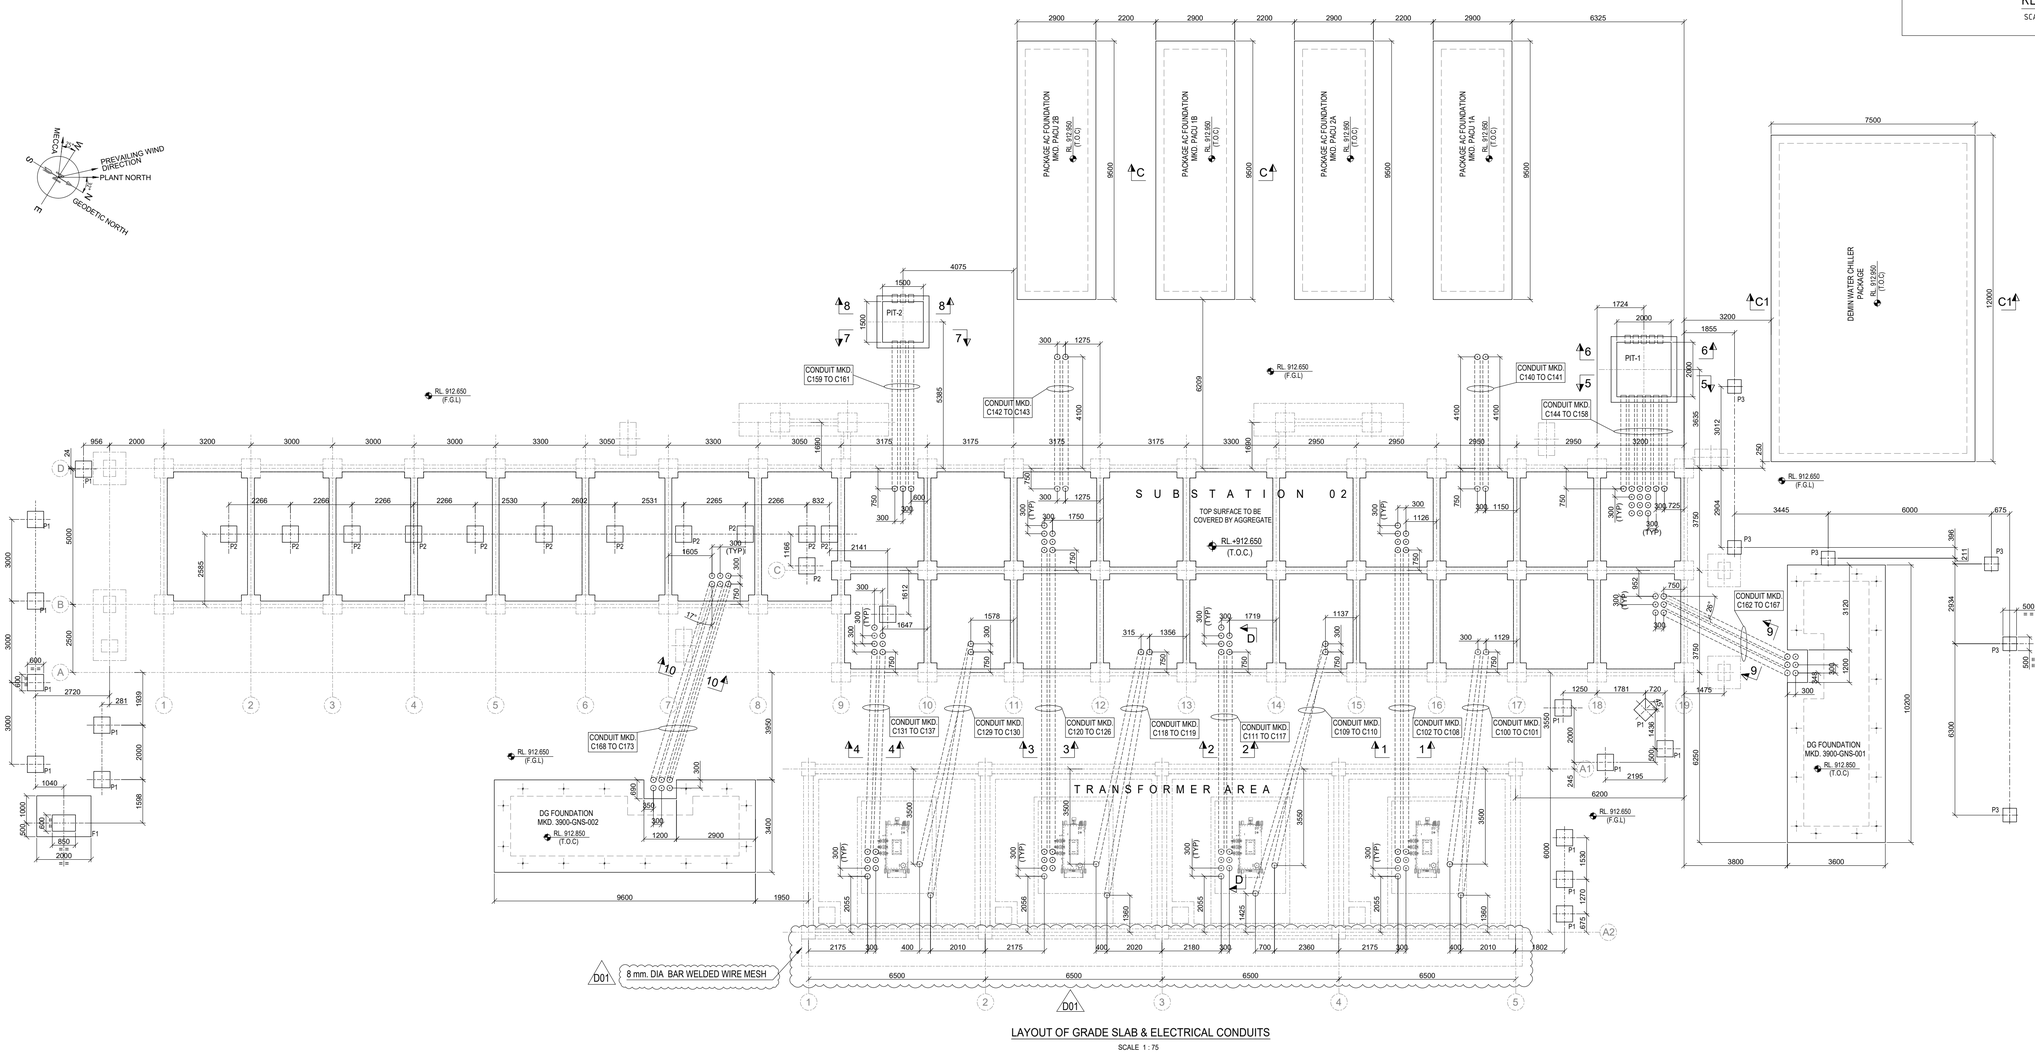

LAYOUT OF GRADE SLAB & ELECTRICAL CONDUITS
SCALE 1 : 75

LEGENDS :-

R.L - REDUCED LEVEL
℄ - CENTRE LINE
T.O.C. - TOP OF CONCRETE
TYP - TYPICAL
T.O.G. - TOP OF GROUT
B.O.F. - BOTTOM OF FOUNDATION
F.G.L. - FINISHED GROUND LEVEL
F.F.L. - FINISHED FLOOR LEVEL
P.C.C. - PLAIN CEMENT CONCRETE
DET. - DETAIL
FDN. - FOUNDATION
THK. - THICK
R.C.C. - REINFORCED CEMENT CONCRETE
MKD. - MARKED

NOTES:-

1. ALL DIMENSIONS ARE IN MILLIMETRES AND LEVELS AND CO-ORDINATES ARE IN METRES UNLESS OTHERWISE STATED.
2. NET SAFE BEARING CAPACITY OF SOIL AT BOTTOM OF FOUNDATION IS CONSIDERED AS 50 KN/ SQM.
3. GRADE OF CONCRETE SHALL BE C35 (35Mpa) FOR FOUNDATION, C30 (30Mpa) FOR GRADE SLAB & C15 (15Mpa) FOR BLINDING CONCRETE.
4. GRADE OF REINFORCEMENT SHALL BE DEFORMED BAR 420 MPa (GRADE 60) - ASTM A615/A615M.
5. CLEAR COVER TO REINFORCEMENT SHALL BE SLAB = 25 MM.
6. FOR STANDARD REINFORCEMENT DETAIL & GENERAL NOTES FOR CIVIL WORKS REFER DRAWING NO. MD-216-1000-EG-CV-DED-1005 & 1001.
7. STRUCTURAL FILL SHALL CONFORM TO PROVISIONS OF DOCUMENT MD-216-1000-EG-CV-MST-1698.
8. THIS DRAWING SHALL READ IN CONJUNCTION WITH DRAWING NO. MD-216-49PQ-EG-CV-GAD-1632.
9. FOR THE DETAILS OF EDGE THICKENING, RE-ENTRANT REABR, REFER DRAWING NO. MD-101-SMEM-EG-ST-DST-0002 & 0004.

DOCUMENT NUMBER	REFERENCE DOCUMENTS	REV	DATE	REVISION DESCRIPTION	DRN	CHK	ENG	APP	EMP
MD-216-49PQ-EG-HV-LAD-V552-1003	HVAC EQUIPMENTS & DUCTS	D01	13/04/2023	AS- BUILT - REVISED AS MARKED D01	PML	SJM	AVG	AG	
	PREFABRICATED SUBSTATION # 2 SHEET-1	C04	13/04/2022	ISSUED FOR CONSTRUCTION & REVISED AS MARKED C04	PML	SJM	AVG	AG	
MD-216-49PQ-EG-CV-GAD-1632	PROCESS PLANT SUBSTATION 02 AND TRANSFORMER AREA	C03	12/08/2021	ISSUED FOR CONSTRUCTION & REVISED AS MARKED C03	SYA	SJM	AVG	AG	
	LAYOUT & DETAIL OF GRADE SLAB & ELECTRICAL CONDUITS	C02	21/06/2021	ISSUED FOR CONSTRUCTION & REVISED AS MARKED C02	SYA	SJM	AVG	AG	
MD-216-49PQ-EG-EL-LAD-1014	CABLE ROUTE LAYOUT - SUBSTATION-2	C01	06/05/2021	ISSUED FOR CONSTRUCTION	AMJ	SJM	AVG	AG	
MD-216-49PQ-EG-CV-GAD-1613	PROCESS PLANT SUBSTATION 02 : DETAIL OF TRANSFORMER AREA	A02	08/04/2021	REVISED AS PER EMPLOYER COMMENTS	AMJ	SJM	AVG	AG	
MD-216-49PQ-EG-CV-GAD-1611	PROCESS PLANT SUBSTATION 02 : LAYOUT OF FOUNDATIONS			DATED 05/04/2021 & REVISED AS MKD. A02					
MD-216-1000-EG-ST-CRT-1001	CIVIL, STRUCTURAL & ARCHITECTURAL - DESIGN CRITERIA	A01	06/03/2021	ISSUED FOR REVIEW	AMJ	SJM	AVG	AG	

RESERVED FOR VENDOR LOGO AND DRAWING NUMBER

LARSEN & TOUBRO

This drawing is the property of LARSEN & TOUBRO and must not be passed on to any person or body not authorized by us to receive it nor be copied or otherwise made use either in full or in part by such person or body without our prior permission in writing.

Outotec

The content of these documents are the sole property of Outotec Oyj. Any rights not expressly granted herein are reserved. Reproduction, transfer or distribution of part or all of the contents in any form without prior written permission of Outotec is prohibited.

MA'ADEN معادن
Saudi Arabian Mining Company

This document and the information contained herein is Ma'aden proprietary know-how. This document or any part thereof should not be reproduced, stored in a retrieval system or transmitted by any means, electronic or otherwise, or divulged without prior written permission of Ma'aden.

LARSEN & TOUBRO DRAWING NUMBER	REVISION 6
019045_950_C_G_24611_001	
OUTOTEC DRAWING NUMBER	DOCUMENT ID / REVISION
900707__GAU01__WD01_MTL01__45094	OU100719976 / 6

DRAWN	AMJ	02/03/2021
CHECKED	SJM	03/03/2021
ENGINEER	AVG	02/03/2021
APPROVED	AG	06/03/2021
EMPLOYER		
SCALE	1:20, 1:30, 1:50, 1:75	A0

MANSOURAH - MASSARAH GOLD PROJECT
GENERAL ARRANGEMENT DRAWING
POWER DISTRIBUTION PROCESS PLANT SUBSTATION 02
LAYOUT & DETAIL OF GRADE SLAB & ELECTRICAL CONDUITS

DRAWING NUMBER: MD - 216 - 49PQ- EG - CV - GAD - 1631 | REV: D01