


DRAWING NUMBER MD-216-1800-EG-CV-GAD-1542 REV D01

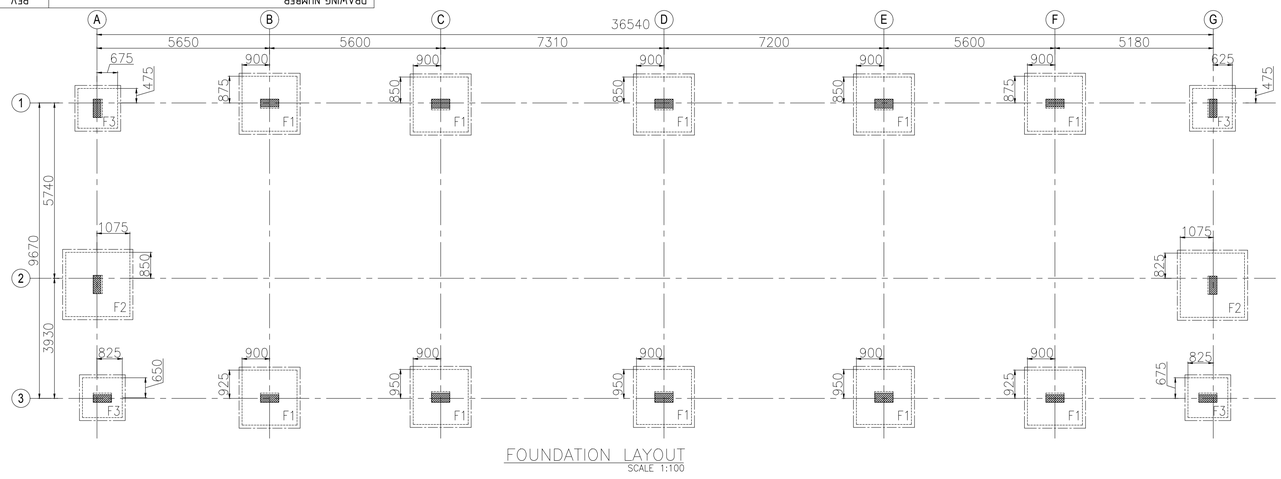

FOUNDATION LAYOUT
SCALE 1:100

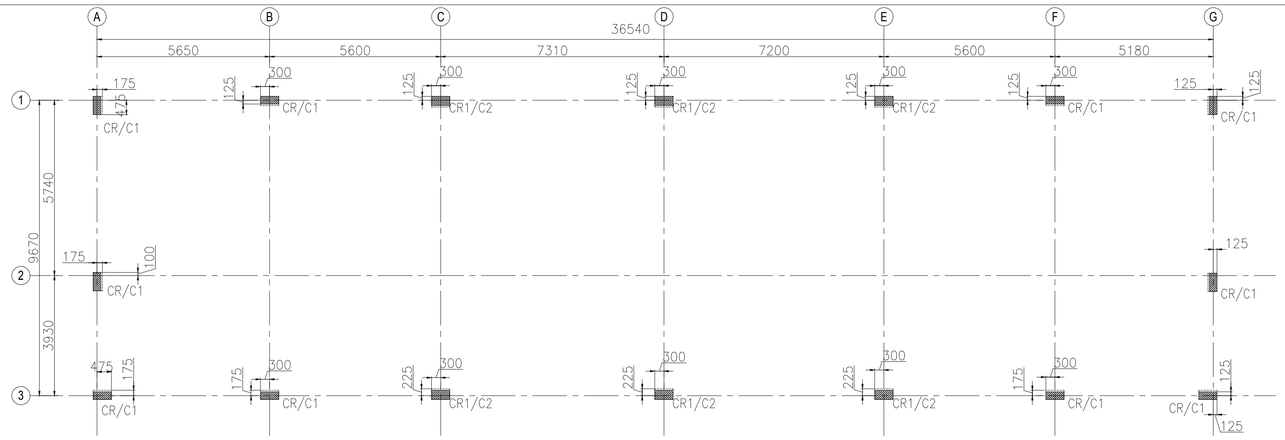

CONCRETE COLUMN LAYOUT
SCALE 1:100

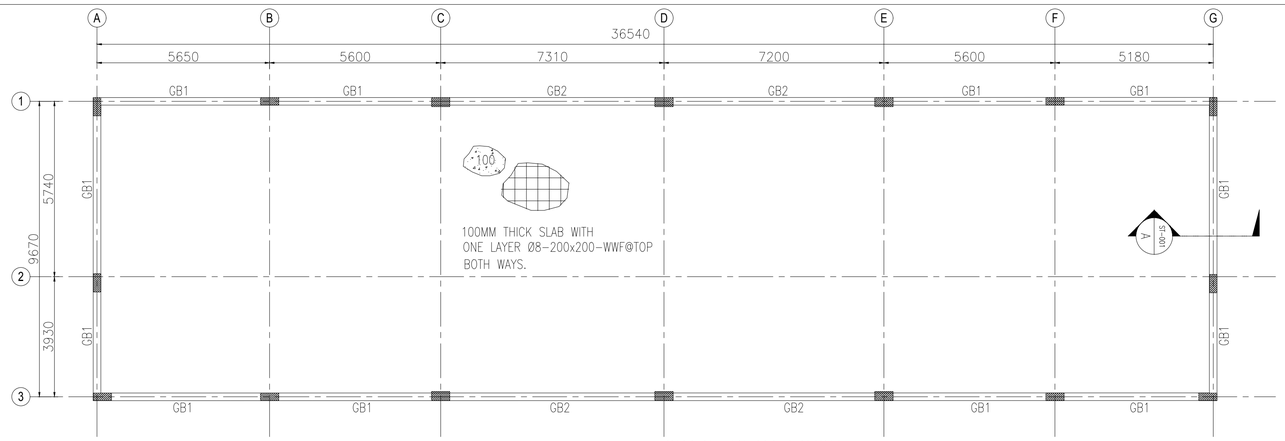


GRADE BEAM LAYOUT
SCALE 1:100

SCHEDULE OF FOOTINGS


FOOTING MARK	PLAIN CONCRETE			REINFORCED CONCRETE			BOTTOM REINFORCEMENT		TOP REINFORCEMENT		Ha	REMARKS
	L	W	T	L	W	T	SHORT BARS	LONG BARS	SHORT BARS	LONG BARS		
F1	2000	2000	50	1800	1800	400	Ø12@150	Ø12@150	–	–	1200	
F2	2300	2300	50	2100	2100	400	Ø12@150	Ø12@150	–	–	1200	
F3	1500	1500	50	1300	1300	400	Ø12@150	Ø12@150	–	–	1200	

SCHEDULE OF GRADE BEAMS


BEAM MARK	DIMENSIONS		STEEL REINFORCEMENT				STIRRUPS
			BOTTOM		TOP		
	WIDTH	DEPTH	STRAIGHT	ADD.	STRAIGHT	ADD.	
GB1	250	500	3Ø16	–	3Ø20	–	PROVIDE Ø10@150 AT THE END SPAN@DISTANCE OF L/3 FROM THE SUPPORT & Ø10@200 IN MID SPAN
GB2	250	600	3Ø20	–	3Ø20	–	




GB1 @ MIDSPAN
SCALE 1:10



GB1 @ ENDSPAN
SCALE 1:10




GB2 @ MIDSPAN
SCALE 1:10



GB2 @ ENDSPAN
SCALE 1:10

TYP SECTION FOR GRADE SLAB
SCALE 1:10

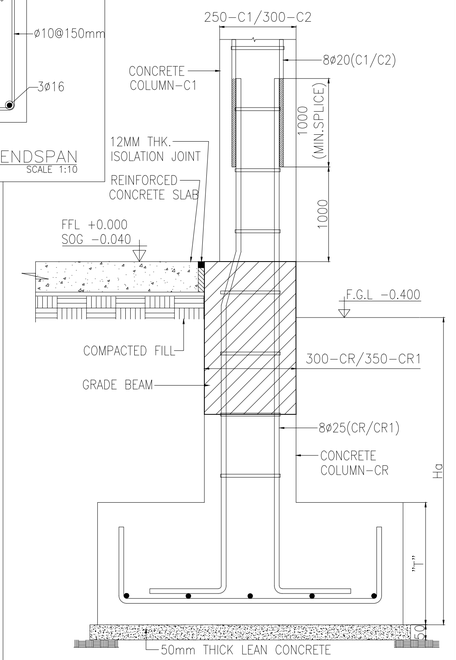



FOUNDATION SECTION
SCALE NTS

COLUMN DETAIL-CR/CR1
(TILL 'NECK')
SCALE 1:10

COLUMN DETAIL-C1/C2
SCALE 1:10

MASTER KEY PLAN

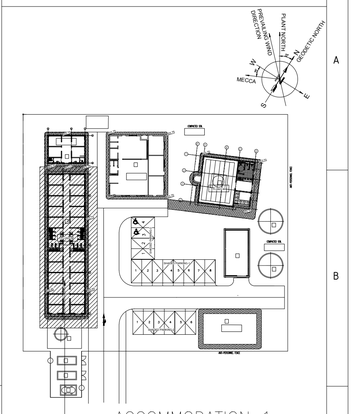

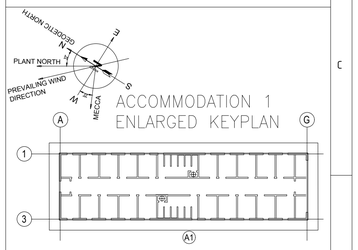

ACCOMMODATION 1			
BLDG. NO.	CORNER NO.	EASTING	NORTHING
A1	A1	E 262078.367	N 2508739.476
	G3	E 262089.529	N 2508703.364

NOTES

1. ALL DIMENSIONS ARE GIVEN IN MILLIMETRES AND ELEVATIONS ARE IN METRES UNLESS OTHERWISE NOTED.
2. MINIMUM REINFORCED CONCRETE GRADE TO BE USED FOR SUPERSTRUCTURE & SUBSTRUCTURES IS M35(5000 PSI).
3. MINIMUM LEAN CONCRETE GRADE TO BE USED FOR THE SUB-STRUCTURES IS M15(2175 PSI).
4. ALL REINFORCING STEEL SHALL BE DEFORMED BILLET STEEL BARS CONFORMING TO ASTM-A615, WITH MINIMUM YIELD STRENGTH OF FY420 MPA .
5. THE NET SOIL BEARING CAPACITY CONSIDERED IN FOUNDATION DESIGN IS 350 KPA.(REFER DOC 216-3000-EG-CV-RPT-1008).
6. WATER PROOFING INSULATION SHALL BE AS PER PROJECT SPECIFICATIONS & ITS MATERIAL TO BE APPROVED BY SITE ENGINEER.
7. THE MINIMUM CONCRETE COVER AS PER SBC-304-2018(TABLE 20.6.1.3.1) MEASURED FROM REBAR SHALL BE
   a. CONCRETE CAST AGAINST & PERMANENTLY EXPOSED TO EARTH (INCLUDING FOUNDATIONS OVER SUB-SLAB) FORMED CONCRETE EXPOSED TO EARTH OR WEATHER.....50MM
   b. CONCRETE NOT EXPOSED TO WEATHER NOR IN CONTACT WITH GROUND
      BEAMS, COLUMNS.....40MM
      SLABS, WALLS, JOISTS.....20MM
   c. CONCRETE SLAB OVER 50MM SUB-SLAB.....20MM
8. ALL DRAWINGS MUST BE READ IN CONJUNCTION WITH RELEVANT ARCHITECTURAL AND ENGINEERING DRAWINGS RELATED TO THE SAME SHEET AND ANY ITEM ON IT .
9. F.F.L +0.00 MENTIONED IS EQUIVALENT TO RL 923.90 AS PER THE CIVIL DRAWING MD-216-1800-EG-CV-GAD-1565-OVERALL LAYOUT PLAN.

LEGEND/ABBREVIATIONS

F-FOUNDATION
C-COLUMN
FFL-FINISH FLOOR LVL
FGL-FINISH GRADE LVL
TOS-TOP OF SCREED
WWF-WELDED WIRE FABRIC
HCS-HOLLOW CORE SLAB
GB-GRADE BEAM
IJ-ISOLATION JOINT
CJ-CONTROL JOINT
GA-GALVANIZED
S.O.G-SLAB ON GRADE
ARCH-ARCHITECTURAL
HOR.-HORIZONTAL
REINF.-REINFORCEMENT
LVL.-LEVEL
RL-REDUCED LEVEL

DOCUMENT NUMBER	REFERENCE DOCUMENTS	REV	DATE	REVISION DESCRIPTION	DRN	CHK	ENG	APP	EMP
MD-216-6000-EG-CV-STD-1002	HOLLOW CORE SLAB STANDARD								
MD-216-6000-EG-CV-STD-1001	REINFORCEMENT STANDARD	D01	05/05/2023	AS - BUILT	--	AVG	--	SJM	
MD-216-1800-EG-AR-GAD-3152	BUILDING PLANS	C01	01/06/2020	ISSUED FOR CONSTRUCTION	--	AVG	--	SJM	
MD-216-1800-EG-CV-GAD-1565	OVERALL LAYOUT PLAN	A01	23/03/2020	ISSUED FOR APPROVAL	--	AVG	--	SJM	

DESIGNER: مكتب الخليج للاستشارات الهندسية الخبر، المملكة العربية السعودية
GULF CONSULT ARCHITECTS AND ENGINEERS

	DATE	DRAWN	CHECKED	APPROVED
	18/03/2020	MAH	MF	
	19/03/2020			
	20/03/2020			FK

DRAWING NUMBER ACCO-1-ST-001 REVISION 0

LARSEN & TOUBRO DRAWING NUMBER 019045_900_C_G_24243_001 REVISION 2

OUTOTEC DRAWING NUMBER 900707__GAU01__AN02__MTL01__18031 DOCUMENT ID OU100668737 REVISION 2

LARSEN & TOUBRO
This drawing is the property of LARSEN & TOUBRO and must not be passed on to any person or body not authorized by us to receive it nor be copied or otherwise made use either in full or in part by such person or body without our prior permission in writing.

Outotec
The content of these documents are the sole property of Outotec Oy). Any rights not expressly granted herein are reserved. Reproduction, transfer or distribution of part or all of the contents in any form without prior written permission of Outotec is prohibited.

MA'ADEN معادن
Saudi Arabian Mining Company شركة معادن العربية السعودية
This document and the information contained herein is Ma'aden proprietary know-how. This document or any part thereof should not be reproduced, stored in a retrieval system or transmitted by any means, electronic or otherwise, or divulged without prior written permission of Ma'aden.

DRAWN	--	--	MANSOURAH - MASSARAH GOLD PROJECT
CHECKED	AVG	22/03/2020	GENERAL ARRANGEMENT
ENGINEER	--	--	SECURITY BASE CAMP: ACCOMMODATION 1
APPROVED	SJM	23/03/2020	LAYOUT & DETAILS OF FDN, COL & GRADE BEAM
EMPLOYER			
SCALE 1:100		A1	DRAWING NUMBER MD-216-1800-EG-CV-GAD-1542 REV D01