


DRAWING NUMBER: MD-216-1800-EG-CV-GAD-1546
REV: D01

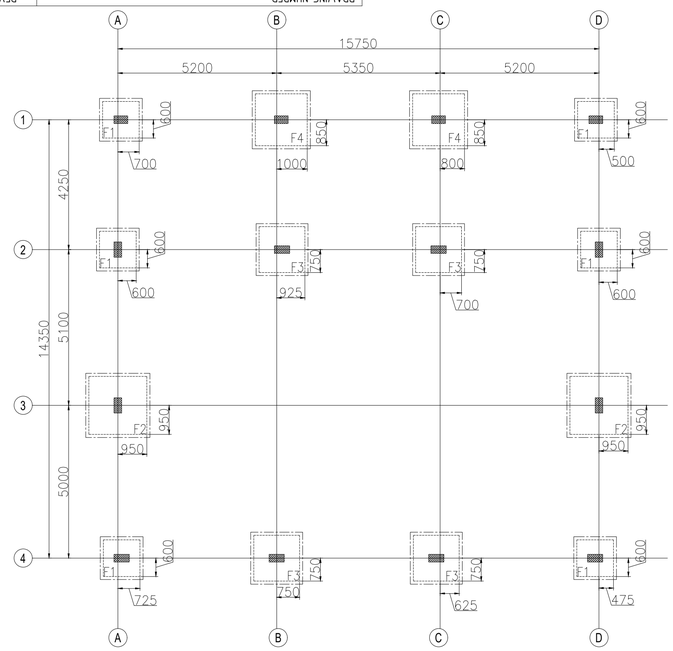


FOUNDATION LAYOUT
SCALE 1:100

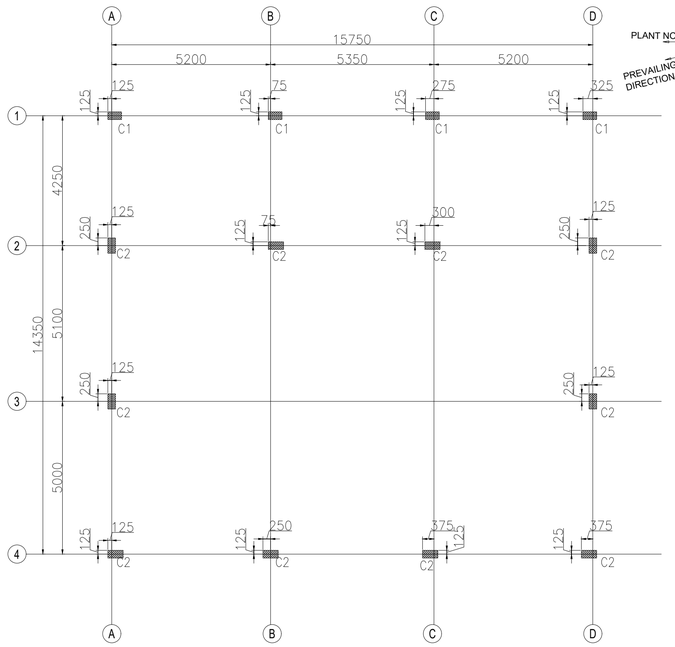


CONCRETE COLUMN LAYOUT
SCALE 1:100



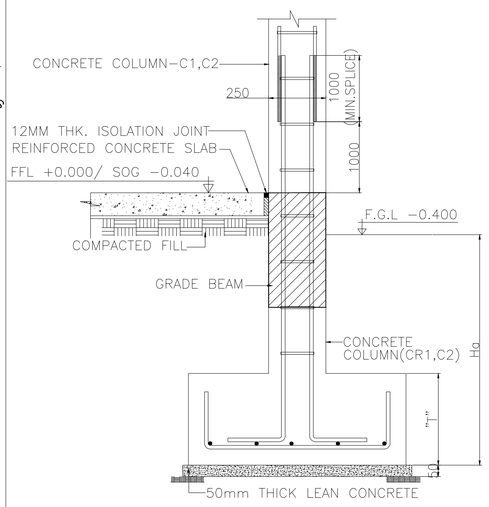


FOUNDATION SECTION
SCALE NTS


MASTER KEY PLAN

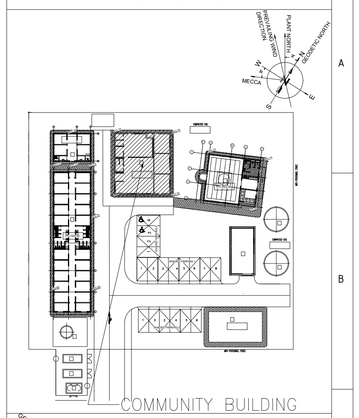


COMMUNITY BUILDING
ENLARGED KEYPLAN




ACCOMMODATION 2			
BLDG. NO.	CORNER NO.	EASTING	NORTHING
A2	A1	E 262091.9004	N 2508759.8567
	D4	E 262088.0790	N 2508738.8952

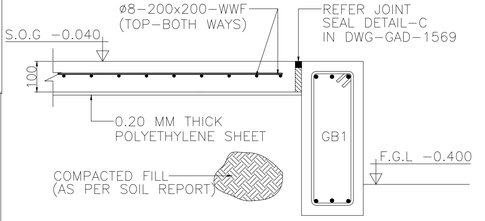


TYP SECTION FOR GRADE SLAB
SCALE 1:10

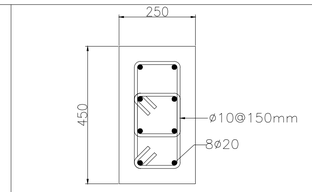

COLUMN DETAIL-C1
SCALE 1:10

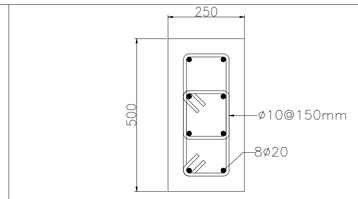

COLUMN DETAIL-C2
SCALE 1:10

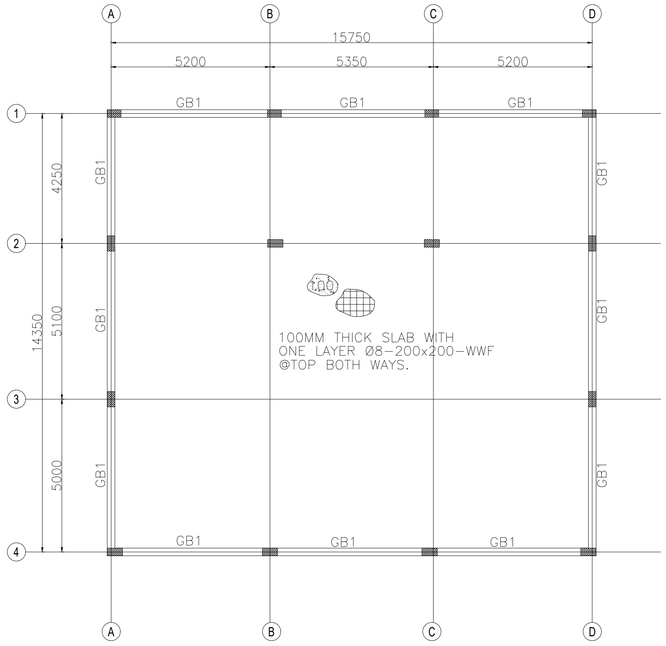


GRADE BEAM LAYOUT
SCALE 1:100

SCHEDULE OF FOOTINGS


FOOTING MARK	LEAN CONCRETE			REINFORCED CONCRETE			BOTTOM REINFORCEMENT		TOP REINFORCEMENT		Ha	REMARKS
	L	W	T	L	W	T	SHORT BARS	LONG BARS	SHORT BARS	LONG BARS		
F1	1400	1400	50	1200	1200	400	ø12@150	ø12@150	-	-	1200	
F2	2100	2100	50	1900	1900	400	ø12@150	ø12@150	-	-	1200	
F3	1700	1700	50	1500	1500	400	ø12@150	ø12@150	-	-	1200	
F4	1900	1900	50	1700	1700	400	ø12@150	ø12@150	-	-	1200	

SCHEDULE OF GRADE BEAMS

BEAM MARK	DIMENSIONS		STEEL REINFORCEMENT					STIRRUPS	REMARKS
			BOTTOM		TOP		SIDE BAR EACH FACE		
	WIDTH	DEPTH	STRAIGHT	ADD.	STRAIGHT	ADD.			
GB1	250	500	3ø16	-	3ø16	-	-	PROVIDE ø10@200 AT THE @DISTANCE OF L/3 FROM THE SUPPORT IN END SPAN & ø10@250 IN THE MID SPAN	



GB1 @ ENDSPAN
SCALE 1:10



GB1 @ MIDSPAN
SCALE 1:10

NOTES

1.) ALL DIMENSIONS ARE GIVEN IN MILLIMETRES AND ELEVATIONS ARE IN METRES UNLESS OTHERWISE NOTED.
2.) MINIMUM REINFORCED CONCRETE GRADE TO BE USED FOR SUPERSTRUCTURE & SUBSTRUCTURES IS C35(5000 PSI).
3.) MINIMUM LEAN CONCRETE GRADE TO BE USED FOR THE SUB-STRUCTURES IS C15(2175 PSI).
4.) ALL REINFORCING STEEL SHALL BE DEFORMED BILLET STEEL BARS CONFORMING TO ASTM-A615, WITH MINIMUM YIELD STRENGTH OF FY420 MPA .
5.) THE NET SOIL BEARING CAPACITY CONSIDERED IN FOUNDATION DESIGN IS 350 KPA.(REFER DOC 216-3000-EG-CV-RPT-1008).
6.) WATER PROOFING INSULATION SHALL BE AS PER PROJECT SPECIFICATIONS & ITS MATERIAL TO BE APPROVED BY ENGINEER @SITE.
7.) THE MINIMUM CONCRETE COVER AS PER SBC-304-2018(TABLE 20.6.1.3.1) MEASURED FROM REBAR SHALL BE
   a) CONCRETE CAST AGAINST & PERMANENTLY EXPOSED TO EARTH (INCLUDING FOUNDATIONS OVER SUB-SLAB) FORMED CONCRETE EXPOSED TO EARTH OR WEATHER.....50MM
   b.) CONCRETE NOT EXPOSED TO WEATHER NOR IN CONTACT WITH GROUND
   BEAMS, COLUMNS.....40MM
   SLABS, WALLS ,JOISTS.....20MM
   c.) CONCRETE SLAB OVER 50MM SUB-SLAB.....20MM
8.) ALL DRAWINGS MUST BE READ IN CONJUNCTION WITH RELEVANT ARCHITECTURAL AND ENGINEERING DRAWINGS RELATED TO THE SAME SHEET AND ANY ITEM ON IT.
9.) F.F.L +0.00 MENTIONED IS EQUIVALENT TO RL 923.90 AS PER THE CIVIL DRAWING MD-216-1800-EG-CV-GAD-1565-OVERALL LAYOUT PLAN.

F-FOUNDATION
C-COLUMN
FFL-FINISH FLOOR LVL
FGL-FINISH GROUND LVL
TOS-TOP OF SCREED
WWF-WELDED WIRE FABRIC
HCS-HOLLOW CORE SLAB
GB-GRADE BEAM
IJ-ISOLATION JOINT
CJ-CONTROL JOINT
GA-GALVANIZED
S.O.G-SLAB ON GRADE
ARCH-ARCHITECTURAL
HOR.-HORIZONTAL
REINF.-REINFORCEMENT
LVL.-LEVEL
RL-REDUCED LEVEL

DOCUMENT NUMBER	REFERENCE DOCUMENTS	REV	DATE	REVISION DESCRIPTION	DRN	CHK	ENG	APP	EMP
MD-216-6000-EG-CV-STD-1002	HOLLOW CORE SLAB STANDARD								
MD-216-6000-EG-CV-STD-1001	REINFORCEMENT STANDARD	D01	05/05/2023	AS - BUILT	--	AVG	--	SJM	
MD-216-1800-EG-AR-GAD-3152	BUILDING PLANS	C01	03/06/2020	ISSUED FOR CONSTRUCTION	--	AVG	--	SJM	
MD-216-1800-EG-CV-GAD-1565	OVERALL LAYOUT PLAN	A01	31/03/2020	ISSUED FOR APPROVAL	--	AVG	--	SJM	

DESIGNER:
مكتب الخليج للاستشارات الهندسية
الخبر، المملكة العربية السعودية
GULF CONSULT
ARCHITECTS AND ENGINEERS

DRAWING NUMBER					REVISION
ACCO-2-ST-001					0
DATE	27/03/2020	DATE	28/03/2020	DATE	29/03/2020
DRAWN	MAH	CHECKED	MF	APPROVED	FK

LARSEN & TOUBRO DRAWING NUMBER		REVISION
019045_900_C_G_24247_001		2
OUTOTEC DRAWING NUMBER	DOCUMENT ID	REVISION
900707__GAU01__AN02__MTL01__18029	0U100668735	2

LARSEN & TOUBRO
This drawing is the property of LARSEN & TOUBRO and must not be passed on to any person or body not authorized by us to receive it nor be copied or otherwise made use either in full or in part by such person or body without our prior permission in writing.

Outotec
The content of these documents are the sole property of Outotec Oyj. Any rights not expressly granted herein are reserved. Reproduction, transfer or distribution of part or all of the contents in any form without prior written permission of Outotec is prohibited.

MA'ADEN معادن
Saudi Arabian Mining Company شركة التعدين العربية السعودية
This document and the information contained herein is Ma'aden proprietary know-how. This document or any part thereof should not be reproduced, stored in a retrieval system or transmitted by any means, electronic or otherwise, or divulged without prior written permission of Ma'aden.

DRAWN	--	--
CHECKED	AVG	30/03/2020
ENGINEER	--	--
APPROVED	SJM	31/03/2020
EMPLOYER		
SCALE	1:100	A1

MANSOURAH - MASSARAH GOLD PROJECT
GENERAL ARRANGEMENT
SECURITY BASE CAMP: COMMUNITY BUILDING
LAYOUT & DETAILS OF FDN, COL & GRADE BEAM

DRAWING NUMBER: MD-216-1800-EG-CV-GAD-1546
REV: D01