

DETAIL OF PEDESTAL MKD. P11 & P12
(SCALE 1:25)


(49W1-PMP-045 & 49W1-PMP-046)

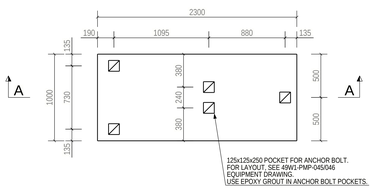


SECTION : A - A
(SCALE 1:25)

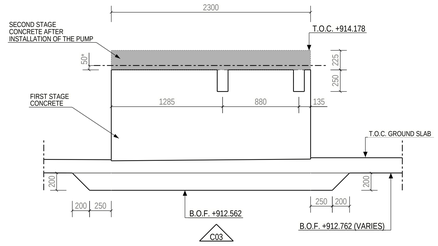


R.C.C. DETAIL OF PEDESTAL MKD. P11 & P12
(SCALE 1:25)

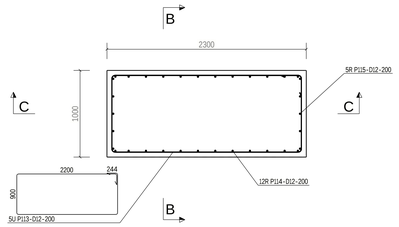

SECTION : B - B
(SCALE 1:25)

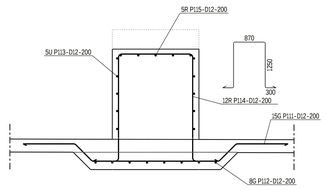


SECTION : C - C
(SCALE 1:25)

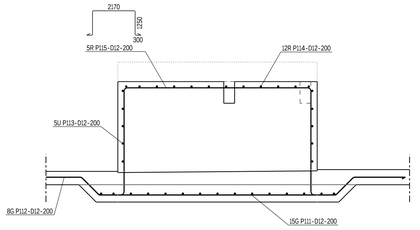


C02 C02 C02 C02

DETAIL OF PEDESTAL MKD. P15, P16, P17, P18, P19 & P20
(SCALE 1:25)


(49W1-PMP-009, 49W1-PMP-010, 49W1-PMP-011, 49W1-PMP-012,
49W1-PMP-001 & 49W1-PMP-002)

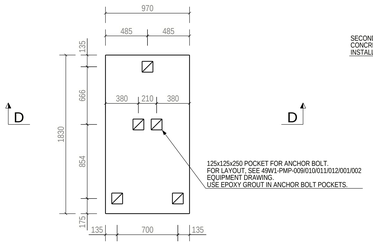


SECTION : D - D
(SCALE 1:25)

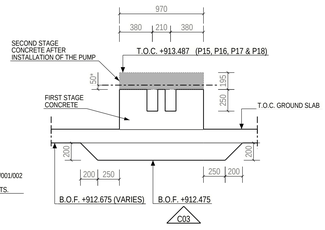


SECTION : D - D
(SCALE 1:25)

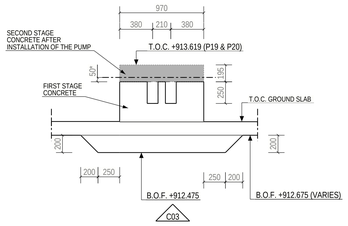


R.C.C. DETAIL OF PEDESTAL MKD. P15, P16, P17, P18, P19 & P20
(SCALE 1:25)



SECTION : E - E
(SCALE 1:25)

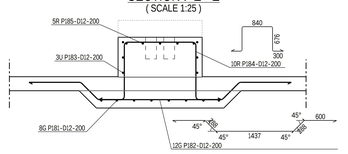


SECTION : F - F
(SCALE 1:25)

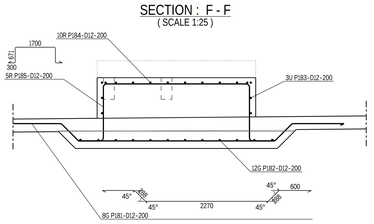


DETAIL OF PEDESTAL MKD. P21, P22, P23 & P24
(SCALE 1:25)


(49W1-PMP-007, 49W1-PMP-008, 49W1-PMP-005 & 49W1-PMP-006)

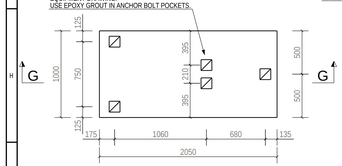


SECTION : G - G
(SCALE 1:25)

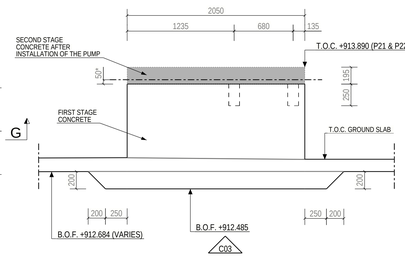


SECTION : G - G
(SCALE 1:25)

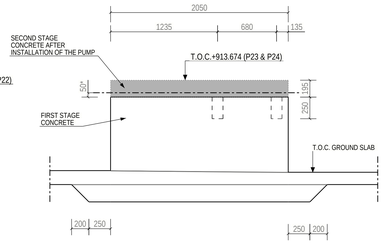


R.C.C. DETAIL OF PEDESTAL MKD. P21, P22, P23 & P24
(SCALE 1:25)

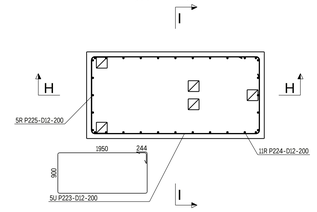

SECTION : H - H
(SCALE 1:25)

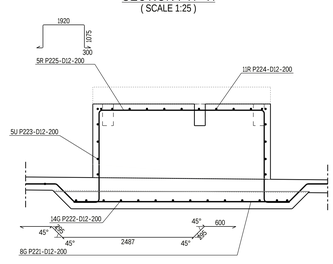


SECTION : I - I
(SCALE 1:25)

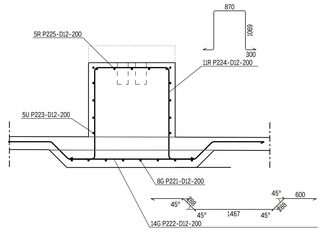


DETAIL OF PEDESTAL MKD. P13 & P14
(SCALE 1:25)


(49W1-PMP-029 & 49W1-PMP-030)

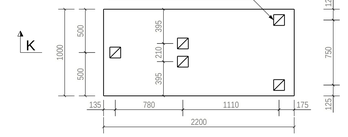


SECTION : K - K
(SCALE 1:25)

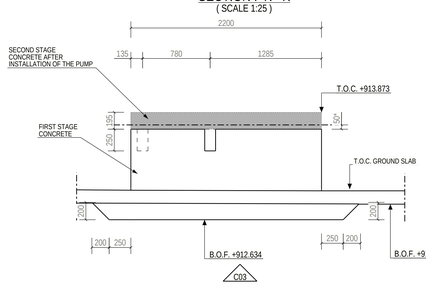


R.C.C. DETAIL OF PEDESTAL MKD. P13 & P14
(SCALE 1:25)



SECTION : M - M
(SCALE 1:25)



SECTION : L - L
(SCALE 1:25)

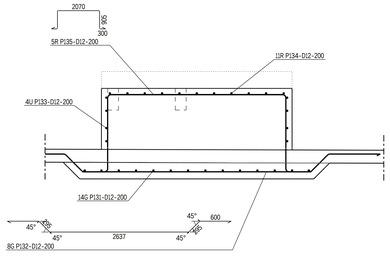

CONCRETE INFORMATION

Concretes used	C35
Concrete cover 1	50x10mm

REINFORCING BAR LIST

CAST UNIT CODE: P11 PCS: 1

REINFORCING BARS TYPE	POS	PCS	GRADE	D [mm]	L [mm]	dL [mm]	WEIGHT SUM [kg]	BENDING DIMENSIONS [mm] a	b	c	d	e	u	v	x	TD	COMMENT
G	P111	15	B500B	12	3210		42.8	600	288	1467	288	600	45	45	214	60	
G	P112	8	B500B	12	4490		32.0	600	295	2737	295	600	45	45	219	60	
U	P113	5	B500B	12	6530		29.0	244	2200	900	2200	900				60	
R	P114	12	B500B	12	3850		41.0	300	1250	870	1250	300				60	
R	P115	5	B500B	12	5150		22.9	300	1250	2170	1250	300				60	

REINFORCING BAR TOTAL WEIGHT [kg] 167.7

REINFORCING BAR LIST

CAST UNIT CODE: P13 PCS: 1

REINFORCING BARS TYPE	POS	PCS	GRADE	D [mm]	L [mm]	dL [mm]	WEIGHT SUM [kg]	BENDING DIMENSIONS [mm] a	b	c	d	e	u	v	x	TD	COMMENT
G	P131	14	B500B	12	3210		40.0	600	288	1467	288	600	45	45	214	60	
G	P132	8	B500B	12	4390		31.3	600	295	2637	295	600	45	45	219	60	
U	P133	4	B500B	12	6350		22.6	250	2100	900	2100	900				60	
R	P134	11	B500B	12	3150		30.8	300	900	870	900	300				60	
R	P135	5	B500B	12	4360		19.4	300	905	2070	905	300				60	

REINFORCING BAR TOTAL WEIGHT [kg] 143.9

REINFORCING BAR LIST

CAST UNIT CODE: P18 PCS: 1

REINFORCING BARS TYPE	POS	PCS	GRADE	D [mm]	L [mm]	dL [mm]	WEIGHT SUM [kg]	BENDING DIMENSIONS [mm] a	b	c	d	e	u	v	x	TD	COMMENT
G	P181	8	B500B	12	4010		28.5	600	288	2270	288	600	45	45	214	60	
G	P182	12	B500B	12	3180		33.9	600	288	1437	288	600	45	45	214	60	
U	P183	3	B500B	12	5530		14.8	244	1730	870	1730	870				60	
R	P184	10	B500B	12	2670		23.7	300	676	840	676	300				60	
R	P185	5	B500B	12	3520		15.6	300	671	1700	671	300				60	

REINFORCING BAR TOTAL WEIGHT [kg] 116.6

REINFORCING BAR LIST

CAST UNIT CODE: P22 PCS: 1

REINFORCING BARS TYPE	POS	PCS	GRADE	D [mm]	L [mm]	dL [mm]	WEIGHT SUM [kg]	BENDING DIMENSIONS [mm] a	b	c	d	e	u	v	x	TD	COMMENT
G	P221	8	B500B	12	4240		30.2	600	295	2487	295	600	45	45	219	60	
G	P222	14	B500B	12	3210		40.0	600	288	1467	288	600	45	45	214	60	
U	P223	5	B500B	12	6030		26.8	244	1950	900	1950	900				60	
R	P224	11	B500B	12	3480		34.1	300	1069	870	1069	300				60	
R	P225	5	B500B	12	4550		20.2	300	1075	1920	1075	300				60	

REINFORCING BAR TOTAL WEIGHT [kg] 151.3

REINFORCEMENT BENDING SHAPES:




* NOMINAL DISTANCE BETWEEN FIRST STAGE CONCRETE AND BOTTOM OF PUMP 50mm

LEGEND:
R.L - REDUCED LEVEL
T.O.C. - TOP OF CONCRETE
B.O.F. - BOTTOM OF FOUNDATION
F.G.L. - FINISHED GROUND LEVEL
P.C.C. - PLAIN CEMENT CONCRETE
TYP - TYPICAL
MKD - MARKED
CL - CENTER LINE
BOTTOM REINF. (B)
TOP REINF. (T)
SBC - SAFE BEARING CAPACITY
MIN. - MINIMUM
REF. - REFERED
GA - GENERAL ARRANGEMENT
DWG. - DRAWING
R.C.C. - REINFORCED CEMENT CONCRETE

NOTES:
1. ALL DIMENSIONS ARE IN MILLIMETRES AND LEVELS ARE IN METRES UNLESS OTHERWISE STATED
2. GRADE OF CONCRETE SHALL BE C35 (35MPa) UNLESS NOTED OTHERWISE & C15 (15MPa) FOR BLINDING CONCRETE
3. GRADE OF REINFORCEMENT SHALL BE DEFORMED BAR ASTM A615-GRADE 60 (fy=420MPa)
4. CLEAR COVER TO MAIN REINFORCEMENT SHALL BE AS FOLLOWS:
a) FOUNDATION: 75 mm (BOTTOM & SIDE)
b) FOUNDATION: 50 mm (TOP)
c) COLUMN & PEDESTAL: 50 mm
5. MINIMUM LAP LENGTHS OF REINFORCEMENT SHALL BE 40XBAR DIAMETER
6. FOR STANDARD REINFORCEMENT DETAILS & GENERAL NOTES FOR CIVIL WORKS REFER TO DRAWING NUMBER MD-216-1000-EG-CV-DED-1005 & 1001
7. ANCHOR BOLTS AND EMBEDDED STEELWORK SHALL BE HOT DIP GALVANIZED
8. T.O.C. & TOP OF SCREED TOLERANCE SHALL BE WITHIN +/- 10MM OF DESIGN LEVEL
9. NET SAFE BEARING CAPACITY OF SOIL AT BOTTOM OF FOUNDATION IS CONSIDERED AS 375 KN/SQ.M.
10. REBARS CAN BE MOVED LOCALLY BY +/- 25mm TO AVOID INTERFERENCE WITH EMBEDDED PARTS

KEYPLAN

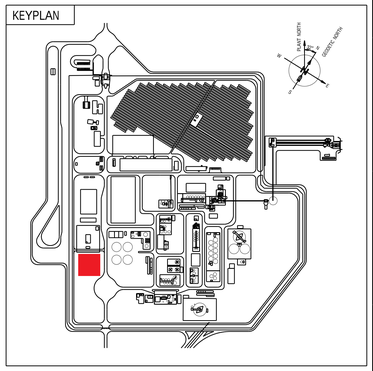

DOCUMENT NUMBER	REFERENCE DOCUMENTS
MD-216-49W1-EG-CV-DED-1017	EQUIPMENT FOUNDATION PUMPS 1
MD-216-49W1-EG-CV-DED-1004	SAND FILTER BOTTOM SLAB REINFORCEMENT DRAWING
MD-216-49W1-EG-CV-GAD-1003	1-10/A-E GENERAL ARRANGEMENT DRAWING
MD-216-49W1-EG-CV-GAD-1001	1-8/E-J GENERAL ARRANGEMENT DRAWING

DOCUMENT NUMBER	REFERENCE DOCUMENTS
MD-216-49WG-EG-CV-CAL-1002	SAND FILTER AND DISTRIBUTION BOX CALCULATION REPORT
MD-216-49WG-EG-CV-DED-1003	SAND FILTER AND DISTRIBUTION BOX DIMENSIONAL DRAWING
MD-216-49WG-EG-CV-GAD-1002	7-12/D-J GENERAL ARRANGEMENT DRAWING

REV	DATE	REVISION DESCRIPTION	DRN	CHK	ENG	APP	EMP
D01	29.01.2024	AS-BUILT	JonRen	MauNot	LuiRz	SouCha	
C03	19.01.2022	B.O.F ADDED	JonRen	MauNot	LuiRz	SouCha	
C02	10.01.2022	COVER THICKNESS UPDATED, HOLD REMOVED	JonRen	MauNot	LuiRz	SouCha	
C01	08.12.2021	ISSUED FOR CONSTRUCTION	AbdDus	MauNot	LuiRz	SouCha	
A01	05.11.2021	ISSUED FOR APPROVAL	AbdDus	MauNot	LuiRz	SouCha	

RESERVED FOR VENDOR LOGO AND DRAWING NUMBER

LARSEN & TOUBRO

This drawing is the property of LARSEN & TOUBRO and must not be passed on to any person or body not authorized by us to receive it or be copied or otherwise made use either in full or in part by such person or body without our prior permission in writing.

Outotec

The content of these documents are the sole property of Outotec Oy. Any rights not expressly granted herein are reserved. Reproduction, transfer or distribution of part or all of the contents in any form without prior written permission of Outotec is prohibited.

MA'ADEN معادن Saudi Arabian Mining Company شركة معادن العربية السعودية

This document and the information contained herein is Ma'aden proprietary know-how. This document or any part thereof should not be reproduced, stored in a retrieval system or transmitted by any means, electronic or otherwise, or divulged without prior written permission of Ma'aden.

LARSEN & TOUBRO DRAWING NUMBER	O19045_080_C_D_24892_017	REVISION 4
OUTOTEC DRAWING NUMBER	900707_GAU01_AG11_CTB01_49017	DOCUMENT ID 0U100734782 / REVISION 4
DRAWN	AbdDus	05.11.2021
CHECKED	MauNot	05.11.2021
ENGINEER	NanWu	05.11.2021
APPROVED	LuiRz	05.11.2021
EMPLOYER		
SCALE	1:25	A0

MANSOURAH - MASSARAH GOLD PROJECT
49W1 RAW WATER TREATMENT PLANT
EQUIPMENT FOUNDATION PUMPS 1
DETAIL AND REINFORCEMENT DRAWING

DRAWING NUMBER MD-216-49W1-EG-CV-DED-1017 REV D01