
DRAWING NUMBER: MD-216-4000-EG-CV-DED-1069 | REV: D01

SCHEDULE OF GRADE BEAMS


BEAM MARK	DIMENSIONS		STEEL REINFORCEMENT				SIDE BAR EACH FACE	STIRRUPS
			BOTTOM		TOP			
	WIDTH	DEPTH	STRAIGHT	ADD.	STRAIGHT	ADD.		
GB1	250	1200	3ø25	–	3ø25	–	5ø12	PROVIDE ø12@150 AT THE END SPAN & MID SPAN
GB2	250	500	3ø20	–	3ø20	–	–	PROVIDE ø10@200 AT DISTANCE OF L/3 IN END SPAN & ø10@200 IN THE MID SPAN
GB3	300	500	4ø16	–	4ø16	–	–	PROVIDE ø10@200 AT THE END SPAN & MID SPAN
GB4	250	1200	3ø25	–	3ø25	–	5ø12	PROVIDE ø12@150 AT THE END SPAN & MID SPAN

SCHEDULE OF FOOTINGS


FOOTING MARK	PLAIN CONCRETE			REINFORCED CONCRETE			BOTTOM REINFORCEMENT		TOP REINFORCEMENT		Ha	REMARKS
	L	W	T	L	W	T	SHORT BARS	LONG BARS	SHORT BARS	LONG BARS		
F1	1500	1500	50	1300	1300	400	ø12@150	ø12@150	–	–	1200	
F2	2500	2500	50	2300	2300	400	ø12@150	ø12@150	–	–	1200	
F3	2200	2200	50	2000	2000	400	ø12@150	ø12@150	ø10@150	ø10@150	1200	
F4	1900	1900	50	1700	1700	400	ø12@150	ø12@150	–	–	1200	
F5	1700	1700	50	1500	1500	400	ø12@150	ø12@150	–	–	1200	
F6	1200	1200	50	1000	1000	400	ø12@150	ø12@150	–	–	1200	
CF1	4700	3000	50	4500	2800	450	ø12@125	ø12@125	ø12@125	ø12@125	1200	
CF2	5650	4800	50	5450	4600	500	ø12@150	ø12@150	ø12@150	ø12@150	1200	SEE SECTION–Y@DED–1497

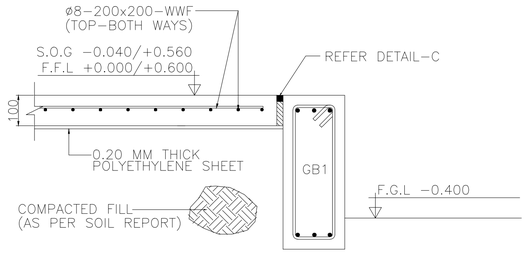

TYP SECTION FOR GRADE SLAB (A) SCALE 1:10 GAD–1512

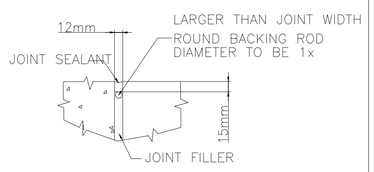


TYP JOINT SEAL DETAIL–C SCALE 1:10




PEDESTAL DETAIL–P1 SCALE 1:10

REFER SECTION–T@DWG DED–1500 FOR GROUT DETAILS.




COLUMN DETAIL–CX SCALE 1:10

CX START FROM GRADE BEAM & STOP UNDER FIRST DROP BEAM




GB2 DETAIL SCALE 1:10




COLUMN DETAIL–C5 SCALE 1:10


NOTE: FOR C3&C6 DETAILS, REFER DWG DED–1497

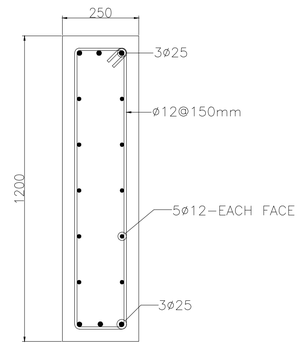

GB1/GB4 @ MIDSPAN & ENDSPAN SCALE 1:10




GB2 @ MIDSPAN SCALE 1:10




GB2 @ ENDSPAN SCALE 1:10


NOTE: FOR GB3 DETAILS, REFER DWG DED–1497




COLUMN DETAIL–C1 SCALE 1:10

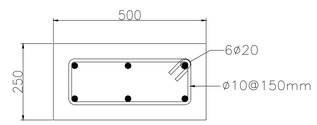

COLUMN DETAIL–C2 SCALE 1:10

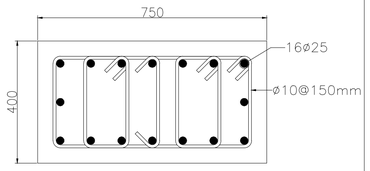

COLUMN DETAIL–C4 SCALE 1:10

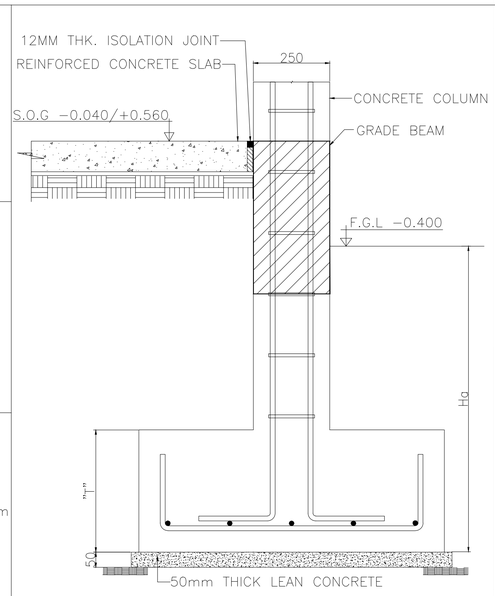

TYPICAL FOUNDATION SECTION SCALE 1:10

NOTES

1.) ALL DIMENSIONS ARE GIVEN IN MILLIMETRES AND ELEVATIONS ARE IN METRES UNLESS OTHERWISE NOTED.
2.) MINIMUM REINFORCED CONCRETE GRADE TO BE USED FOR SUPERSTRUCTURE & SUBSTRUCTURES IS M35(5000 PSI).
3.) MINIMUM LEAN CONCRETE GRADE TO BE USED FOR THE SUB–STRUCTURES IS M15(2175 PSI).
4.) ALL REINFORCING STEEL SHALL BE DEFORMED BILLET STEEL BARS CONFORMING TO ASTM–A615, WITH MINIMUM YIELD STRENGTH OF FY420 MPA .
5.) THE NET SOIL BEARING CAPACITY CONSIDERED IN FOUNDATION DESIGN IS 570 KPA(REFER DOC 216–3000–EG–CV–RPT–1008)
6.) WATER PROOFING INSULATION SHALL BE AS PER PROJECT SPECIFICATIONS & ITS MATERIAL TO BE APPROVED BY SITE ENGINEER.
7.) MINIMUM CONCRETE COVER AS PER SBC–304–2018(TABLE 20.6.1.3.1) MEASURED FROM REBAR SHALL BE.
   a) CONCRETE CAST AGAINST & PERMANENTLY EXPOSED TO EARTH (INCLUDING FOUNDATIONS OVER SUB–SLAB) FORMED CONCRETE EXPOSED TO EARTH OR WEATHER.....50MM
   b.) CONCRETE NOT EXPOSED TO WEATHER NOR IN CONTACT WITH GROUND
   BEAMS, COLUMNS.....40MM
   SLABS, WALLS, JOISTS.....20MM
   c.) CONCRETE SLAB OVER 50MM SUB–SLAB.....20MM
8.) ALL DRAWINGS MUST BE READ IN CONJUNCTION WITH RELEVANT ARCHITECTURAL AND ENGINEERING DRAWINGS RELATED TO THE SAME SHEET AND ANY ITEM ON IT.
9.) F.F.L +0.00 MENTIONED IS EQUIVALENT TO RL 915.400 AS PER THE CIVIL DRAWING MD–216–1000–EG–ME–PPD–1002.

LEGENDS
F–FOUNDATION
CR–COLUMN NECK
C–COLUMN
FFL–FINISH FLOOR LVL
FGL–FINISH GRUND LVL
TOS–TOP OF SCREED
WWF–WELDED WIRE FABRIC
HCS–HOLLOW CORE SLAB
GB–GRADE BEAM
IJ–ISOLATION JOINT
CJ–CONTROL JOINT
GA–GALVANIZED
S.O.G–SLAB ON GRADE
ARCH–ARCHITECTURAL
HOR.–HORIZONTAL
REINF.–REINFORCEMENT
LVL.–LEVEL
RL.–REDUCED LEVEL
P.–PEDESTAL
FDN.–FOUNDATION
COL.–COLUMN

DOCUMENT NUMBER	REFERENCE DOCUMENTS	REV	DATE	REVISION DESCRIPTION	DRN	CHK	ENG	APP	EMP
MD–216–4000–EG–CV–DED–1071	DETAILS OF MINARETE & MIHRAB								
MD–216–4000–EG–CV–DED–1073	DETAILS OF WALKWAY SHED & ROOF DOME								
MD–216–4000–EG–CV–DED–1070	DETAILS OF ROOF BEAMS & GRADE SLAB								
MD–216–4000–EG–CV–DED–1067	LAYOUT OF FDN, COL. & GRADE BEAM								
MD–216–4000–EG–CV–DED–1068	LAYOUT OF ROOF BEAMS & GRADE SLAB								
MD–216–4000–EG–AR–GAD–3018	BUILDING ELEVATIONS & SECTIONS								
MD–216–6000–EG–CV–STD–1002	HOLLOW CORE SLAB STANDARD								
MD–216–6000–EG–CV–STD–1001	REINFORCEMENT STANDARD	D01	24/05/2023	AS–BUILT	--	AVG	--	SJM	
MD–216–4000–EG–AR–GAD–3017	BUILDING PLANS	C01	13/06/2020	ISSUED FOR CONSTRUCTION	--	AVG	--	SJM	
MD–216–1000–EG–ME–PPD–1002	GENERAL PROCESS PLANT LAYOUT	A01	16/05/2020	ISSUED FOR APPROVAL	--	AVG	--	SJM	

DESIGNER: مكتب الخليج للاستشارات الهندسية, الخبر, المملكة العربية السعودية — GULF CONSULT ARCHITECTS AND ENGINEERS

DRAWING NUMBER					REVISION
MOSQ–ABLU–ST–003					1
DATE	10/05/2020	DATE	12/05/2020	DATE	13/05/2020
DRAWN	MAH	CHECKED	MF	APPROVED	FK

LARSEN & TOUBRO DRAWING NUMBER: 019045_900_C_D_24030_001 — REVISION: 2
OUTOTEC DRAWING NUMBER: 900707__GAU01__AN03__CTB17__40010 — DOCUMENT ID: OU100687078 — REVISION: 2

This drawing is the property of LARSEN & TOUBRO and must not be passed on to any person or body not authorized by us to receive it nor be copied or otherwise made use either in full or in part by such person or body without our prior permission in writing.

The content of these documents are the sole property of Outotec Oyj. Any rights not expressly granted herein are reserved. Reproduction, transfer or distribution of part or all of the contents in any form without prior written permission of Outotec is prohibited.

This document and the information contained herein is Ma'aden proprietary know-how. This document or any part thereof should not be reproduced, stored in a retrieval system or transmitted by any means, electronic or otherwise, or divulged without prior written permission of Ma'aden.

DRAWN	--	--	MANSOURAH – MASSARAH GOLD PROJECT
CHECKED	AVG	15/05/2020	DETAIL DRAWING
ENGINEER	--	--	PROCESS PLANT: MOSQUE AND ABLUTION
APPROVED	SJM	16/05/2020	DETAILS OF FDN, COL. & GRADE BEAM
EMPLOYER			
SCALE	1:100	A1	DRAWING NUMBER: MD–216–4000–EG–CV–DED–1069 — REV: D01