


DRAWING NUMBER MD-216-2500-EG-CV-GAD-2004 | REV D01

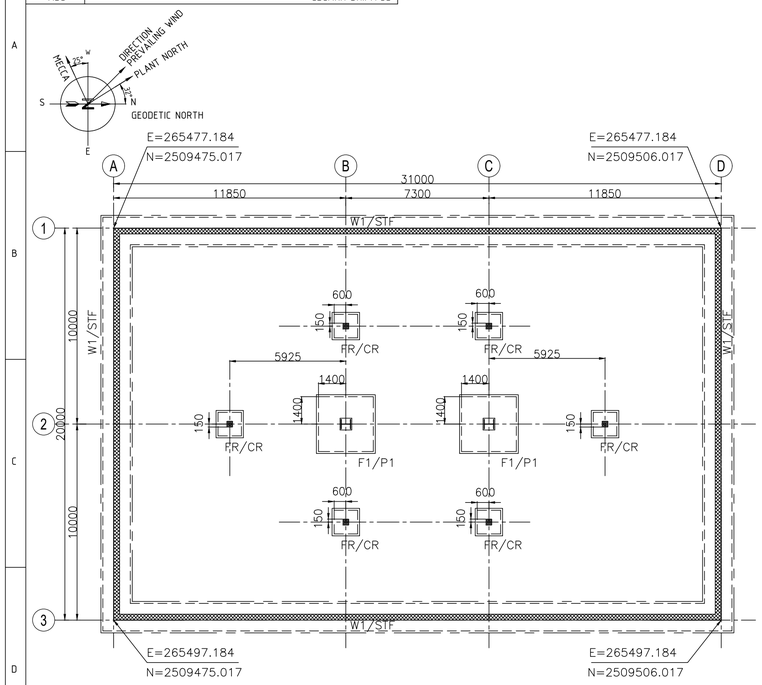


FOUNDATION LAYOUT
SCALE 1:150

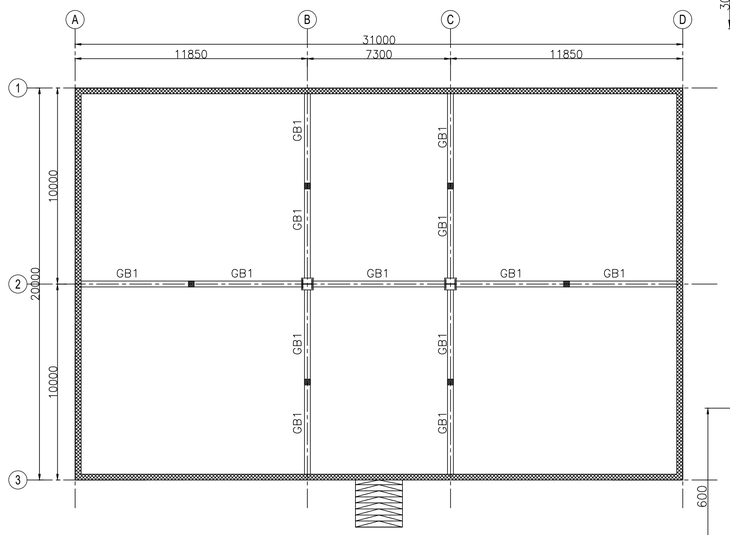


GRADE BEAM LAYOUT
SCALE 1:150

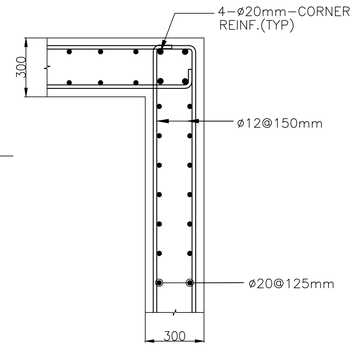

WALL CORNER REINF. DETAIL
SCALE: 1:100

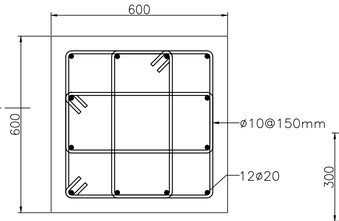


PEDESTAL DETAIL–P1
SCALE 1:50
(PROVIDE TOP '7' STIRRUPS @100mm C/C)



NECK COLUMN CR
SCALE 1:50
(STOP AT GRADE SLAB LVL,)

KEY PLAN

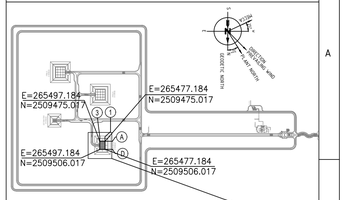

NOTES

1. ALL DIMENSIONS ARE GIVEN IN MILLIMETRES AND ELEVATIONS ARE IN METRES UNLESS OTHERWISE NOTED.
2. EL. (–) 0.300 CORRESPONDS TO RL.(+) 912.000 M (FGL)
3. MINIMUM REINFORCED CONCRETE GRADE TO BE USED FOR SUPERSTRUCTURE & SUBSTRUCTURES IS C35(5000 PSI).
4. MINIMUM LEAN CONCRETE GRADE TO BE USED FOR THE SUB–STRUCTURES IS C15(2175 PSI).
5. ALL REINFORCING STEEL SHALL BE DEFORMED BILLET STEEL BARS CONFORMING TO ASTM–A615, WITH MINIMUM YIELD STRENGTH OF FY420 MPA .
6. THE NET SOIL BEARING CAPACITY CONSIDERED IN FOUNDATION DESIGN IS 570 KPA(REFER DOC 216–3000–EG–CV–RPT–1008)
7. WATER PROOFING INSULATION SHALL BE AS PER PROJECT SPECIFICATIONS & ITS MATERIAL TO BE APPROVED BY SITE ENGINEER.
8. MINIMUM CONCRETE COVER AS PER SBC–304–2018(TABLE 20.6.1.3.1) MEASURED FROM REBAR SHALL BE
   a. CONCRETE CAST AGAINST & PERMANENTLY EXPOSED TO EARTH (INCLUDING FOUNDATIONS OVER SUB–SLAB) FORMED CONCRETE EXPOSED TO EARTH OR WEATHER.....50MM
   b. CONCRETE NOT EXPOSED TO WEATHER NOR IN CONTACT WITH GROUND
      BEAMS, COLUMNS.....40MM
      SLABS, WALLS, JOISTS.....20MM
   c. CONCRETE SLAB OVER 50MM SUB–SLAB.....20MM
9. ALL DRAWINGS MUST BE READ IN CONJUNCTION WITH RELEVANT ARCHITECTURAL AND ENGINEERING DRAWINGS RELATED TO THE SAME SHEET AND ANY ITEM ON IT(MD–216–2500–EG–CV–LAD–2001).
10. THE STEEL STRUCTURE DETAILS & MEMBER SIZES SHALL BE AS PER PEB VENDOR.BRACKET & CONNECTION DESIGN IS SUBJECT TO RECEVING REACTION FROM PES VENDOR.
11. ALL THE ROOF AND WALL OPENING SHALL BE FOLLOWED AS PER APPROVED ARCH. DRAWING.

LEGENDS


F/FDN.–FOUNDATION
FFL–FINISH FLOOR LEVEL
FGL–FINISH GROUND LEVEL
VER–VERTICAL
GB–GRADE BEAM
BW's–BOTH WAYS
S.O.G–SLAB ON GRADE
TYP–TYPICAL
HOR.–HORIZONTAL
REINF.–REINFORCEMENT
LVL.–LEVEL
P.–PEDESTAL
W1–CONCRETE WALL 300mm THICK
STF– STRIP FOOTING

SCHEDULE OF FOOTINGS


FOOTING MARK	PLAIN CONCRETE			REINFORCED CONCRETE			BOTTOM REINFORCEMENT		TOP REINFORCEMENT		Ha	REMARKS
	L	W	T	L	W	T	SHORT BARS	LONG BARS	SHORT BARS	LONG BARS		
F1	3000	3000	50	2800	2800	500	ø12@150	ø12@150	ø12@150	ø12@150	1200	
STF	SEE PLAN		50	SEE PLAN		500	ø12@150	ø12@150	ø12@150	ø12@150	1200	
FR	1400	1400	50	1200	1200	300	ø12@150	ø12@150	ø12@150	ø12@150	1200	

SCHEDULE OF GRADE BEAMS


BEAM MARK	DIMENSIONS		STEEL REINFORCEMENT				STIRRUPS
			BOTTOM		TOP		
	WIDTH	DEPTH	STRAIGHT	ADD.	STRAIGHT	ADD.	
GB1	300	750	3ø20	2ø20	3ø20	2ø20	PROVIDE ø10@150 AT END SPAN@DISTANCE OF L/3 FROM THE SUPPORT & ø10@200 AT MIDSPAN

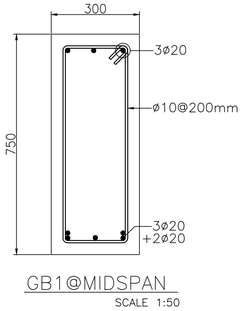

GB1@MIDSPAN
SCALE 1:50



GB1@ENDSPAN
SCALE 1:50

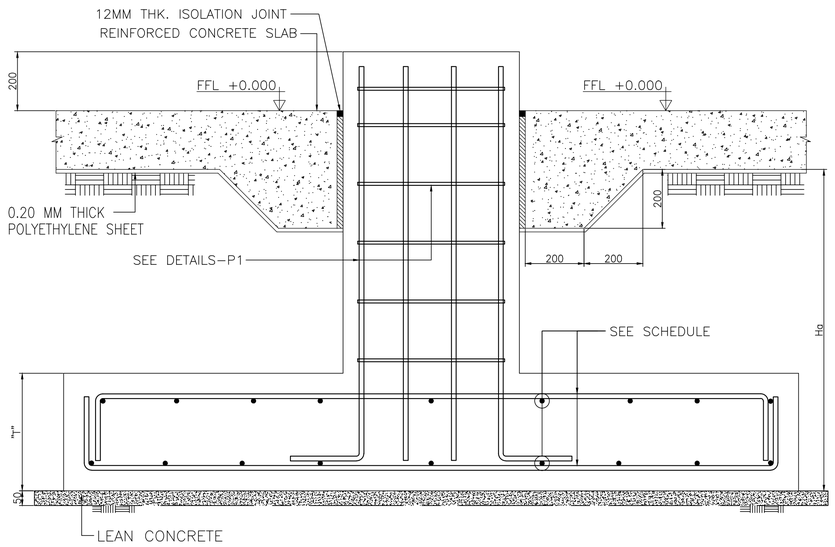

FOUNDATION SECTION X
SCALE 1:50

DOCUMENT NUMBER	REFERENCE DOCUMENTS	REV	DATE	REVISION DESCRIPTION	DRN	CHK	ENG	APP	EMP
		D01	13/06/2023	AS–BUILT	––	SNM	––	SJM	
		C01	08/11/2020	ISSUED FOR CONSTRUCTION	––	SNM	––	SJM	
		A02	08/10/2020	REVISED AS PER EMPLOYER COMMENTS ON 26/08/2020	––	SNM	––	SJM	
		A01	01/08/2020	ISSUED FOR APPROVAL	––	SNM	––	SJM	

ADVACON

LARSEN & TOUBRO
This drawing is the property of LARSEN & TOUBRO and must not be passed on to any person or body not authorized by us to receive it nor be copied or otherwise made use either in full or in part by such person or body without our prior permission in writing.

Outotec
The content of these documents are the sole property of Outotec Oyj. Any rights not expressly granted herein are reserved. Reproduction, transfer or distribution of part or all of the contents in any form without prior written permission of Outotec is prohibited.

MA'ADEN معادن
Saudi Arabian Mining Company شركة معادن العربية السعودية
This document and the information contained herein is Ma'aden proprietary know–how. This document or any part thereof should not be reproduced, stored in a retrieval system or transmitted by any means, electronic or otherwise, or divulged without prior written permission of Ma'aden.

DRAWING NUMBER	MD–216–1800–EG–CV–DDE–1015
REVISION	C01
DATE / DRAWN	05/11/2020 / ABDUL
DATE / CHECKED	07/11/2020 / LARA
DATE / APPROVED	08/11/2020 / IHAB
LARSEN & TOUBRO DRAWING NUMBER	019045_900_C_G_24454_001
REVISION	3
OUTOTEC DRAWING NUMBER	900707 _GAU01 _ZZ01 _MTL01 _25021
DOCUMENT ID	OU100691801
REVISION	3

DRAWN	D01	––
CHECKED	SNM	10/08/2020
ENGINEER	––	––
APPROVED	SJM	10/08/2020
EMPLOYER		
SCALE	AS SHOWN	A1

MANSOURAH – MASSARAH GOLD PROJECT
GENERAL ARRANGEMENT
EXPLOSIVE MAGAZINE
EXPLOSIVE STORAGE FOUNDATION DETAILS

DRAWING NUMBER MD – 216 – 2500 – EG– CV – GAD – 2004 | REV C01