


DRAWING NUMBER MD-216-1800-EG-CV-GAD-1570 REV D01

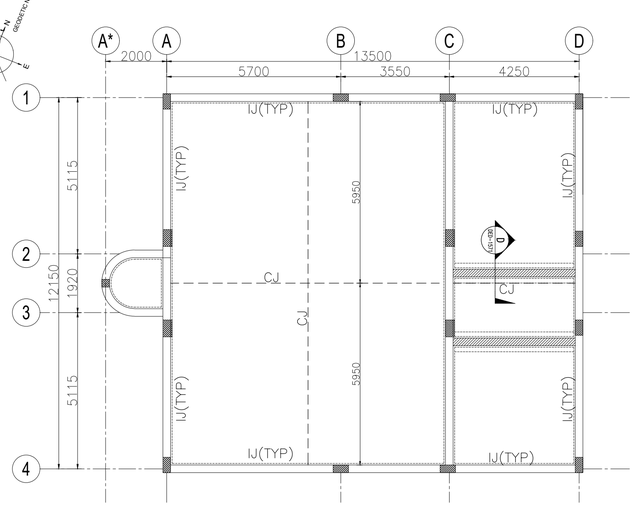


SLAB ON GRADE LAYOUT
SCALE 1:100

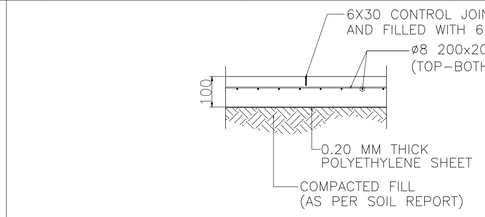


TYPICAL CONTROL JOINT DETAIL-B
SCALE 1:10

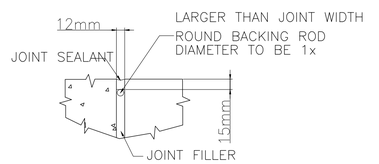


TYP JOINT SEAL DETAIL C
SCALE 1:10 GAD-1548

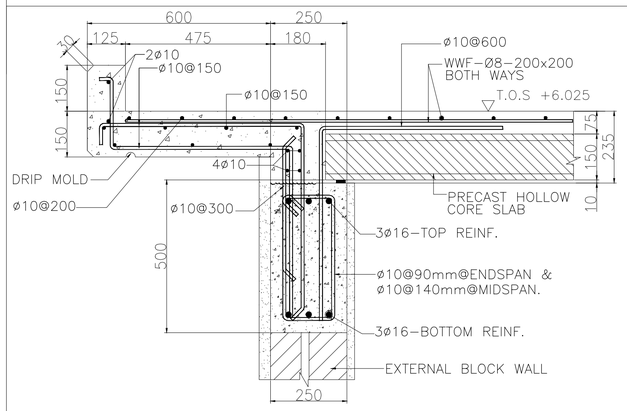


SECTION-Y (LB1)
SCALE 1:10

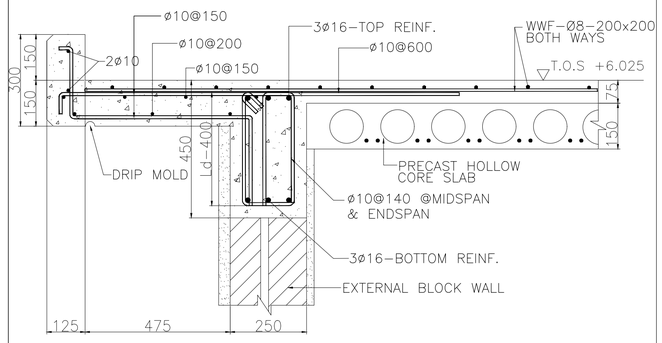


SECTION-X (B1)
SCALE 1:10

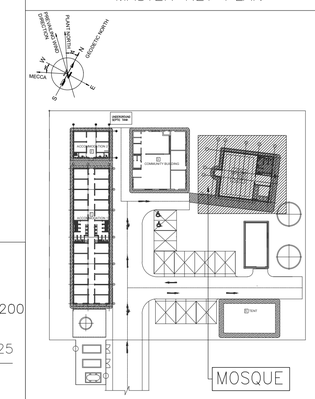




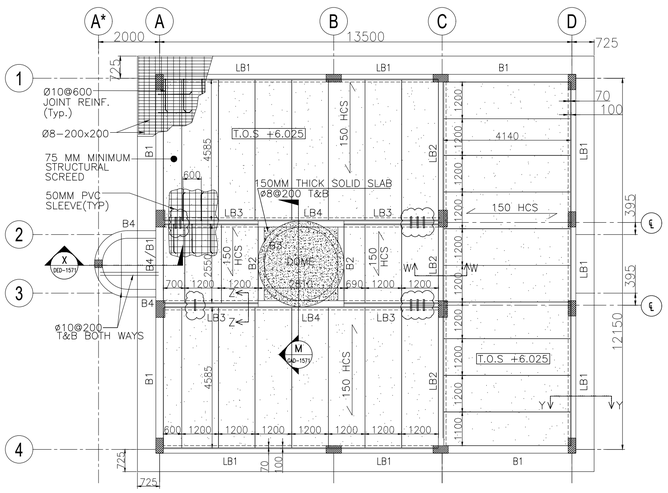

ROOF HOLLOW CORE SLAB LAYOUT
SCALE 1:100

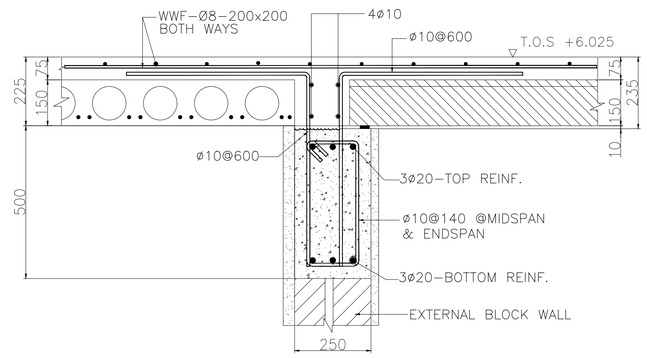

SECTION-W (LB2)
SCALE 1:10

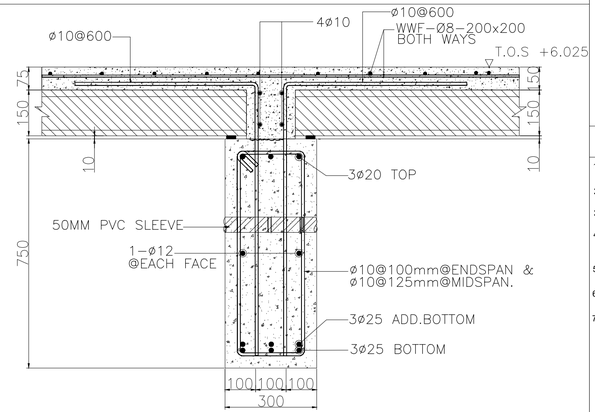

SECTION-Z (LB3)
SCALE 1:10

SCHEDULE OF ROOF BEAMS

BEAM MARK	DIMENSIONS		STEEL REINFORCEMENT				SIDE REINF. EACH FACE	STIRRUPS	REMARKS
			TOP		BOTTOM				
	WIDTH	DEPTH	STRAIGHT	ADD.	STRAIGHT	ADD.			
LB1	250	500	3ø16	–	3ø16	–	–	PROVIDE ø10@90 IN THE ENDSPAN@DISTANCE L/3 FROM THE SUPPORT & ø10@140 IN THE MIDSPAN	REFER DETAIL-Y
LB2	250	500	3ø20	–	3ø20	–	–	PROVIDE ø10@140 BOTH IN THE ENDSPAN & MIDSPAN	REFER DETAIL-W
LB3	300	750	3ø20	–	3ø25+3ø25	–	1ø12	PROVIDE ø10@100 IN THE ENDSPAN@DISTANCE L/3 FROM THE SUPPORT & ø10@125 IN THE MIDSPAN	REFER DETAIL-Z
LB4	300	750	3ø20	–	3ø25+3ø25	–	1ø12	PROVIDE ø10@100 IN THE ENDSPAN@DISTANCE L/3 FROM THE SUPPORT & ø10@125 IN THE MIDSPAN	REFER DETAIL-M@GAD-1571
B1	250	450	3ø16	–	3ø16	–	–	PROVIDE ø10@140 BOTH IN THE ENDSPAN & MIDSPAN	REFER SECTION-X
B2	200	400	3ø20	–	3ø20	–	–	PROVIDE ø10@150 BOTH IN THE ENDSPAN & MIDSPAN	–
B3	200	300	3ø16	–	3ø16	–	–	PROVIDE ø10@150 BOTH IN THE ENDSPAN & MIDSPAN	REFER DETAIL-M@GAD-1571
B4	250	400	3ø12	–	3ø12	–	–	PROVIDE ø10@150 BOTH IN THE ENDSPAN & MIDSPAN	REFER DETAIL-D1@GAD-1571

NOTES

1.) ALL DIMENSIONS ARE GIVEN IN MILLIMETRES AND ELEVATIONS ARE IN METRES UNLESS OTHERWISE NOTED.
2.) MINIMUM REINFORCED CONCRETE GRADE TO BE USED FOR SUPERSTRUCTURE & SUBSTRUCTURES IS C35(5000 PSI).
3.) MINIMUM LEAN CONCRETE GRADE TO BE USED FOR THE SUB-STRUCTURES IS C15(2175 PSI).
4.) ALL REINFORCING STEEL SHALL BE DEFORMED BILLET STEEL BARS CONFORMING TO ASTM-A615, WITH MINIMUM YIELD STRENGTH OF FY420 MPA.
5.) THE NET SOIL BEARING CAPACITY CONSIDERED IN FOUNDATION DESIGN IS 350 KPA.(REFER DOC 216-3000-EG-CV-RPT-1008)
6.) WATER PROOFING INSULATION SHALL BE AS PER PROJECT SPECIFICATIONS & ITS MATERIAL TO BE APPROVED BY SITE ENGINEER.
7.) THE MINIMUM CONCRETE COVER AS PER SBC-304-2018(TABLE 20.6.1.3.1) MEASURED FROM REBAR SHALL BE
a) CONCRETE CAST AGAINST & PERMANENTLY EXPOSED TO EARTH (INCLUDING FOUNDATIONS OVER SUB-SLAB) FORMED CONCRETE EXPOSED TO EARTH OR WEATHER.....50MM
b.) CONCRETE NOT EXPOSED TO WEATHER NOR IN CONTACT WITH GROUND
BEAMS, COLUMNS.....40MM
SLABS, WALLS, JOISTS.....20MM
c.) CONCRETE SLAB OVER 50MM SUB-SLAB.....20MM
8.) ALL DRAWINGS MUST BE READ IN CONJUNCTION WITH RELEVANT ARCHITECTURAL AND ENGINEERING DRAWINGS RELATED TO THE SAME SHEET AND ANY ITEM ON IT.
9.) F.F.L +0.00 MENTIONED IS EQUIVALENT TO FINISH FLOOR LVL +922.70M AS PER THE CIVIL DRAWING CE-004A-OVERALL LAYOUT PLAN.

LEGEND/ABBREVIATIONS

F-FOUNDATION
C-COLUMN
FFL-FINISH FLOOR LVL
FGL-FINISH GRADE LVL
TOS-TOP OF SCREED
WWF-WELDED WIRE FABRIC
HCS-HOLLOW CORE SLAB
GB-GRADE BEAM
IJ-ISOLATION JOINT
CJ-CONTROL JOINT
GA-GALVANIZED
S.O.G-SLAB ON GRADE
℄-CENTER OF BEAM
HOR.-HORIZONTAL
REINF.-REINFORCEMENT
LVL.-LEVEL
-150MM/200MM THICK BLOCK WALL

DOCUMENT NUMBER	REFERENCE DOCUMENTS	REV	DATE	REVISION DESCRIPTION	DRN	CHK	ENG	APP	EMP
MD-216-1800-EG-AR-GAD-3166	BUILDING ELEVATIONS & SECTIONS								
MD-216-6000-EG-CV-STD-1002	HOLLOW CORE SLAB STANDARD								
MD-216-6000-EG-CV-STD-1001	REINFORCEMENT STANDARD	D01	29/06/2023	AS -BUILT	--	AVG		SJM	
MD-216-1800-EG-AR-GAD-3165	BUILDING PLANS	C01	19/05/2020	ISSUED FOR CONSTRUCTION	--	AVG		SJM	
MD-216-1800-EG-CV-GAD-1565	OVERALL LAYOUT PLAN	A01	19/04/2020	ISSUED FOR APPROVAL	--	AVG	--	SJM	

DESIGNER: مكتب الخليج للاستشارات الهندسية الخبر، المملكة العربية السعودية GULF CONSULT ARCHITECTS AND ENGINEERS

DRAWING NUMBER					REVISION
FACILITY-MOSQUE-ST-002					0
DATE	15/03/2020	DATE	16/04/2020	DATE	17/04/2020
DRAWN	MAH	CHECKED	MF	APPROVED	FK

LARSEN & TOUBRO DRAWING NUMBER	REVISION
019045_900_C_G_24249_002	2
OUTOTEC DRAWING NUMBER	DOCUMENT ID / REVISION
900707__GAU01__AN02__MTL01__18036	OU100668742 / 2

DRAWN	--	--
CHECKED	AVG	18/04/2020
ENGINEER	--	--
APPROVED	SJM	19/04/2020
EMPLOYER		
SCALE	1:100	A1

MANSOURAH - MASSARAH GOLD PROJECT
GENERAL ARRANGEMENT DRAWING
SECURITY BASE CAMP: MOSQUE
LAYOUT & DETAILS OF ROOF & GRADE SLAB

DRAWING NUMBER MD-216-1800-EG-CV-GAD-1570 REV D01

LARSEN & TOUBRO
This drawing is the property of LARSEN & TOUBRO and must not be passed on to any person or body not authorized by us to receive it nor be copied or otherwise made use either in full or in part by such person or body without our prior permission in writing.

Outotec
The content of these documents are the sole property of Outotec Oyj. Any rights not expressly granted herein are reserved. Reproduction, transfer or distribution of part or all of the contents in any form without prior written permission of Outotec is prohibited.

MA'ADEN معادن
Saudi Arabian Mining Company شركة معادن العربية السعودية
This document and the information contained herein is Ma'aden proprietary know-how. This document or any part thereof should not be reproduced, stored in a retrieval system or transmitted by any means, electronic or otherwise, or divulged without prior written permission of Ma'aden.