DETAIL - X
(SCALE 1:30)
SECTION Y - Y
(TYP. DETAIL OF DYKE WALL)
SECTION A - A
(TYP. DETAIL OF PEDESTAL MKD. F1)
SECTION Z - Z
DETAIL OF INSERT PLATE MKD. IP1
SECTION G - G
TYP. DETAIL OF PIT MKD. PT4
TYP. DETAIL OF PIT MKD. PT1
TYP. DETAIL OF PIT MKD. PT2, PT6 & PT8
TYP. DETAIL OF PIT MKD. PT10
TYP. DETAIL OF PIT MKD. PT7
SECTION 1-1
TYP. DETAIL OF PIT MKD. PT12
TYP. DETAIL OF PIT MKD. PT3, PT5, PT11 & PT14
SECTION 2 - 2
SECTION 14 - 14
TYP. DETAIL OF PEDESTAL MKD. P7
DETAIL - Q
SECTION 4-4
TYP. DETAIL OF PEDESTAL MKD. P8
SECTION 15 - 15
TYP. DETAIL OF PEDESTAL MKD. P1A, P1B & P1C
DAY TANK AREA
KEY PLAN
(SCALE 1:1000)
TYP. DETAIL OF PIT MKD. PT20
SECTION 7 - 7
TYP. DETAIL OF PIT MKD. PT9
SECTION 8-8
DETAIL OF PIT MKD. PT15, PT18, PT15A, PT15B, PT15C & PT15D
SECTION 9 - 9
TYP. DETAIL OF PIT MKD. PT19, PT20 & PT20A
TYP. DETAIL OF PEDESTAL MKD. P1
SECTION 10 - 10 & 10A - 10A
TYP. DETAIL OF PEDESTAL MKD. P4
SECTION 12 - 12
TYPICAL FIXED HANDRAIL DETAILS
TYP. DETAIL OF PEDESTAL MKD. P3
SECTION 11 - 11
TYP. DETAIL OF PEDESTAL MKD. P5
SECTION 13 - 13
SECTION W - W
TYP. DETAIL OF PEDESTAL MKD. P2
SECTION 1-1
SECTION 2 - 2
SECTION 4-4
DETAIL - P
TYPICAL DETAIL OF CHQD. PLATE FOR MKD. PT1, PT2, PT4 & PT10
(SCALE 1:50)
TYPICAL DETAIL OF CHQD. PLATE FOR MKD. PT3, PT5, PT9, PT11 & PT13
(SCALE 1:50)
LFO DAY TANK
ALCO BUFFER TANK
ALCO DAY TANK
OILY WATER BUFFER TANK
SLUDGE TANK
CLEAN LUBE OIL STORAGE TANK

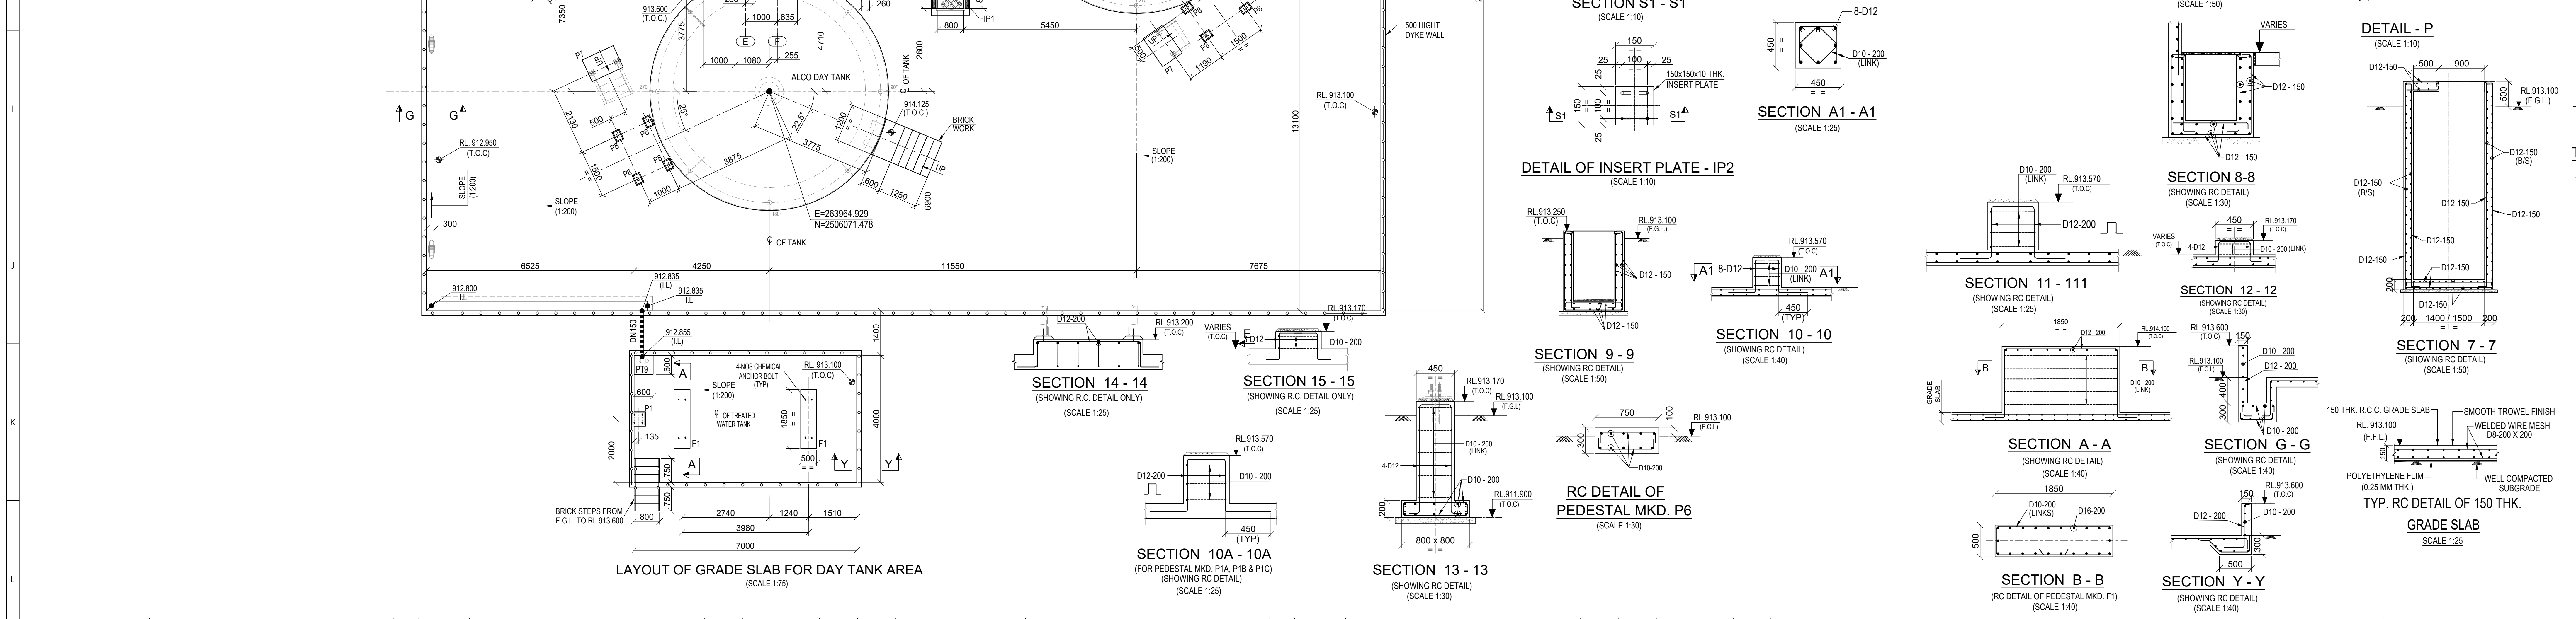

TYPICAL DETAIL OF CHQD. PLATE FOR PIT MKD. PT6

(SCALE 1:50)

LEGEND :-

RL. - REDUCED LEVEL.
CL. - CENTRE LINE.
T.O.C. - TOP OF CONCRETE.
T.O.G. - TOP OF GROUT
F.G.L. - FINISHED GROUND LEVEL.
P.C.D. - PITCH CIRCLE DIAMETER.
TYP. - TYPICAL.
PCC. - PLAIN CEMENT CONCRETE.
MKD. - MARKED.
Ø - DIAMETER.
R - RADIUS.
I.L - INVERT LEVEL
F.F.L - FINISHED FLOOR LEVEL
I.D - INNER DIAMETER.
O.D - OUTER DIAMETER.
THK. - THICK.
DET. - DETAIL.
TNK. - TANK.
FDN. - FOUNDATION.
OS. - OILY WATER DRAINAGE PIPE
RS. - STORM WATER DRAINAGE PIPE

NOTES :-

1. ALL DIMENSIONS ARE IN MILLIMETERS AND LEVELS AND CO-ORDINATES ARE IN METERS. UNLESS OTHERWISE STATED.
2. GRADE OF CONCRETE SHALL BE 35 MPa FOR FOUNDATION & 15 MPa FOR BLINDING CONCRETE.
3. GRADE OF REINFORCEMENT SHALL BE DEFORMED BAR 420 MPa (GRADE 60) - ASTM A615/A615M.
4. NET SAFE BEARING CAPACITY OF SOIL AT BOTTOM OF FOUNDATION CONSIDER 500KN/ SQ. M.
5. CLEAR COVER TO MAIN REINFORCEMENT SHALL BE FOUNDATIONS = 50 MM., WALLS = 50 MM., GRADE SLAB = 25 MM., PEDESTAL = 50 mm.
6. IF ANY PART OF FOUNDATION COMES ON BACKFILL ZONE OF ADJACENT FOUNDATION OR ANY LOOSE SOIL ARE ENCOUNTERED BELOW FOUNDATION LEVEL THE SAME SHALL BE REMOVED AND FILLED WITH PCC.
7. ALL OTHER NOTES REFER DRAWING NO. MD-101-SMEM-EG-ST-DST-0001 TO 0008.
8. GENERAL NOTES FOR CIVIL WORKS & STANDARD REINFORCEMENT DETAIL REFER DRAWING NO. MD-216-1000-EG-CV-DED-1001 & 1005.
9. FOR ANCHOR BOLTS STANDARD DETAILS. REFER DRAWING NO. MD-216-1000-EG-CV-DED-1003
10. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH DRAWING NO. MD-216-49PR-EG-ST-GAD-2414.
11. PIPING MATERIAL STANDARD - AT12.
12. ALL LEVELS AS MENTIONED ARE BOTTOM OF PIPE.
13. OILY WATER DRAINAGE TO BE ADJUSTED ACCORDING TO SITE CONDITION.
14. ALL PITS MARKED WITH VALVE SYMBOL SHALL BE PROVIDED WITH 100 MM EXTENDED AT12 PIPE LINE INSIDE PIT.
15. FOR VALVE FIXING DETAILS INSIDE VALVE PIT SEPARATE DRAWING WILL BE PROVIDED.
16. ALL PIT PIPE CONNECTION SHALL BE DONE AS PER THE PLAN DRAWING. IN ELEVATION OF THE PITS THE PIPE CONNECTION ARE NOT SHOWN.
17. PIPE SHALL BE EXTENDED BY 100 MM INSIDE FOR THESE PITS TO INSTALL VALVES AT A LATER STAGE

DOCUMENT NUMBER	REFERENCE DOCUMENTS	REV	DATE	REVISION DESCRIPTION	DRN	CHK	ENG	APP	EMP
DBAF518994	TREATED WATER TANK FOUNDATION								
DBAF523407	LOAD INPUT - LUBE OIL TANK AREA								
DBAF523405	LOAD INPUT - DAY TANK AREA								
MD-216-49PR-EG-ME-GAD-V553-1040	LFO DAY TANK	D01	17/02/2023	AS-BUILT	SYA	SJM	AVG	AG	
MD-216-49PR-EG-ME-GAD-V553-1039	SLUDGE TANK	C04	18/06/2021	ISSUED FOR CONSTRUCTION AND REVISED AS MKD. C04	SYA	SJM	AVG	AG	
MD-216-49PR-EG-ME-GAD-V553-1038	LUBE OIL STORAGE TANK	C03	31/03/2021	ISSUED FOR CONSTRUCTION AND REVISED AS MKD. C03	PDK	SGC	SHD	PRI	
MD-216-49PR-EG-ME-GAD-V553-1036	HFO BUFFER TANK	C02	06/02/2021	ISSUED FOR CONSTRUCTION AND REVISED AS MKD. C02	PDK	SGC	SHD	PRI	
MD-216-1000-EG-ST-CRT-1001	CIVIL, STRUCTURAL & ARCHITECTURAL - DESIGN CRITERIA	C01	19/10/2020	ISSUED FOR CONSTRUCTION AND REVISED AS MKD. C01	AMJ	SGC	SHD	PRI	
MD-216-49PR-EG-ME-LAD-V553-1002	LAYOUT OF POWER GENERATION	A01	18/09/2020	ISSUED FOR REFERENCE	AMJ	SGC	SHD	PRI	

DOCUMENT NUMBER	REFERENCE DOCUMENTS	REV	DATE	REVISION DESCRIPTION	DRN	CHK	ENG	APP	EMP

RESERVED FOR VENDOR LOGO AND DRAWING NUMBER

LARSEN & TOUBRO

This drawing is the property of LARSEN & TOUBRO and must not be passed on to any person or body not authorized by us to receive it nor be copied or otherwise made use either in full or in part by such person or body without our prior permission in writing.

Outotec

The content of these documents are the sole property of Outotec Oyj. Any rights not expressly granted herein are reserved. Reproduction, transfer or distribution of part or all of the contents in any form without prior written permission of Outotec is prohibited.

MA'ADEN معادن
Saudi Arabian Mining Company شركة التعدين العربية السعودية

This document and the information contained herein is Ma'aden proprietary know-how. This document or any part thereof should not be reproduced, stored in a retrieval system or transmitted by any means, electronic or otherwise, or divulged without prior written permission of Ma'aden.

LARSEN & TOUBRO DRAWING NUMBER		REVISION
019045_008_C_G_24292_003		5
OUTOTEC DRAWING NUMBER	DOCUMENT ID	REVISION
900707 _GAU01 _WG01_MTL01 _45079	OU100688137	5

DRAWN	AMJ	10/09/2020
CHECKED	SGC	14/09/2020
ENGINEER	SHD	06/09/2020
APPROVED	PRI	18/09/2020
EMPLOYER		
SCALE	1:100, 1:40, 1:20	A0

MANSOURAH - MASSARAH GOLD PROJECT
GENERAL ARRANGEMENT
POWER PLANT DAY TANK AREA
GA AND DETAIL OF GRADE SLAB

DRAWING NUMBER
MD-216-49PR-EG-CV-GAD-2006
REV
D01