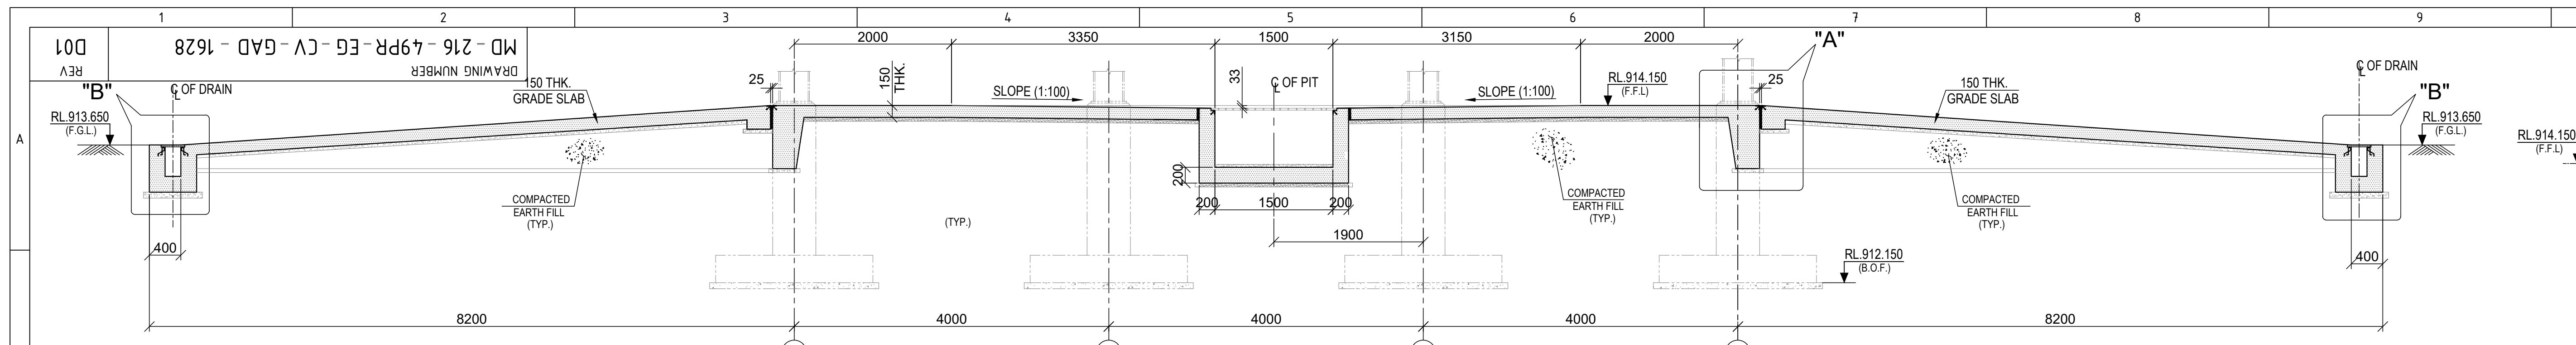

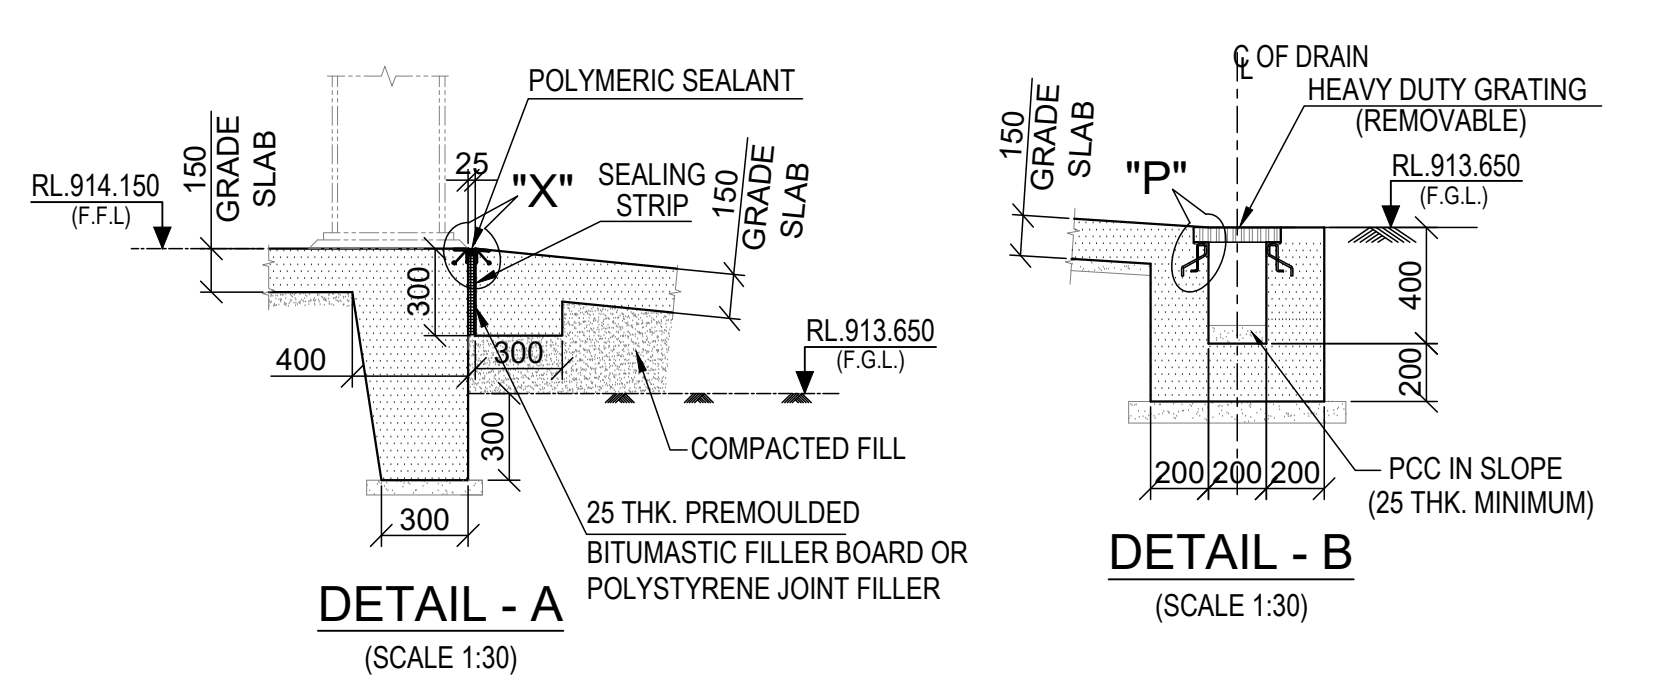
POLYMERIC SEALANT
SEALING STRIP
"X"
RL 914.150 (F.F.L)
150 GRADE SLAB
RL 913.650 (F.G.L)
COMPACTED FILL
25 THK. PREMOULDED BITUMASTIC FILLER BOARD OR POLYSTYRENE JOINT FILLER
"P"
C OF DRAIN
HEAVY DUTY GRATING (REMOVABLE)
PCC IN SLOPE (25 THK. MINIMUM)

DETAIL - A (SCALE 1:30)

DETAIL - B (SCALE 1:30)

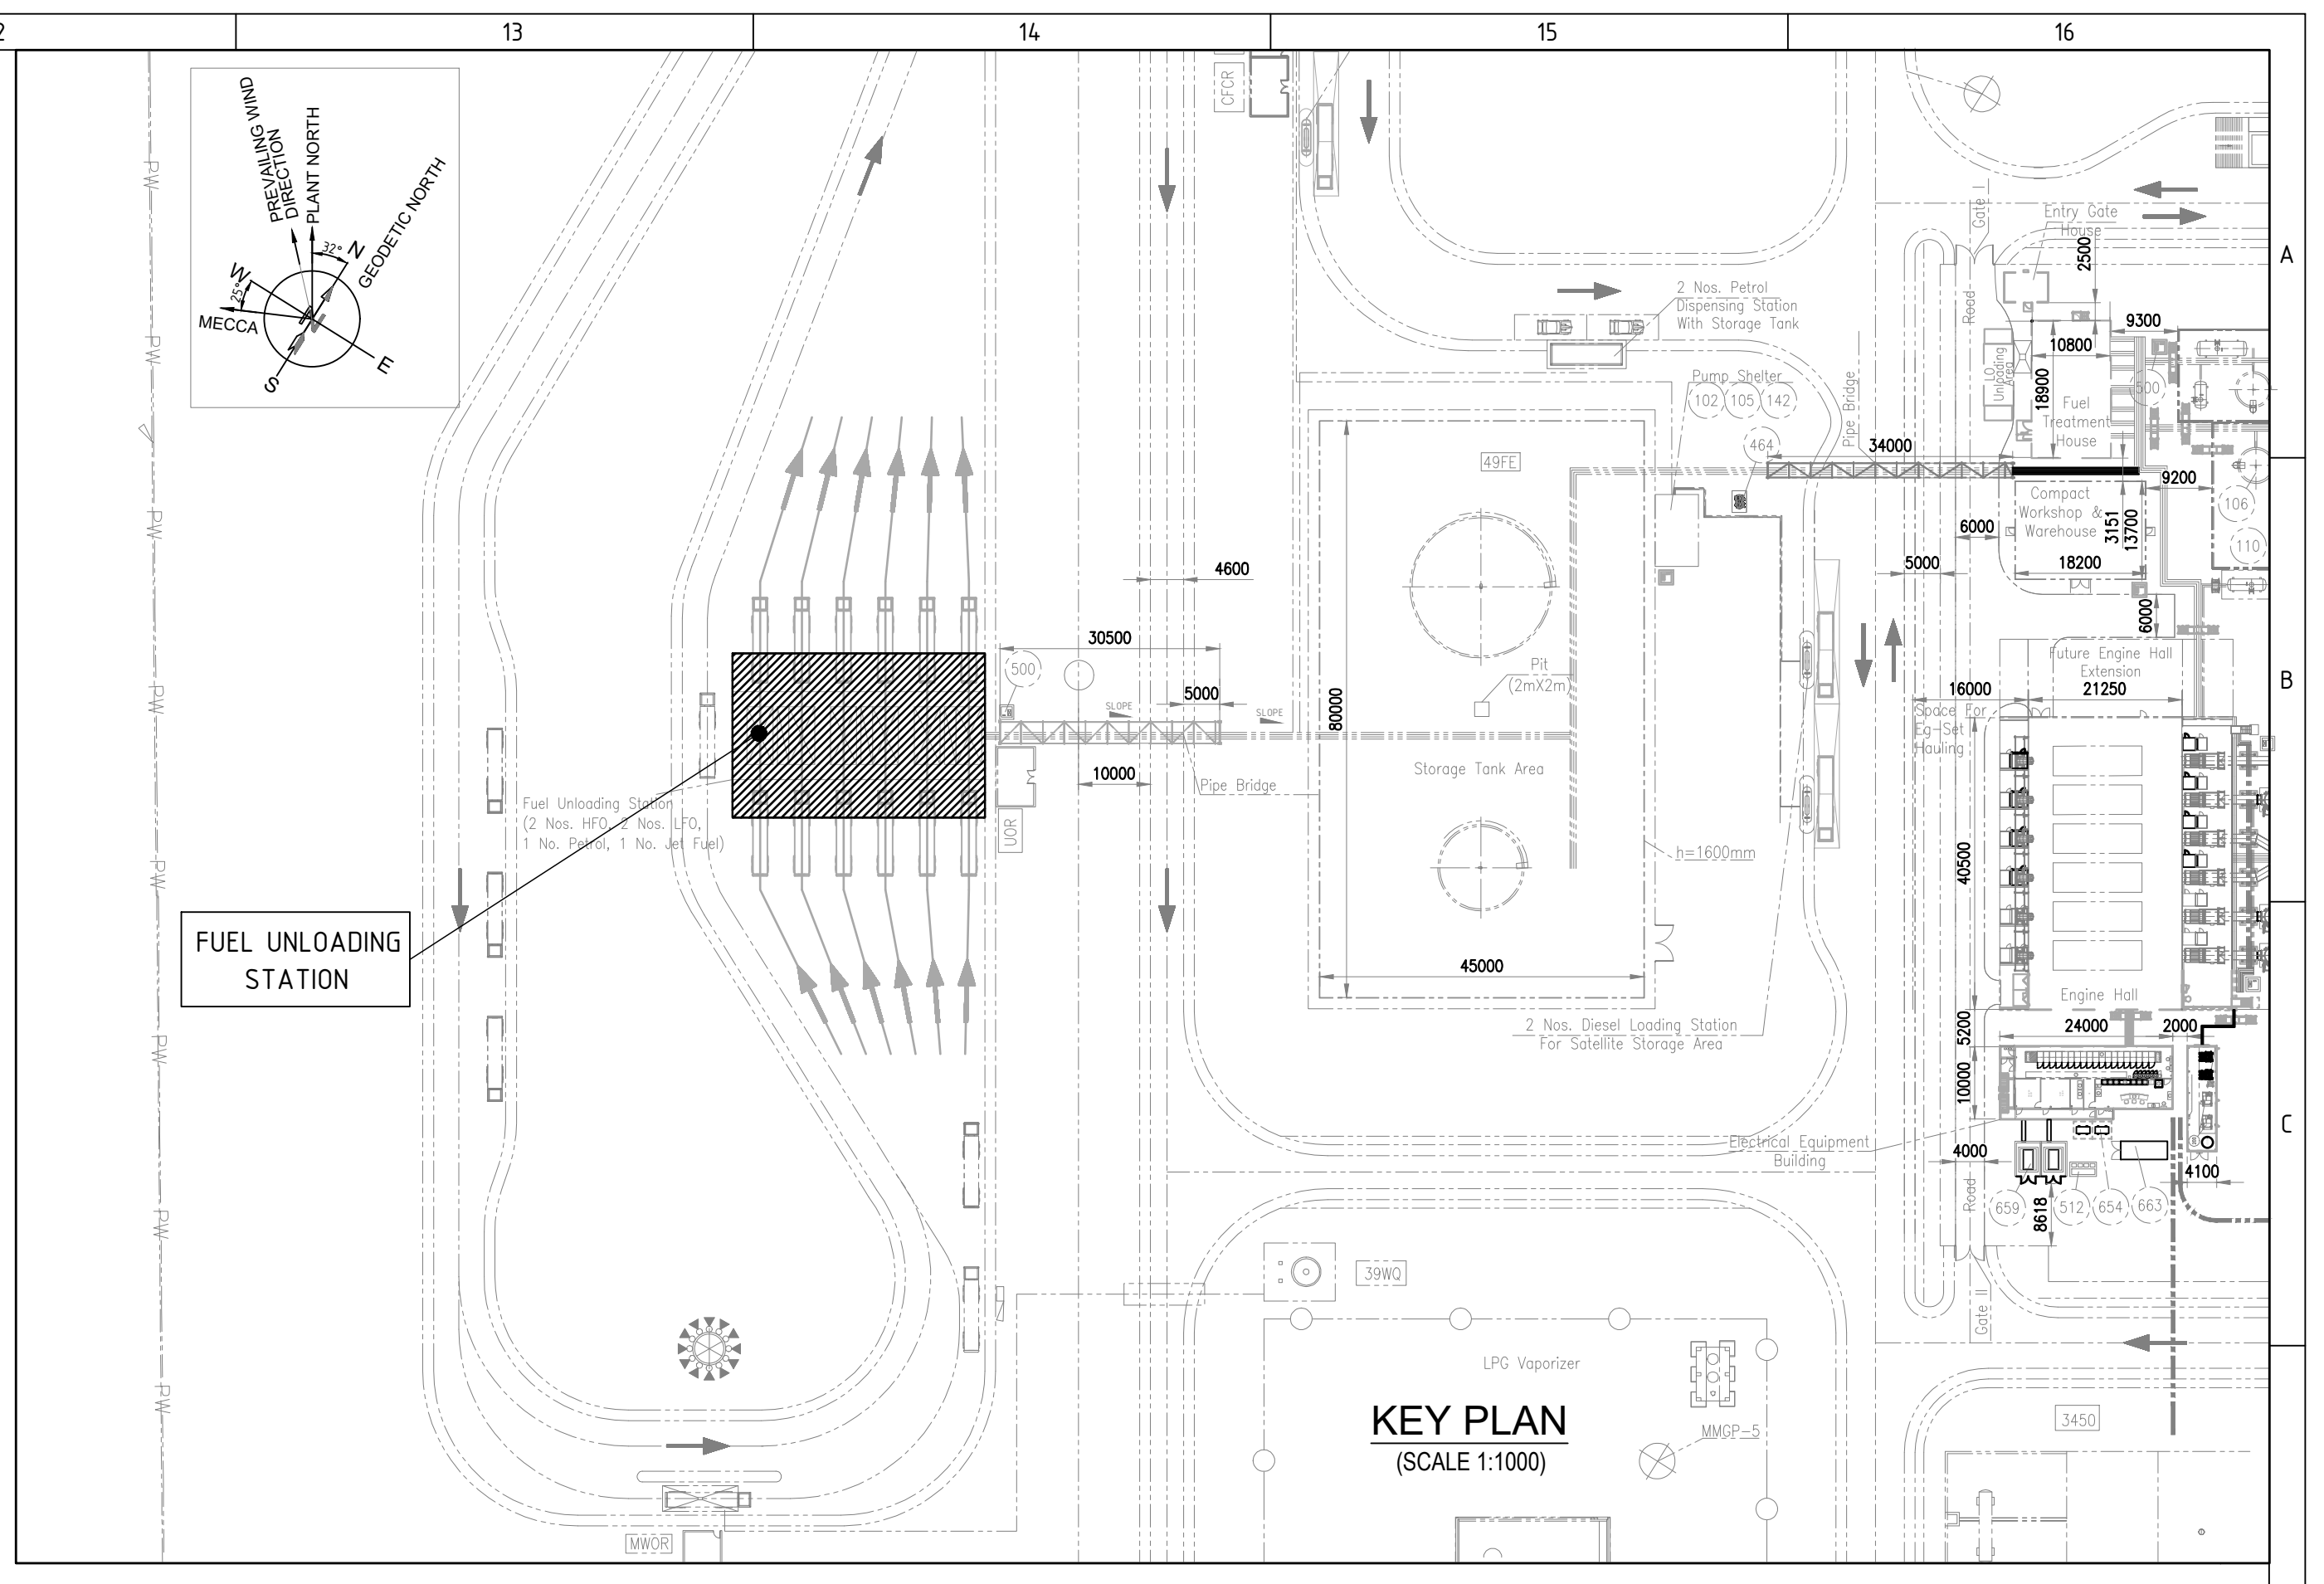

KEY PLAN (SCALE 1:1000)

SECTION : 1 - 1 (SCALE - 1:50)

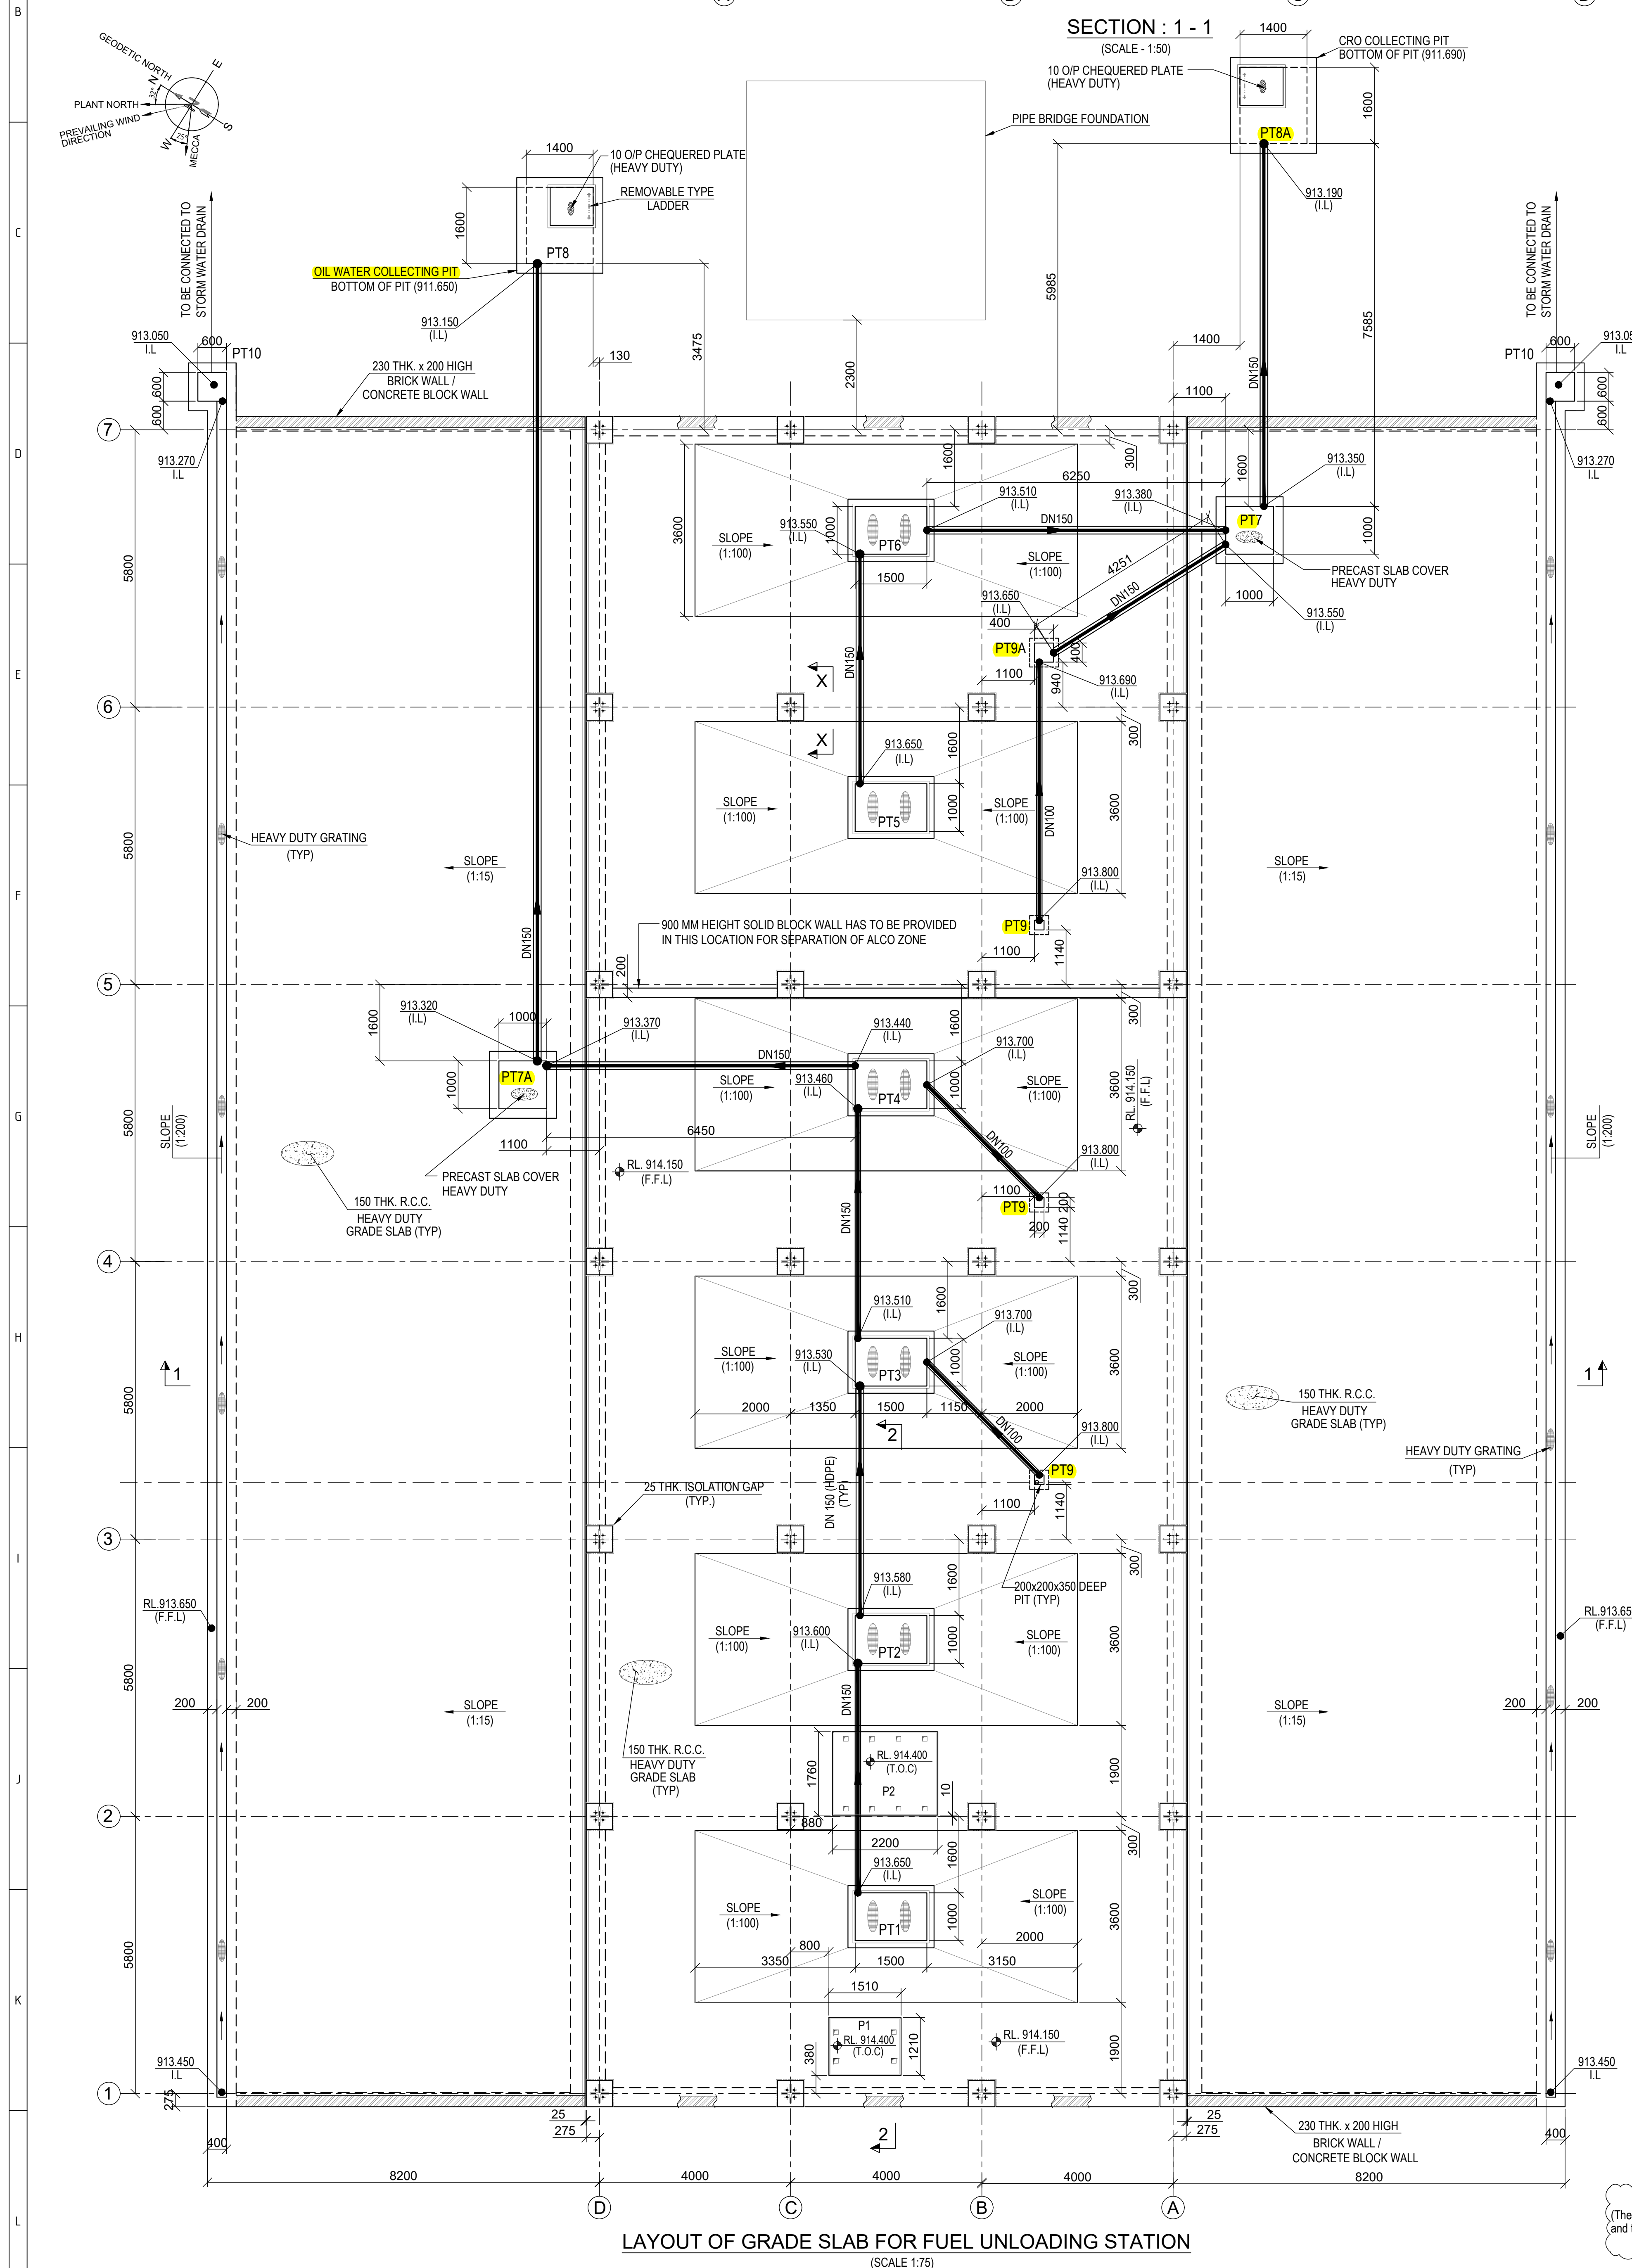
GEODETIC NORTH
PLANT NORTH
PREVAILING WIND DIRECTION
MECCA
10 O/P CHEQUERED PLATE (HEAVY DUTY)
REMOVABLE TYPE LADDER
PT8
OIL WATER COLLECTING PIT
BOTTOM OF PIT (911.650)
CRO COLLECTING PIT BOTTOM OF PIT (911.690)
PT8A
PIPE BRIDGE FOUNDATION
TO BE CONNECTED TO STORM WATER DRAIN
PT10
230 THK. x 200 HIGH BRICK WALL / CONCRETE BLOCK WALL
PT6
PT7
PT9A
PT5
PT4
PT9
PT3
PT2
PT1
PT7A
P1
P2
DN150
PRECAST SLAB COVER HEAVY DUTY
HEAVY DUTY GRATING (TYP)
SLOPE (1:15)
900 MM HEIGHT SOLID BLOCK WALL HAS TO BE PROVIDED IN THIS LOCATION FOR SEPARATION OF ALCO ZONE
150 THK. R.C.C. HEAVY DUTY GRADE SLAB (TYP)
25 THK ISOLATION GAP (TYP.)
200x200x350 DEEP PIT (TYP)
DN 150 (HDPE) (TYP)
RL 913.650 (F.G.L)
RL 914.150 (F.F.L)
8200
4000
4000
4000
8200
5800
D
C
B
A
1
2
3
4
5
6
7

LAYOUT OF GRADE SLAB FOR FUEL UNLOADING STATION (SCALE 1:75)

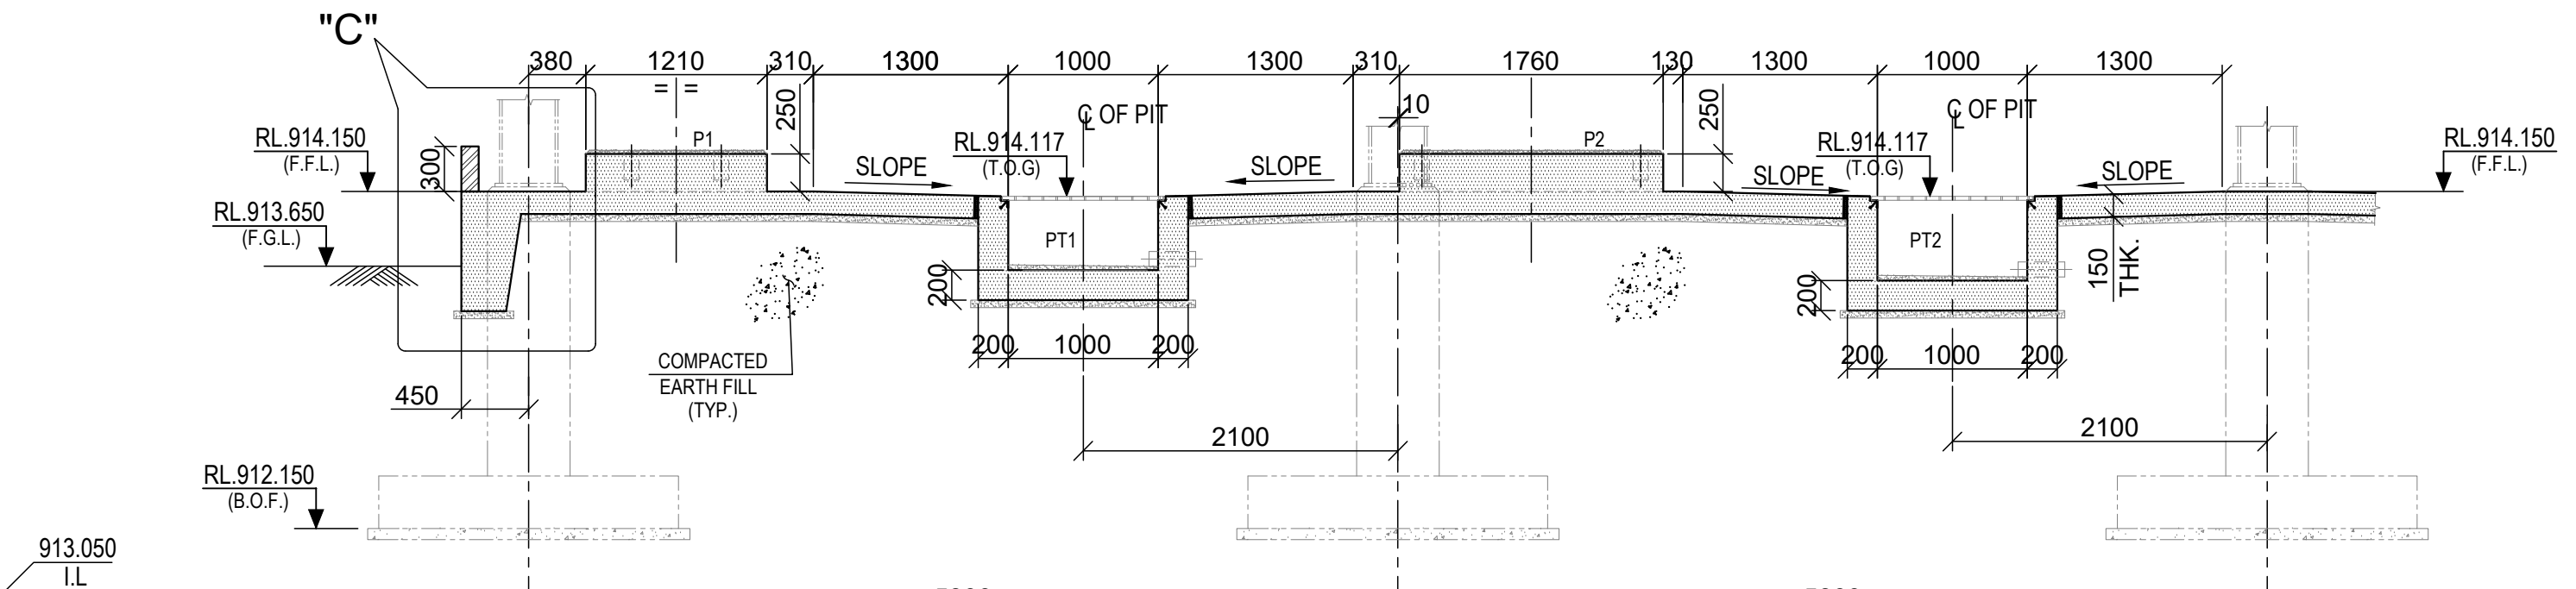

SECTION : 2 - 2 (SCALE - 1:50)

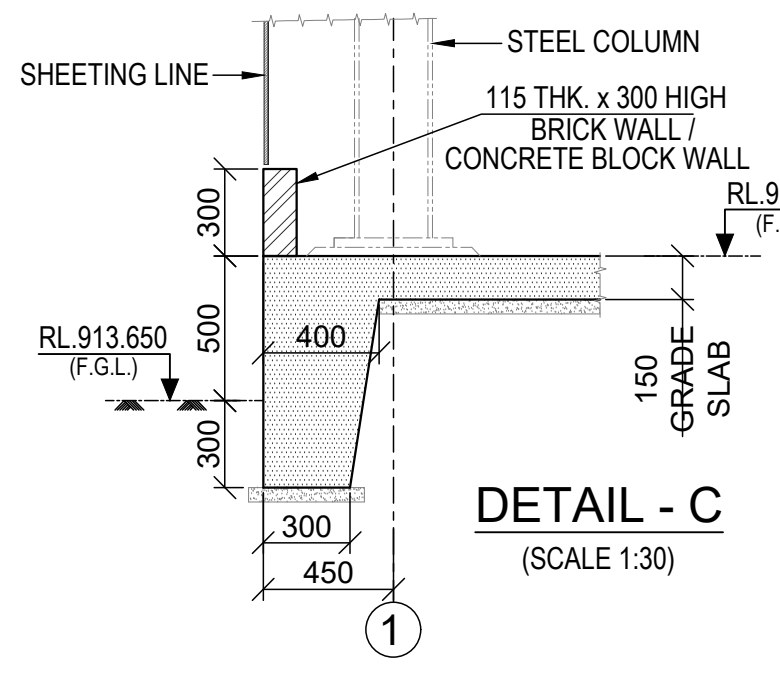

DETAIL - C (SCALE 1:30)

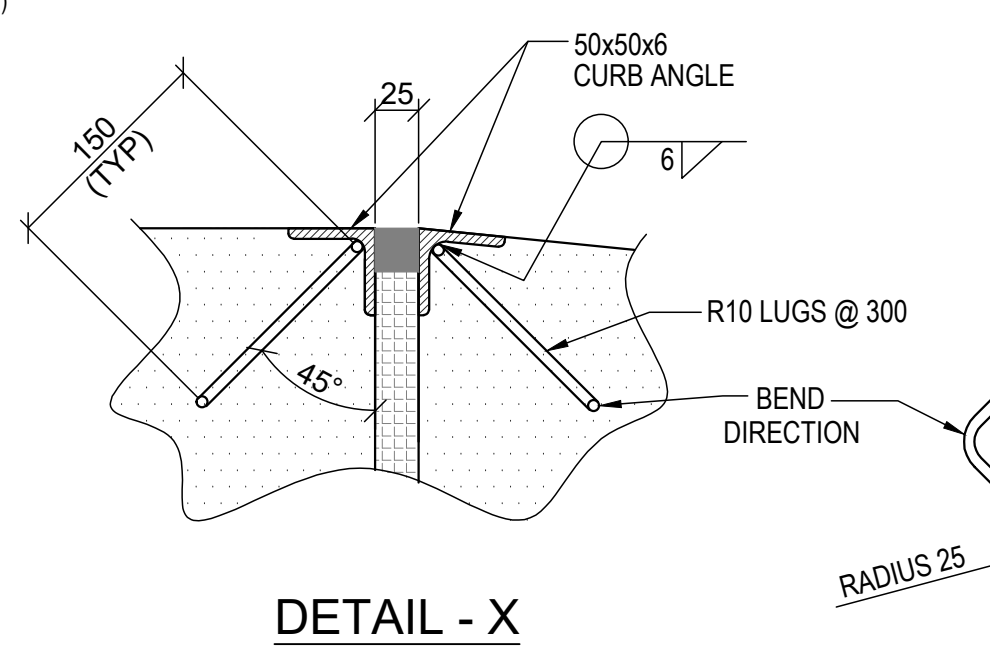

DETAIL - X (SCALE 1:5)

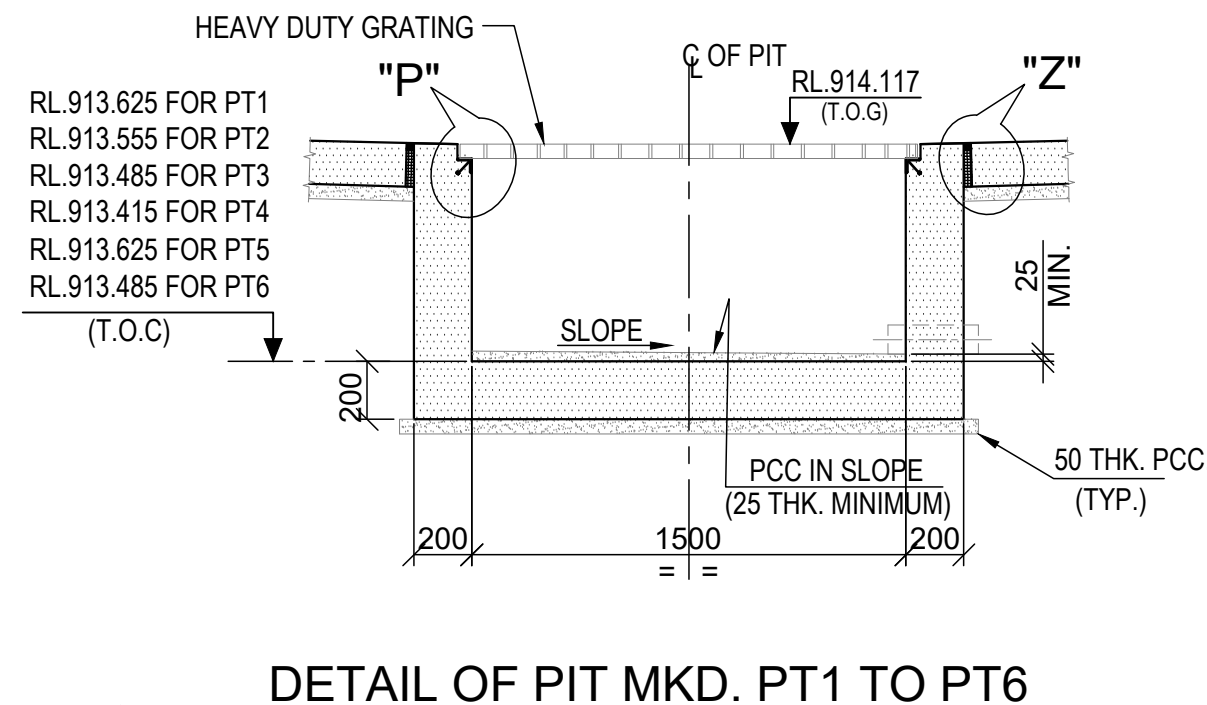

DETAIL OF PIT MKD. PT1 TO PT6 (SCALE 1:30)

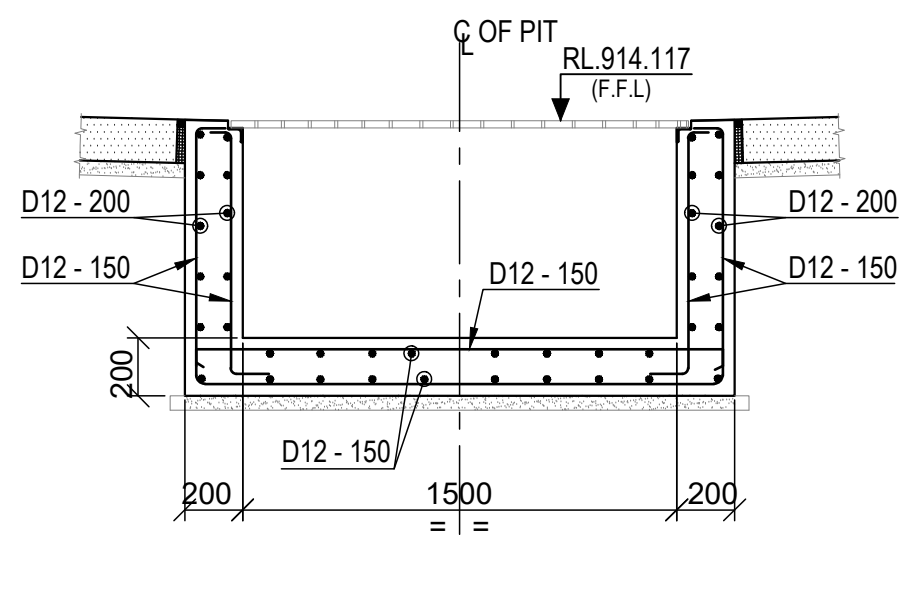

RC DETAIL OF PIT MKD. PT1 TO PT6 (SHOWING RC DETAIL MKD. PT1) (SCALE 1:30)

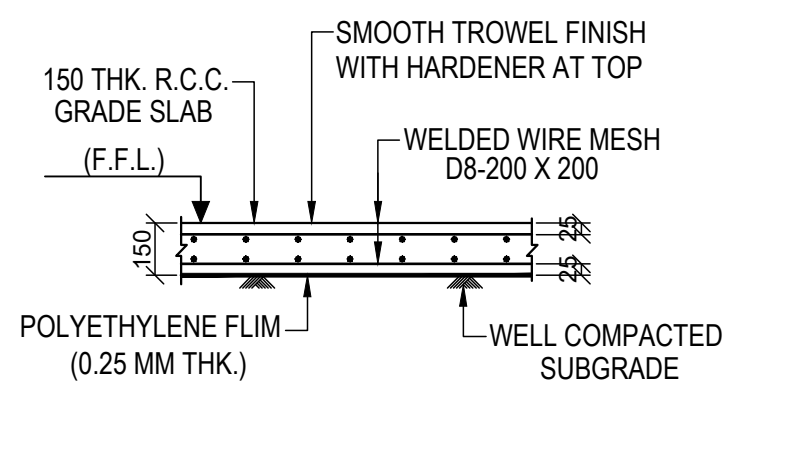
150 THK. R.C.C. GRADE SLAB (F.F.L.)
SMOOTH TROWEL FINISH WITH HARDENER AT TOP
WELDED WIRE MESH D8-200 X 200
POLYETHYLENE FILM (0.25 MM THK.)
WELL COMPACTED SUBGRADE

TYP. RC DETAIL OF 150 THK. HEAVY DUTY GRADE SLAB (SCALE 1:25)

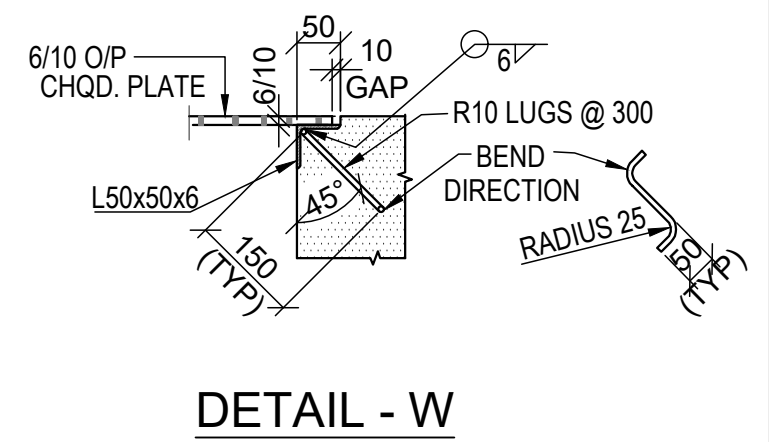

DETAIL - W (SCALE 1:10)

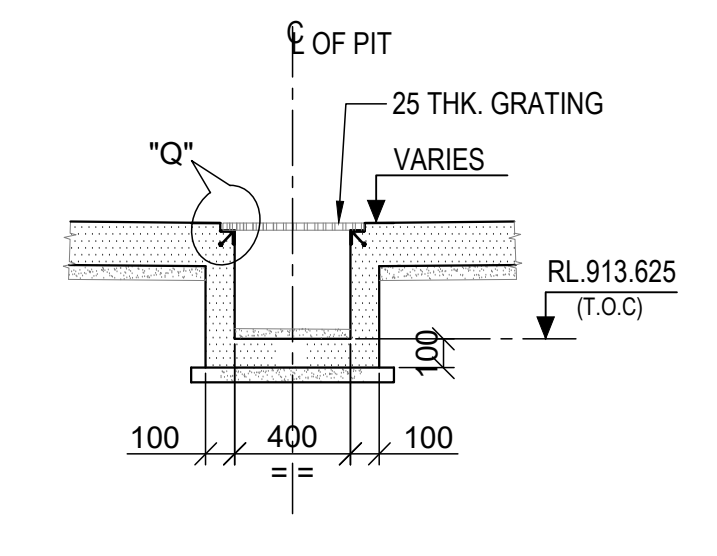

DETAIL OF PIT MKD. PT9A (SCALE 1:30)

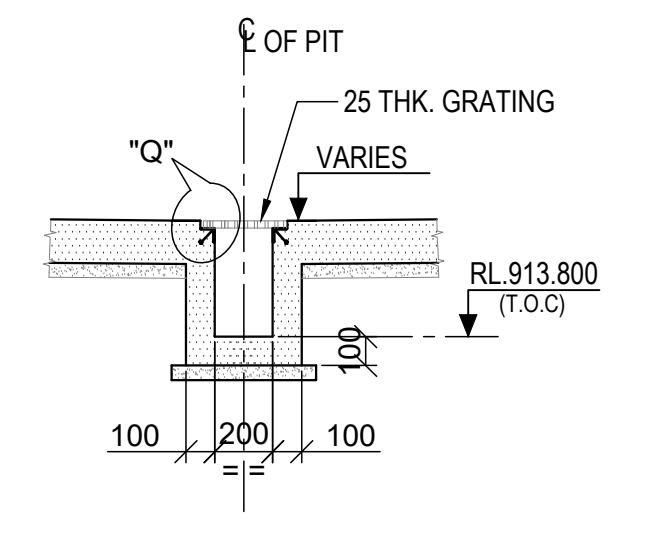

DETAIL OF PIT MKD. PT9 (SCALE 1:30)

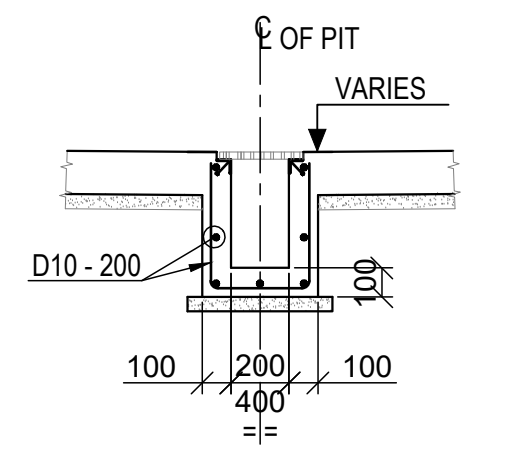

RC DETAIL OF PIT MKD. PT9 &PT9A (SCALE 1:30)

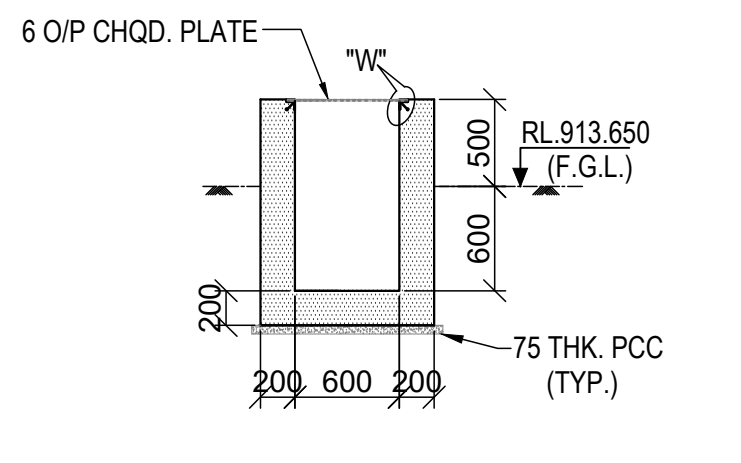

TYP. DETAIL OF PIT MKD. PT10 (SCALE 1:50)

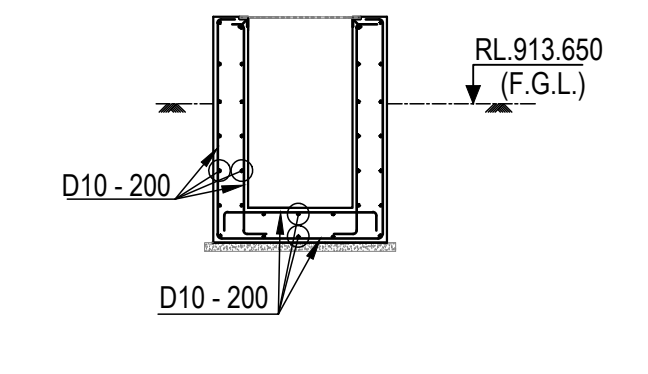

RC DETAIL OF PIT MKD. PT10 (SCALE 1:50)

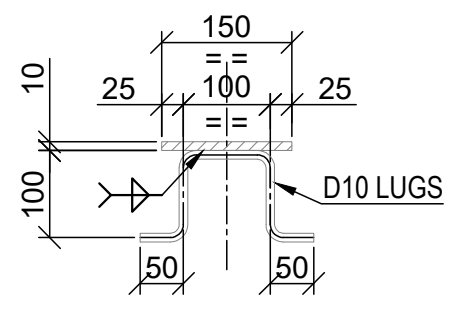

SECTION S1 - S1 (SCALE 1:10)

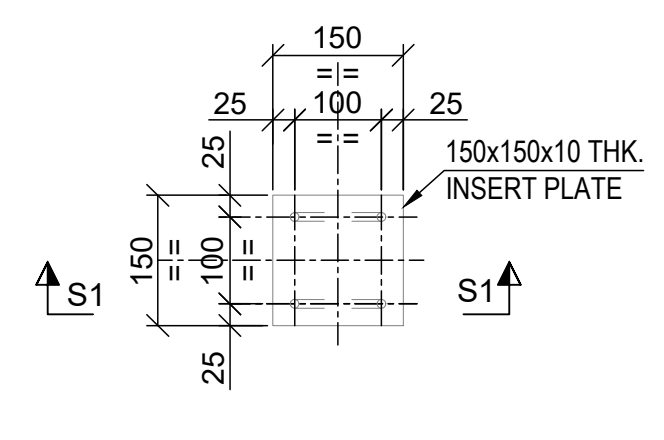

DETAIL OF INSERT PLATE - IP1 (SCALE 1:10)

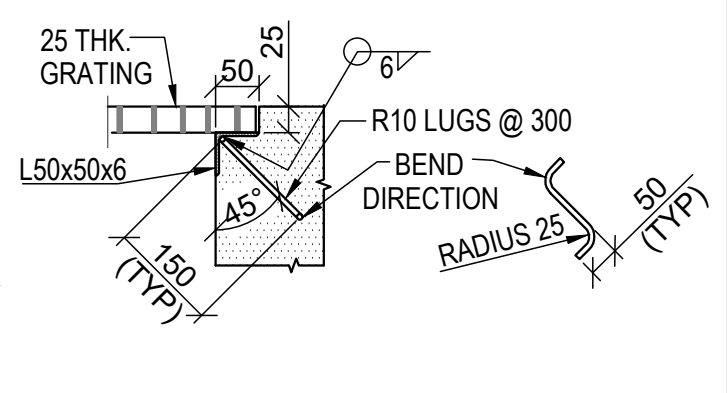

DETAIL - Q (SCALE 1:10)

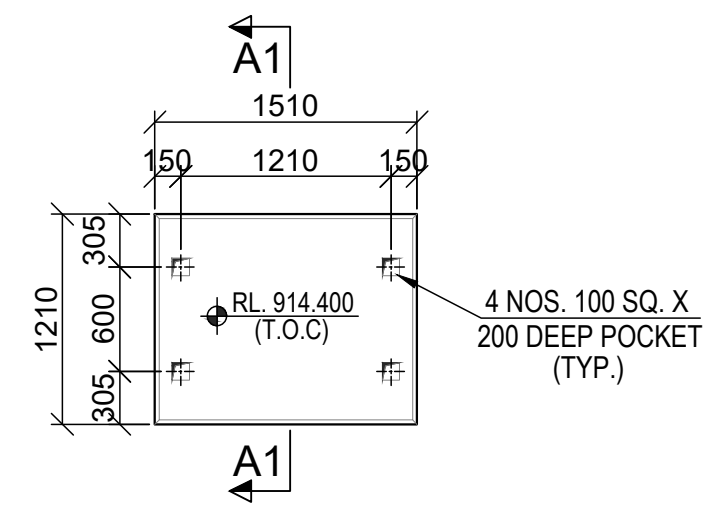

TYP. DETAIL OF PEDESTAL MKD. P1 (SCALE 1:50)

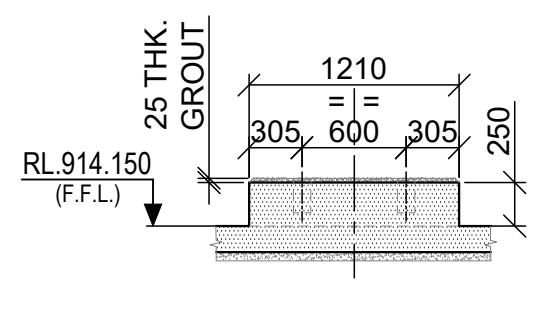

SECTION : A1-A1 (SCALE - 1:50)

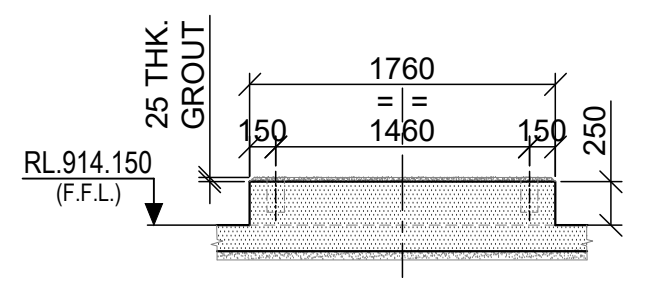

SECTION : A2-A2 (SCALE - 1:50)

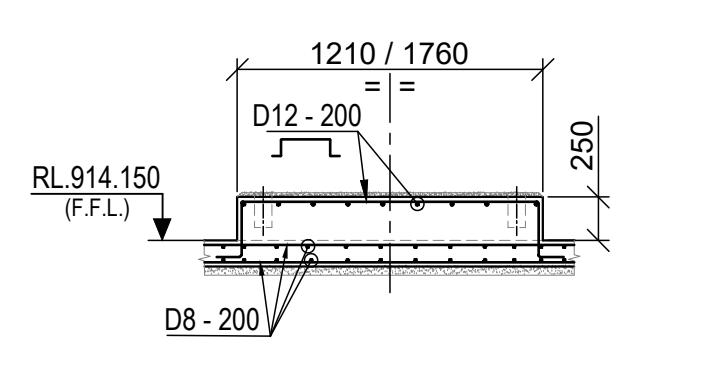

RC DETAIL OF PEDESTAL MKD. P1 & P2 (SCALE 1:50)

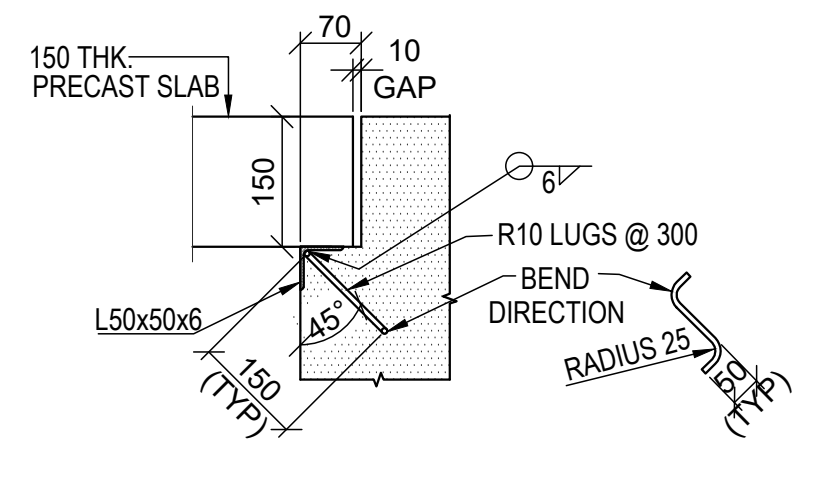

DETAIL -X (SCALE 1:10)

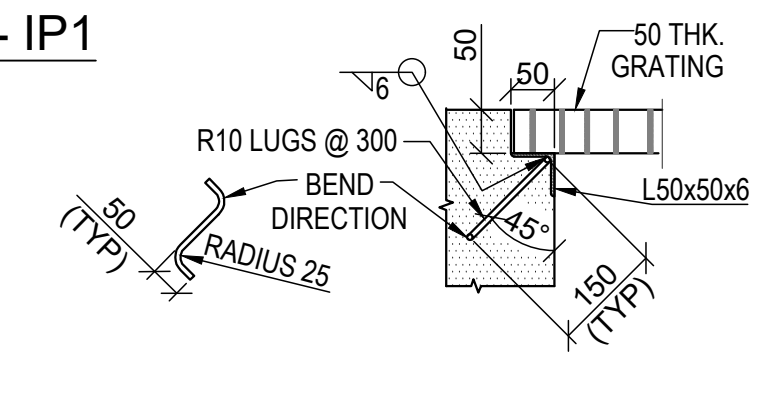

DETAIL - P (SCALE 1:10)

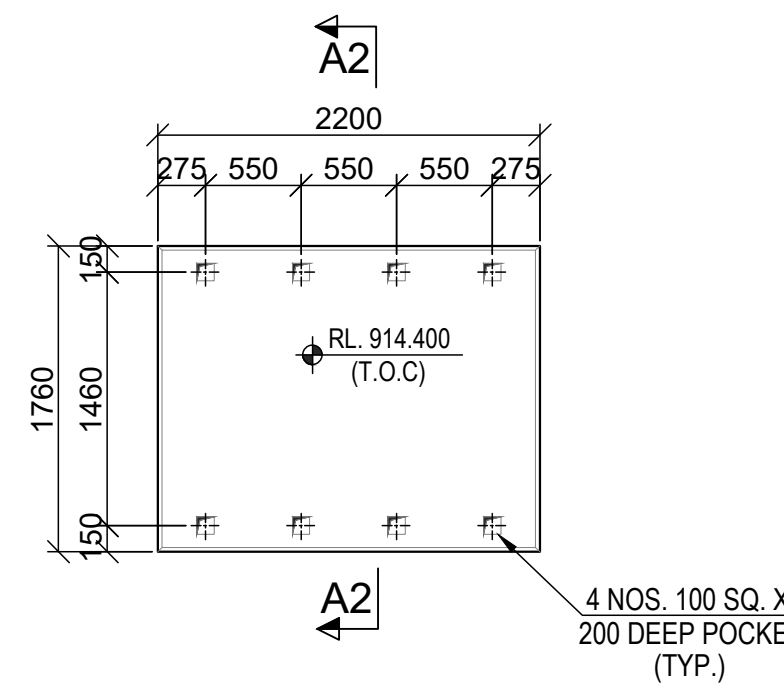

TYP. DETAIL OF PEDESTAL MKD. P2 (SCALE 1:50)

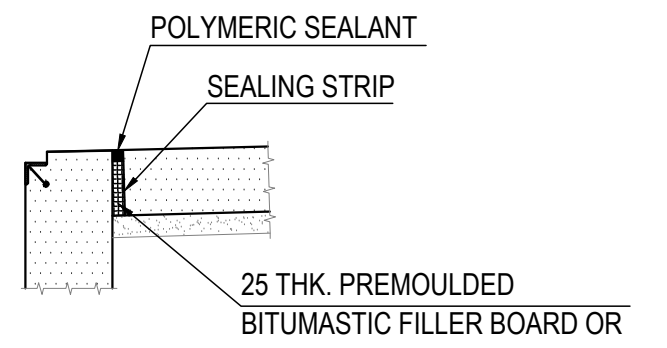
POLYMERIC SEALANT
SEALING STRIP
25 THK. PREMOULDED BITUMASTIC FILLER BOARD OR POLYSTYRENE JOINT FILLER

DETAIL - Z (SCALE 1:20)

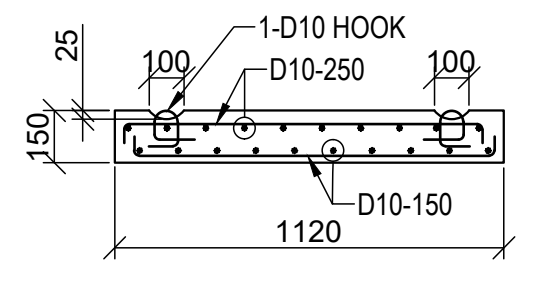

SECTION Y1-Y1 (SCALE 1:25)

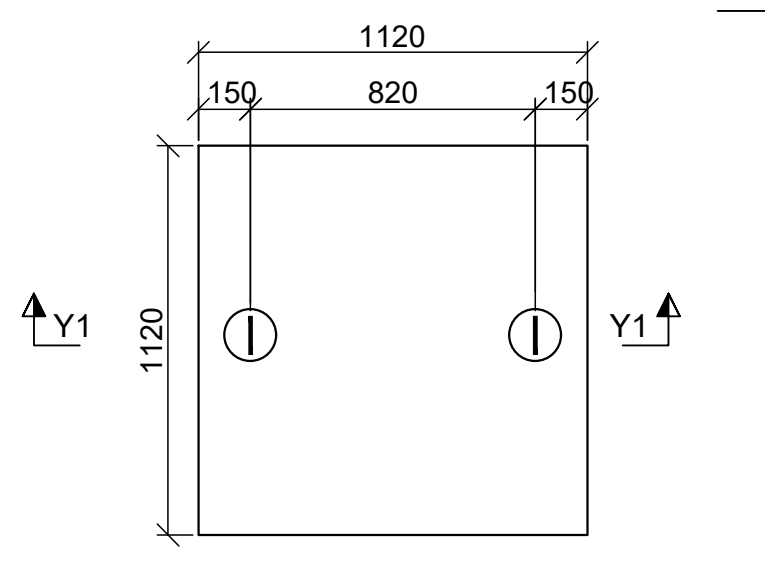

DETAIL OF PRECAST SLAB COVER (SCALE 1:25)

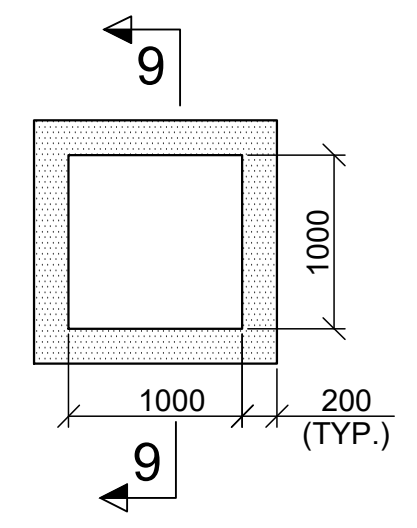

DETAIL OF PIT MKD. PT7 & PT7A (SCALE 1:50)

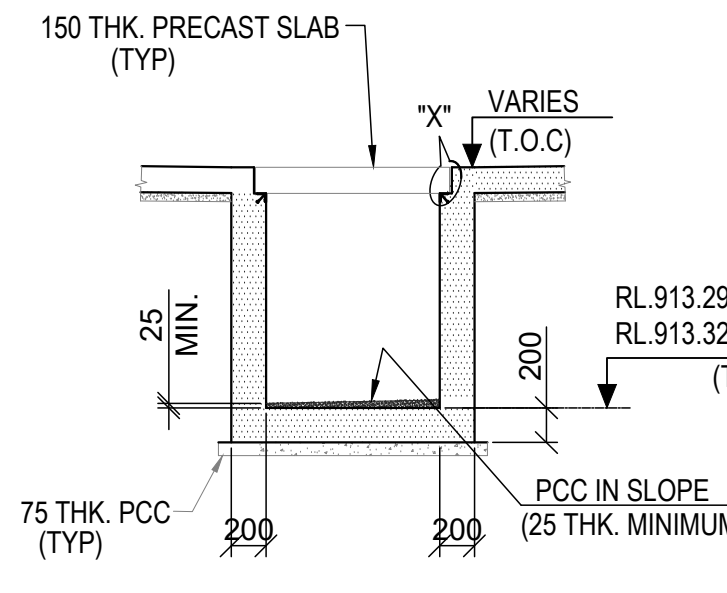
150 THK. PRECAST SLAB (TYP)
"X"
VARIES
RL 913.295 FOR PT7A
RL 913.325 FOR PT7 (T.O.C)
75 THK. PCC (TYP)
PCC IN SLOPE (25 THK. MINIMUM)

SECTION 9 - 9 (SCALE 1:50)

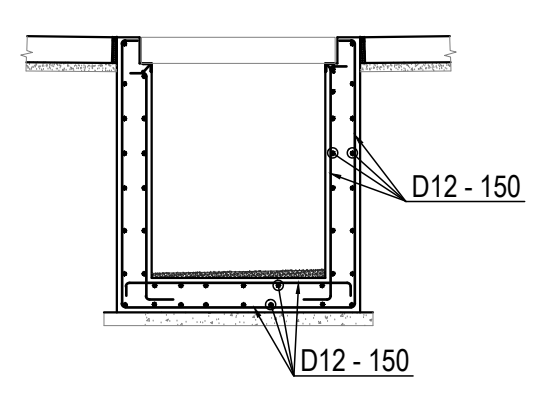

SECTION 9 - 9 (SHOWING RC DETAIL) (SCALE 1:50)

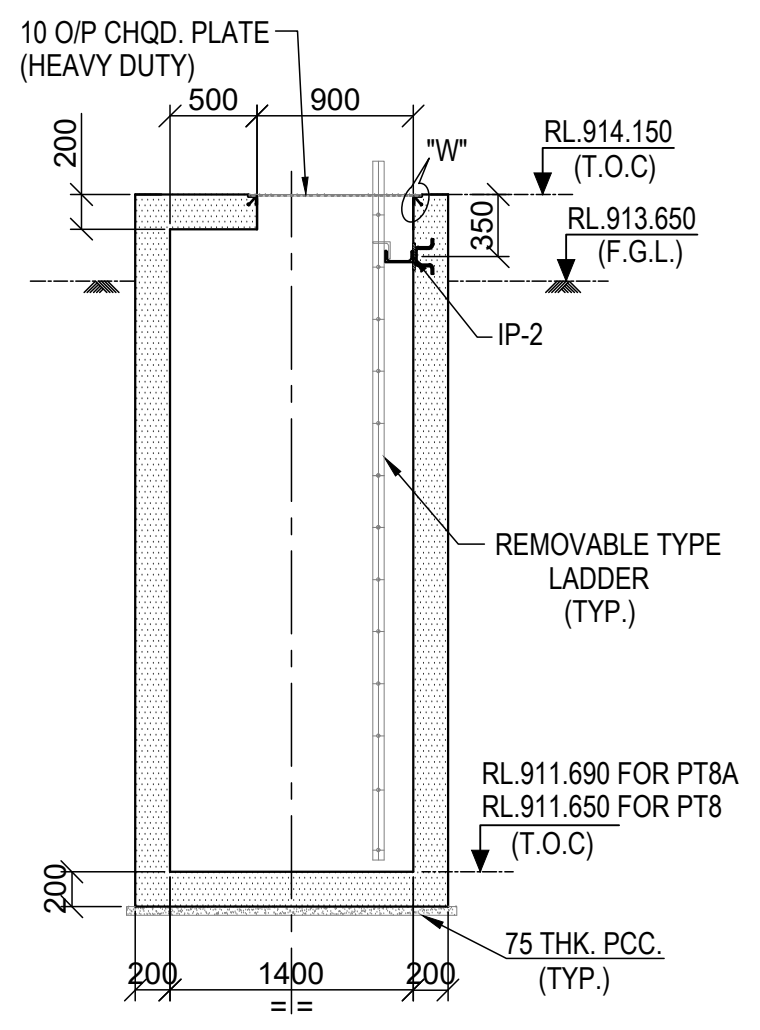
10 O/P CHQD. PLATE (HEAVY DUTY)
"W"
RL 914.150 (T.O.C)
RL 913.650 (F.G.L)
IP-2
REMOVABLE TYPE LADDER (TYP.)
RL 911.690 FOR PT8A
RL 911.650 FOR PT8 (T.O.C)
75 THK. PCC (TYP.)

SECTION 3 - 3 (SCALE 1:50)

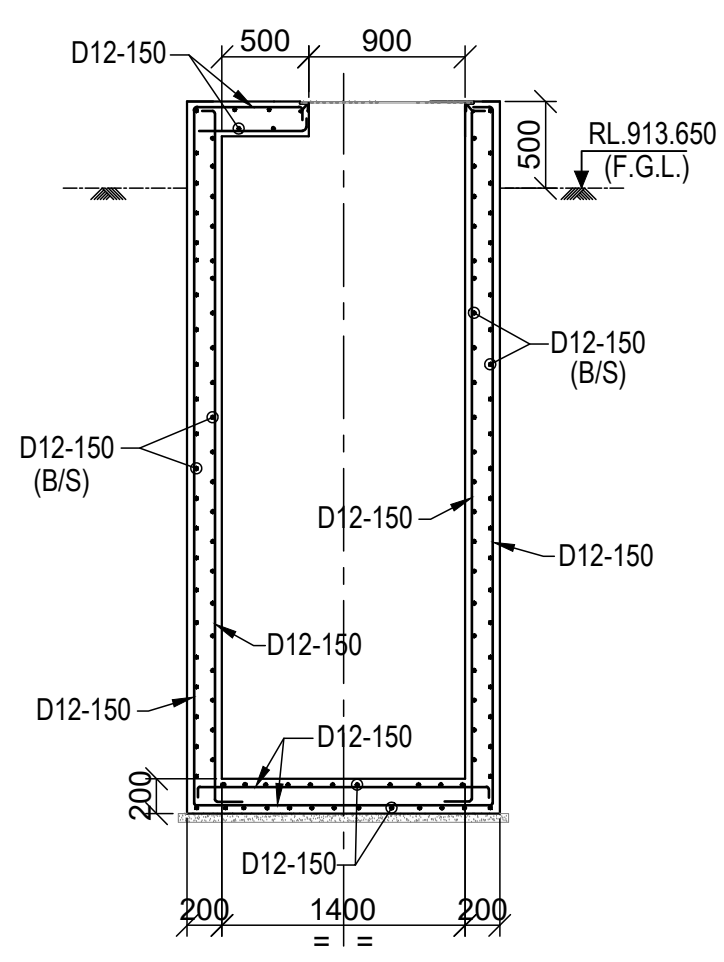

SECTION 3 - 3 (SHOWING RC DETAIL) (SCALE 1:50)

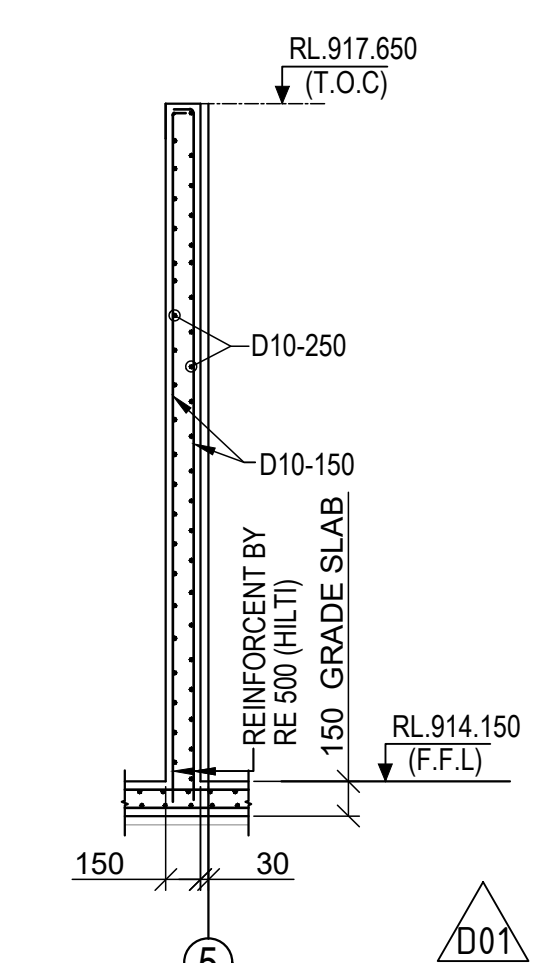

SECTION X - X
(The partition wall shall be executed with lugs welded with structural column and the wall shall be casted from web to web of the existing structural columns)
(SCALE 1:50)

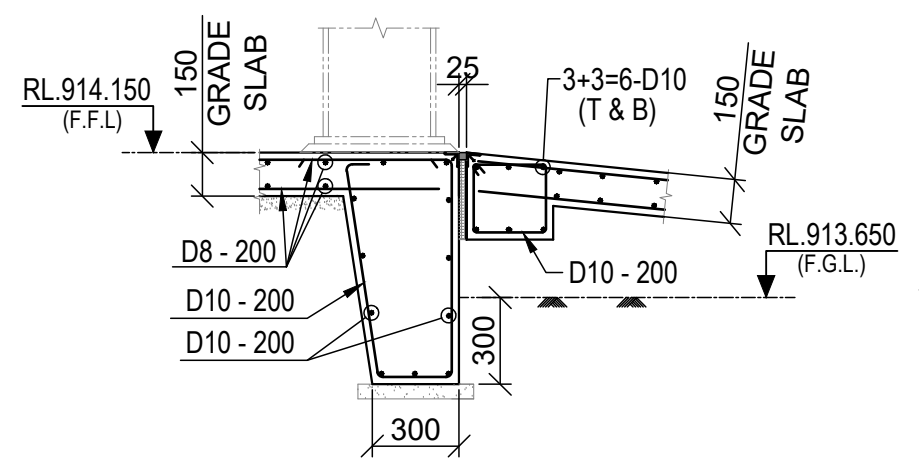

DETAIL - A (SHOWING RC DETAIL) (SCALE 1:30)

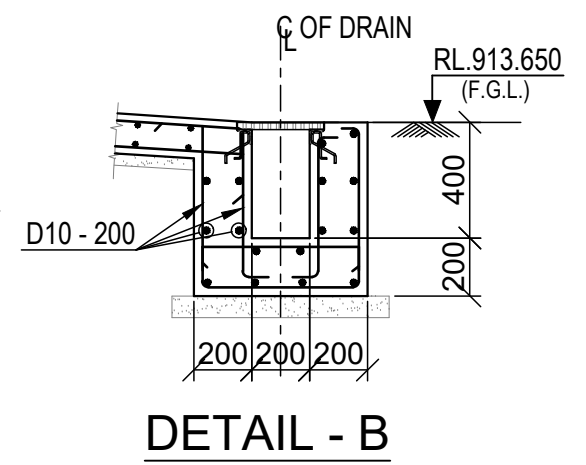

DETAIL - B (SHOWING RC DETAIL) (SCALE 1:30)

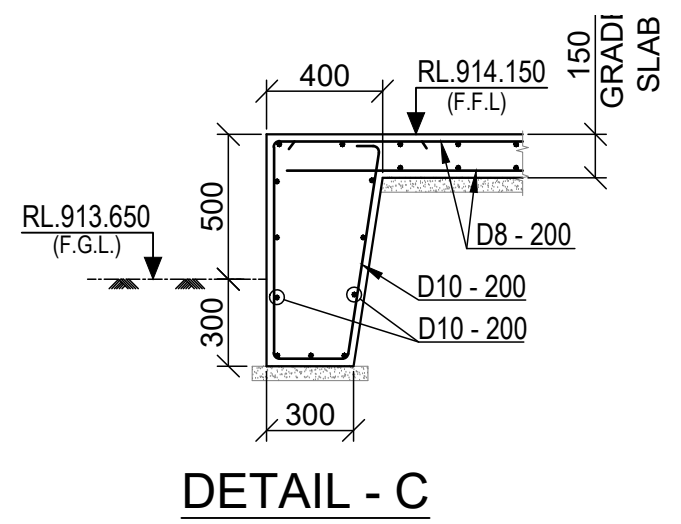

DETAIL - C (SHOWING RC DETAIL) (SCALE 1:30)

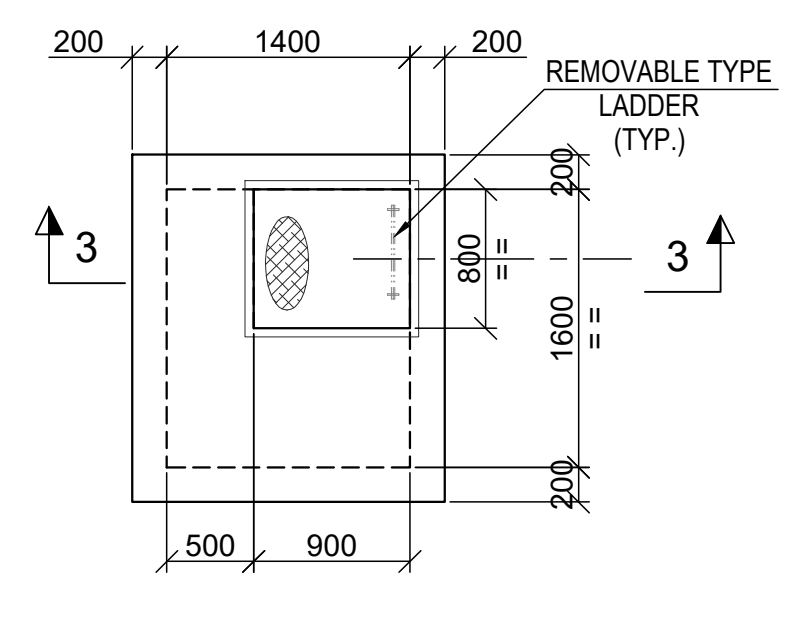

TYP. DETAIL OF PIT MKD. PT8 (SCALE 1:50)

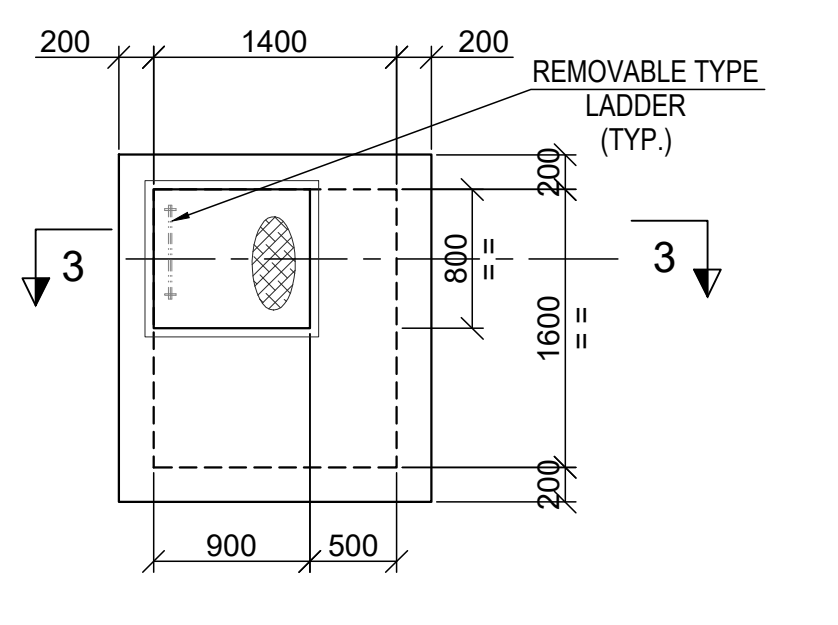

TYP. DETAIL OF PIT MKD. PT8A (SCALE 1:50)

LEGEND :-

R.L. - REDUCED LEVEL
T.O.C. - TOP OF CONCRETE.
F.G.L. - FINISHED GROUND LEVEL.
F.F.L. - FINISHED FLOOR LEVEL.
TYP. - TYPICAL.
P.C.C - PLAIN CEMENT CONCRETE
℄ - CENTRE LINE
MKD. - MARKED
B.O.F. - BOTTOM OF FOUNDATION
THK. - THICK
FDN. - FOUNDATION
DIA - DIAMETER
DRG.- DRAWING
C/C- CENTRE TO CENTRE
OS. - OILY WATER DRAINAGE PIPE
I.L - INVERT LEVEL
CE - CONDUIT EARTHING
PS - PIPE SLEEVE
CHQD. - CHEQUERED PLATE
GA. - GENERAL ARRANGEMENT.

NOTES :-

1. ALL DIMENSIONS ARE IN MILLIMETRES AND LEVELS AND CO-ORDINATES ARE IN METRES. UNLESS OTHERWISE STATED.
2. GRADE OF CONCRETE SHALL BE 35 MPa FOR FOUNDATION & 15 MPa FOR BLINDING CONCRETE.
3. GRADE OF REINFORCEMENT SHALL BE DEFORMED BAR 420 MPa (GRADE 60) - ASTM A615/A615M.
4. NET SAFE BEARING CAPACITY OF SOIL AT BOTTOM OF FOUNDATION CONSIDER 500KN/ SQ. M.
5. CLEAR COVER TO MAIN REINFORCEMENT SHALL BE 75 mm FOR RAFT & 50 mm FOR COLUMN.
6. IF ANY PART OF FOUNDATION COMES ON BACKFILL ZONE OF ADJACENT FOUNDATION OR ANY LOOSE SOIL ARE ENCOUNTERED BELOW FOUNDATION LEVEL THE SAME SHALL BE REMOVED AND FILLED WITH PCC.
7. FOR DETAILS OF GRADE SLAB REFER DRG. NO. MD-216-1000-EG-CV-DED-1002.
8. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH DRAWING NO. MD-216-49PR-EG-ST-GAD-2411.
9. FOR ALL OTHER NOTES REFER DRAWING NO. MD-101-SMEM-EG-ST-DST-0001 TO 0008.
10. FOR GENERAL NOTES OF CIVIL WORKS & STANDARD REINFORCEMENT DETAIL REFER DRAWING NO. MD-216-1000-EG-CV-DED-1001 & 1005.
11. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH DRAWING NO. MD-216-49PR-EG-CV-GAD-1626.
12. OILY WATER DRAINAGE TO BE ADJUSTED ACCORDING TO SITE CONDITION.
13. PIPING MATERIAL STANDARD - AT12, HDPE (PEA4710).
14. ALL LEVELS AS MENTIONED ARE BOTTOM OF PIPE.
15. FOR STANDARD DETAILS OF GRADE SLAB REFER DRAWING NO. MD-216-1000-EG-CV-DED-1002.
16. ALL PIT PIPE CONNECTION SHALL BE DONE AS PER THE PLAN DRAWING. IN ELEVATION OF THE PITS THE PIPE CONNECTION ARE NOT SHOWN.

DOCUMENT NUMBER	REFERENCE DOCUMENTS	REV	DATE	REVISION DESCRIPTION	DRN	CHK	ENG	APP	EMP
		D01	06/03/2023	AS-BUIL & REVISED AS MKD. D01	SYA	SJM	AVG	AG	
MD-216-49PR-EG-ME-LAD-V553-1011	FUEL UNLOADING STATION - OILY WATER DRAINAGE	C03	18/06/2021	ISSUED FOR CONSTRUCTION AND REVISED AS MKD. C03	SYA	SJM	AVG	AG	
MD-216-49PR-EG-ME-GAD-V553-1056	FUEL UNLOADING STATION, 4 TRUCKS FUEL SYSTEM	C02	23/12/2020	ISSUED FOR CONSTRUCTION AND REVISED AS MKD. C02	AMJ	SGC	SHD	PRI	
MD-216-49PR-EG-ME-GAD-V553-1054	GENERAL ARRANGEMENT DRAWING FUEL UNLOADING AREA.	C01	22/09/2020	ISSUED FOR CONSTRUCTION AND REVISED AS MKD. C01	AMJ	SGC	SHD	PRI	
MD-216-1000-EG-CV-DED-1003	ANCHOR BOLTS STANDARD DETAILS.	A02	18/08/2020	REVISED AS PER EMPLOYER COMMENTS ON 13/07/2020	AMJ	SGC	SHD	PRI	
MD-216-1000-EG-ST-CRT-1001	CIVIL, STRUCTURAL & ARCHITECTURAL - DESIGN CRITERIA			& REVISED AS MKD. A02					
MD-216-49PR-EG-ME-LAD-V553-1002	LAUOUT OF POWER GENERATION	A01	10/06/2020	ISSUED FOR REFERENCE	AMJ	SGC	SHD	PRI	

DOCUMENT NUMBER	REFERENCE DOCUMENTS	REV	DATE	REVISION DESCRIPTION	DRN	CHK	ENG	APP	EMP

RESERVED FOR VENDOR LOGO AND DRAWING NUMBER

LARSEN & TOUBRO

This drawing is the property of LARSEN & TOUBRO and must not be passed on to any person or body not authorized by us to receive it nor be copied or otherwise made use either in full or in part by such person or body without our prior permission in writing.

Outotec

The content of these documents are the sole property of Outotec Oyj. Any rights not expressly granted herein are reserved. Reproduction, transfer or distribution of part or all of the contents in any form without prior written permission of Outotec is prohibited.

MA'ADEN معادن
Saudi Arabian Mining Company شركة التعدين العربية السعودية

This document and the information contained herein is Ma'aden proprietary know-how. This document or any part thereof should not be reproduced, stored in a retrieval system or transmitted by any means, electronic or otherwise, or divulged without prior written permission of Ma'aden.

LARSEN & TOUBRO DRAWING NUMBER	019045_008_C_G_24290_005	REVISION 5
OUTOTEC DRAWING NUMBER	900707 _ GAU01 _ WG01 _ MTL01 _ 45049	
DOCUMENT ID	0U100682325	REVISION 5

DRAWN	AMJ	25/05/2020
CHECKED	SGC	27/05/2020
ENGINEER	SHD	24/05/2020
APPROVED	PRI	10/06/2020
EMPLOYER		
SCALE	1:200,100,20	A0

MANSOURAH - MASSARAH GOLD PROJECT
GENERAL ARRANGEMENT
FUEL UNLOADING STATION
GA AND DETAIL OF GRADE SLAB

DRAWING NUMBER
MD - 216 - 49PR - EG - CV - GAD - 1628
REV
D01