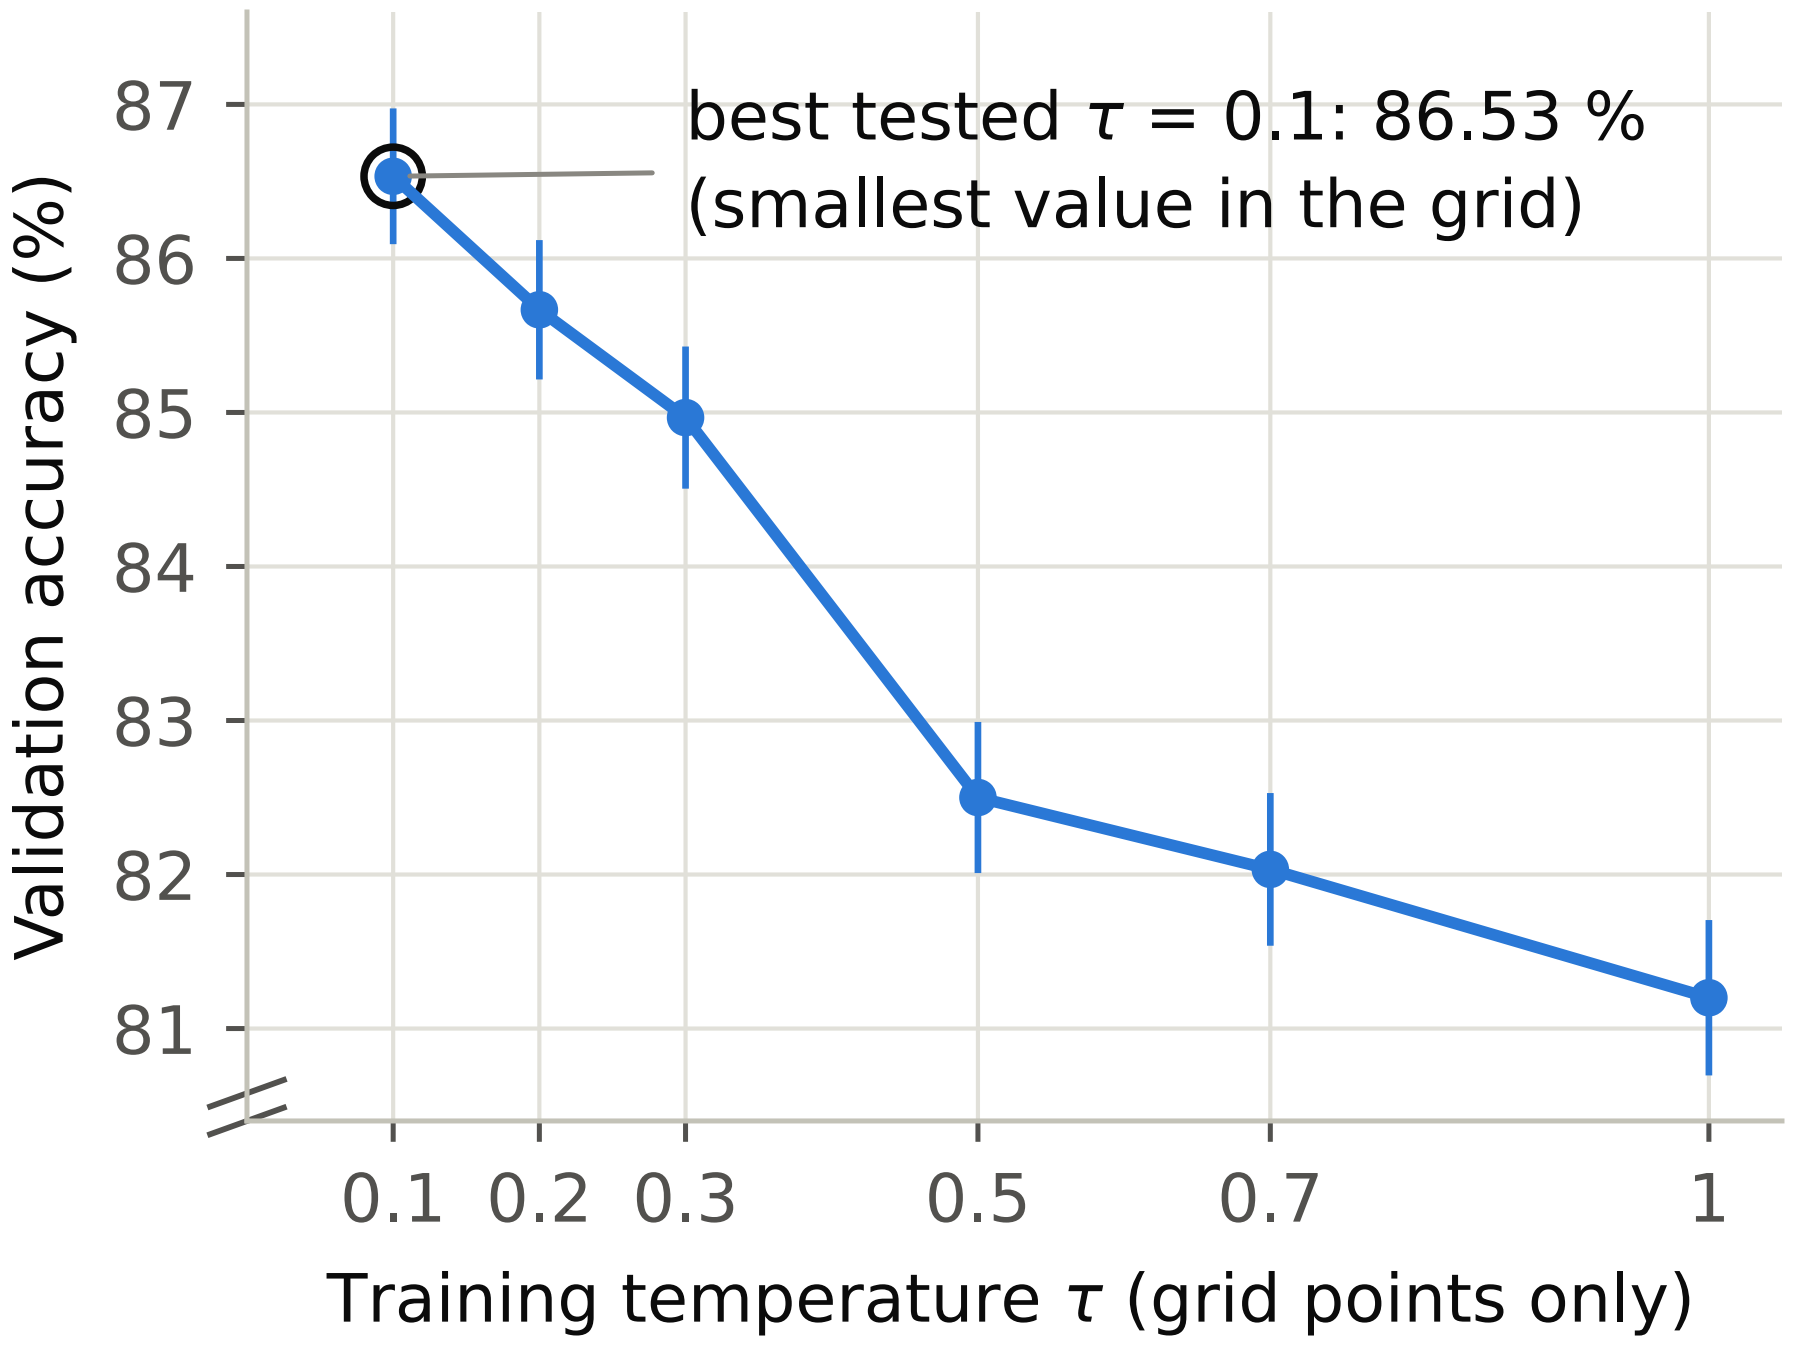
best tested $\tau$ = 0.1: 86.53 %
(smallest value in the grid)
Validation accuracy (%)
87
86
85
84
83
82
81
0.1
0.2
0.3
0.5
0.7
1
Training temperature $\tau$ (grid points only)