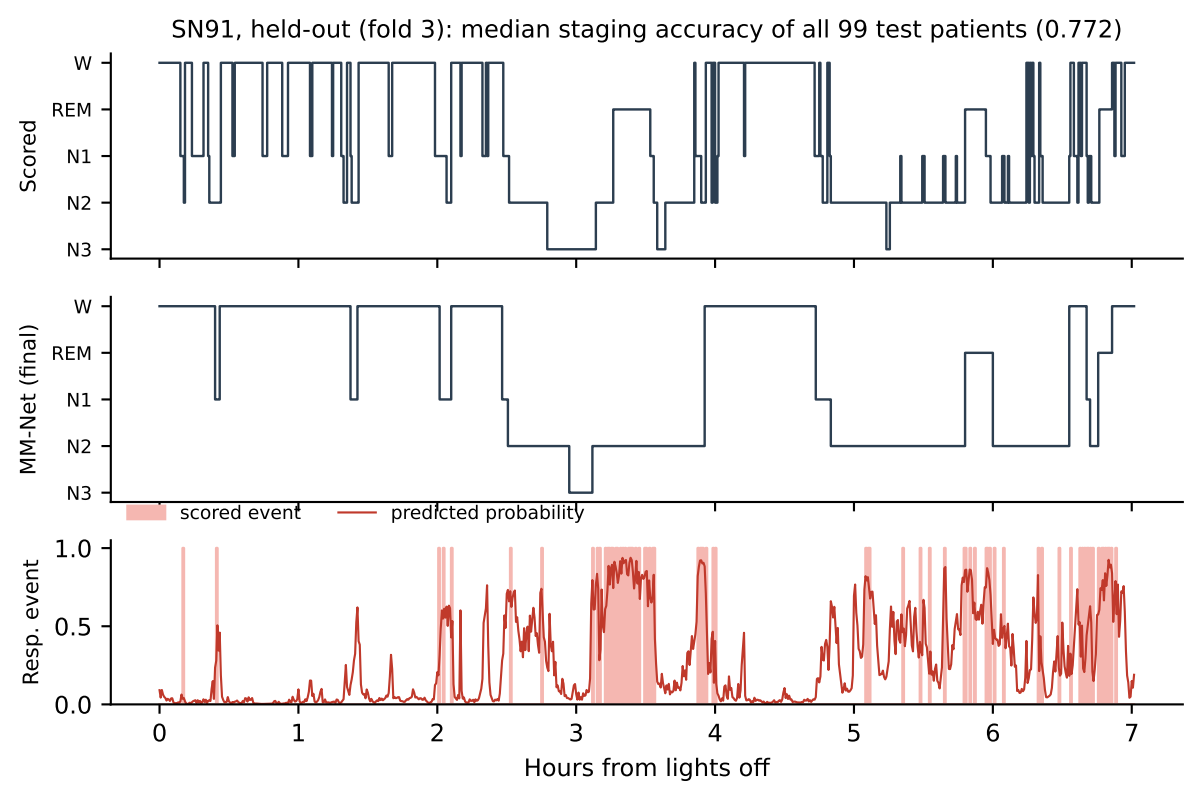
SN91, held-out (fold 3): median staging accuracy of all 99 test patients (0.772)
Scored
W
REM
N1
N2
N3
MM-Net (final)
W
REM
N1
N2
N3
scored event
predicted probability
Resp. event
1.0
0.5
0.0
0
1
2
3
4
5
6
7
Hours from lights off