



Fig. 5.10 diagnostic: DE421-initialized planar BCR4BP extension
Numerical acceptance 2/2; paper equivalence 0/2 (not a canonical thesis-figure replacement)


(a) Case 1: 23.0 d | numerical PASS

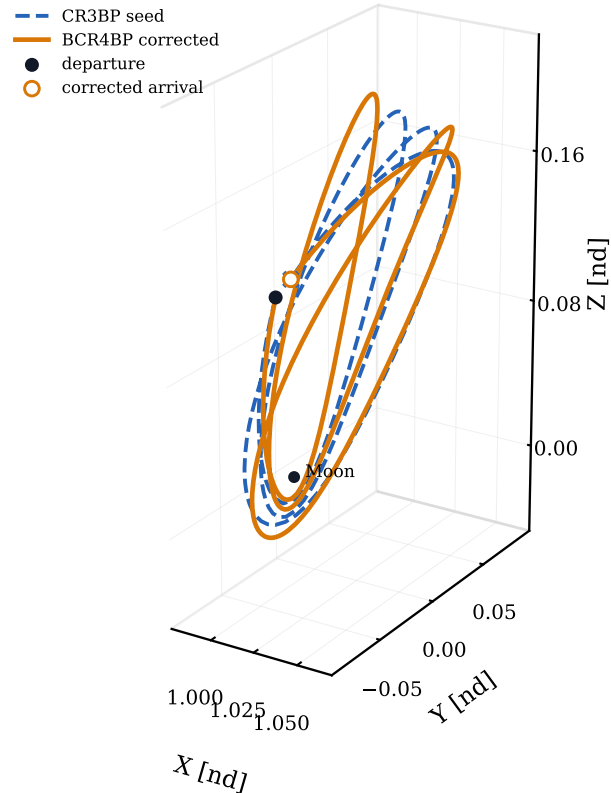

(b) Case 2: 12.4 d | numerical PASS

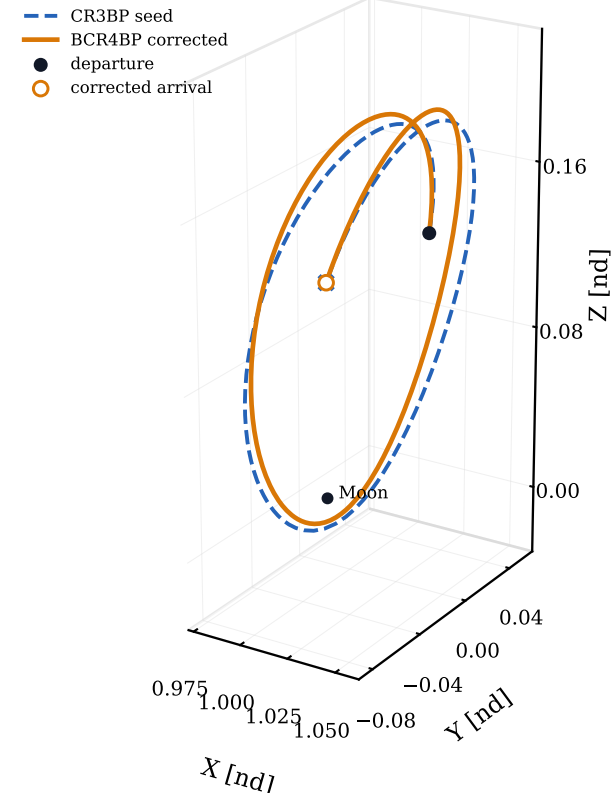

(c) Two-impulse total Δv comparison

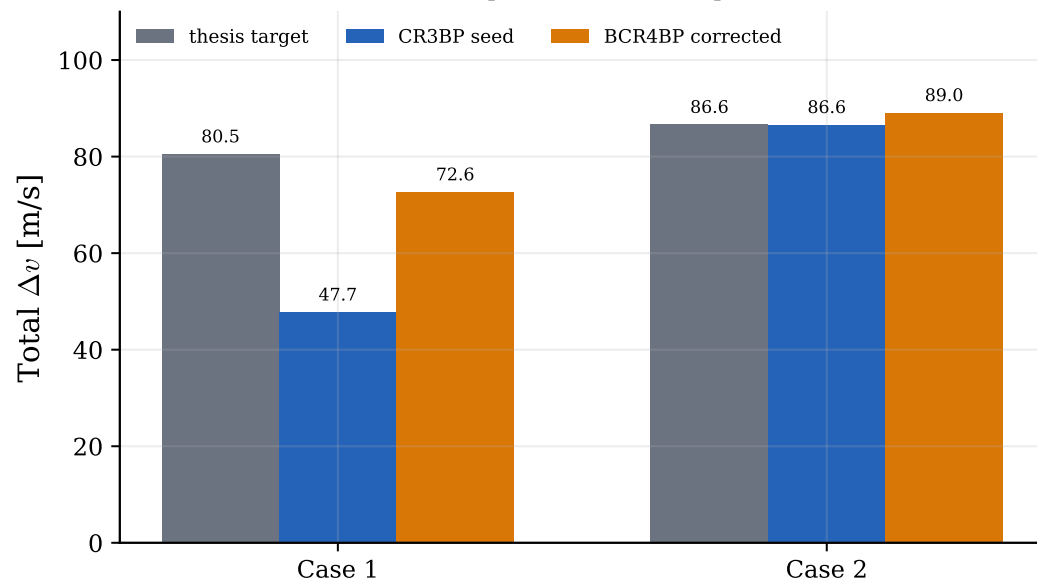

(d) Independent terminal propagation audit

