



SOLAR DISTRICT COOLING SDN BHD

KKR2 MONTHLY REPORT

MONTH: AUGUST
TEAM MEMBERS: MUHAMMAD AMIRUN SHAHMI BIN ROSHDI
MUHAMMAD HAZIQ AIMAN BIN SHAHARIN
SUBMITTED TO: CAKRA MAKOTA SDN BHD
DATE OF SUBMISSION: 24/8/2026

PREPARED BY :	
HAZIQ	
NAME :	MUHAMMAD HAZIQ AIMAN
DATE :	24/8/2026

ACKNOWLEDGE BY :	
NAME :	ZAINAL ABIDIN BIN CHE HASSAN
DATE :	


KEMENTERIAN KERJA RAYA 2 MONTHLY REPORT

NO	DEVICE FUNCTIONALITY	FUNCTIONAL (%)	FAULTY (%)
1	WORKSTATION	100%	0%
2	JACE	75%	25%
3	DDC	98%	2%
4	AHU	58%	42%
5	FCU LL	45%	55%
6	FCU TCR	51%	49%
7	VAV	88%	12%
8	CHILLER	90%	10%
9	DPM SSBM	71%	29%
10	DPM SSBE	58%	43%
11	DPM SSB	56%	44%
12	VRF	0%	100%
13	FAN	64%	36%
TOTAL		66%	34%

OVERALL TOTAL FUNCTIONALITY



BMS SERVICES FUNCTIONALITY

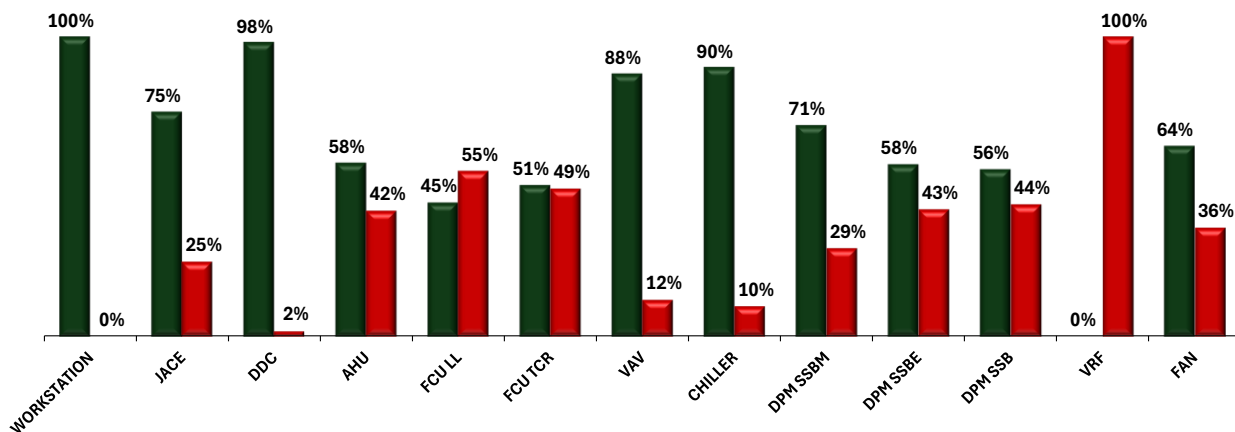

NO	ITEM	PROBLEM / REMARK	PROBLEM IMPACT	RECOMMENDATION
1	NETWORK CONTROL UNIT (DB1) AND (DB3)	FAULTY	A FAULTY OR OFFLINE NETWORK CONTROLLER CAN CAUSE LOSS OF CONNECTIVITY AND DECREASED PERFORMANCE. MANY EQUIPMENT CANNOT BE CONTROL IF NETWORK CONTROLLER UNIT IS FAULTY	NEED TO REPLACE NCU (DB1) AND NCU (DB3)
2	DDC	OFFLINE	ALL DDC FOR NCU (DB1) AND NCU (DB3) OFFLINE	NEED TO REPLACE NCU (DB1) AND NCU (DB3)
3	SENSOR	SEVERAL SENSOR FOR AHU, FCU AND CHILLER ARE FAULTY	INNACURATE READING FROM THE SENSORS	NEED TO REPLACE THE SENSORS
4	WATER METER	ALL WATER METER FROM TOTALIZER ENCOUNTER COMMUNICATION FAULTY	WATER METER VALUE CANNOT BE READ AND COUNT	NEED TO REPLACE THE WATER METER
5	HIGH LEVEL INTERFACING (HLI) CHILLER	ALL CHILLER HLI COMMUNICATION FAULTY	HLI CHILLER CANNOT BE READ	NEED TO REPLACE CHILLER CARD
6	VSD	A FEW VSD FOR AHU AND CHILLER FAULTY	VSD CANNOT BE CONTROL	NEED TO REPLACE NEW VSD
7	VAV	A FEW VAV FAULTY	VAV CANNOT BE CONTROL	NEED TO REPLACE NEW VAV

DATA TABLE: WORKSTATION

FUNCTIONAL	PERCENTAGE (%)	100%
FAULTY	PERCENTAGE (%)	0%

WORKSTATION PC - CONTROL ROOM

NO	DESCRIPTION	FREQUENCY	PASS	FAIL	REMARK
1	PERSONAL COMPUTER	MONTHLY			
	ACCESS TO AND PERFORMANCE OF THE SYSTEM		✓		OK
	MEMORY CAPACITY / DRIVER OF WORKSTATION		✓		OK
	MONITOR FOR CLARITY, FOCUS & COLOUR		✓		OK
	VERIFY WORKSTATION'S IP ADDRESS		✓		192.168.1.2
	CLEAN ALL EXTERIOR SURFACES		✓		OK
2	SYSTEM VERIFICATION				
	SYSTEM LOG-IN & LOG-OUT VERIFICATION		✓		OK
	CRITICAL, FOLLOW-UP & OFFLINE INDICATION		✓		OK
	OVERIDE, RELEASE INDICATION		✓		OK
	DATE, TIME & HARDWARE STATUS		✓		OK
	POWER RESTART & REBOOT		✓		OK
	GRAPHIC FUNCTIONALITY		✓		OK
3	SOFTWARE VERIFICATION				
	SAVE WORKSTATION SOFTWARE (DATABASE)		✓		OK
	SAVE / UPDATE FIELD SOFTWARE (NCU / DDC)		✓		OK
	SYNCHRONIZATION OF DATABASE		✓		OK
	INSPECT HISTORY EXTENSION		✓		OK
	INSPECT ALARM PORTAL CONNECTIVITY		✓		OK

DATA TABLE: JACE / NCU

FUNCTIONAL	PERCENTAGE (%)	75%
	OK (UNIT)	6
FAULTY	PERCENTAGE (%)	25%
	FAULTY (UNIT)	2

NO	JACE NAME	IP ADDRESS	LOCATION	STATUS	REMARK
1	KKR2-DB1	192.168.1.10	AHU WEST LEVEL 5	✗	4. CWOSDC202604303218
2	KKR2-DB1A	192.168.10.122	AHU WEST LEVEL 5	✓	
3	KKR2-DB2	192.168.1.20	CHILLER PLANT ROOM	✓	
4	KKR2-DB3	192.168.30.11	AHU WEST LEVEL 14	✗	6. CWOSDC202606293404
5	KKR2-DB3A	192.168.30.101	AHU WEST LEVEL 14	✓	
6	KKR2-DB4	192.168.1.40	AHU WEST LEVEL 23	✓	
7	KKR2-DB5	192.168.1.50	AHU WEST LEVEL 24	✓	
8	KKR2-DB6	192.168.1.60	AHU WEST LEVEL 32	✓	

DATA TABLE: DDC

FUNCTIONAL	PERCENTAGE (%)	98%
	OK (UNIT)	164
FAULTY	PERCENTAGE (%)	2%
	FAULTY (UNIT)	3

NO	DDC NAME	BRAND / MODEL	STATUS	REMARK
1	BMS-B2-1-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
2	BMS-B2-1-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
3	BMS-B2-1-3	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
4	BMS-B2-2-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
5	BMS-B2-2-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
6	BMS-B2-2-3	EASY IO 30P	✗	6. CWOSDC202606033316
7	BMS-B2-2-4	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
8	BMS-B2-3-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
9	BMS-B2-3-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
10	BMS-B1-1-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
11	BMS-B1-1-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
12	BMS-B1-1-3	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
13	BMS-B1-2-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
14	BMS-B1-2-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
15	BMS-B1-2-3	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
16	BMS-B1-3-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
17	BMS-B1-3-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
18	BMS-LGR-1-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
19	BMS-LGR-1-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
20	BMS-LGR-1-3	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
21	BMS-L1-1-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
22	BMS-L1-2-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
23	BMS-L2-1-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
24	BMS-L2-2-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
25	BMS-L3-1-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
26	BMS-L3-1-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
27	BMS-L3-2-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
28	BMS-L3-2-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
29	BMS-L3-2-3	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
30	BMS-L4-1-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
31	BMS-L4-1-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
32	BMS-L4-2-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
33	BMS-L4-2-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
34	BMS-L5-1-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
35	BMS-L5-1-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
36	BMS-L5-2-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY
37	BMS-L5-2-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB1 FAULTY

DATA TABLE: DDC

FUNCTIONAL	PERCENTAGE (%)	98%
	OK (UNIT)	164
FAULTY	PERCENTAGE (%)	2%
	FAULTY (UNIT)	3

NO	DDC NAME	BRAND / MODEL	STATUS	REMARK
38	BMS-L6-1-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
39	BMS-L6-1-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
40	BMS-L6-2-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
41	BMS-L6-2-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
42	BMS-L7-1-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
43	BMS-L7-1-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
44	BMS-L7-2-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
45	BMS-L7-2-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
46	BMS-L8-1-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
47	BMS-L8-1-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
48	BMS-L8-2-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
49	BMS-L8-2-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
50	BMS-L9-1-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
51	BMS-L9-1-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
52	BMS-L9-2-1	EASY IO 30P	✗	OFFLINE DUE TO JACE DB3 FAULTY, POWER OFF DUE TO VSD PROBLEM
53	BMS-L9-2-2	EASY IO 30P	✗	OFFLINE DUE TO JACE DB3 FAULTY, POWER OFF DUE TO VSD PROBLEM
54	BMS-L10-1-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
55	BMS-L10-1-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
56	BMS-L10-2-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
57	BMS-L10-2-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
58	BMS-L11-1-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
59	BMS-L11-1-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
60	BMS-L11-2-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
61	BMS-L11-2-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
62	BMS-L12-1-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
63	BMS-L12-1-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
64	BMS-L12-2-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
65	BMS-L12-2-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
66	BMS-L13-1-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
67	BMS-L13-1-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
68	BMS-L13-2-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
69	BMS-L13-2-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
70	BMS-L14-1-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
71	BMS-L14-1-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
72	BMS-L14-2-1	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY

DATA TABLE: DDC

FUNCTIONAL	PERCENTAGE (%)	98%
	OK (UNIT)	164
FAULTY	PERCENTAGE (%)	2%
	FAULTY (UNIT)	3

NO	DDC NAME	BRAND / MODEL	STATUS	REMARK
73	BMS-L14-2-2	EASY IO 30P	✓	OFFLINE DUE TO JACE DB3 FAULTY
74	BMS-L15-1-1	EASY IO 30P	✓	
75	BMS-L15-1-2	EASY IO 30P	✓	
76	BMS-L15-2-1	EASY IO 30P	✓	
77	BMS-L15-2-2	EASY IO 30P	✓	
78	BMS-L16-1-1	EASY IO 30P	✓	
79	BMS-L16-1-2	EASY IO 30P	✓	
80	BMS-L16-2-1	EASY IO 30P	✓	
81	BMS-L16-2-2	EASY IO 30P	✓	
82	BMS-L17-1-1	EASY IO 30P	✓	
83	BMS-L17-1-2	EASY IO 30P	✓	
84	BMS-L17-2-1	EASY IO 30P	✓	
85	BMS-L17-2-2	EASY IO 30P	✓	
86	BMS-L18-1-1	EASY IO 30P	✓	
87	BMS-L18-1-2	EASY IO 30P	✓	
88	BMS-L18-1-3	EASY IO 30P	✓	
89	BMS-L18-1-4	EASY IO 30P	✓	
90	BMS-L18-1-5	EASY IO 30P	✓	
91	BMS-L18-2-1	EASY IO 30P	✓	
92	BMS-L18-2-2	EASY IO 30P	✓	
93	BMS-L18-2-3	EASY IO 30P	✓	
94	BMS-L18-2-4	EASY IO 30P	✓	
95	BMS-L18-2-5	EASY IO 30P	✓	
96	BMS-L18-2-6	EASY IO 30P	✓	
97	BMS-L19-1-1	EASY IO 30P	✓	
98	BMS-L19-2-1	EASY IO 30P	✓	
99	BMS-L19-2-2	EASY IO 30P	✓	
100	BMS-L20-1-1	EASY IO 30P	✓	
101	BMS-L20-1-2	EASY IO 30P	✓	
102	BMS-L20-2-1	EASY IO 30P	✓	
103	BMS-L20-2-2	EASY IO 30P	✓	
104	BMS-L21-1-1	EASY IO 30P	✓	
105	BMS-L21-1-2	EASY IO 30P	✓	
106	BMS-L21-2-1	EASY IO 30P	✓	
107	BMS-L21-2-2	EASY IO 30P	✓	
108	BMS-L22-1-1	EASY IO 30P	✓	
109	BMS-L22-1-2	EASY IO 30P	✓	

DATA TABLE: DDC

FUNCTIONAL	PERCENTAGE (%)	98%
	OK (UNIT)	164
FAULTY	PERCENTAGE (%)	2%
	FAULTY (UNIT)	3

NO	DDC NAME	BRAND / MODEL	STATUS	REMARK
110	BMS-L22-2-1	EASY IO 30P	✓	
111	BMS-L22-2-2	EASY IO 30P	✓	
112	BMS-L23-1-1	EASY IO 30P	✓	
113	BMS-L23-1-2	EASY IO 30P	✓	
114	BMS-L23-2-1	EASY IO 30P	✓	
115	BMS-L23-2-2	EASY IO 30P	✓	
116	BMS-L24-1-1	EASY IO 30P	✓	
117	BMS-L24-1-2	EASY IO 30P	✓	
118	BMS-L24-2-1	EASY IO 30P	✓	
119	BMS-L24-2-2	EASY IO 30P	✓	
120	BMS-L25-1-1	EASY IO 30P	✓	
121	BMS-L25-1-2	EASY IO 30P	✓	
122	BMS-L25-2-1	EASY IO 30P	✓	
123	BMS-L25-2-2	EASY IO 30P	✓	
124	BMS-L26-1-1	EASY IO 30P	✓	
125	BMS-L26-1-2	EASY IO 30P	✓	
126	BMS-L26-2-1	EASY IO 30P	✓	
127	BMS-L26-2-2	EASY IO 30P	✓	
128	BMS-L27-1-1	EASY IO 30P	✓	
129	BMS-L27-1-2	EASY IO 30P	✓	
130	BMS-L27-2-1	EASY IO 30P	✓	
131	BMS-L27-2-2	EASY IO 30P	✓	
132	BMS-L28-1-1	EASY IO 30P	✓	
133	BMS-L28-1-2	EASY IO 30P	✓	
134	BMS-L28-2-1	EASY IO 30P	✓	
135	BMS-L28-2-2	EASY IO 30P	✓	
136	BMS-L29-1-1	EASY IO 30P	✓	
137	BMS-L29-1-2	EASY IO 30P	✓	
138	BMS-L29-2-1	EASY IO 30P	✓	
139	BMS-L29-2-2	EASY IO 30P	✓	
140	BMS-L30-1-1	EASY IO 30P	✓	
141	BMS-L30-1-2	EASY IO 30P	✓	
142	BMS-L30-2-1	EASY IO 30P	✓	
143	BMS-L30-2-2	EASY IO 30P	✓	
144	BMS-L31-1-1	EASY IO 30P	✓	
145	BMS-L31-1-2	EASY IO 30P	✓	
146	BMS-L31-2-1	EASY IO 30P	✓	

DATA TABLE: DDC

FUNCTIONAL	PERCENTAGE (%)	98%
	OK (UNIT)	164
FAULTY	PERCENTAGE (%)	2%
	FAULTY (UNIT)	3

NO	DDC NAME	BRAND / MODEL	STATUS	REMARK
147	BMS-L31-2-2	EASY IO 30P	✓	
148	BMS-L32-1-1	EASY IO 30P	✓	
149	BMS-L32-1-2	EASY IO 30P	✓	
150	BMS-L32-2-1	EASY IO 30P	✓	
151	BMS-L32-2-2	EASY IO 30P	✓	
152	BMS-L33-1-1	EASY IO 30P	✓	
153	BMS-L33-1-2	EASY IO 30P	✓	
154	BMS-L33-2-1	EASY IO 30P	✓	
155	BMS-L33-2-2	EASY IO 30P	✓	
156	BMS-L34-1-1	EASY IO 30P	✓	
157	BMS-L34-1-2	EASY IO 30P	✓	
158	BMS-L35-1-1	EASY IO 30P	✓	
159	BMS-L35-1-2	EASY IO 30P	✓	
160	BMS-L35-2-1	EASY IO 30P	✓	
161	BMS-L35-2-2	EASY IO 30P	✓	
162	BMS-L36-1-1	EASY IO 30P	✓	
163	BMS-L36-1-2	EASY IO 30P	✓	
164	BMS-L36-1-3	EASY IO 30P	✓	
165	BMS-L36-1-4	EASY IO 30P	✓	
166	BMS-L36-1-5	EASY IO 30P	✓	
167	BMS-L36-1-6	EASY IO 30P	✓	

DATA TABLE: VAV						
FUNCTIONAL	PERCENTAGE (%)	95%	95%	66%	95%	88%
	OK (UNIT)	331	334	230	333	
FAULTY	PERCENTAGE (%)	5%	5%	34%	5%	12%
	FAULTY (UNIT)	19	16	120	17	

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	VAV NAME	BRAND / MODEL	CONTROLLER	TUBE	AIR FLOW	DAMPER	FUNCTIONALITY	REMARK
1	VAV-MZ-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
2	VAV-MZ-W-2	BELIMO VAV	✓	✓	✓	✓	100%	
3	VAV-MZ-W-3	BELIMO VAV	✓	✓	✓	✓	100%	
4	VAV-MZ-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
5	VAV-MZ-W-5	BELIMO VAV	✓	✓	✓	✓	100%	
6	VAV-MZ-W-6	BELIMO VAV	✓	✓	✓	✓	100%	
7	VAV-MZ-W-7	BELIMO VAV	✓	✓	✗	✓	75%	
8	VAV-MZ-W-8	BELIMO VAV	✓	✓	✗	✓	75%	
9	VAV-3-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
10	VAV-3-W-2	BELIMO VAV	✓	✓	✓	✓	100%	
11	VAV-3-W-3	BELIMO VAV	✓	✓	✓	✓	100%	
12	VAV-3-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
13	VAV-3-W-5	BELIMO VAV	✓	✓	✗	✓	75%	
14	VAV-3-E-1	BELIMO VAV	✓	✓	✗	✓	75%	
15	VAV-3-E-2	BELIMO VAV	✓	✓	✗	✓	75%	
16	VAV-3-E-3	BELIMO VAV	✓	✓	✗	✓	75%	
17	VAV-3-E-4	BELIMO VAV	✓	✓	✓	✓	100%	
18	VAV-3-E-5	BELIMO VAV	✓	✓	✗	✓	75%	

DATA TABLE: VAV						
FUNCTIONAL	PERCENTAGE (%)	95%	95%	66%	95%	88%
	OK (UNIT)	331	334	230	333	
FAULTY	PERCENTAGE (%)	5%	5%	34%	5%	12%
	FAULTY (UNIT)	19	16	120	17	

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	VAV NAME	BRAND / MODEL	CONTROLLER	TUBE	AIR FLOW	DAMPER	FUNCTIONALITY	REMARK
19	VAV-4-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
20	VAV-4-W-2	BELIMO VAV	✓	✓	✓	✓	100%	
21	VAV-4-W-3	BELIMO VAV	✓	✓	✗	✓	75%	
22	VAV-4-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
23	VAV-4-W-5	BELIMO VAV	✓	✓	✓	✓	100%	
24	VAV-4-W-6	BELIMO VAV	✓	✓	✓	✓	100%	
25	VAV-4-E-1	BELIMO VAV	✓	✓	✓	✓	100%	
26	VAV-4-E-2	BELIMO VAV	✓	✓	✓	✓	100%	
27	VAV-4-E-3	BELIMO VAV	✓	✓	✗	✓	75%	
28	VAV-4-E-4	BELIMO VAV	✓	✓	✓	✓	100%	
29	VAV-4-E-5	BELIMO VAV	✓	✓	✓	✓	100%	
30	VAV-4-E-6	BELIMO VAV	✓	✓	✓	✓	100%	
31	VAV-5-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
32	VAV-5-W-2	BELIMO VAV	✓	✓	✓	✓	100%	
33	VAV-5-W-3	BELIMO VAV	✓	✓	✓	✓	100%	
34	VAV-5-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
35	VAV-5-W-5	BELIMO VAV	✓	✓	✓	✓	100%	
36	VAV-5-W-6	BELIMO VAV	✓	✓	✓	✓	100%	

DATA TABLE: VAV						
FUNCTIONAL	PERCENTAGE (%)	95%	95%	66%	95%	88%
	OK (UNIT)	331	334	230	333	
FAULTY	PERCENTAGE (%)	5%	5%	34%	5%	12%
	FAULTY (UNIT)	19	16	120	17	

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	VAV NAME	BRAND / MODEL	CONTROLLER	TUBE	AIR FLOW	DAMPER	FUNCTIONALITY	REMARK
37	VAV-5-E-1	BELIMO VAV	✓	✓	✓	✓	100%	
38	VAV-5-E-2	BELIMO VAV	✓	✓	✗	✓	75%	
39	VAV-5-E-3	BELIMO VAV	✓	✓	✓	✓	100%	
40	VAV-5-E-4	BELIMO VAV	✓	✓	✓	✓	100%	
41	VAV-5-E-5	BELIMO VAV	✓	✓	✗	✓	75%	
42	VAV-5-E-6	BELIMO VAV	✓	✓	✓	✓	100%	
43	VAV-6-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
44	VAV-6-W-2	BELIMO VAV	✓	✓	✓	✓	100%	
45	VAV-6-W-3	BELIMO VAV	✗	✗	✗	✗	0%	
46	VAV-6-W-4	BELIMO VAV	✗	✗	✗	✗	0%	
47	VAV-6-W-5	BELIMO VAV	✗	✗	✗	✗	0%	
48	VAV-6-W-6	BELIMO VAV	✗	✗	✗	✗	0%	
49	VAV-6-E-1	BELIMO VAV	✗	✓	✓	✓	75%	2. CWOSDC202602272897 (VAV L6-E-1)
50	VAV-6-E-2	BELIMO VAV	✗	✓	✓	✓	75%	2. CWOSDC202602272896 (VAV L6-E-2)
51	VAV-6-E-3	BELIMO VAV	✗	✗	✗	✓	25%	2. CWOSDC202602272898 (VAV L6-E-3)
52	VAV-6-E-4	BELIMO VAV	✗	✓	✗	✓	50%	2. CWOSDC202602272900 (VAV L6-E-5)
53	VAV-6-E-5	BELIMO VAV	✗	✓	✓	✓	75%	2. CWOSDC202602272901 (VAV L6-E-6)
54	VAV-6-E-6	BELIMO VAV	✓	✗	✗	✓	50%	

DATA TABLE: VAV						
FUNCTIONAL	PERCENTAGE (%)	95%	95%	66%	95%	88%
	OK (UNIT)	331	334	230	333	
FAULTY	PERCENTAGE (%)	5%	5%	34%	5%	12%
	FAULTY (UNIT)	19	16	120	17	

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	VAV NAME	BRAND / MODEL	CONTROLLER	TUBE	AIR FLOW	DAMPER	FUNCTIONALITY	REMARK
55	VAV-7-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
56	VAV-7-W-2	BELIMO VAV	✓	✓	✗	✓	75%	
57	VAV-7-W-3	BELIMO VAV	✓	✓	✓	✓	100%	
58	VAV-7-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
59	VAV-7-W-5	BELIMO VAV	✓	✓	✗	✓	75%	
60	VAV-7-W-6	BELIMO VAV	✓	✓	✓	✓	100%	
61	VAV-7-E-1	BELIMO VAV	✓	✓	✓	✓	100%	
62	VAV-7-E-2	BELIMO VAV	✓	✓	✗	✓	75%	
63	VAV-7-E-3	BELIMO VAV	✓	✓	✓	✓	100%	
64	VAV-7-E-4	BELIMO VAV	✓	✓	✓	✓	100%	
65	VAV-7-E-5	BELIMO VAV	✓	✓	✓	✓	100%	
66	VAV-7-E-6	BELIMO VAV	✓	✓	✗	✓	75%	
67	VAV-8-W-1	BELIMO VAV	✓	✓	✗	✓	75%	
68	VAV-8-W-2	BELIMO VAV	✓	✓	✗	✓	75%	
69	VAV-8-W-3	BELIMO VAV	✓	✓	✗	✓	75%	
70	VAV-8-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
71	VAV-8-W-5	BELIMO VAV	✓	✓	✓	✓	100%	
72	VAV-8-W-6	BELIMO VAV	✓	✓	✓	✓	100%	

DATA TABLE: VAV						
FUNCTIONAL	PERCENTAGE (%)	95%	95%	66%	95%	88%
	OK (UNIT)	331	334	230	333	
FAULTY	PERCENTAGE (%)	5%	5%	34%	5%	12%
	FAULTY (UNIT)	19	16	120	17	

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	VAV NAME	BRAND / MODEL	CONTROLLER	TUBE	AIR FLOW	DAMPER	FUNCTIONALITY	REMARK
73	VAV-8-E-1	BELIMO VAV	✓	✓	✓	✓	100%	
74	VAV-8-E-2	BELIMO VAV	✓	✓	✗	✓	75%	
75	VAV-8-E-3	BELIMO VAV	✓	✓	✓	✓	100%	
76	VAV-8-E-4	BELIMO VAV	✓	✓	✓	✓	100%	
77	VAV-8-E-5	BELIMO VAV	✓	✓	✓	✓	100%	
78	VAV-8-E-6	BELIMO VAV	✓	✓	✗	✓	75%	
79	VAV-9-W-1	BELIMO VAV	✓	✓	✗	✓	75%	
80	VAV-9-W-2	BELIMO VAV	✓	✓	✓	✓	100%	
81	VAV-9-W-3	BELIMO VAV	✓	✓	✓	✓	100%	
82	VAV-9-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
83	VAV-9-W-5	BELIMO VAV	✓	✓	✓	✓	100%	
84	VAV-9-W-6	BELIMO VAV	✓	✓	✓	✓	100%	
85	VAV-9-E-1	BELIMO VAV	✓	✓	✗	✓	75%	
86	VAV-9-E-2	BELIMO VAV	✓	✓	✓	✓	100%	
87	VAV-9-E-3	BELIMO VAV	✓	✓	✓	✓	100%	
88	VAV-9-E-4	BELIMO VAV	✓	✓	✗	✓	75%	
89	VAV-9-E-5	BELIMO VAV	✓	✓	✗	✓	75%	
90	VAV-9-E-6	BELIMO VAV	✓	✓	✗	✓	75%	

DATA TABLE: VAV						
FUNCTIONAL	PERCENTAGE (%)	95%	95%	66%	95%	88%
	OK (UNIT)	331	334	230	333	
FAULTY	PERCENTAGE (%)	5%	5%	34%	5%	12%
	FAULTY (UNIT)	19	16	120	17	

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	VAV NAME	BRAND / MODEL	CONTROLLER	TUBE	AIR FLOW	DAMPER	FUNCTIONALITY	REMARK
91	VAV-10-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
92	VAV-10-W-2	BELIMO VAV	✓	✓	✗	✓	75%	
93	VAV-10-W-3	BELIMO VAV	✓	✓	✓	✓	100%	
94	VAV-10-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
95	VAV-10-W-5	BELIMO VAV	✓	✓	✗	✓	75%	
96	VAV-10-W-6	BELIMO VAV	✓	✓	✗	✓	75%	
97	VAV-10-E-1	BELIMO VAV	✓	✓	✓	✓	100%	
98	VAV-10-E-2	BELIMO VAV	✓	✓	✓	✓	100%	
99	VAV-10-E-3	BELIMO VAV	✓	✓	✓	✓	100%	
100	VAV-10-E-4	BELIMO VAV	✓	✓	✓	✓	100%	
101	VAV-10-E-5	BELIMO VAV	✓	✓	✗	✓	75%	
102	VAV-10-E-6	BELIMO VAV	✓	✓	✓	✓	100%	
103	VAV-11-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
104	VAV-11-W-2	BELIMO VAV	✓	✓	✓	✓	100%	
105	VAV-11-W-3	BELIMO VAV	✓	✓	✗	✓	75%	
106	VAV-11-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
107	VAV-11-W-5	BELIMO VAV	✓	✓	✓	✓	100%	
108	VAV-11-W-6	BELIMO VAV	✓	✓	✓	✓	100%	

DATA TABLE: VAV						
FUNCTIONAL	PERCENTAGE (%)	95%	95%	66%	95%	88%
	OK (UNIT)	331	334	230	333	
FAULTY	PERCENTAGE (%)	5%	5%	34%	5%	12%
	FAULTY (UNIT)	19	16	120	17	

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	VAV NAME	BRAND / MODEL	CONTROLLER	TUBE	AIR FLOW	DAMPER	FUNCTIONALITY	REMARK
109	VAV-11-E-1	BELIMO VAV	✓	✓	✗	✓	75%	
110	VAV-11-E-2	BELIMO VAV	✗	✗	✗	✗	0%	
111	VAV-11-E-3	BELIMO VAV	✗	✗	✗	✗	0%	
112	VAV-11-E-4	BELIMO VAV	✗	✗	✗	✗	0%	
113	VAV-11-E-5	BELIMO VAV	✗	✗	✗	✗	0%	
114	VAV-11-E-6	BELIMO VAV	✓	✓	✓	✓	100%	
115	VAV-12-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
116	VAV-12-W-2	BELIMO VAV	✓	✓	✗	✓	75%	
117	VAV-12-W-3	BELIMO VAV	✓	✓	✗	✓	75%	
118	VAV-12-W-4	BELIMO VAV	✓	✓	✗	✓	75%	
119	VAV-12-W-5	BELIMO VAV	✓	✓	✓	✓	100%	
120	VAV-12-W-6	BELIMO VAV	✓	✓	✓	✓	100%	
121	VAV-12-E-1	BELIMO VAV	✗	✗	✗	✗	0%	
122	VAV-12-E-2	BELIMO VAV	✗	✗	✗	✗	0%	
123	VAV-12-E-3	BELIMO VAV	✗	✗	✗	✗	0%	
124	VAV-12-E-4	BELIMO VAV	✗	✗	✗	✗	0%	
125	VAV-12-E-5	BELIMO VAV	✓	✓	✗	✓	75%	
126	VAV-12-E-6	BELIMO VAV	✓	✓	✗	✓	75%	

DATA TABLE: VAV						
FUNCTIONAL	PERCENTAGE (%)	95%	95%	66%	95%	88%
	OK (UNIT)	331	334	230	333	
FAULTY	PERCENTAGE (%)	5%	5%	34%	5%	12%
	FAULTY (UNIT)	19	16	120	17	

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	VAV NAME	BRAND / MODEL	CONTROLLER	TUBE	AIR FLOW	DAMPER	FUNCTIONALITY	REMARK
127	VAV-13-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
128	VAV-13-W-2	BELIMO VAV	✓	✓	✗	✓	75%	
129	VAV-13-W-3	BELIMO VAV	✗	✗	✗	✗	0%	
130	VAV-13-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
131	VAV-13-W-5	BELIMO VAV	✓	✓	✗	✓	75%	
132	VAV-13-W-6	BELIMO VAV	✓	✓	✓	✓	100%	
133	VAV-13-E-1	BELIMO VAV	✓	✓	✓	✓	100%	
134	VAV-13-E-2	BELIMO VAV	✓	✓	✓	✓	100%	
135	VAV-13-E-3	BELIMO VAV	✓	✓	✗	✓	75%	
136	VAV-13-E-4	BELIMO VAV	✓	✓	✓	✓	100%	
137	VAV-13-E-5	BELIMO VAV	✓	✓	✓	✓	100%	
138	VAV-13-E-6	BELIMO VAV	✓	✓	✓	✗	75%	
139	VAV-14-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
140	VAV-14-W-2	BELIMO VAV	✓	✓	✗	✓	75%	
141	VAV-14-W-3	BELIMO VAV	✓	✓	✗	✓	75%	
142	VAV-14-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
143	VAV-14-W-5	BELIMO VAV	✓	✓	✓	✓	100%	
144	VAV-14-W-6	BELIMO VAV	✓	✓	✓	✓	100%	

DATA TABLE: VAV						
FUNCTIONAL	PERCENTAGE (%)	95%	95%	66%	95%	88%
	OK (UNIT)	331	334	230	333	
FAULTY	PERCENTAGE (%)	5%	5%	34%	5%	12%
	FAULTY (UNIT)	19	16	120	17	

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	VAV NAME	BRAND / MODEL	CONTROLLER	TUBE	AIR FLOW	DAMPER	FUNCTIONALITY	REMARK
145	VAV-14-E-1	BELIMO VAV	✓	✓	✓	✓	100%	
146	VAV-14-E-2	BELIMO VAV	✓	✓	✓	✓	100%	
147	VAV-14-E-3	BELIMO VAV	✓	✓	✓	✓	100%	
148	VAV-14-E-4	BELIMO VAV	✓	✓	✗	✓	75%	
149	VAV-14-E-5	BELIMO VAV	✓	✓	✓	✓	100%	
150	VAV-14-E-6	BELIMO VAV	✓	✓	✓	✓	100%	
151	VAV-15-W-1	BELIMO VAV	✓	✓	✗	✓	75%	
152	VAV-15-W-2	BELIMO VAV	✓	✓	✓	✓	100%	
153	VAV-15-W-3	BELIMO VAV	✓	✓	✓	✓	100%	
154	VAV-15-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
155	VAV-15-W-5	BELIMO VAV	✓	✓	✓	✓	100%	
156	VAV-15-E-1	BELIMO VAV	✓	✓	✗	✓	75%	
157	VAV-15-E-2	BELIMO VAV	✓	✓	✓	✓	100%	
158	VAV-15-E-3	BELIMO VAV	✓	✓	✓	✓	100%	
159	VAV-15-E-4	BELIMO VAV	✓	✓	✓	✓	100%	
160	VAV-15-E-5	BELIMO VAV	✓	✓	✓	✓	100%	
161	VAV-16-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
162	VAV-16-W-2	BELIMO VAV	✓	✓	✓	✓	100%	

DATA TABLE: VAV						
FUNCTIONAL	PERCENTAGE (%)	95%	95%	66%	95%	88%
	OK (UNIT)	331	334	230	333	
FAULTY	PERCENTAGE (%)	5%	5%	34%	5%	12%
	FAULTY (UNIT)	19	16	120	17	

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	VAV NAME	BRAND / MODEL	CONTROLLER	TUBE	AIR FLOW	DAMPER	FUNCTIONALITY	REMARK
163	VAV-16-W-3	BELIMO VAV	✓	✓	✗	✓	75%	
164	VAV-16-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
165	VAV-16-W-5	BELIMO VAV	✓	✓	✓	✓	100%	
166	VAV-16-W-6	BELIMO VAV	✓	✓	✓	✓	100%	
167	VAV-16-E-1	BELIMO VAV	✓	✓	✓	✓	100%	
168	VAV-16-E-2	BELIMO VAV	✓	✓	✓	✓	100%	
169	VAV-16-E-3	BELIMO VAV	✓	✓	✓	✓	100%	
170	VAV-16-E-4	BELIMO VAV	✓	✓	✗	✓	75%	
171	VAV-16-E-5	BELIMO VAV	✓	✓	✗	✓	75%	
172	VAV-16-E-6	BELIMO VAV	✓	✓	✓	✓	100%	
173	VAV-17-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
174	VAV-17-W-2	BELIMO VAV	✓	✓	✓	✓	100%	
175	VAV-17-W-3	BELIMO VAV	✓	✓	✗	✓	75%	
176	VAV-17-W-4	BELIMO VAV	✓	✓	✗	✓	75%	
177	VAV-17-W-5	BELIMO VAV	✓	✓	✓	✓	100%	
178	VAV-17-W-6	BELIMO VAV	✓	✓	✓	✓	100%	
179	VAV-17-E-1	BELIMO VAV	✓	✓	✓	✗	75%	
180	VAV-17-E-2	BELIMO VAV	✓	✓	✗	✗	50%	

DATA TABLE: VAV						
FUNCTIONAL	PERCENTAGE (%)	95%	95%	66%	95%	88%
	OK (UNIT)	331	334	230	333	
FAULTY	PERCENTAGE (%)	5%	5%	34%	5%	12%
	FAULTY (UNIT)	19	16	120	17	

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	VAV NAME	BRAND / MODEL	CONTROLLER	TUBE	AIR FLOW	DAMPER	FUNCTIONALITY	REMARK
181	VAV-17-E-3	BELIMO VAV	✓	✓	✗	✓	75%	
182	VAV-17-E-4	BELIMO VAV	✓	✓	✓	✓	100%	
183	VAV-17-E-5	BELIMO VAV	✓	✓	✓	✓	100%	
184	VAV-17-E-6	BELIMO VAV	✓	✓	✓	✓	100%	
185	VAV-19-W-1	BELIMO VAV	✓	✓	✗	✓	75%	
186	VAV-19-W-2	BELIMO VAV	✓	✓	✓	✓	100%	
187	VAV-19-W-3	BELIMO VAV	✓	✓	✓	✓	100%	
188	VAV-19-W-4	BELIMO VAV	✓	✓	✗	✓	75%	
189	VAV-19-W-5	BELIMO VAV	✓	✓	✓	✓	100%	
190	VAV-19-W-6	BELIMO VAV	✓	✓	✗	✓	75%	
191	VAV-20-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
192	VAV-20-W-2	BELIMO VAV	✓	✓	✓	✓	100%	
193	VAV-20-W-3	BELIMO VAV	✓	✓	✗	✓	75%	
194	VAV-20-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
195	VAV-20-W-5	BELIMO VAV	✓	✓	✗	✓	75%	
196	VAV-20-W-6	BELIMO VAV	✓	✓	✓	✓	100%	
197	VAV-20-E-1	BELIMO VAV	✓	✓	✓	✓	100%	
198	VAV-20-E-2	BELIMO VAV	✓	✓	✓	✓	100%	

DATA TABLE: VAV						
FUNCTIONAL	PERCENTAGE (%)	95%	95%	66%	95%	88%
	OK (UNIT)	331	334	230	333	
FAULTY	PERCENTAGE (%)	5%	5%	34%	5%	12%
	FAULTY (UNIT)	19	16	120	17	

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	VAV NAME	BRAND / MODEL	CONTROLLER	TUBE	AIR FLOW	DAMPER	FUNCTIONALITY	REMARK
199	VAV-20-E-3	BELIMO VAV	✓	✓	✓	✓	100%	
200	VAV-20-E-4	BELIMO VAV	✓	✓	✓	✓	100%	
201	VAV-20-E-5	BELIMO VAV	✓	✓	✗	✓	75%	
202	VAV-20-E-6	BELIMO VAV	✓	✓	✓	✓	100%	
203	VAV-21-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
204	VAV-21-W-2	BELIMO VAV	✓	✓	✗	✓	75%	
205	VAV-21-W-3	BELIMO VAV	✓	✓	✓	✓	100%	
206	VAV-21-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
207	VAV-21-W-5	BELIMO VAV	✓	✓	✗	✓	75%	
208	VAV-21-W-6	BELIMO VAV	✓	✓	✗	✓	75%	
209	VAV-21-E-1	BELIMO VAV	✓	✓	✗	✓	75%	
210	VAV-21-E-2	BELIMO VAV	✓	✓	✓	✓	100%	
211	VAV-21-E-3	BELIMO VAV	✓	✓	✗	✓	75%	
212	VAV-21-E-4	BELIMO VAV	✓	✓	✓	✓	100%	
213	VAV-21-E-5	BELIMO VAV	✓	✓	✗	✓	75%	
214	VAV-21-E-6	BELIMO VAV	✓	✓	✗	✓	75%	
215	VAV-22-W-1	BELIMO VAV	✓	✓	✗	✓	75%	
216	VAV-22-W-2	BELIMO VAV	✓	✓	✗	✓	75%	

DATA TABLE: VAV						
FUNCTIONAL	PERCENTAGE (%)	95%	95%	66%	95%	88%
	OK (UNIT)	331	334	230	333	
FAULTY	PERCENTAGE (%)	5%	5%	34%	5%	12%
	FAULTY (UNIT)	19	16	120	17	

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	VAV NAME	BRAND / MODEL	CONTROLLER	TUBE	AIR FLOW	DAMPER	FUNCTIONALITY	REMARK
217	VAV-22-W-3	BELIMO VAV	✓	✓	✓	✓	100%	
218	VAV-22-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
219	VAV-22-W-5	BELIMO VAV	✓	✓	✗	✓	75%	
220	VAV-22-W-6	BELIMO VAV	✓	✓	✓	✓	100%	
221	VAV-22-E-1	BELIMO VAV	✓	✓	✓	✓	100%	
222	VAV-22-E-2	BELIMO VAV	✓	✓	✓	✓	100%	
223	VAV-22-E-3	BELIMO VAV	✓	✓	✓	✓	100%	
224	VAV-22-E-4	BELIMO VAV	✓	✓	✓	✓	100%	
225	VAV-22-E-5	BELIMO VAV	✓	✓	✓	✓	100%	
226	VAV-22-E-6	BELIMO VAV	✓	✓	✗	✓	75%	
227	VAV-23-W-1	BELIMO VAV	✓	✓	✗	✓	75%	
228	VAV-23-W-2	BELIMO VAV	✓	✓	✓	✓	100%	
229	VAV-23-W-3	BELIMO VAV	✓	✓	✗	✓	75%	
230	VAV-23-W-4	BELIMO VAV	✓	✓	✗	✓	75%	
231	VAV-23-W-5	BELIMO VAV	✓	✓	✓	✓	100%	
232	VAV-23-W-6	BELIMO VAV	✓	✓	✓	✓	100%	
233	VAV-23-E-1	BELIMO VAV	✓	✓	✗	✓	75%	
234	VAV-23-E-2	BELIMO VAV	✓	✓	✗	✓	75%	

DATA TABLE: VAV						
FUNCTIONAL	PERCENTAGE (%)	95%	95%	66%	95%	88%
	OK (UNIT)	331	334	230	333	
FAULTY	PERCENTAGE (%)	5%	5%	34%	5%	12%
	FAULTY (UNIT)	19	16	120	17	

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	VAV NAME	BRAND / MODEL	CONTROLLER	TUBE	AIR FLOW	DAMPER	FUNCTIONALITY	REMARK
235	VAV-23-E-3	BELIMO VAV	✓	✓	✓	✓	100%	
236	VAV-23-E-4	BELIMO VAV	✓	✓	✓	✓	100%	
237	VAV-23-E-5	BELIMO VAV	✓	✓	✓	✓	100%	
238	VAV-23-E-6	BELIMO VAV	✓	✓	✓	✓	100%	
239	VAV-24-E-1	BELIMO VAV	✓	✓	✓	✓	100%	
240	VAV-24-E-2	BELIMO VAV	✓	✓	✓	✓	100%	
241	VAV-24-E-3	BELIMO VAV	✓	✓	✓	✓	100%	
242	VAV-24-E-4	BELIMO VAV	✓	✓	✓	✓	100%	
243	VAV-24-E-5	BELIMO VAV	✓	✓	✗	✓	75%	
244	VAV-24-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
245	VAV-24-W-2	BELIMO VAV	✓	✓	✗	✓	75%	
246	VAV-24-W-3	BELIMO VAV	✓	✓	✗	✓	75%	
247	VAV-24-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
248	VAV-24-W-5	BELIMO VAV	✓	✓	✗	✓	75%	
249	VAV-25-E-1	BELIMO VAV	✓	✓	✓	✓	100%	
250	VAV-25-E-2	BELIMO VAV	✓	✓	✓	✓	100%	
251	VAV-25-E-3	BELIMO VAV	✓	✓	✓	✓	100%	
252	VAV-25-E-4	BELIMO VAV	✓	✓	✓	✓	100%	

DATA TABLE: VAV						
FUNCTIONAL	PERCENTAGE (%)	95%	95%	66%	95%	88%
	OK (UNIT)	331	334	230	333	
FAULTY	PERCENTAGE (%)	5%	5%	34%	5%	12%
	FAULTY (UNIT)	19	16	120	17	

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	VAV NAME	BRAND / MODEL	CONTROLLER	TUBE	AIR FLOW	DAMPER	FUNCTIONALITY	REMARK
253	VAV-25-E-5	BELIMO VAV	✓	✓	✓	✓	100%	
254	VAV-25-W-1	BELIMO VAV	✓	✓	✗	✓	75%	
255	VAV-25-W-2	BELIMO VAV	✓	✓	✓	✓	100%	
256	VAV-25-W-3	BELIMO VAV	✓	✓	✓	✓	100%	
257	VAV-25-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
258	VAV-25-W-5	BELIMO VAV	✓	✓	✓	✓	100%	
259	VAV-26-E-1	BELIMO VAV	✓	✓	✓	✓	100%	
260	VAV-26-E-2	BELIMO VAV	✓	✓	✗	✓	75%	
261	VAV-26-E-3	BELIMO VAV	✓	✓	✗	✓	75%	
262	VAV-26-E-4	BELIMO VAV	✓	✓	✓	✓	100%	
263	VAV-26-E-5	BELIMO VAV	✓	✓	✓	✓	100%	
264	VAV-26-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
265	VAV-26-W-2	BELIMO VAV	✓	✓	✓	✓	100%	
266	VAV-26-W-3	BELIMO VAV	✓	✓	✓	✓	100%	
267	VAV-26-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
268	VAV-26-W-5	BELIMO VAV	✓	✓	✗	✓	75%	
269	VAV-27-E-1	BELIMO VAV	✓	✓	✓	✓	100%	
270	VAV-27-E-2	BELIMO VAV	✓	✓	✗	✓	75%	

DATA TABLE: VAV						
FUNCTIONAL	PERCENTAGE (%)	95%	95%	66%	95%	88%
	OK (UNIT)	331	334	230	333	
FAULTY	PERCENTAGE (%)	5%	5%	34%	5%	12%
	FAULTY (UNIT)	19	16	120	17	

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	VAV NAME	BRAND / MODEL	CONTROLLER	TUBE	AIR FLOW	DAMPER	FUNCTIONALITY	REMARK
271	VAV-27-E-3	BELIMO VAV	✓	✓	✓	✓	100%	
272	VAV-27-E-4	BELIMO VAV	✓	✓	✗	✓	75%	
273	VAV-27-E-5	BELIMO VAV	✓	✓	✗	✓	75%	
274	VAV-27-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
275	VAV-27-W-2	BELIMO VAV	✓	✓	✓	✓	100%	
276	VAV-27-W-3	BELIMO VAV	✓	✓	✓	✓	100%	
277	VAV-27-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
278	VAV-27-W-5	BELIMO VAV	✓	✓	✓	✓	100%	
279	VAV-28-E-1	BELIMO VAV	✓	✓	✓	✓	100%	
280	VAV-28-E-2	BELIMO VAV	✓	✓	✓	✓	100%	
281	VAV-28-E-3	BELIMO VAV	✓	✓	✓	✓	100%	
282	VAV-28-E-4	BELIMO VAV	✓	✓	✗	✓	75%	
283	VAV-28-E-5	BELIMO VAV	✓	✓	✓	✓	100%	
284	VAV-28-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
285	VAV-28-W-2	BELIMO VAV	✓	✓	✓	✓	100%	
286	VAV-28-W-3	BELIMO VAV	✓	✓	✓	✓	100%	
287	VAV-28-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
288	VAV-28-W-5	BELIMO VAV	✓	✓	✓	✓	100%	

DATA TABLE: VAV						
FUNCTIONAL	PERCENTAGE (%)	95%	95%	66%	95%	88%
	OK (UNIT)	331	334	230	333	
FAULTY	PERCENTAGE (%)	5%	5%	34%	5%	12%
	FAULTY (UNIT)	19	16	120	17	

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	VAV NAME	BRAND / MODEL	CONTROLLER	TUBE	AIR FLOW	DAMPER	FUNCTIONALITY	REMARK
289	VAV-29-E-1	BELIMO VAV	✓	✓	✗	✓	75%	
290	VAV-29-E-2	BELIMO VAV	✓	✓	✓	✓	100%	
291	VAV-29-E-3	BELIMO VAV	✓	✓	✗	✓	75%	
292	VAV-29-E-4	BELIMO VAV	✓	✓	✓	✓	100%	
293	VAV-29-E-5	BELIMO VAV	✓	✓	✗	✓	75%	
294	VAV-29-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
295	VAV-29-W-2	BELIMO VAV	✓	✓	✓	✓	100%	
296	VAV-29-W-3	BELIMO VAV	✓	✓	✓	✓	100%	
297	VAV-29-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
298	VAV-29-W-5	BELIMO VAV	✓	✓	✓	✓	100%	
299	VAV-30-E-1	BELIMO VAV	✓	✓	✓	✓	100%	
300	VAV-30-E-2	BELIMO VAV	✓	✓	✓	✓	100%	
301	VAV-30-E-3	BELIMO VAV	✓	✓	✓	✓	100%	
302	VAV-30-E-4	BELIMO VAV	✓	✓	✓	✓	100%	
303	VAV-30-E-5	BELIMO VAV	✓	✓	✗	✓	75%	
304	VAV-30-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
305	VAV-30-W-2	BELIMO VAV	✓	✓	✓	✓	100%	
306	VAV-30-W-3	BELIMO VAV	✓	✓	✓	✓	100%	

DATA TABLE: VAV						
FUNCTIONAL	PERCENTAGE (%)	95%	95%	66%	95%	88%
	OK (UNIT)	331	334	230	333	
FAULTY	PERCENTAGE (%)	5%	5%	34%	5%	12%
	FAULTY (UNIT)	19	16	120	17	

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	VAV NAME	BRAND / MODEL	CONTROLLER	TUBE	AIR FLOW	DAMPER	FUNCTIONALITY	REMARK
307	VAV-30-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
308	VAV-30-W-5	BELIMO VAV	✓	✓	✓	✓	100%	
309	VAV-30-E-1	BELIMO VAV	✓	✓	✓	✓	100%	
310	VAV-30-E-2	BELIMO VAV	✓	✓	✓	✓	100%	
311	VAV-30-E-3	BELIMO VAV	✓	✓	✗	✓	75%	
312	VAV-30-E-4	BELIMO VAV	✓	✓	✓	✓	100%	
313	VAV-30-E-5	BELIMO VAV	✓	✓	✓	✓	100%	
314	VAV-31-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
315	VAV-31-W-2	BELIMO VAV	✓	✓	✗	✓	75%	
316	VAV-31-W-3	BELIMO VAV	✓	✓	✗	✓	75%	
317	VAV-31-W-4	BELIMO VAV	✓	✓	✗	✓	75%	
318	VAV-31-W-5	BELIMO VAV	✓	✓	✗	✓	75%	
319	VAV-32-E-1	BELIMO VAV	✓	✓	✓	✓	100%	
320	VAV-32-E-2	BELIMO VAV	✓	✓	✓	✓	100%	
321	VAV-32-E-3	BELIMO VAV	✗	✗	✗	✗	0%	
322	VAV-32-E-4	BELIMO VAV	✓	✓	✗	✓	75%	
323	VAV-32-E-5	BELIMO VAV	✓	✓	✗	✓	75%	
324	VAV-32-W-1	BELIMO VAV	✓	✓	✓	✓	100%	

DATA TABLE: VAV						
FUNCTIONAL	PERCENTAGE (%)	95%	95%	66%	95%	88%
	OK (UNIT)	331	334	230	333	
FAULTY	PERCENTAGE (%)	5%	5%	34%	5%	12%
	FAULTY (UNIT)	19	16	120	17	

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	VAV NAME	BRAND / MODEL	CONTROLLER	TUBE	AIR FLOW	DAMPER	FUNCTIONALITY	REMARK
325	VAV-32-W-2	BELIMO VAV	✓	✓	✓	✓	100%	
326	VAV-32-W-3	BELIMO VAV	✓	✓	✓	✓	100%	
327	VAV-32-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
328	VAV-32-W-5	BELIMO VAV	✓	✓	✗	✓	75%	
329	VAV-33-E-1	BELIMO VAV	✓	✓	✓	✓	100%	
330	VAV-33-E-2	BELIMO VAV	✓	✓	✓	✓	100%	
331	VAV-33-E-3	BELIMO VAV	✓	✓	✗	✓	75%	
332	VAV-33-E-4	BELIMO VAV	✓	✓	✓	✓	100%	
333	VAV-33-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
334	VAV-33-W-2	BELIMO VAV	✓	✓	✓	✓	100%	
335	VAV-33-W-3	BELIMO VAV	✓	✓	✓	✓	100%	
336	VAV-33-W-4	BELIMO VAV	✓	✓	✗	✓	75%	
337	VAV-34-E-1	BELIMO VAV	✓	✓	✗	✓	75%	
338	VAV-34-E-2	BELIMO VAV	✓	✓	✗	✓	75%	
339	VAV-34-E-3	BELIMO VAV	✓	✓	✓	✓	100%	
340	VAV-34-E-4	BELIMO VAV	✓	✓	✗	✓	75%	
341	VAV-34-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
342	VAV-34-W-2	BELIMO VAV	✓	✓	✓	✓	100%	

DATA TABLE: VAV						
FUNCTIONAL	PERCENTAGE (%)	95%	95%	66%	95%	88%
	OK (UNIT)	331	334	230	333	
FAULTY	PERCENTAGE (%)	5%	5%	34%	5%	12%
	FAULTY (UNIT)	19	16	120	17	

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	VAV NAME	BRAND / MODEL	CONTROLLER	TUBE	AIR FLOW	DAMPER	FUNCTIONALITY	REMARK
343	VAV-34-W-3	BELIMO VAV	✓	✓	✓	✓	100%	
344	VAV-34-W-4	BELIMO VAV	✓	✓	✓	✓	100%	
345	VAV-35-E-1	BELIMO VAV	✓	✓	✓	✓	100%	
346	VAV-35-E-2	BELIMO VAV	✓	✓	✓	✓	100%	
347	VAV-35-E-3	BELIMO VAV	✓	✓	✓	✓	100%	
348	VAV-35-W-1	BELIMO VAV	✓	✓	✓	✓	100%	
349	VAV-35-W-2	BELIMO VAV	✓	✓	✗	✓	75%	
350	VAV-35-W-3	BELIMO VAV	✓	✓	✓	✓	100%	

DATA TABLE: DPM SSBM

FUNCTIONAL	PERCENTAGE (%)	71%
	OK (UNIT)	23
FAULTY	PERCENTAGE (%)	43%
	FAULTY (UNIT)	17

NO	DPM NAME	JACE	STATUS	REMARK
1	SSB-B1-M	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
2	SSBE-B1-M	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
3	SSB-LGR-M	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
4	SSB-1-M	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
5	SSB-2-M	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
6	SSB-3-M	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
7	SSB-4-M	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
8	SSB-5-M	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
9	SSB-6-M	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
10	SSB-7-M	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
11	SSB-8-M	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
12	SSB-9-M	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
13	SSB-10-M	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
14	SSB-11-M	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
15	SSB-12-M	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
16	SSB-13-M	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
17	SSB-14-M	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
18	SSB-15-M	KKR2-DB4	✓	
19	SSB-16-M	KKR2-DB4	✓	
20	SSB-17-M	KKR2-DB4	✓	
21	SSB-18-M	KKR2-DB4	✓	
22	SSBE-18-M	KKR2-DB4	✓	
23	SSB-19-M	KKR2-DB4	✓	
24	SSB-21-M	KKR2-DB4	✓	
25	SSB-22-M	KKR2-DB4	✓	
26	SSB-23-M	KKR2-DB4	✓	
27	SSB-24-M	KKR2-DB5	✓	
28	SSB-25-M	KKR2-DB5	✓	
29	SSB-26-M	KKR2-DB5	✓	
30	SSB-27-M	KKR2-DB5	✓	
31	SSB-28-M	KKR2-DB5	✓	
32	SSB-29-M	KKR2-DB5	✓	
33	SSB-30-M	KKR2-DB5	✓	
34	SSB-31-M	KKR2-DB5	✓	
35	SSB-32-M	KKR2-DB6	✓	
36	SSB-33-M	KKR2-DB6	✓	
37	SSB-34-M	KKR2-DB6	✓	
38	SSB-35-M	KKR2-DB6	✓	
39	SSB-36-MECH	KKR2-DB6	✓	
40	SSBE-36-MECH	KKR2-DB6	✓	
41	DPM-EMSB-1	KKR2-DB2	✓	

DATA TABLE: DPM SSBM

FUNCTIONAL	PERCENTAGE (%)	71%
	OK (UNIT)	23
FAULTY	PERCENTAGE (%)	43%
	FAULTY (UNIT)	17

NO	DPM NAME	JACE	STATUS	REMARK
42	DPM-MSB-1A	KKR2-DB2	✓	
43	DPM-MSB-1B	KKR2-DB2	✓	
44	TX-FEEDER-1-DPM	KKR2-DB2	✓	
45	TX-FEEDER-2-DPM	KKR2-DB2	✓	
46	OUTGOING-F1-DPM	KKR2-DB2	✓	
47	OUTGOING-F2-DPM	KKR2-DB2	✓	
48	TNB-IN-1-DPM	KKR2-DB2	✗	NEW DPM
49	TNB-IN-2-DPM	KKR2-DB2	✗	NEW DPM
50	DPM-CHILLER-1	KKR2-DB2	✓	
51	DPM-CHILLER-2	KKR2-DB2	✓	
52	DPM-CHILLER-3	KKR2-DB2	✗	
53	DPM-CWP-1	KKR2-DB2	✗	
54	DPM-CWP-2	KKR2-DB2	✗	
55	DPM-CWP-3	KKR2-DB2	✓	
56	DPM-CHWP-1	KKR2-DB2	✓	
57	DPM-CHWP-2	KKR2-DB2	✓	
58	DPM-CHWP-3	KKR2-DB2	✓	
59	DPM-IN-CHILLER	KKR2-DB2	✓	
60	DPM-SSB-P8-KIOSK	KKR2-DB2	✓	
61	DPM-SSB-P8-KIOSK	KKR2-DB2	✓	
62	DPM-SSBE-P8-PARK-L	KKR2-DB2	✓	
63	DPM-MDB-P8-KAFETERIA-PV	KKR2-DB2	✓	
64	DPM-SSB-P8-PARK-L	KKR2-DB2	✓	
65	DPM-EMDB-P8-KAFETERIA-PV	KKR2-DB2	✗	DISABLE
66	AMF-1-DPM	KKR2-DB2	✓	OFFLINE DUE TO GENSET OFF
67	AMF-2-DPM	KKR2-DB2	✓	OFFLINE DUE TO GENSET OFF
68	SSB-P1-PARK-L-DPM	KKR2-DB2	✓	
69	SSBE-P1-PARK-L-DPM	KKR2-DB2	✓	
70	SSB-P1-PARK-P-DPM	KKR2-DB2	✓	
71	SSBE-P1-PARK-P-DPM	KKR2-DB2	✓	
72	SSBE-LM-FP2-DPM	KKR2-DB2	✓	
73	SSBE-LG-MECH-DPM	KKR2-DB2	✓	
74	SSBE-LG-FP1-DPM	KKR2-DB2	✓	
75	SSB-LG-MECH-DPM	KKR2-DB2	✓	
76	SSBE-LM-FP1-DPM	KKR2-DB2	✓	
77	SSBE-P7A-MECH-DPM	KKR2-DB2	✓	
78	SSB-P7A-PV-DPM	KKR2-DB2	✓	

DATA TABLE: DPM SSBE

FUNCTIONAL	PERCENTAGE (%)	58%
	OK (UNIT)	46
FAULTY	PERCENTAGE (%)	43%
	FAULTY (UNIT)	34

NO	DPM NAME	JACE	STATUS	REMARK
1	SSBE-B1-P	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
2	SSBE-B1-L	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
3	SSBE-LGR-P	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
4	SSBE-LGR-L	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
5	SSBE-MZ-P	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
6	SSBE-MZ-L	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
7	SSBE-1-P	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
8	SSBE-1-L	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
9	SSBE-2-P	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
10	SSBE-2-L	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
11	SSBE-3-P	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
12	SSBE-3-L	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
13	SSBE-4-P	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
14	SSBE-4-L	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
15	SSBE-5-P	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
16	SSBE-5-L	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
17	SSBE-6-P	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
18	SSBE-6-L	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
19	SSBE-7-P	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
20	SSBE-7-L	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
21	SSBE-8-P	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
22	SSBE-8-L	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
23	SSBE-9-P	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
24	SSBE-9-L	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
25	SSBEE-10-P	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
26	SSBEE-10-L	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
27	SSBE-11-P	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
28	SSBE-11-L	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
29	SSBE-12-P	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
30	SSBE-12-L	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
31	SSBE-13-P	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
32	SSBE-13-L	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
33	SSBE-14-P	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
34	SSBE-14-L	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
35	SSBE-15-P	KKR2-DB4	✓	
36	SSBE-15-L	KKR2-DB4	✓	
37	SSBE-16-P	KKR2-DB4	✓	

DATA TABLE: DPM SSBE

FUNCTIONAL	PERCENTAGE (%)	58%
	OK (UNIT)	46
FAULTY	PERCENTAGE (%)	43%
	FAULTY (UNIT)	34

NO	DPM NAME	JACE	STATUS	REMARK
38	SSBE-16-L	KKR2-DB4	✓	
39	SSBE-17-P	KKR2-DB4	✓	
40	SSBE-17-L	KKR2-DB4	✓	
41	SSBE-18-P	KKR2-DB4	✓	
42	SSBE-18-L	KKR2-DB4	✓	
43	SSBE-18-FP2	KKR2-DB4	✓	
44	SSBE-18-FP3	KKR2-DB4	✓	
45	SSBE-19-P	KKR2-DB4	✓	
46	SSBE-19-L	KKR2-DB4	✓	
47	SSBE-20-P	KKR2-DB4	✓	
48	SSBE-20-L	KKR2-DB4	✓	
49	SSBE-21-P	KKR2-DB4	✓	
50	SSBE-21-L	KKR2-DB4	✓	
51	SSBE-22-P	KKR2-DB4	✓	
52	SSBE-22-L	KKR2-DB4	✓	
53	SSBE-23-P	KKR2-DB4	✓	
54	SSBE-23-L	KKR2-DB4	✓	
55	SSBE-24-P	KKR2-DB5	✓	
56	SSBE-24-L	KKR2-DB5	✓	
57	SSBE-25-P	KKR2-DB5	✓	
58	SSBE-25-L	KKR2-DB5	✓	
59	SSBE-26-P	KKR2-DB5	✓	
60	SSBE-26-L	KKR2-DB5	✓	
61	SSBE-27-P	KKR2-DB5	✓	
62	SSBE-27-L	KKR2-DB5	✓	
63	SSBE-28-P	KKR2-DB5	✓	
64	SSBE-28-L	KKR2-DB5	✓	
65	SSBE-29-P	KKR2-DB5	✓	
66	SSBE-29-L	KKR2-DB5	✓	
67	SSBE-30-P	KKR2-DB5	✓	
68	SSBE-30-L	KKR2-DB5	✓	
69	SSBE-31-P	KKR2-DB5	✓	
70	SSBE-31-L	KKR2-DB5	✓	
72	SSBE-32-P	KKR2-DB6	✓	
73	SSBE-32-L	KKR2-DB6	✓	
74	SSBE-33-P	KKR2-DB6	✓	
75	SSBE-33-L	KKR2-DB6	✓	

DATA TABLE: DPM SSBE

FUNCTIONAL	PERCENTAGE (%)	58%
	OK (UNIT)	46
FAULTY	PERCENTAGE (%)	43%
	FAULTY (UNIT)	34

NO	DPM NAME	JACE	STATUS	REMARK
76	SSBE-34-P	KKR2-DB6	✓	
77	SSBE-34-L	KKR2-DB6	✓	
78	SSBE-35-P	KKR2-DB6	✓	
79	SSBE-35-L	KKR2-DB6	✓	
80	SSBE-36-L	KKR2-DB6	✓	
81	SSBE-36-FP3	KKR2-DB6	✓	

DATA TABLE: DPM SSB

FUNCTIONAL	PERCENTAGE (%)	56%
	OK (UNIT)	43
FAULTY	PERCENTAGE (%)	44%
	FAULTY (UNIT)	34

NO	DPM NAME	JACE	STATUS	REMARK
1	SSB-B1-P	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
2	SSB-B1-L	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
3	SSB-LGR-P	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
4	SSB-LGR-L	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
5	SSB-MZ-P	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
6	SSB-MZ-L	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
7	SSB-1-P	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
8	SSB-1-L	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
9	SSB-2-P	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
10	SSB-2-L	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
11	SSB-3-P	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
12	SSB-3-L	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
13	SSB-4-P	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
14	SSB-4-L	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
15	SSB-5-P	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
16	SSB-5-L	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
17	SSB-6-P	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
18	SSB-6-L	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
19	SSB-7-P	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
20	SSB-7-L	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
21	SSB-8-P	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
22	SSB-8-L	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
23	SSB-9-P	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
24	SSB-9-L	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
25	SSB-10-P	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
26	SSB-10-L	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
27	SSB-11-P	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
28	SSB-11-L	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
29	SSB-12-P	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
30	SSB-12-L	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
31	SSB-13-P	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
32	SSB-13-L	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
33	SSB-14-P	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
34	SSB-14-L	KKR2-DB3	✗	OFFLINE DUE TO JACE DB3 FAULTY
35	SSB-15-P	KKR2-DB4	✓	
36	SSB-15-L	KKR2-DB4	✓	
37	SSB-16-P	KKR2-DB4	✓	

DATA TABLE: DPM SSB

FUNCTIONAL	PERCENTAGE (%)	56%
	OK (UNIT)	43
FAULTY	PERCENTAGE (%)	44%
	FAULTY (UNIT)	34

NO	DPM NAME	JACE	STATUS	REMARK
38	SSB-16-L	KKR2-DB4	✓	
39	SSB-17-P	KKR2-DB4	✓	
40	SSB-17-L	KKR2-DB4	✓	
41	SSB-18-P	KKR2-DB4	✓	
42	SSB-18-L	KKR2-DB4	✓	
45	SSB-19-P	KKR2-DB4	✓	
46	SSB-19-L	KKR2-DB4	✓	
47	SSB-20-P	KKR2-DB4	✓	
48	SSB-20-L	KKR2-DB4	✓	
49	SSB-21-P	KKR2-DB4	✓	
50	SSB-21-L	KKR2-DB4	✓	
51	SSB-22-P	KKR2-DB4	✓	
52	SSB-22-L	KKR2-DB4	✓	
53	SSB-23-P	KKR2-DB4	✓	
54	SSB-23-L	KKR2-DB4	✓	
55	SSB-24-P	KKR2-DB5	✓	
56	SSB-24-L	KKR2-DB5	✓	
57	SSB-25-P	KKR2-DB5	✓	
58	SSB-25-L	KKR2-DB5	✓	
59	SSB-26-P	KKR2-DB5	✓	
60	SSB-26-L	KKR2-DB5	✓	
61	SSB-27-P	KKR2-DB5	✓	
62	SSB-27-L	KKR2-DB5	✓	
63	SSB-28-P	KKR2-DB5	✓	
64	SSB-28-L	KKR2-DB5	✓	
65	SSB-29-P	KKR2-DB5	✓	
66	SSB-29-L	KKR2-DB5	✓	
67	SSB-30-P	KKR2-DB5	✓	
68	SSB-30-L	KKR2-DB5	✓	
69	SSB-31-P	KKR2-DB5	✓	
70	SSB-31-L	KKR2-DB5	✓	
71	SSB-31-L	KKR2-DB5	✓	
72	SSB-32-P	KKR2-DB6	✓	
73	SSB-32-L	KKR2-DB6	✓	
74	SSB-33-P	KKR2-DB6	✓	
75	SSB-33-L	KKR2-DB6	✓	
76	SSB-34-P	KKR2-DB6	✓	

DATA TABLE: DPM SSB

FUNCTIONAL	PERCENTAGE (%)	56%
	OK (UNIT)	43
FAULTY	PERCENTAGE (%)	44%
	FAULTY (UNIT)	34

NO	DPM NAME	JACE	STATUS	REMARK
77	SSB-34-L	KKR2-DB6	✓	
78	SSB-35-P	KKR2-DB6	✓	
79	SSB-35-L	KKR2-DB6	✓	

DATA TABLE: VRF

FUNCTIONAL	PERCENTAGE (%)	0%
	OK (UNIT)	0
FAULTY	PERCENTAGE (%)	100%
	FAULTY (UNIT)	43

NO	NAME	JACE	STATUS	REMARK
1	FCU_L1_NILAM_1A	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
2	FCU_L1_NILAM_1B	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
3	FCU_L1_DELIMA_1A	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
4	FCU_L1_DELIMA_1B	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
5	FCU_L1_DELIMA_2A	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
6	FCU_L1_DELIMA_2B	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
7	FCU_L1_MUTIARA_1	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
8	FCU_L1_MUTIARA_2	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
9	FCU_L1_DELIMA_3A	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
10	FCU_L1_DELIMA_3B	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
11	FCU_L1_DELIMA_4A	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
12	FCU_L1_DELIMA_4B	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
13	FCU_L1_DELIMA_5A	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
14	FCU_L1_DELIMA_5B	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
15	FCU_L1_NILAM_2A	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
16	FCU_L1_NILAM_2B	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
17	FCU_L1_COR_1E	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
18	FCU_L1_COR_2E	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
19	FCU_L1_PF_E	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
20	FCU_L1_COR_1_W	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
21	FCU_L1_COR_2_W	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
22	FCU_L1_PF_W	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
23	FCU_L2_BERLIAN_A	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
24	FCU_L2_BERLIAN_B	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
25	FCU_L2_BERLIAN_C	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
26	FCU_L2_BERLIAN_D	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
27	FCU_L2_BAIDURI_1	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
28	FCU_L2_BAIDURI_2	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
29	FCU_L2_BAIDURI_3	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
30	FCU_L2_BAIDURI_4	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
31	FCU_L2_BAIDURI_5	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
32	FCU_L2_BAIDURI_6	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
33	FCU_L2_BAIDURI_7	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
34	FCU_L2_BAIDURI_8	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
35	FCU_L2_KUARZA_1A	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
36	FCU_L2_KUARZA_1B	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
37	FCU_L2_ZAMRUD_1A	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
38	FCU_L2_ZAMRUD_1B	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY

DATA TABLE: VRF

FUNCTIONAL	PERCENTAGE (%)	0%
	OK (UNIT)	0
FAULTY	PERCENTAGE (%)	100%
	FAULTY (UNIT)	43

NO	NAME	JACE	STATUS	REMARK
39	FCU_L2_COR_1_W	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
40	FCU_L2_COR_2_W	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
41	FCU_L2_PF_W	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
42	FCU_L2_COR_E	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
43	FCU_L2_PF_E	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY

DATA TABLE: FAN

FUNCTIONAL	PERCENTAGE (%)	64%
	OK (UNIT)	21
FAULTY	PERCENTAGE (%)	36%
	FAULTY (UNIT)	12

NO	DPM NAME	JACE	STATUS	REMARK
1	SSMAF_B1_A	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
2	SSMAF_B1_B	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
3	SSMEF_B1_1A	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
4	SSMEF_B1_1B	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
5	SSMEF_B1_2A	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
6	SSMEF_B1_2B	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
7	SSMAF_B2_A	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
8	SSMAF_B2_B	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
9	SSMEF_B2_2A	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
10	SSMEF_B2_2B	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
11	EF_B2_CCL	KKR2-DB1	✗	OFFLINE DUE TO JACE DB1 FAULTY
12	SSEAF_P1A	KKR2-DB2	✓	
13	SSFAF_P1A	KKR2-DB2	✓	
14	FE_P1_GF	KKR2-DB2	✓	
15	EF_P1_MSBR	KKR2-DB2	✓	
16	EF_P1_TXR	KKR2-DB2	✓	
17	EF_P1_TNB	KKR2-DB2	✓	
18	EF_P1_FPR	KKR2-DB2	✓	
19	SSEAF_P2_1	KKR2-DB2	✓	
20	SSEAF_P2A_1	KKR2-DB2	✓	
21	SSFAF_P2_P2A_1	KKR2-DB2	✓	
22	SSFAF_P2_1B	KKR2-DB2	✓	
23	SSEAF_P3_1	KKR2-DB2	✓	
24	SSEAF_P3A_1	KKR2-DB2	✓	
25	SSFAF_P3_P3A_1	KKR2-DB2	✓	
26	SSFAF_P3_1B	KKR2-DB2	✓	
27	SSEAF_P4_1	KKR2-DB2	✓	
28	SSEAF_P4A_1	KKR2-DB2	✓	
29	SSFAF_P4_P4A_1	KKR2-DB2	✓	
30	SSFAF_P4_1B	KKR2-DB2	✓	
31	EF_P4_CHILLER	KKR2-DB2	✓	
32	EF_P4_TX	KKR2-DB2	✓	
33	EF_P4_DCW	KKR2-DB2	✗	POINT STALE

DATA TABLE: AHU

FUNCTIONAL	PERCENTAGE (%)	59%	59%	59%	59%	59%	59%	59%	55%	59%	59%	59%	56%	58%	58%	59%	59%	59%	50%	58%	
	OK (UNIT)	39	39	39	39	39	39	39	36	39	39	39	37	38	38	39	39	39	33		
FAULTY	PERCENTAGE (%)	41%	41%	41%	41%	41%	41%	41%	45%	41%	41%	41%	44%	42%	42%	41%	41%	41%	50%	42%	
	FAULTY (UNIT)	27	27	27	27	27	27	27	30	27	27	27	29	28	28	27	27	27	33		

CONTACT	
CMD	START/STOP COMMAND
ST	STATUS
TA	TRIP ALARM
MD	AUTO /MANUAL

SENSOR	
AFS	AIR FLOW SWITCH
PRI FD	PRIMARY FILTER DIRTY
SEC FD	SECONDARY FILTER DIRTY
SWT	SUPPLY WATER TEMPERATURE
RWT	RETURN WATER TEMPERATURE

SENSOR	
OFCT	OFFCOIL TEMPERATURE
RAT	RETURN AIR TEMPERATURE
RAH	RETURN AIR HUMIDITY
CO2	CARBON DIOXIDE SENSOR
DSP	DUCT STATIC PRESSURE

CONTROL	
MV	MODULATED VALVE
FAD	FRESH AIR DAMPER
VSD	VARIABLE SPEED DRIVE
HLI	HIGH LEVEL INTERFACING

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

			CONTACT				SENSOR										CONTROL				HLI		
NO	AHU NAME	LOCATION	CMD	ST	TA	MD	AFS	PRI FD	SEC FD	SWT	RWT	OFCT	RAT	RAH	CO2	DSP	MV	FAD	VSD	VSD	FUNCTIONALITY	REMARK	
1	AHU-B1-WEST	AHU B1 WEST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB1 FAULTY	
2	AHU-B1-EAST	AHU B1 EAST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB1 FAULTY	
3	AHU-MZ-WEST	AHU MZ WEST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB1 FAULTY	
4	AHU-L3-WEST	AHU L3 WEST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB1 FAULTY	
5	AHU-L3-EAST	AHU L3 EAST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB1 FAULTY	
6	AHU-L4-WEST	AHU L4 WEST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB1 FAULTY	
7	AHU-L4-EAST	AHU L4 EAST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB1 FAULTY	
8	AHU-L5-WEST	AHU L5 WEST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB1 FAULTY	
9	AHU-L5-EAST	AHU L5 EAST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB1 FAULTY	
10	AHU-L6-WEST	AHU L6 WEST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB3 FAULTY	
11	AHU-L6-EAST	AHU L6 EAST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB3 FAULTY	
12	AHU-L7-WEST	AHU L7 WEST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB3 FAULTY	
13	AHU-L7-EAST	AHU L7 EAST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB3 FAULTY	
14	AHU-L8-WEST	AHU L8 WEST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB3 FAULTY	
15	AHU-L8-EAST	AHU L8 EAST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB3 FAULTY	
16	AHU-L9-WEST	AHU L9 WEST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB3 FAULTY	
17	AHU-L9-EAST	AHU L9 EAST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB3 FAULTY	
18	AHU-L10-WEST	AHU L10 WEST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB3 FAULTY	
19	AHU-L10-EAST	AHU L10 EAST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB3 FAULTY	
20	AHU-L11-WEST	AHU L11 WEST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB3 FAULTY	
21	AHU-L11-EAST	AHU L11 EAST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB3 FAULTY	
22	AHU-L12-WEST	AHU L12 WEST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB3 FAULTY	
23	AHU-L12-EAST	AHU L12 EAST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB3 FAULTY	
24	AHU-L13-WEST	AHU L13 WEST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB3 FAULTY	
25	AHU-L13-EAST	AHU L13 EAST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB3 FAULTY	
26	AHU-L14-WEST	AHU L14 WEST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB3 FAULTY	
27	AHU-L14-EAST	AHU L14 EAST	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	✖	0%	OFFLINE DUE TO JACE DB3 FAULTY	

DATA TABLE: AHU

FUNCTIONAL	PERCENTAGE (%)	59%	59%	59%	59%	59%	59%	59%	55%	59%	59%	59%	56%	58%	58%	59%	59%	59%	50%	58%	
	OK (UNIT)	39	39	39	39	39	39	39	36	39	39	39	37	38	38	39	39	39	33		
FAULTY	PERCENTAGE (%)	41%	41%	41%	41%	41%	41%	41%	45%	41%	41%	41%	44%	42%	42%	41%	41%	41%	50%	42%	
	FAULTY (UNIT)	27	27	27	27	27	27	27	30	27	27	27	29	28	28	27	27	27	33		

CONTACT	
CMD	START/STOP COMMAND
ST	STATUS
TA	TRIP ALARM
MD	AUTO /MANUAL

SENSOR	
AFS	AIR FLOW SWITCH
PRI FD	PRIMARY FILTER DIRTY
SEC FD	SECONDARY FILTER DIRTY
SWT	SUPPLY WATER TEMPERATURE
RWT	RETURN WATER TEMPERATURE

SENSOR	
OFCT	OFFCOIL TEMPERATURE
RAT	RETURN AIR TEMPERATURE
RAH	RETURN AIR HUMIDITY
CO2	CARBON DIOXIDE SENSOR
DSP	DUCT STATIC PRESSURE

CONTROL	
MV	MODULATED VALVE
FAD	FRESH AIR DAMPER
VSD	VARIABLE SPEED DRIVE
HLI	HIGH LEVEL INTERFACING

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

			CONTACT				SENSOR										CONTROL				HLI		
NO	AHU NAME	LOCATION	CMD	ST	TA	MD	AFS	PRI FD	SEC FD	SWT	RWT	OFCT	RAT	RAH	CO2	DSP	MV	FAD	VSD	VSD	FUNCTIONALITY	REMARK	
28	AHU-L15-WEST	AHU L15 WEST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
29	AHU-L15-EAST	AHU L15 EAST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
30	AHU-L16-WEST	AHU L16 WEST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
31	AHU-L16-EAST	AHU L16 EAST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
32	AHU-L17-WEST	AHU L17 WEST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
33	AHU-L17-EAST	AHU L17 EAST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
34	AHU-L19-WEST	AHU L19 WEST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
35	AHU-L20-WEST	AHU L20 WEST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
36	AHU-L20-EAST	AHU L20 EAST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
37	AHU-L21-WEST	AHU L21 WEST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✗	94%	VSD HLI INTERMITENT	
38	AHU-L21-EAST	AHU L21 EAST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
39	AHU-L22-WEST	AHU L22 WEST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✗	94%	VSD HLI INTERMITENT	
40	AHU-L22-EAST	AHU L22 EAST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
41	AHU-L23-WEST	AHU L23 WEST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
42	AHU-L23-EAST	AHU L23 EAST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
43	AHU-L24-WEST	AHU L24 WEST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
44	AHU-L24-EAST	AHU L24 EAST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
45	AHU-L25-WEST	AHU L25 WEST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
46	AHU-L25-EAST	AHU L25 EAST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
47	AHU-L26-WEST	AHU L26 WEST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✗	94%	VSD HLI INTERMITENT	
48	AHU-L26-EAST	AHU L26 EAST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✗	94%	VSD HLI INTERMITENT	
49	AHU-L27-WEST	AHU L27 WEST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
50	AHU-L27-EAST	AHU L27 EAST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
51	AHU-L28-WEST	AHU L28 WEST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✗	✓	✓	✓	✓	✓	✓	94%	6. CWOSDC202606293405	
52	AHU-L28-EAST	AHU L28 EAST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
53	AHU-L29-WEST	AHU L29 WEST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		
54	AHU-L29-EAST	AHU L29 EAST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%		

DATA TABLE: AHU

FUNCTIONAL	PERCENTAGE (%)	59%	59%	59%	59%	59%	59%	59%	55%	59%	59%	59%	56%	58%	58%	59%	59%	59%	50%	58%
	OK (UNIT)	39	39	39	39	39	39	39	36	39	39	39	37	38	38	39	39	39	33	
FAULTY	PERCENTAGE (%)	41%	41%	41%	41%	41%	41%	41%	45%	41%	41%	41%	44%	42%	42%	41%	41%	41%	50%	42%
	FAULTY (UNIT)	27	27	27	27	27	27	27	30	27	27	27	29	28	28	27	27	27	33	

CONTACT	
CMD	START/STOP COMMAND
ST	STATUS
TA	TRIP ALARM
MD	AUTO /MANUAL

SENSOR	
AFS	AIR FLOW SWITCH
PRI FD	PRIMARY FILTER DIRTY
SEC FD	SECONDARY FILTER DIRTY
SWT	SUPPLY WATER TEMPERATURE
RWT	RETURN WATER TEMPERATURE

SENSOR	
OFCT	OFFCOIL TEMPERATURE
RAT	RETURN AIR TEMPERATURE
RAH	RETURN AIR HUMIDITY
CO2	CARBON DIOXIDE SENSOR
DSP	DUCT STATIC PRESSURE

CONTROL	
MV	MODULATED VALVE
FAD	FRESH AIR DAMPER
VSD	VARIABLE SPEED DRIVE
HLI	HIGH LEVEL INTERFACING

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

			CONTACT				SENSOR										CONTROL			HLI		
NO	AHU NAME	LOCATION	CMD	ST	TA	MD	AFS	PRI FD	SEC FD	SWT	RWT	OFCT	RAT	RAH	CO2	DSP	MV	FAD	VSD	VSD	FUNCTIONALITY	REMARK
55	AHU-L30-WEST	AHU L30 WEST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
56	AHU-L30-EAST	AHU L30 EAST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
57	AHU-L31-WEST	AHU L31 WEST	✓	✓	✓	✓	✓	✓	✓	✗	✓	✓	✓	✓	✓	✓	✓	✓	✓	✗	89%	6. CWOSDC202606293406
58	AHU-L31-EAST	AHU L31 EAST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
59	AHU-L32-WEST	AHU L32 WEST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✗	✗	✓	✓	✓	✗	83%	ACDC SUSPECT FAULTY
60	AHU-L32-EAST	AHU L32 EAST	✓	✓	✓	✓	✓	✓	✓	✗	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	94%	6. CWOSDC202606293406
61	AHU-L33-WEST	AHU L33 WEST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✗	✓	✓	✓	✓	✓	✓	94%	6. CWOSDC202606293405
62	AHU-L33-EAST	AHU L33 EAST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
63	AHU-L34-WEST	AHU L34 WEST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
64	AHU-L34-EAST	AHU L34 EAST	✓	✓	✓	✓	✓	✓	✓	✗	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	94%	6. CWOSDC202606293406
65	AHU-L35-WEST	AHU L35 WEST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
66	AHU-L35-EAST	AHU L35 EAST	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	

DATA TABLE: FCU LL

FUNCTIONAL	PERCENTAGE (%)	48%	48%	48%	48%	38%	43%	43%	40%	48%	45%	
	OK (UNIT)	20	20	20	20	16	18	18	17	20		
FAULTY	PERCENTAGE (%)	52%	52%	52%	52%	62%	57%	57%	60%	52%	55%	
	FAULTY (UNIT)	22	22	22	22	26	24	24	25	22		

CONTACT	
CMD	START / STOP COMMAND (CMD)
ST	STATUS (ST)
TA	TRIP ALARM (TA)
MD	AUTO / MANUAL MODE (MD)

CONTROL/SENSOR	
SWT	SUPPLY WATER TEMPERATURE
RWT	RETURN WATER TEMPERATURE
RT	ROOM TEMPERATURE
RH	ROOM HUMIDITY
MV	MOTORIZED VALVE

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	FCU NAME	LOCATION	CONTACT				SENSOR				CONTROL	FUNCTIONALITY	REMARK
			CMD	ST	TA	MD	SWT	RWT	RT	RH	MV		
1	FCU-B2-CLL		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
2	FCU-B2-FFLE		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
3	FCU-B2-SC		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
4	FCU-B1-CLL		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
5	FCU-B1-FFLE		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
6	FCU-B1-SC		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
7	FCU-LLGR-LL		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
8	FCU-MZ-LL		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
9	FCU-L1-LL		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
10	FCU-L2-LL		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
11	FCU-L3-LL		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
12	FCU-L4-LL		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
13	FCU-L5-LL		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
14	FCU-L6-LL		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB3 FAULTY

DATA TABLE: FCU LL

FUNCTIONAL	PERCENTAGE (%)	48%	48%	48%	48%	38%	43%	43%	40%	48%	45%	
	OK (UNIT)	20	20	20	20	16	18	18	17	20		
FAULTY	PERCENTAGE (%)	52%	52%	52%	52%	62%	57%	57%	60%	52%	55%	
	FAULTY (UNIT)	22	22	22	22	26	24	24	25	22		

CONTACT	
CMD	START / STOP COMMAND (CMD)
ST	STATUS (ST)
TA	TRIP ALARM (TA)
MD	AUTO / MANUAL MODE (MD)

CONTROL/SENSOR	
SWT	SUPPLY WATER TEMPERATURE
RWT	RETURN WATER TEMPERATURE
RT	ROOM TEMPERATURE
RH	ROOM HUMIDITY
MV	MOTORIZED VALVE

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	FCU NAME	LOCATION	CONTACT				SENSOR				CONTROL	FUNCTIONALITY	REMARK
			CMD	ST	TA	MD	SWT	RWT	RT	RH	MV		
15	FCU-L7-LL		✗	✗	✗	✗	✗	✗	✗	✗	✗	0%	OFFLINE DUE TO JACE DB3 FAULTY
16	FCU-L8-LL		✗	✗	✗	✗	✗	✗	✗	✗	✗	0%	OFFLINE DUE TO JACE DB3 FAULTY
17	FCU-L9-LL		✗	✗	✗	✗	✗	✗	✗	✗	✗	0%	OFFLINE DUE TO JACE DB3 FAULTY
18	FCU-L10-LL		✗	✗	✗	✗	✗	✗	✗	✗	✗	0%	OFFLINE DUE TO JACE DB3 FAULTY
19	FCU-L11-LL		✗	✗	✗	✗	✗	✗	✗	✗	✗	0%	OFFLINE DUE TO JACE DB3 FAULTY
20	FCU-L12-LL		✗	✗	✗	✗	✗	✗	✗	✗	✗	0%	OFFLINE DUE TO JACE DB3 FAULTY
21	FCU-L13-LL		✗	✗	✗	✗	✗	✗	✗	✗	✗	0%	OFFLINE DUE TO JACE DB3 FAULTY
22	FCU-L14-LL		✗	✗	✗	✗	✗	✗	✗	✗	✗	0%	OFFLINE DUE TO JACE DB3 FAULTY
23	FCU-L15-LL		✓	✓	✓	✓	✓	✓	✗	✓	✓	89%	7. CWOSDC202607283523
24	FCU-L16-LL		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
25	FCU-L17-LL		✓	✓	✓	✓	✓	✓	✗	✓	✓	89%	7. CWOSDC202607283523
26	FCU-L19-LL		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
27	FCU-L20-LL		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
28	FCU-L21-LL		✓	✓	✓	✓	✗	✓	✓	✓	✓	89%	6. CWOSDC202606293407

DATA TABLE: FCU LL

FUNCTIONAL	PERCENTAGE (%)	48%	48%	48%	48%	38%	43%	43%	40%	48%	45%	
	OK (UNIT)	20	20	20	20	16	18	18	17	20		
FAULTY	PERCENTAGE (%)	52%	52%	52%	52%	62%	57%	57%	60%	52%	55%	
	FAULTY (UNIT)	22	22	22	22	26	24	24	25	22		

CONTACT	
CMD	START / STOP COMMAND (CMD)
ST	STATUS (ST)
TA	TRIP ALARM (TA)
MD	AUTO / MANUAL MODE (MD)

CONTROL/SENSOR	
SWT	SUPPLY WATER TEMPERATURE
RWT	RETURN WATER TEMPERATURE
RT	ROOM TEMPERATURE
RH	ROOM HUMIDITY
MV	MOTORIZED VALVE

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	FCU NAME	LOCATION	CONTACT				SENSOR				CONTROL	FUNCTIONALITY	REMARK
			CMD	ST	TA	MD	SWT	RWT	RT	RH	MV		
29	FCU-L22-LL		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
30	FCU-L23-LL		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
31	FCU-L24-LL		✓	✓	✓	✓	✗	✓	✓	✓	✓	89%	6. CWOSDC202606293407
32	FCU-L25-LL		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
33	FCU-L26-LL		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
34	FCU-L27-LL		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
35	FCU-L28-LL		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
36	FCU-L29-LL		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
37	FCU-L30-LL		✓	✓	✓	✓	✓	✗	✓	✓	✓	89%	6. CWOSDC202606293407
38	FCU-L31-LL		✓	✓	✓	✓	✗	✓	✓	✓	✓	89%	6. CWOSDC202606293407
39	FCU-L32-LL		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
40	FCU-L33-LL		✓	✓	✓	✓	✗	✓	✓	✗	✓	78%	7. CWOSDC202607283524 / 6. CWOSDC202606293407
41	FCU-L34-LL		✓	✓	✓	✓	✓	✓	✓	✗	✓	89%	7. CWOSDC202607283524
42	FCU-L35-LL		✓	✓	✓	✓	✓	✗	✓	✗	✓	78%	7. CWOSDC202607283524 / 6. CWOSDC202606293407

DATA TABLE: FCU TCR

FUNCTIONAL	PERCENTAGE (%)	53%	53%	53%	53%	45%	45%	53%	50%	53%	51%
	OK (UNIT)	20	20	20	20	17	17	20	19	20	
FAULTY	PERCENTAGE (%)	47%	47%	47%	47%	55%	55%	47%	50%	47%	49%
	FAULTY (UNIT)	18	18	18	18	21	21	18	19	18	

CONTACT	
CMD	START / STOP COMMAND (CMD)
ST	STATUS (ST)
TA	TRIP ALARM (TA)
MD	AUTO / MANUAL MODE (MD)

CONTROL/SENSOR	
SWT	SUPPLY WATER TEMPERATURE
RWT	RETURN WATER TEMPERATURE
RT	ROOM TEMPERATURE
RH	ROOM HUMIDITY
MV	MOTORIZED VALVE

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	FCU NAME	LOCATION	CONTACT				SENSOR				CONTROL	FUNCTIONALITY	REMARK
			CMD	ST	TA	MD	SWT	RWT	RT	RH	MV		
1	FCU-B2-TCR		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
2	FCU-B1-TCR		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
3	FCU-LLGR-TCR		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
4	FCU-MZ-TCR		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
5	FCU-L1-TCR		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
6	FCU-L2-TCR		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
7	FCU-L3-TCR		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
8	FCU-L4-TCR		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY

DATA TABLE: FCU TCR

FUNCTIONAL	PERCENTAGE (%)	53%	53%	53%	53%	45%	45%	53%	50%	53%	51%
	OK (UNIT)	20	20	20	20	17	17	20	19	20	
FAULTY	PERCENTAGE (%)	47%	47%	47%	47%	55%	55%	47%	50%	47%	49%
	FAULTY (UNIT)	18	18	18	18	21	21	18	19	18	

CONTACT	
CMD	START / STOP COMMAND (CMD)
ST	STATUS (ST)
TA	TRIP ALARM (TA)
MD	AUTO / MANUAL MODE (MD)

CONTROL/SENSOR	
SWT	SUPPLY WATER TEMPERATURE
RWT	RETURN WATER TEMPERATURE
RT	ROOM TEMPERATURE
RH	ROOM HUMIDITY
MV	MOTORIZED VALVE

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	FCU NAME	LOCATION	CONTACT				SENSOR				CONTROL	FUNCTIONALITY	REMARK
			CMD	ST	TA	MD	SWT	RWT	RT	RH	MV		
9	FCU-L5-TCR		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB1 FAULTY
10	FCU-L6-TCR		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB3 FAULTY
11	FCU-L7-TCR		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB3 FAULTY
12	FCU-L8-TCR		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB3 FAULTY
13	FCU-L9-TCR		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB3 FAULTY
14	FCU-L10-TCR		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB3 FAULTY
15	FCU-L11-TCR		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB3 FAULTY
16	FCU-L12-TCR		×	×	×	×	×	×	×	×	×	0%	OFFLINE DUE TO JACE DB3 FAULTY

DATA TABLE: FCU TCR

FUNCTIONAL	PERCENTAGE (%)	53%	53%	53%	53%	45%	45%	53%	50%	53%	51%
	OK (UNIT)	20	20	20	20	17	17	20	19	20	
FAULTY	PERCENTAGE (%)	47%	47%	47%	47%	55%	55%	47%	50%	47%	49%
	FAULTY (UNIT)	18	18	18	18	21	21	18	19	18	

CONTACT	
CMD	START / STOP COMMAND (CMD)
ST	STATUS (ST)
TA	TRIP ALARM (TA)
MD	AUTO / MANUAL MODE (MD)

CONTROL/SENSOR	
SWT	SUPPLY WATER TEMPERATURE
RWT	RETURN WATER TEMPERATURE
RT	ROOM TEMPERATURE
RH	ROOM HUMIDITY
MV	MOTORIZED VALVE

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	FCU NAME	LOCATION	CONTACT				SENSOR				CONTROL	FUNCTIONALITY	REMARK
			CMD	ST	TA	MD	SWT	RWT	RT	RH	MV		
17	FCU-L13-TCR		✗	✗	✗	✗	✗	✗	✗	✗	✗	0%	OFFLINE DUE TO JACE DB3 FAULTY
18	FCU-L14-TCR		✗	✗	✗	✗	✗	✗	✗	✗	✗	0%	OFFLINE DUE TO JACE DB3 FAULTY
19	FCU-L15-TCR		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
20	FCU-L16-TCR		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
21	FCU-L17-TCR		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
22	FCU-L19-TCR		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
23	FCU-L20-TCR		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
24	FCU-L21-TCR		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	

DATA TABLE: FCU TCR

FUNCTIONAL	PERCENTAGE (%)	53%	53%	53%	53%	45%	45%	53%	50%	53%	51%
	OK (UNIT)	20	20	20	20	17	17	20	19	20	
FAULTY	PERCENTAGE (%)	47%	47%	47%	47%	55%	55%	47%	50%	47%	49%
	FAULTY (UNIT)	18	18	18	18	21	21	18	19	18	

CONTACT	
CMD	START / STOP COMMAND (CMD)
ST	STATUS (ST)
TA	TRIP ALARM (TA)
MD	AUTO / MANUAL MODE (MD)

CONTROL/SENSOR	
SWT	SUPPLY WATER TEMPERATURE
RWT	RETURN WATER TEMPERATURE
RT	ROOM TEMPERATURE
RH	ROOM HUMIDITY
MV	MOTORIZED VALVE

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	FCU NAME	LOCATION	CONTACT				SENSOR				CONTROL	FUNCTIONALITY	REMARK
			CMD	ST	TA	MD	SWT	RWT	RT	RH	MV		
25	FCU-L22-TCR		✓	✓	✓	✓	✓	✗	✓	✓	✓	89%	6. CWOSDC202606293407
26	FCU-L23-TCR		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
27	FCU-L24-TCR		✓	✓	✓	✓	✗	✓	✓	✓	✓	89%	7. CWOSDC202607283525
28	FCU-L25-TCR		✓	✓	✓	✓	✓	✗	✓	✓	✓	89%	6. CWOSDC202606293407
29	FCU-L26-TCR		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
30	FCU-L27-TCR		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
31	FCU-L28-TCR		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
32	FCU-L29-TCR		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	

DATA TABLE: FCU TCR

FUNCTIONAL	PERCENTAGE (%)	53%	53%	53%	53%	45%	45%	53%	50%	53%	51%
	OK (UNIT)	20	20	20	20	17	17	20	19	20	
FAULTY	PERCENTAGE (%)	47%	47%	47%	47%	55%	55%	47%	50%	47%	49%
	FAULTY (UNIT)	18	18	18	18	21	21	18	19	18	

CONTACT	
CMD	START / STOP COMMAND (CMD)
ST	STATUS (ST)
TA	TRIP ALARM (TA)
MD	AUTO / MANUAL MODE (MD)

CONTROL/SENSOR	
SWT	SUPPLY WATER TEMPERATURE
RWT	RETURN WATER TEMPERATURE
RT	ROOM TEMPERATURE
RH	ROOM HUMIDITY
MV	MOTORIZED VALVE

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	FCU NAME	LOCATION	CONTACT				SENSOR				CONTROL	FUNCTIONALITY	REMARK
			CMD	ST	TA	MD	SWT	RWT	RT	RH	MV		
33	FCU-L30-TCR		✓	✓	✓	✓	✗	✗	✓	✓	✓	78%	6. CWOSDC202606293407
34	FCU-L31-TCR		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
35	FCU-L32-TCR		✓	✓	✓	✓	✗	✓	✓	✓	✓	89%	7. CWOSDC202607283525
36	FCU-L33-TCR		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
37	FCU-L34-TCR		✓	✓	✓	✓	✓	✓	✓	✓	✓	100%	
38	FCU-L35-TCR		✓	✓	✓	✓	✓	✓	✓	✗	✓	89%	7. CWOSDC202607283524

DATA TABLE: CHILLER

FUNCTIONAL	PERCENTAGE (%)	100%	100%	100%	100%	83%	50%	88%	88%	85%	88%	100%	90%
	OK (UNIT)	18	18	18	18	10	3	14	14	17	15	1	
FAULTY	PERCENTAGE (%)	0%	0%	0%	0%	17%	50%	13%	13%	15%	12%	0%	10%
	FAULTY (UNIT)	0	0	0	0	2	3	2	2	3	2	0	

CONTACT	
CMD	START / STOP COMMAND
ST	STATUS
TA	TRIP ALARM
MD	AUTO / MANUAL MODE

CONTROL/SENSOR	
SWT	SUPPLY WATER TEMPERATURE
RWT	RETURN WATER TEMPERATURE
SWP	ROOM TEMPERATURE
RWP	ROOM HUMIDITY
FLOW	MOTORIZED VALVE
VSD	VARIABLE SPEED DRIVE
HLI	HIGH LEVEL INTERFACING

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	FCU NAME	LOCATION	CONTACT				CONTROL		SENSOR				FLOW	FUNCTIONALITY	REMARK
			CMD	ST	TA	MD	VSD	HLI	SWT	RWT	SWP	RWP			
1	CHILLER 1 (EVAPORATOR)	CHILLER PLANT P4A	✓	✓	✓	✓	✓	✗	✓	✓	✓	✓		90%	
2	CHILLER 1 (CONDENSOR)	CHILLER PLANT P4A							✓	✓	✗	✓		75%	6. CWOSDC202606293408
3	CHILLER 2 (EVAPORATOR)	CHILLER PLANT P4A	✓	✓	✓	✓	✓	✗	✓	✓	✓	✓		90%	
4	CHILLER 2 (CONDENSOR)	CHILLER PLANT P4A							✗	✓	✓	✓		75%	6. CWOSDC202606293409
5	CHILLER 3 (EVAPORATOR)	CHILLER PLANT P4A	✓	✓	✓	✓	✓	✗	✓	✓	✓	✓		90%	
6	CHILLER 3 (CONDENSOR)	CHILLER PLANT P4A							✓	✓	✓	✓		100%	
7	CHILLED WATER PUMP 1	CHILLER PLANT P4A	✓	✓	✓	✓	✓				✓			100%	
8	CHILLED WATER PUMP 2	CHILLER PLANT P4A	✓	✓	✓	✓	✓				✓			100%	
9	CHILLED WATER PUMP 3	CHILLER PLANT P4A	✓	✓	✓	✓	✓				✓			100%	
10	CONDENSOR PUMP 1	CHILLER PLANT P4A	✓	✓	✓	✓	✗				✓			83%	
11	CONDENSOR PUMP 2	CHILLER PLANT P4A	✓	✓	✓	✓	✗				✓			83%	
12	CONDENSOR PUMP 3	CHILLER PLANT P4A	✓	✓	✓	✓	✓				✓			100%	
13	COOLING TOWER 1	CHILLER PLANT P4A	✓	✓	✓	✓			✓	✓				100%	
14	COOLING TOWER 2	CHILLER PLANT P4A	✓	✓	✓	✓			✓	✓				100%	
15	COOLING TOWER 3	CHILLER PLANT P4A	✓	✓	✓	✓			✓	✓				100%	
16	CHILLER MAIN HEADER	CHILLER PLANT P4A	✓	✓	✓	✓			✓	✓	✓	✓	✓	100%	
17	HEX 1 (TO HIGH ZONE)	HEX ROOM LEVEL 18							✗	✓	✓	✗		50%	

DATA TABLE: CHILLER

FUNCTIONAL	PERCENTAGE (%)	100%	100%	100%	100%	83%	50%	88%	88%	85%	88%	100%	90%
	OK (UNIT)	18	18	18	18	10	3	14	14	17	15	1	
FAULTY	PERCENTAGE (%)	0%	0%	0%	0%	17%	50%	13%	13%	15%	12%	0%	10%
	FAULTY (UNIT)	0	0	0	0	2	3	2	2	3	2	0	

CONTACT	
CMD	START / STOP COMMAND
ST	STATUS
TA	TRIP ALARM
MD	AUTO / MANUAL MODE

CONTROL/SENSOR	
SWT	SUPPLY WATER TEMPERATURE
RWT	RETURN WATER TEMPERATURE
SWP	ROOM TEMPERATURE
RWP	ROOM HUMIDITY
FLOW	MOTORIZED VALVE
VSD	VARIABLE SPEED DRIVE
HLI	HIGH LEVEL INTERFACING

FUNCTIONALITY	
PERCENTAGE	PERFORMANCE
90% - 100%	FULLY FUNCTIONAL
70% - 89%	MINOR ISSUE
50% - 69%	MODERATE ISSUE
30% - 49%	MAJOR ISSUE
0% - 29%	OFFLINE/CRITICAL

NO	FCU NAME	LOCATION	CONTACT				CONTROL		SENSOR					FUNCTIONALITY	REMARK
			CMD	ST	TA	MD	VSD	HLI	SWT	RWT	SWP	RWP	FLOW		
18	HEX 1 (FROM CHILLER PLANT)	HEX ROOM LEVEL 18							✓	✓	✗	✓		75%	
19	HEX 2 (TO HIGH ZONE)	HEX ROOM LEVEL 18							✓	✓	✓	✓		100%	
20	HEX 2 (FROM CHILLER PLANT)	HEX ROOM LEVEL 18							✓	✓	✗	✗		50%	
21	CHILLED WATER PUMP 1	HEX ROOM LEVEL 18	✓	✓	✓	✓	✓	✓				✓		100%	
22	CHILLED WATER PUMP 2	HEX ROOM LEVEL 18	✓	✓	✓	✓	✓	✓				✓		100%	
23	CHILLED WATER PUMP 3	HEX ROOM LEVEL 18	✓	✓	✓	✓	✓	✓				✓		100%	
24	HEX MAIN HEADER	HEX ROOM LEVEL 18									✓	✓		100%	
25	CHILLER 4	CHILLER ROOF TOP	✓	✓	✓	✓			✓	✗	✓	✓		88%	
26	CHILLER 5	CHILLER ROOF TOP	✓	✓	✓	✓			✓	✗	✓	✓		88%	