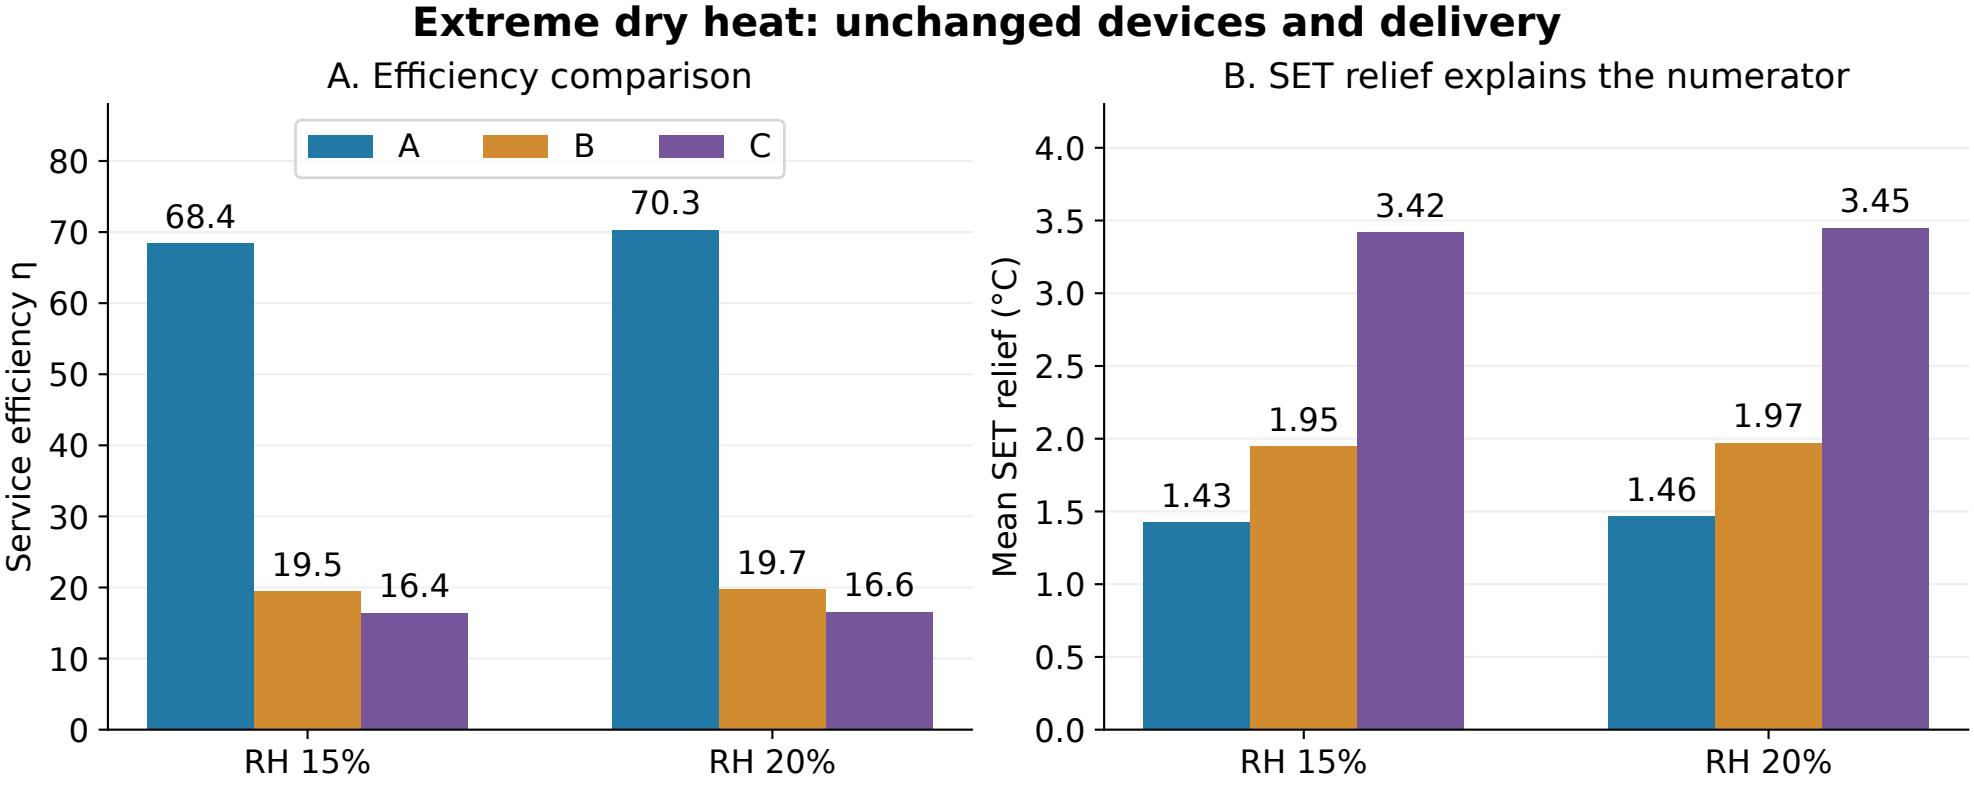
Extreme dry heat: unchanged devices and delivery
A. Efficiency comparison
B. SET relief explains the numerator
A
B
C
Service efficiency η
Mean SET relief (°C)
68.4
19.5
16.4
70.3
19.7
16.6
1.43
1.95
3.42
1.46
1.97
3.45
RH 15%
RH 20%
Ta = Tr = 40°C: accepted boundary of the installed default SET input guard.
η is the comparison criterion; SET relief describes its numerator. η unit: person·°C·h/kWh.