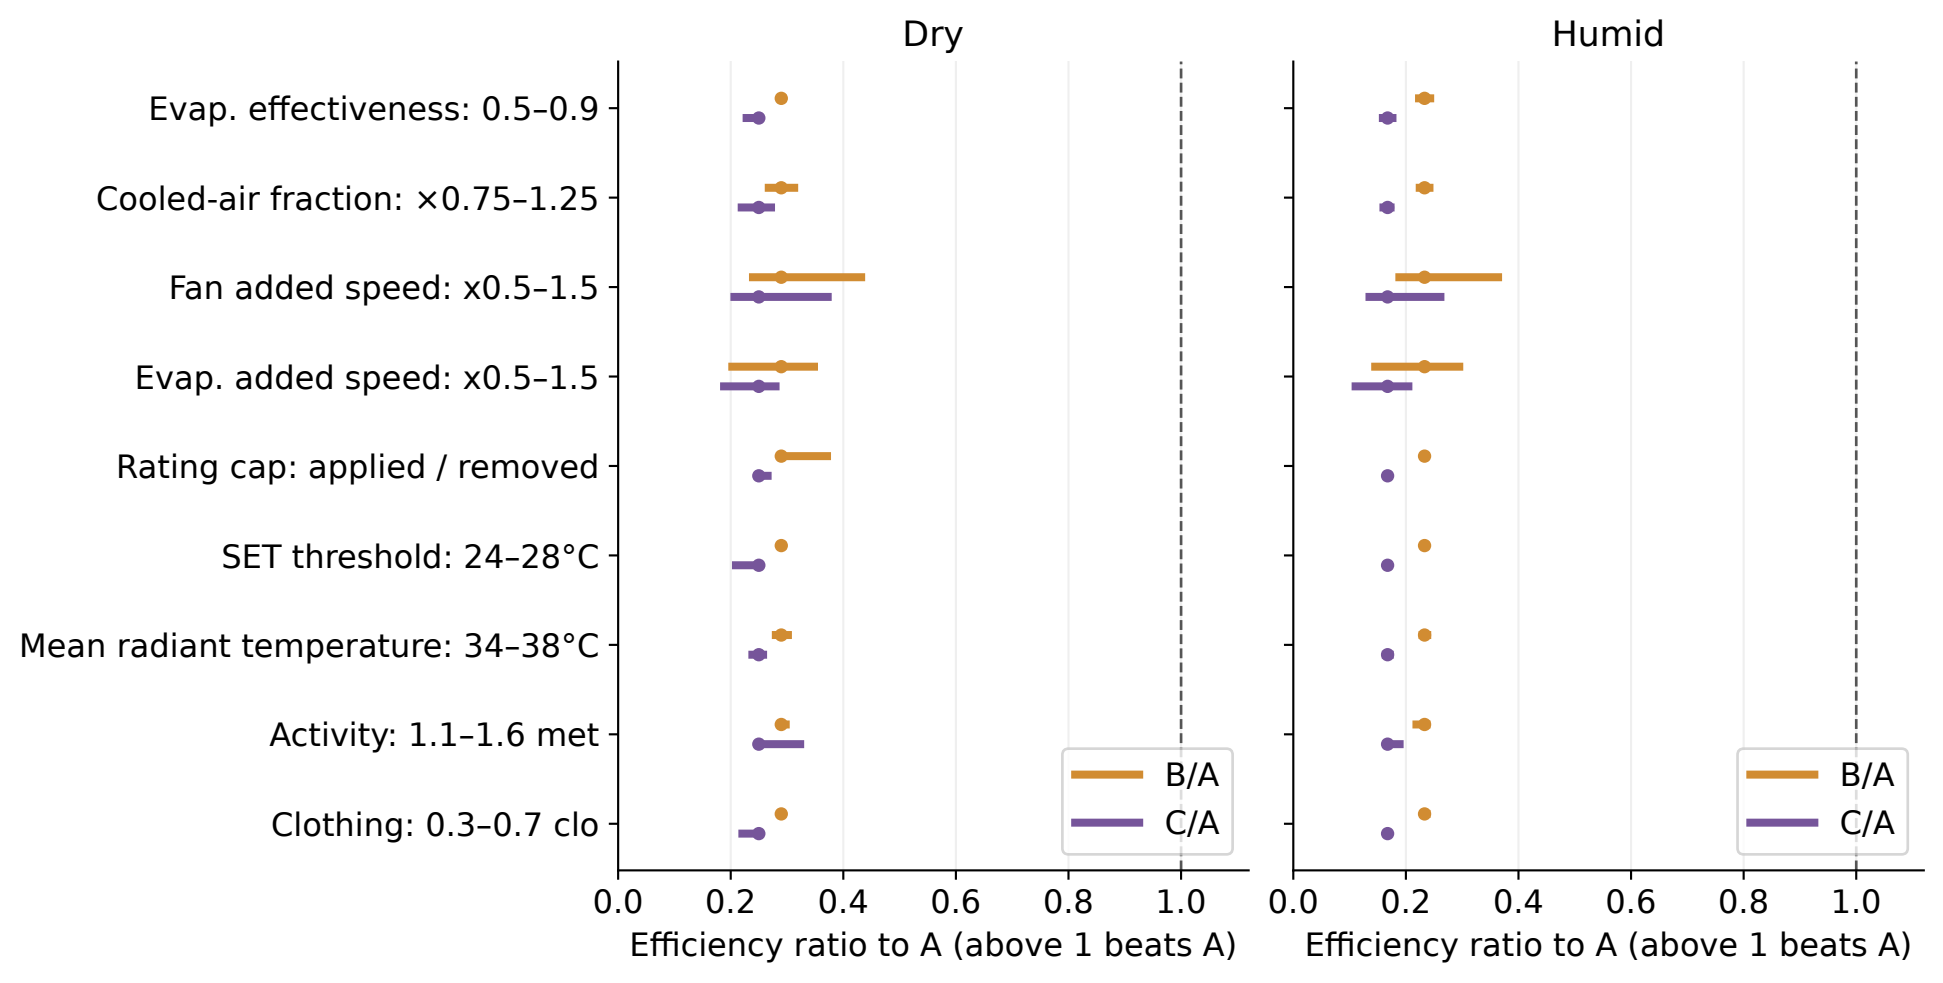
Dry
Humid
Evap. effectiveness: 0.5–0.9
Cooled-air fraction: ×0.75–1.25
Fan added speed: x0.5–1.5
Evap. added speed: x0.5–1.5
Rating cap: applied / removed
SET threshold: 24–28°C
Mean radiant temperature: 34–38°C
Activity: 1.1–1.6 met
Clothing: 0.3–0.7 clo
B/A
C/A
0.0
0.2
0.4
0.6
0.8
1.0
Efficiency ratio to A (above 1 beats A)