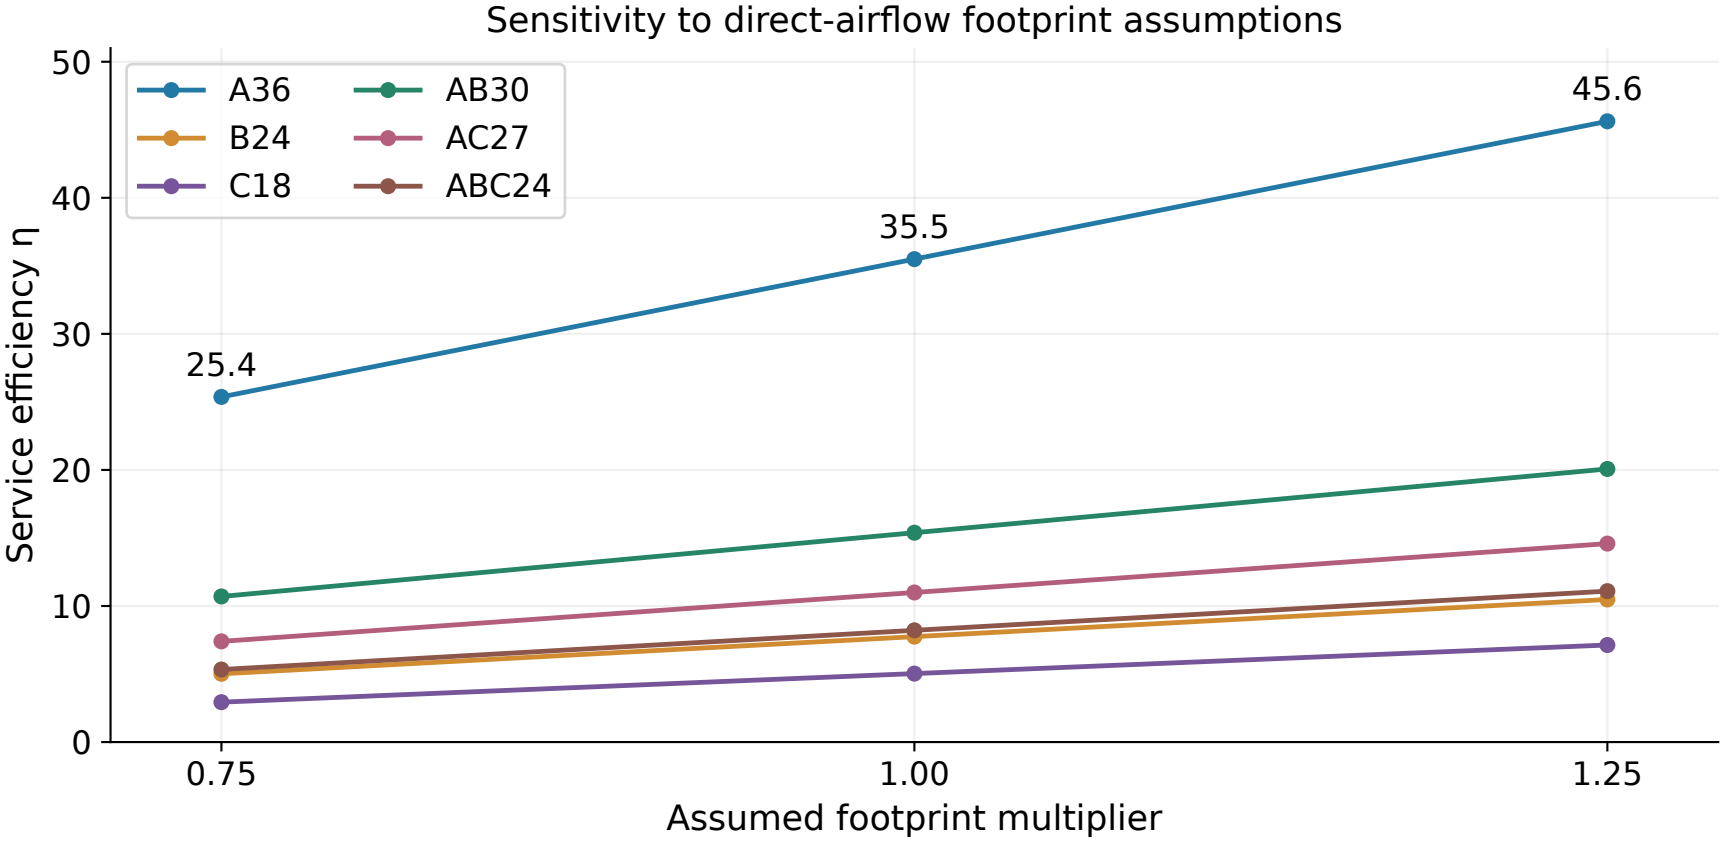

Thermal trajectories and device electricity are fixed; only service footprints vary.
Nominal local delivery: β = 0.5, χ = 1. η unit: person·°C·h/kWh.