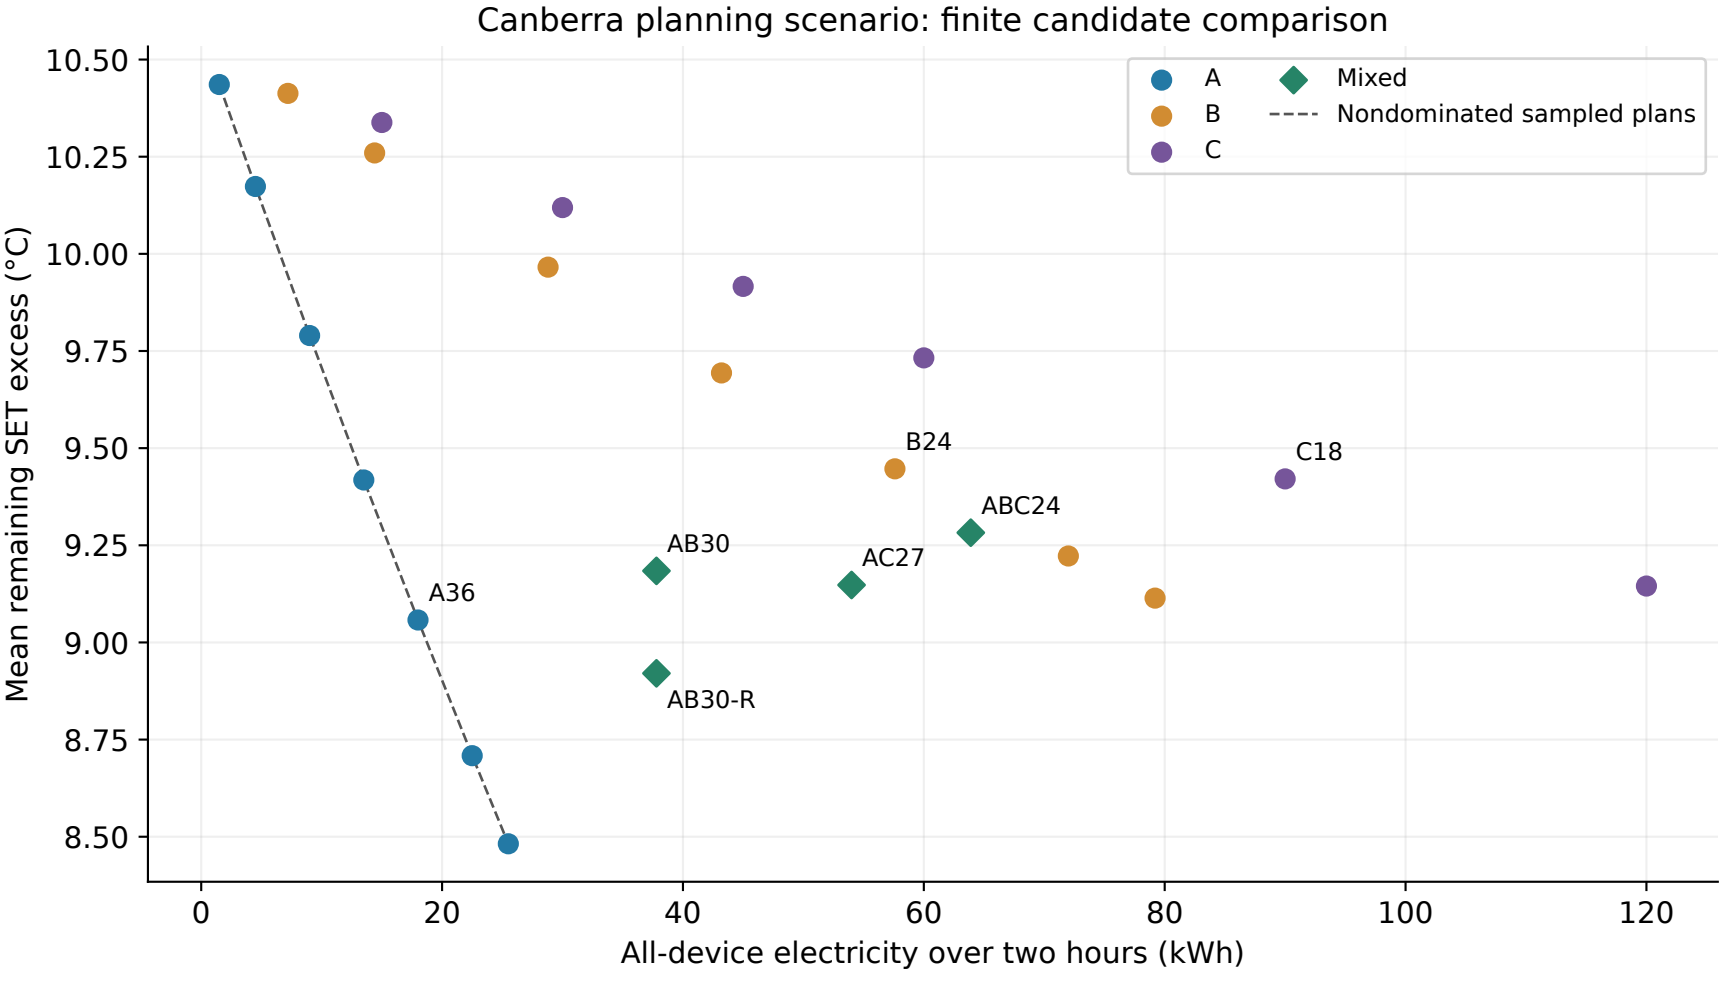
Canberra planning scenario: finite candidate comparison
A
B
C
Mixed
Nondominated sampled plans
A36
AB30
AB30-R
AC27
ABC24
B24
C18
Mean remaining SET excess (°C)
All-device electricity over two hours (kWh)
10.50
10.25
10.00
9.75
9.50
9.25
9.00
8.75
8.50
0
20
40
60
80
100
120