Place equipment where it serves passengers

A36: 18.0 kWh | person-time coverage 68.2%

Access | 57.2 people	Core | 121.0 people	Edge | 41.8 people
SET reduction +1.34 °C	SET reduction +1.71 °C	SET reduction +1.17 °C
Direct coverage 68.2%	Direct coverage 68.2%	Direct coverage 68.2%
12A	12A	12A

Tracks / non-waiting space: no service credit; temperature not solved

AB30: 37.8 kWh | person-time coverage 68.2%

Access | 57.2 people	Core | 121.0 people	Edge | 41.8 people
SET reduction +1.19 °C	SET reduction +1.59 °C	SET reduction +1.07 °C
Direct coverage 68.2%	Direct coverage 68.2%	Direct coverage 68.2%
6A + 4B	6A + 4B	6A + 4B

Tracks / non-waiting space: no service credit; temperature not solved

AB30-R: 37.8 kWh | person-time coverage 76.2%

Access | 57.2 people	Core | 121.0 people	Edge | 41.8 people
SET reduction +0.83 °C	SET reduction +2.30 °C	SET reduction +0.88 °C
Direct coverage 51.1%	Direct coverage 93.8%	Direct coverage 59.7%
3A + 4B	12A + 3B	3A + 5B

Tracks / non-waiting space: no service credit; temperature not solved

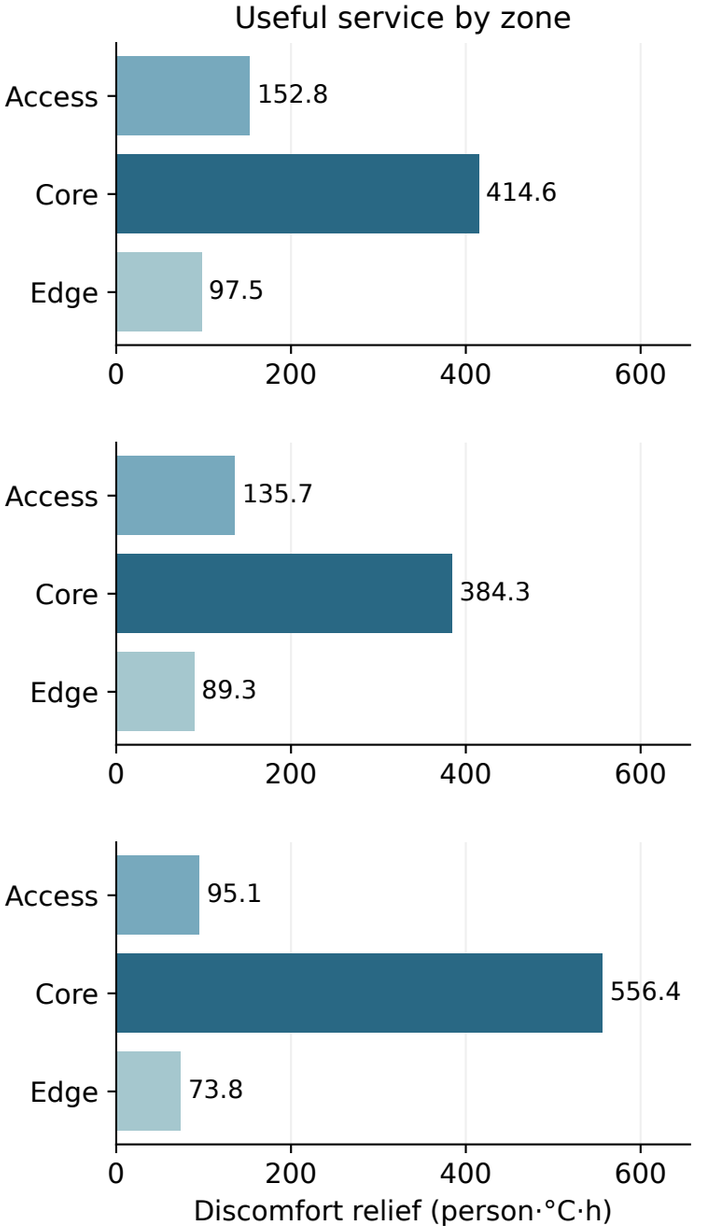



Passenger-weighted SET reduction (°C); common color scale

A: fan; B: evaporative device. Numbers in tiles = local counts; plan numbers = total units; -R = redistributed.
Functional-zone schematic, not a surveyed floor plan. Equal tiles denote 352 m² zones; track-band size is symbolic.
Grey hatching marks an excluded domain, not zero cooling. Occupancy and delivery footprints are assumed.