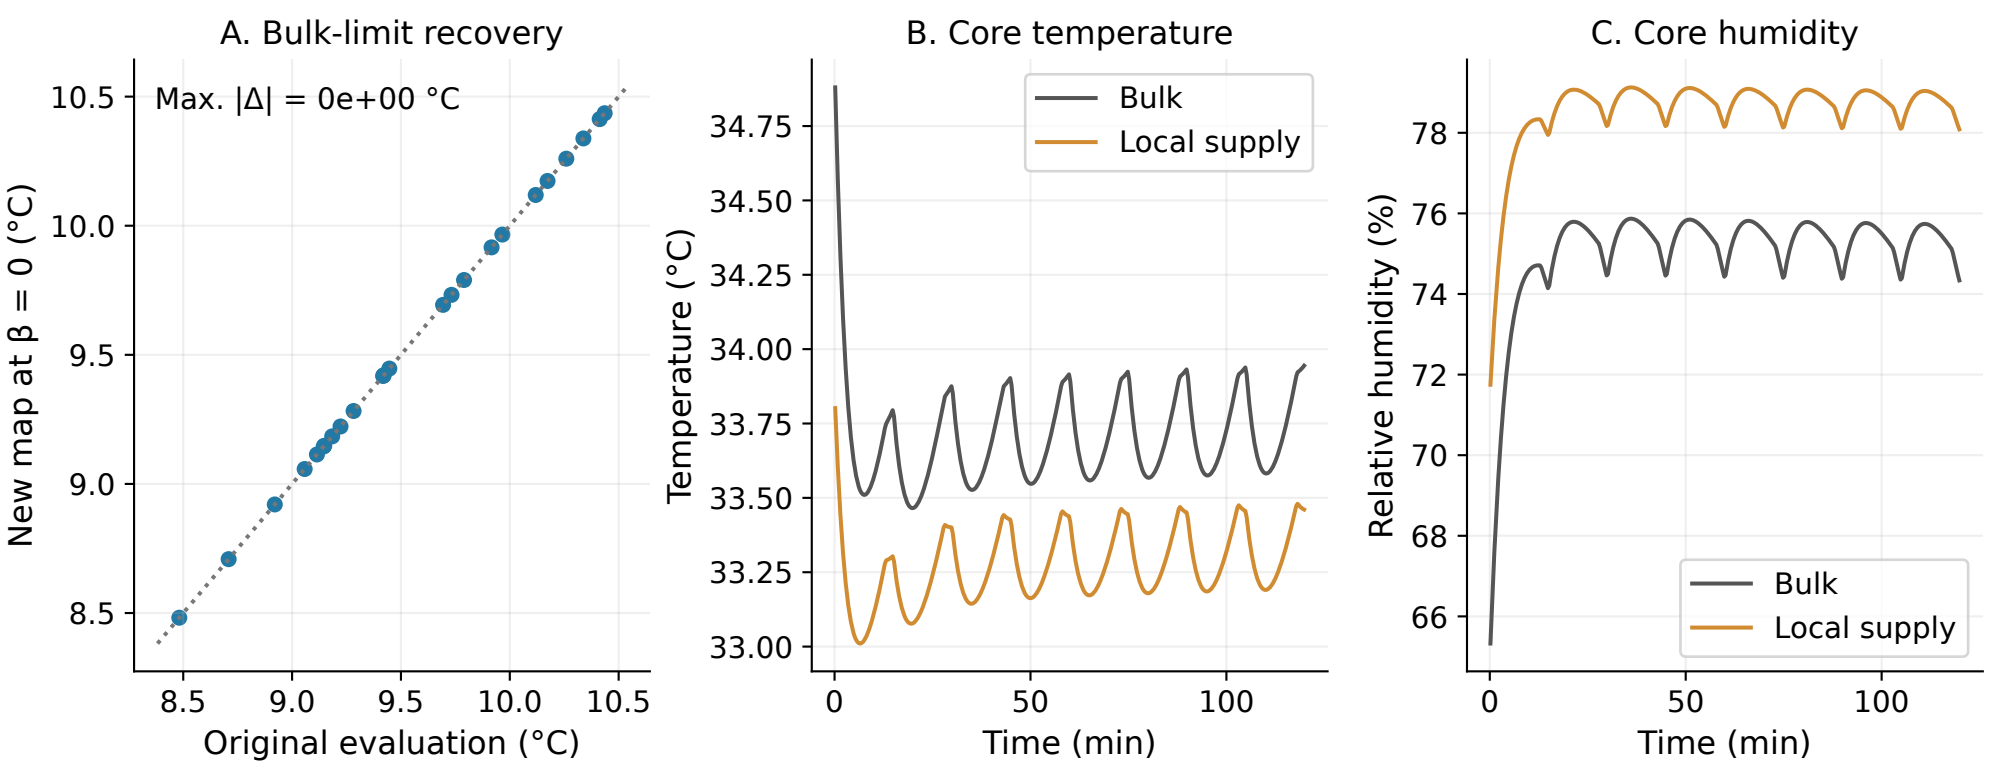

B24: β = 0.5, χ = 1. Bulk heat and moisture are counted once.
Local delivery has negligible storage and adds no second source.