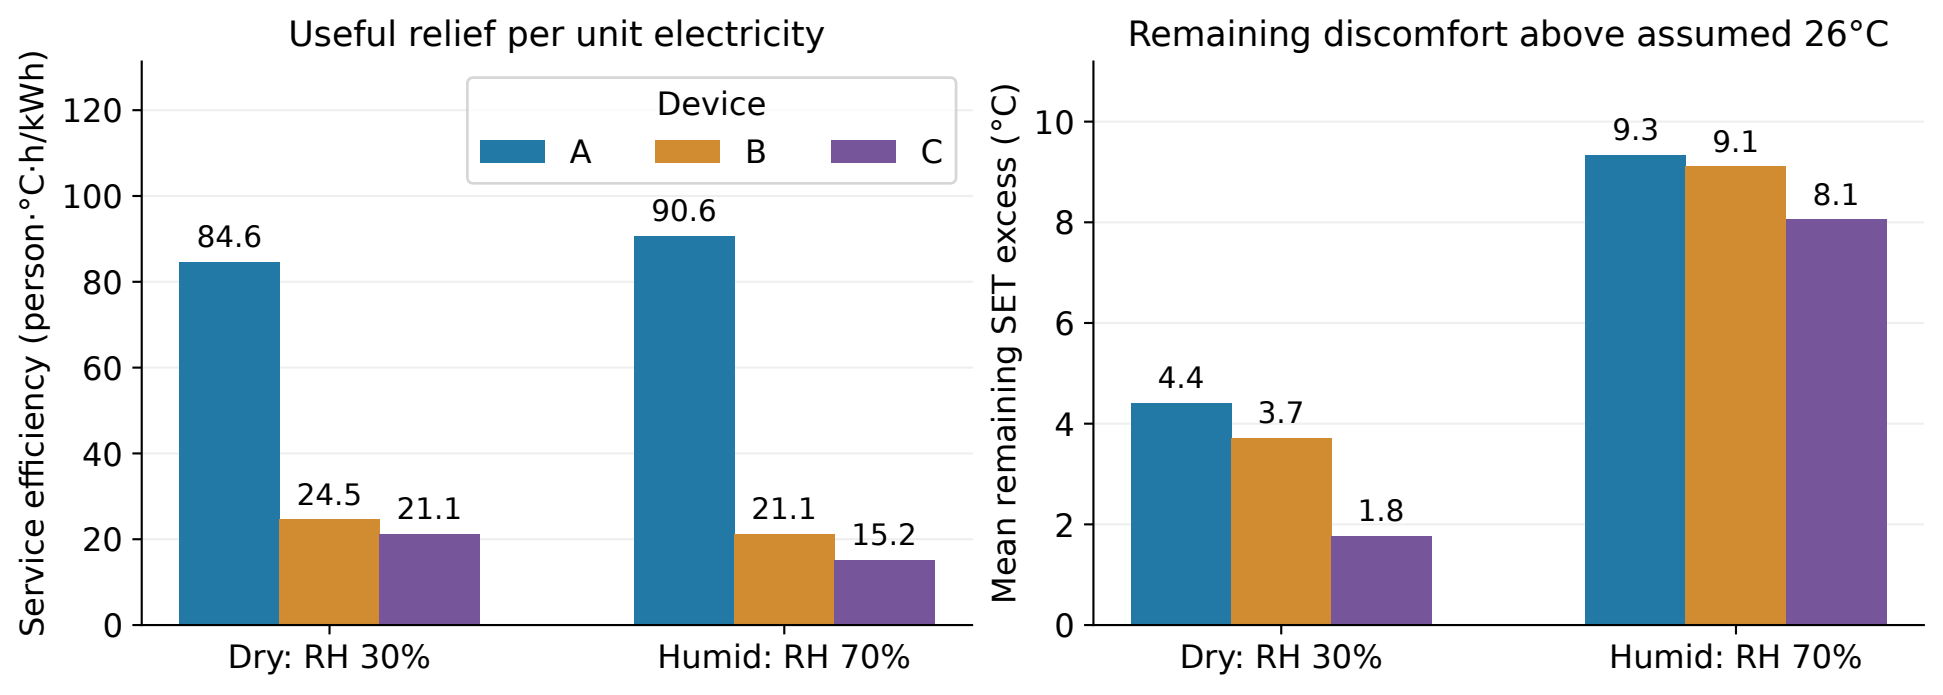
Useful relief per unit electricity
Service efficiency (person·°C·h/kWh)
Device
A
B
C
84.6
24.5
21.1
90.6
21.1
15.2
Dry: RH 30%
Humid: RH 70%
Remaining discomfort above assumed 26°C
Mean remaining SET excess (°C)
4.4
3.7
1.8
9.3
9.1
8.1
Dry: RH 30%
Humid: RH 70%