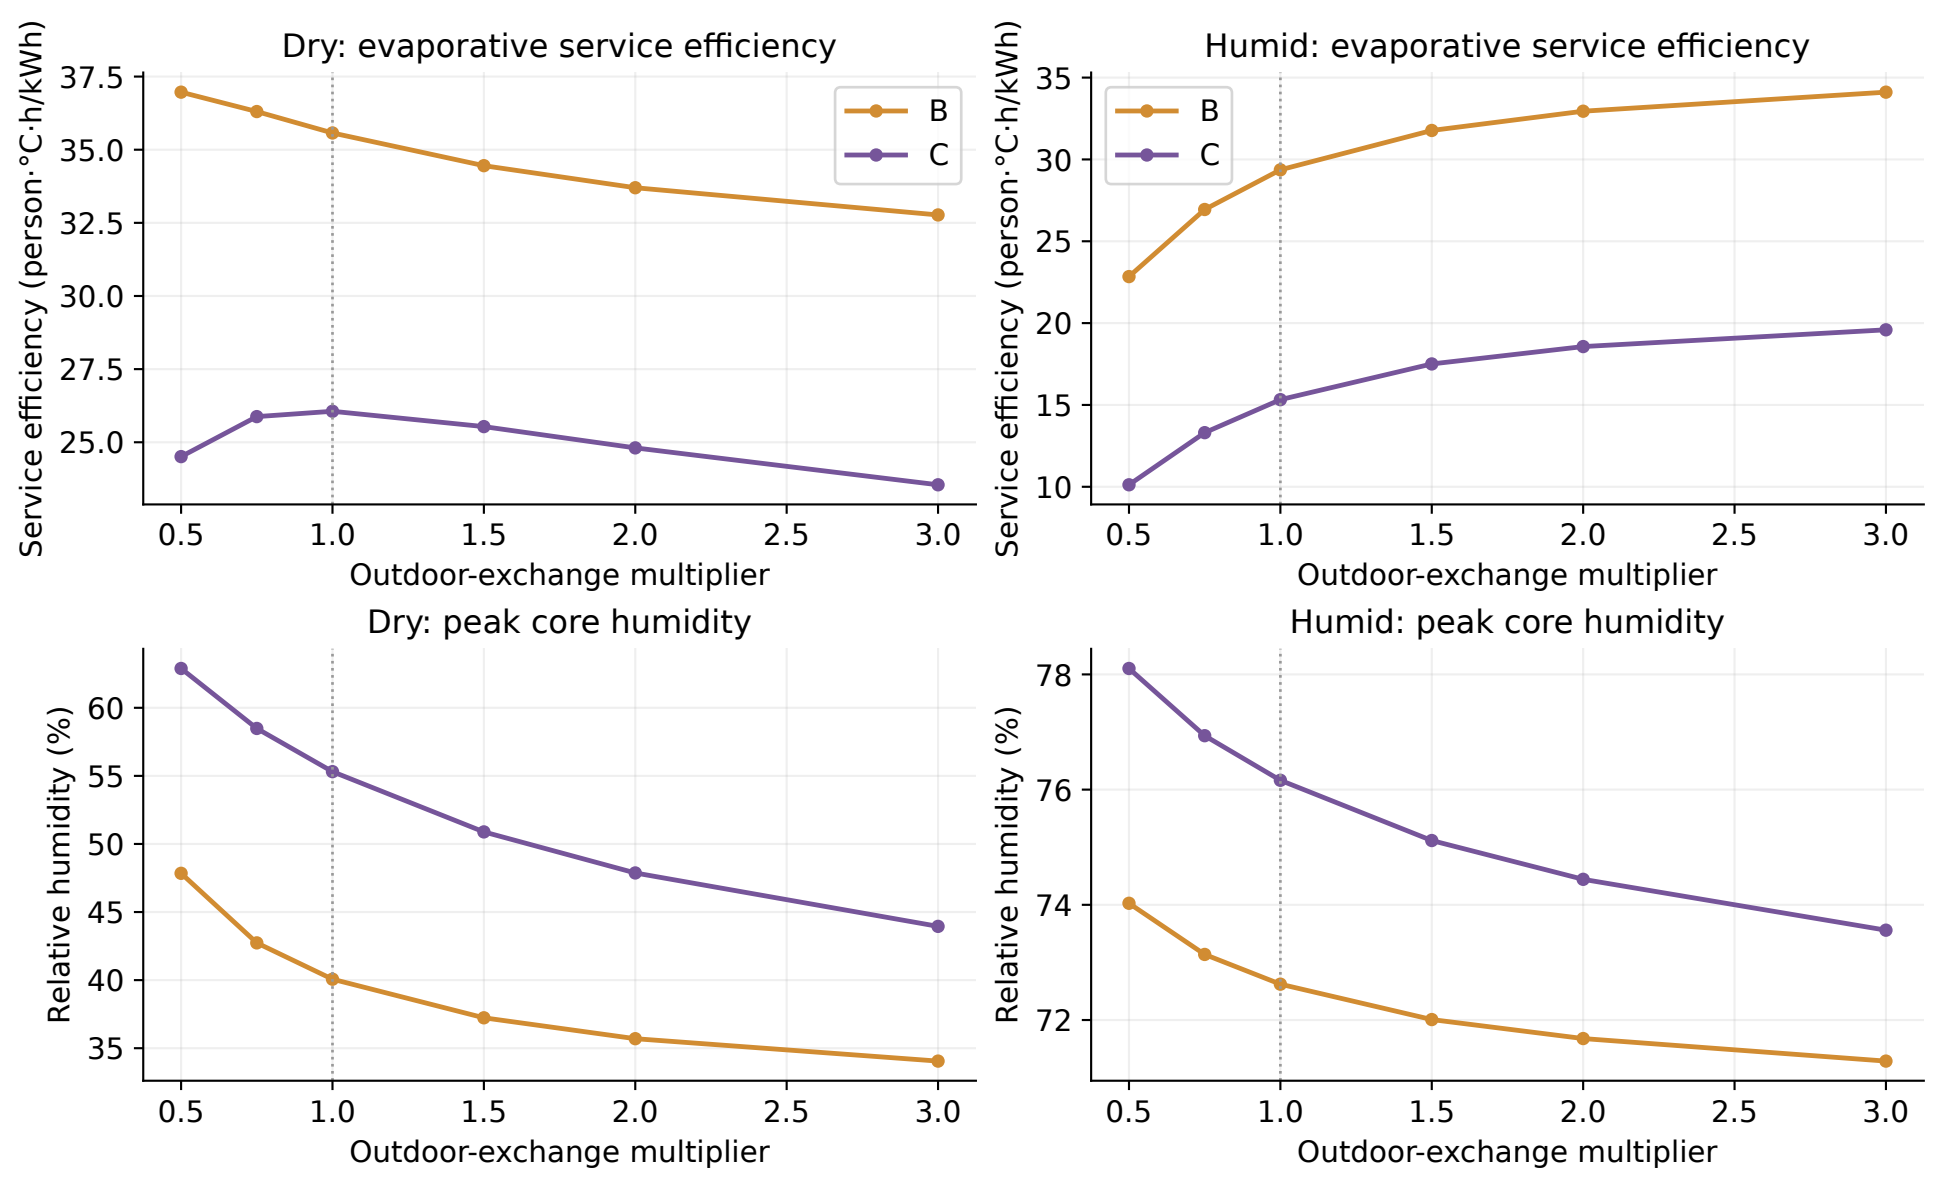
Dry: evaporative service efficiency
Service efficiency (person·°C·h/kWh)
37.5
35.0
32.5
30.0
27.5
25.0
B
C
0.5
1.0
1.5
2.0
2.5
3.0
Outdoor-exchange multiplier
Humid: evaporative service efficiency
Service efficiency (person·°C·h/kWh)
35
30
25
20
15
10
B
C
0.5
1.0
1.5
2.0
2.5
3.0
Outdoor-exchange multiplier
Dry: peak core humidity
Relative humidity (%)
60
55
50
45
40
35
0.5
1.0
1.5
2.0
2.5
3.0
Outdoor-exchange multiplier
Humid: peak core humidity
Relative humidity (%)
78
76
74
72
0.5
1.0
1.5
2.0
2.5
3.0
Outdoor-exchange multiplier