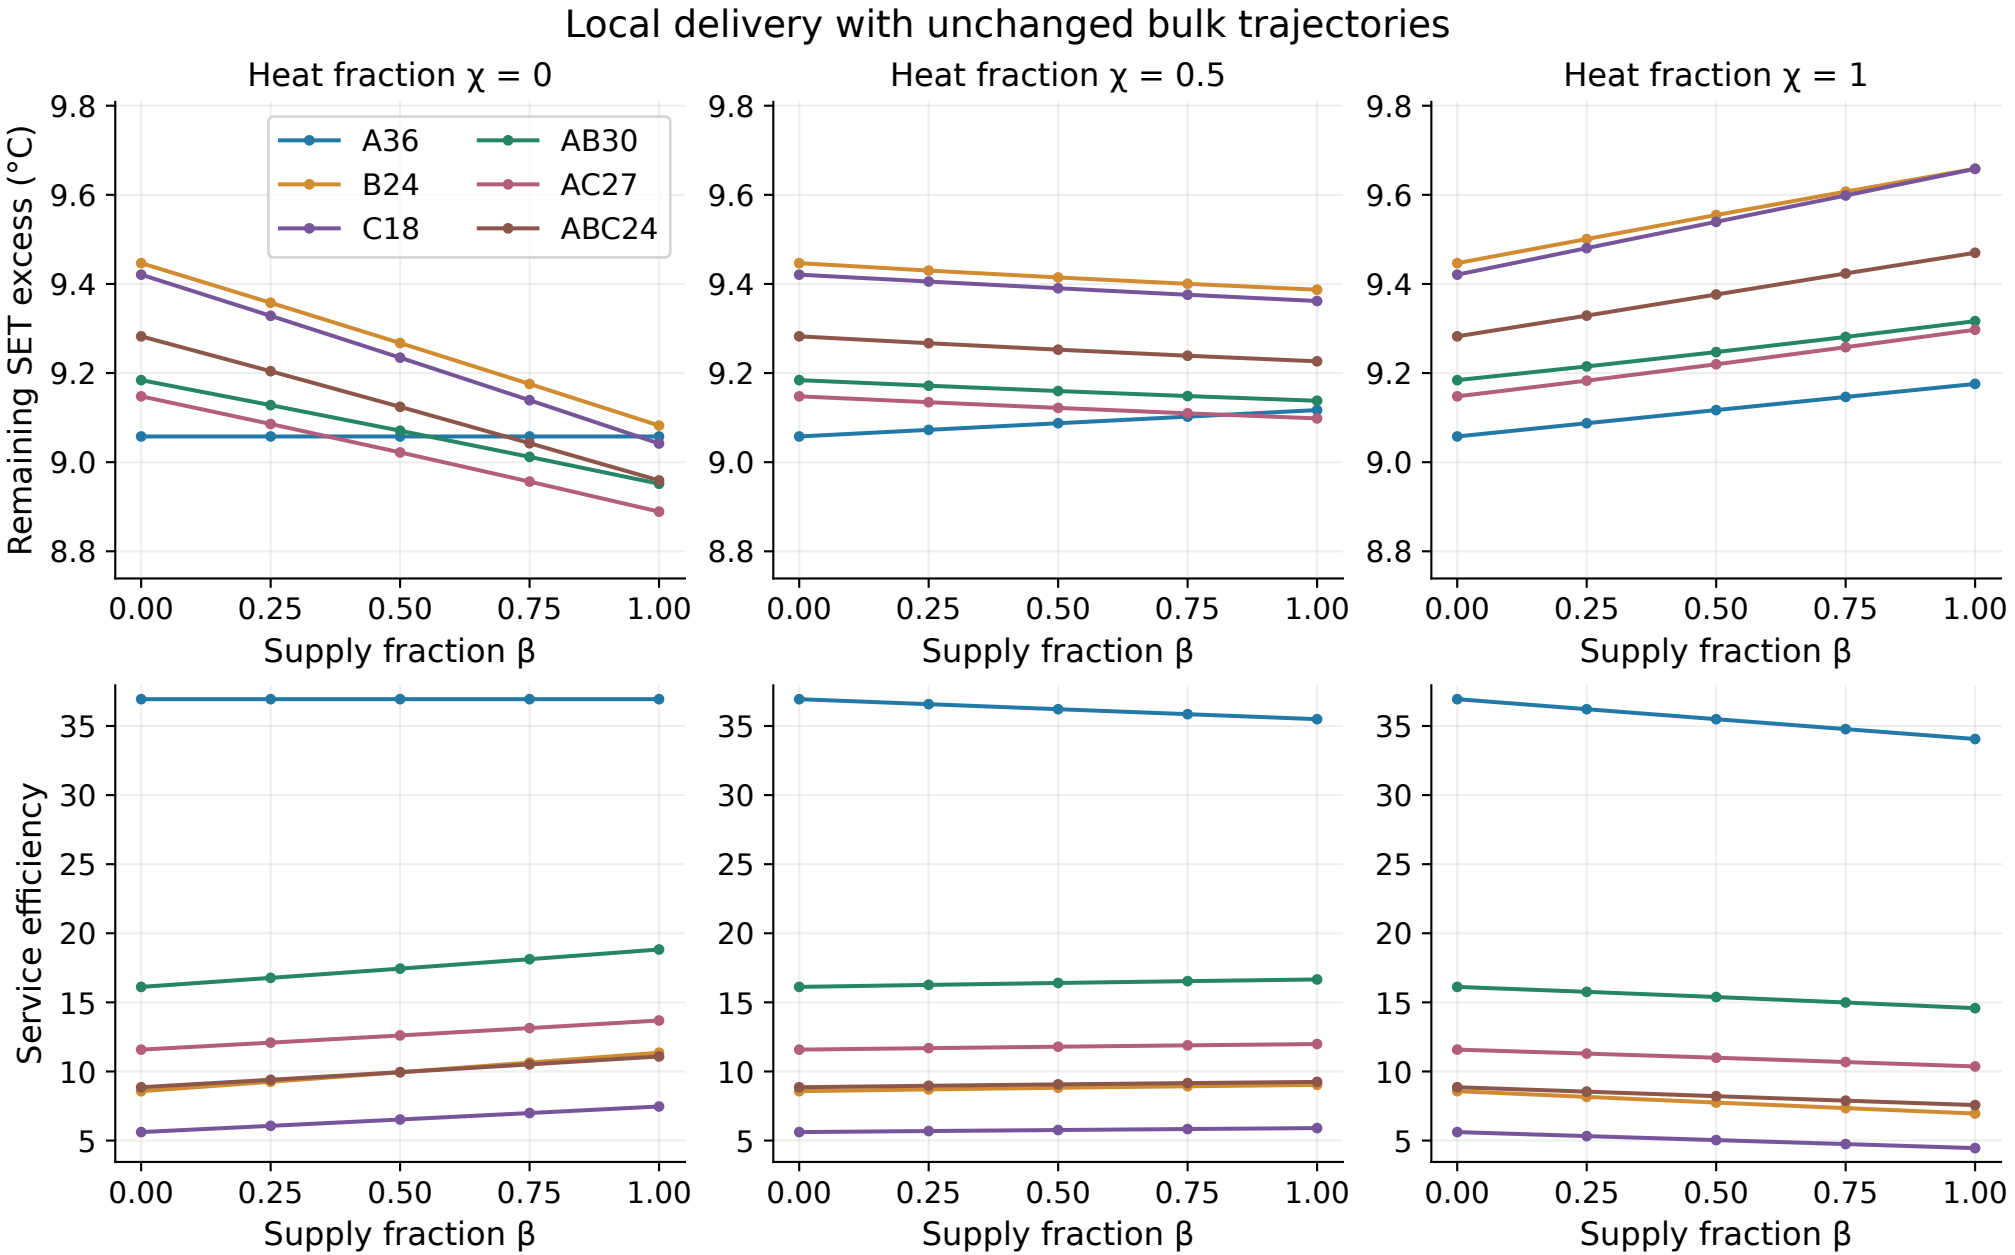
Local delivery with unchanged bulk trajectories
Heat fraction χ = 0
Heat fraction χ = 0.5
Heat fraction χ = 1
Remaining SET excess (°C)
A36
B24
C18
AB30
AC27
ABC24
Service efficiency
Supply fraction β
β = 0: bulk-scalar limit; nominal: β = 0.5, χ = 1. Local speeds remain prescribed.
χ is the pre-delivery electrical-heat fraction; all β and χ values are assumptions.
Service efficiency unit: person·°C·h/kWh.