

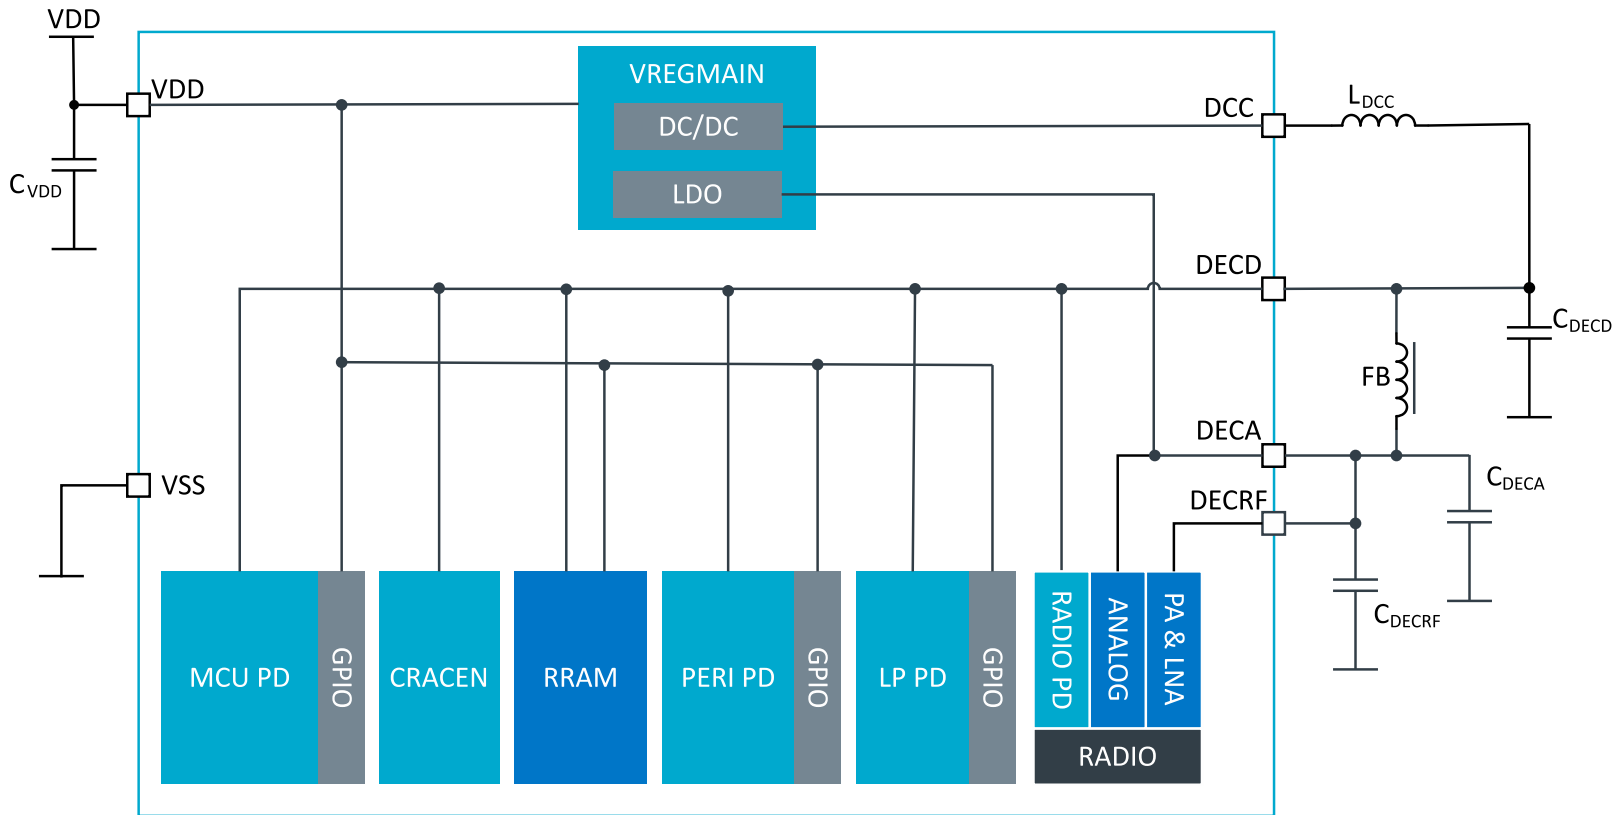


Figure 21: Regulator configuration