


6-Month Mortality by Baseline Plasma Citrulline Levels (Number of Death=44)

Log-Rank Test: p=0.68

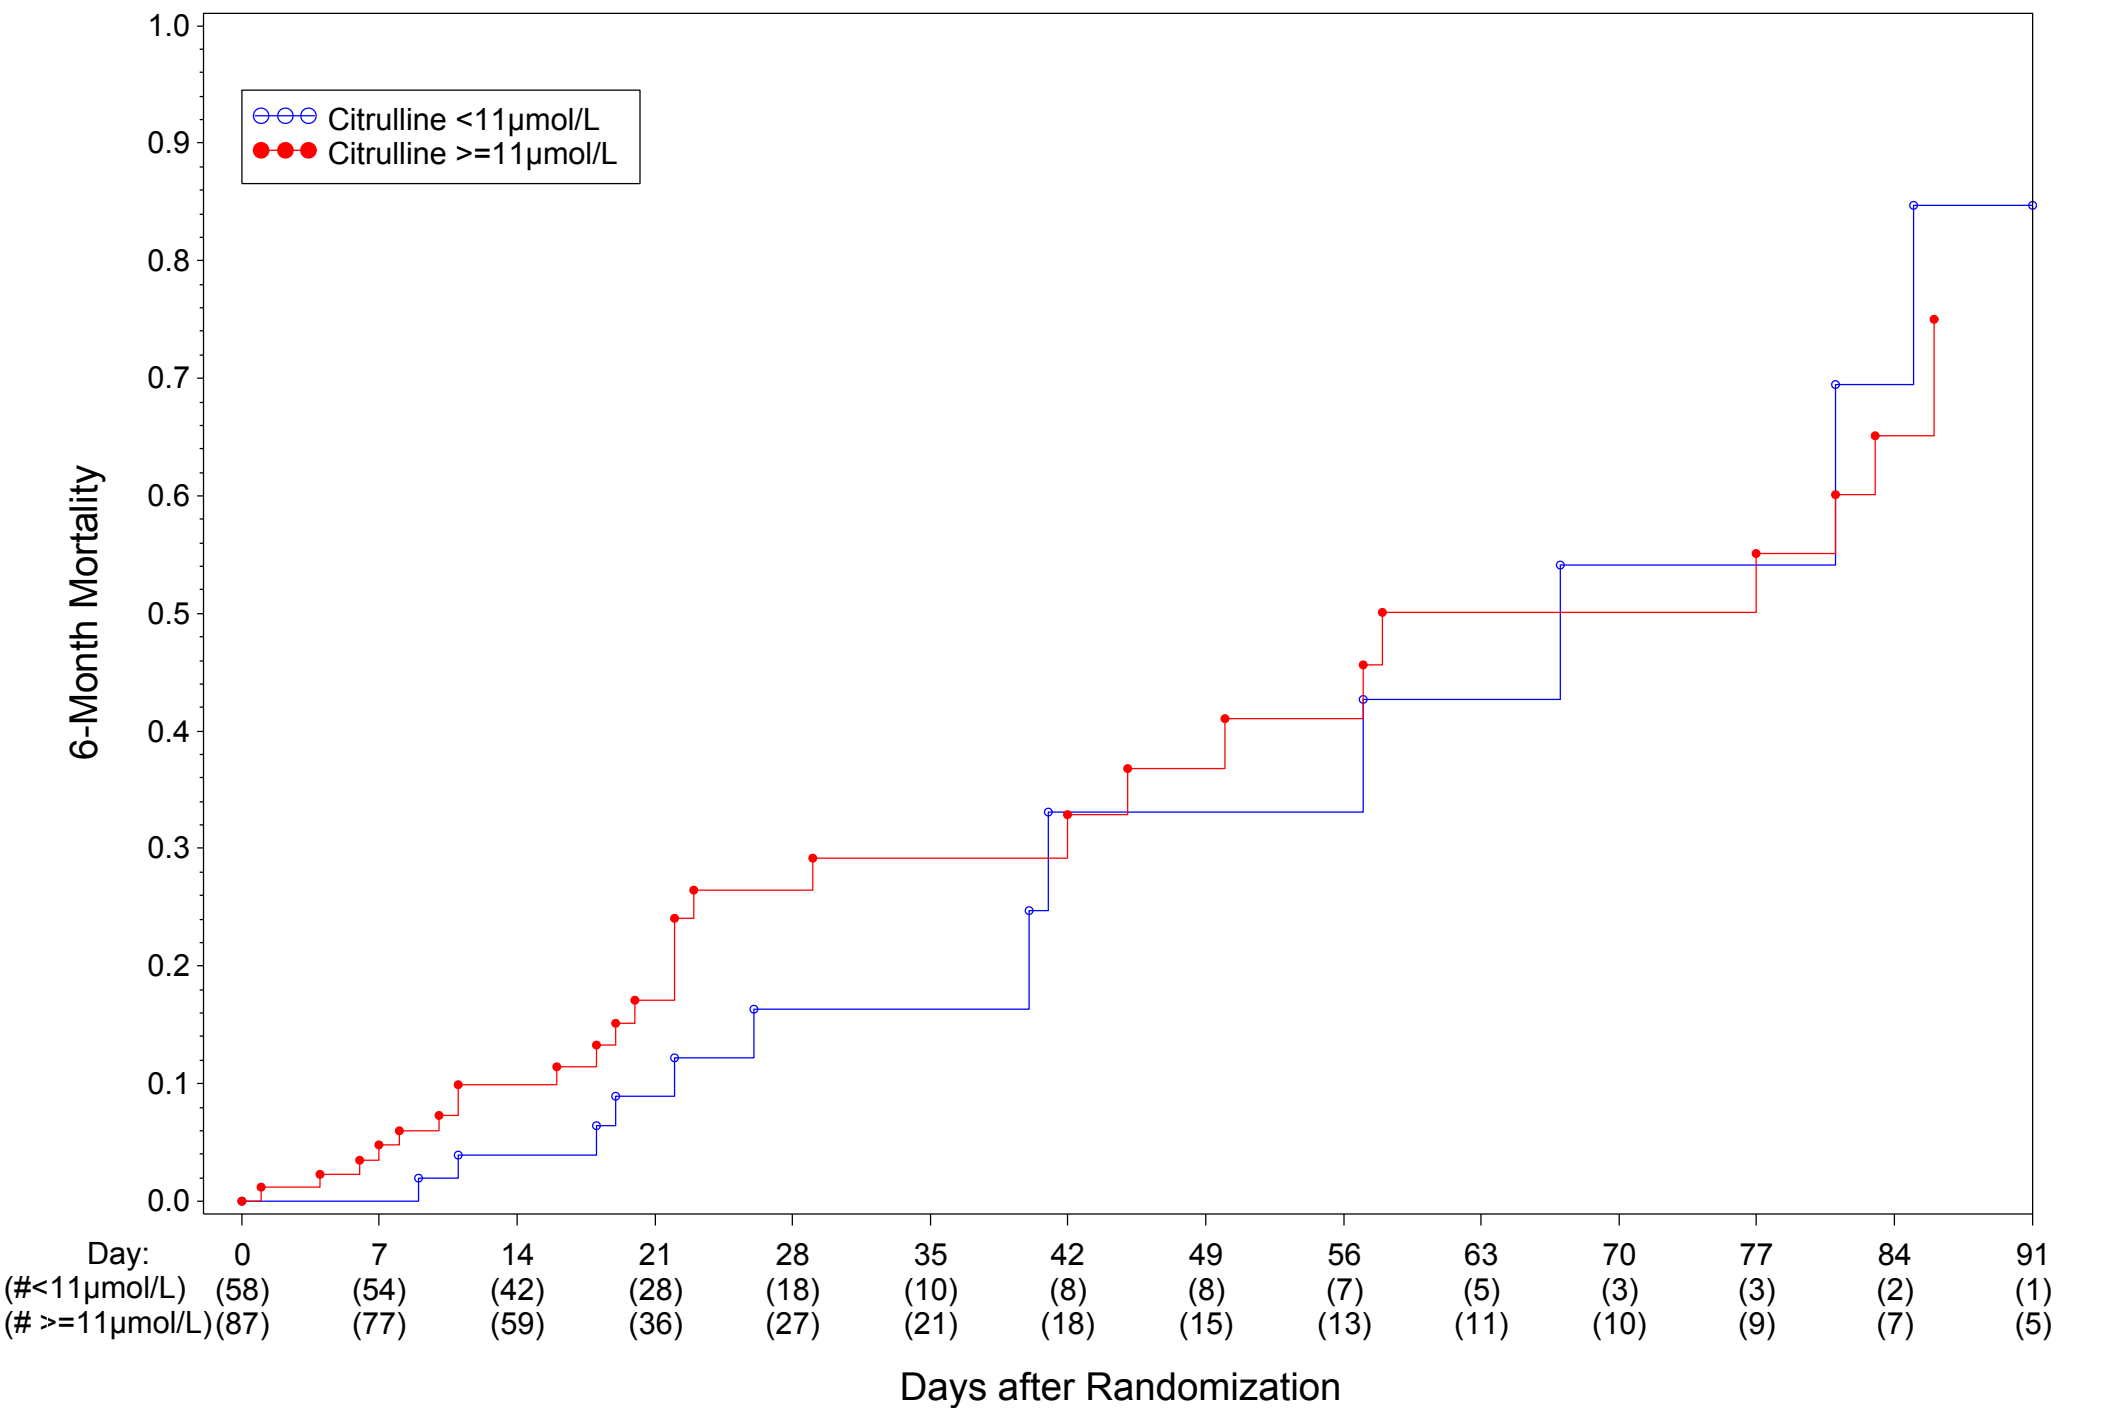

<i>Citrulline</i>	<i>Days on Study</i>	<i>Mortality(%)</i>	<i>Survival Standard Error</i>	<i>Number Left</i>
<11 µmol/L	30	0.1639	0.0645	16
>=11 µmol/L	30	0.2915	0.0638	25