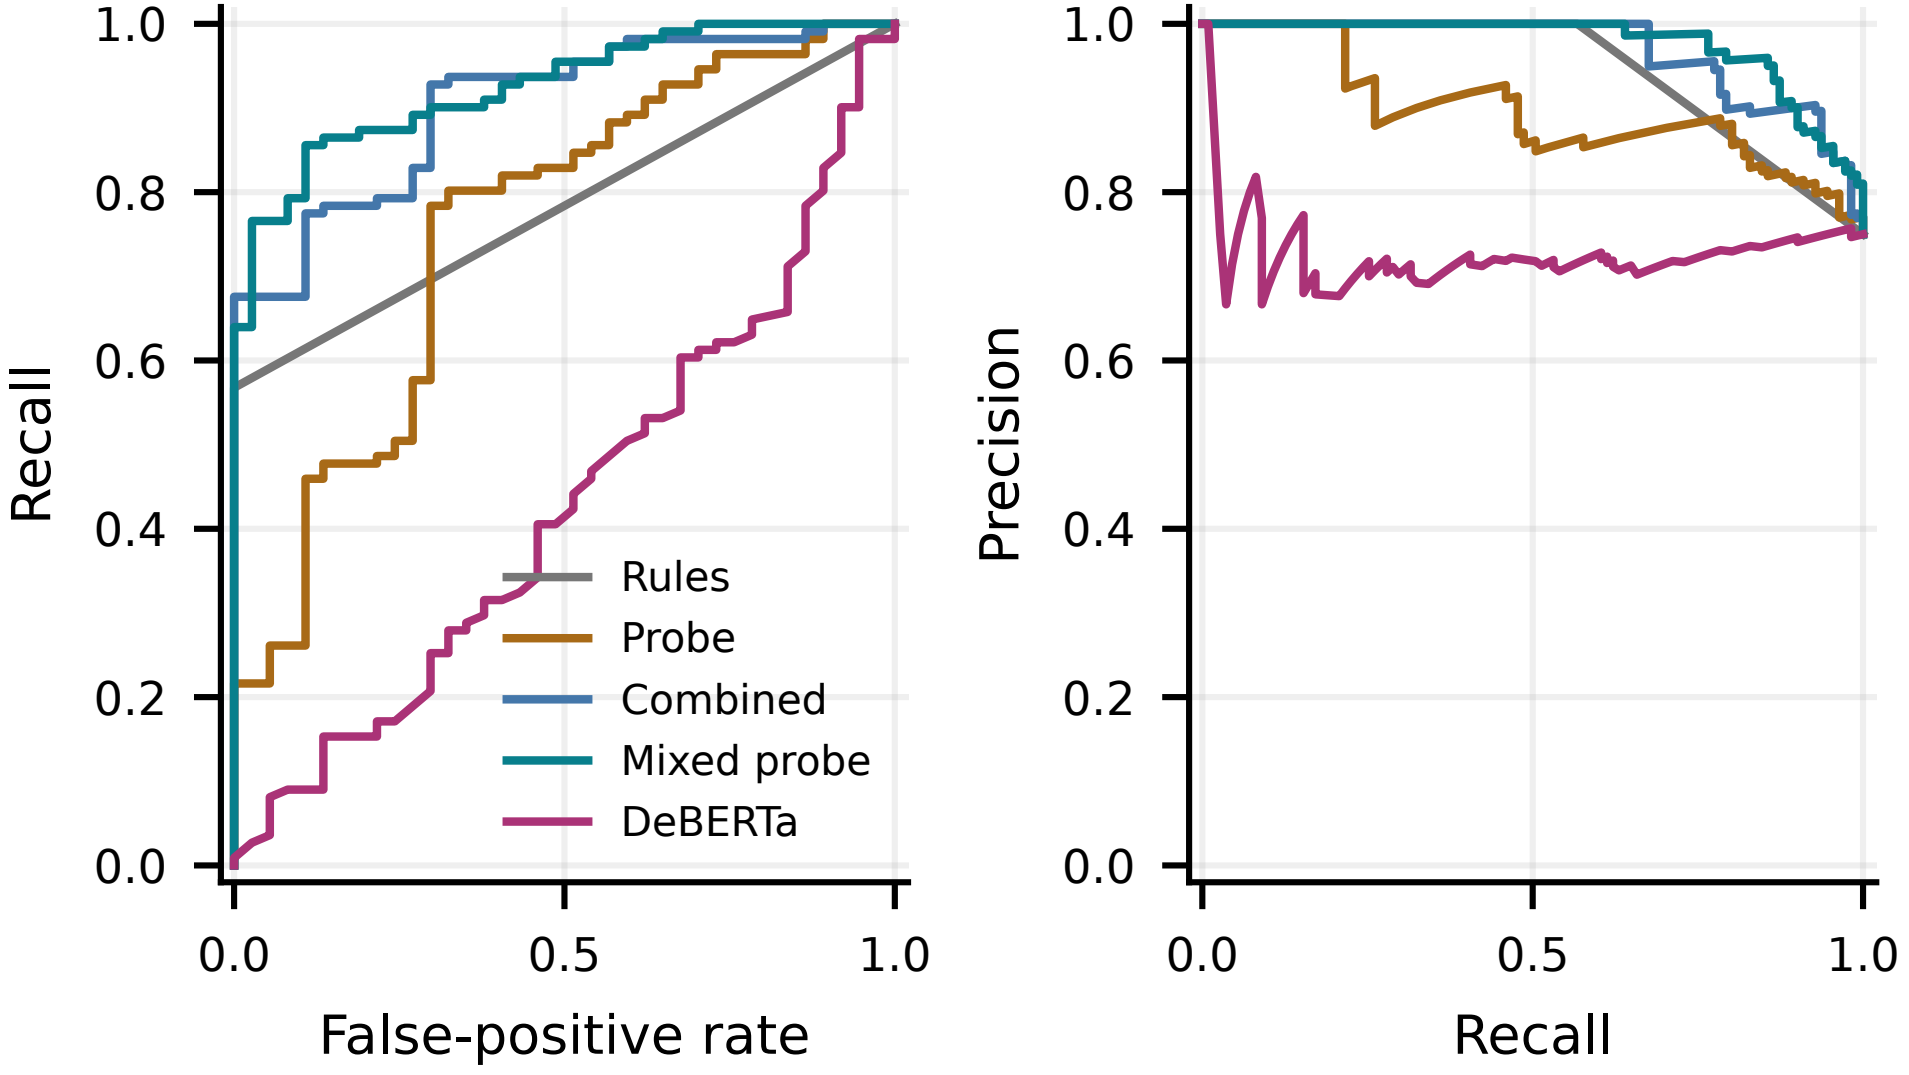
1.0
0.8
0.6
0.4
0.2
0.0
Recall
0.0
0.5
1.0
False-positive rate
Rules
Probe
Combined
Mixed probe
DeBERTa
Precision
Recall