


DPG10 Power Choke Tester

D.U.T.: CM inductor-high AL
 Inspector:
 Date: 3/24/2026 3:32:22 PM
 Parameters: 1 A / 10 V / 1000 (35) μ s
 Resistance: 2.22 mOhm

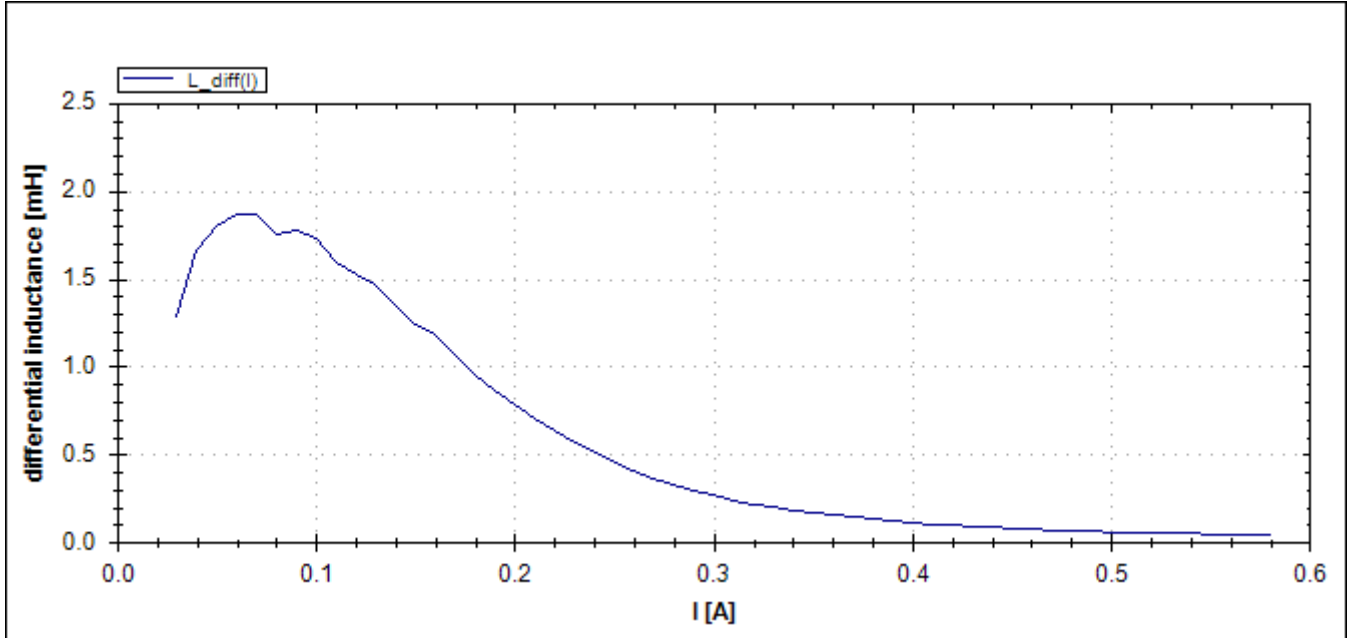

Current [A]	L _{diff} [mH]	Current [A]	L _{diff} [mH]	Current [A]	L _{diff} [mH]	Current [A]	L _{diff} [mH]	Current [A]	L _{diff} [mH]
		0.21	0.699	0.41	0.101				
		0.22	0.629	0.42	0.0945				
0.03	1.29	0.23	0.567	0.43	0.0881				
0.04	1.66	0.24	0.508	0.44	0.0824				
0.05	1.79	0.25	0.452	0.45	0.0772				
0.06	1.86	0.26	0.404	0.46	0.0725				
0.07	1.86	0.27	0.364	0.47	0.0683				
0.08	1.76	0.28	0.327	0.48	0.0644				
0.09	1.77	0.29	0.294	0.49	0.0609				
0.10	1.73	0.30	0.266	0.50	0.0576				
0.11	1.59	0.31	0.240	0.51	0.0547				
0.12	1.53	0.32	0.217	0.52	0.0519				
0.13	1.46	0.33	0.198	0.53	0.0494				
0.14	1.36	0.34	0.180	0.54	0.0471				
0.15	1.24	0.35	0.165	0.55	0.0450				
0.16	1.18	0.36	0.151	0.56	0.0430				
0.17	1.07	0.37	0.139	0.57	0.0412				
0.18	0.949	0.38	0.128	0.58	0.0395				
0.19	0.859	0.39	0.118						
0.20	0.781	0.40	0.109						