


A
B
C
D
E
F

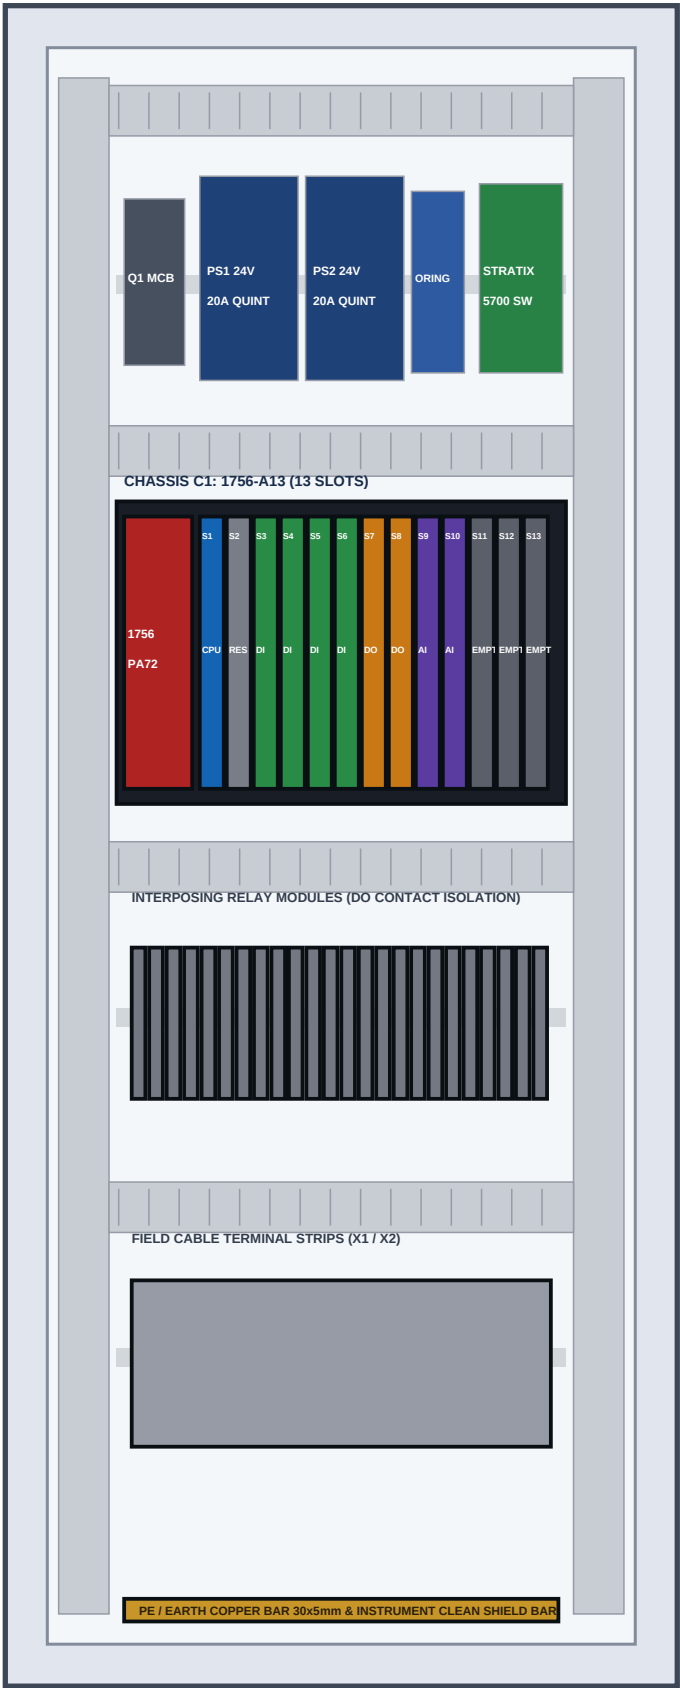

PANEL M1 - RACK C1 HARDWARE ALLOCATION & FIELD TERMINAL SCHEDULE							
Slot	Module Catalog	Description / Module Function	I/O Type	Channels	Terminal Strip	Connected Junction Boxes / Signals	Status
PS	1756-PA72	ControlLogix 85-265V AC Power Supply (72W @ 60C)	POWER	120/230VAC	Internal Rack	Chassis Backplane Power	ACTIVE (RED)
01	1756-L950TPSXT	ControlLogix 5580 Controller (50MB Memory)	CPU	1	ETH1/2	Plant Master Controller / SCADA	ACTIVE (MASTER)
02	Reserve	Reserved for 1756-EN2TR / Redundancy	RES	-	-	Reserved for Controller Redundancy	SPARE (RESERVE)
03	1756-IB32	32-Point 24VDC Sink/Source Digital Input	DI	32	C1S03-X1,X2	JB-401 Field Signals & Spares	ACTIVE
04	1756-IB32	32-Point 24VDC Sink/Source Digital Input	DI	32	C1S04-X1,X2	JB-401 Field Signals	ACTIVE
05	1756-IB32	32-Point 24VDC Sink/Source Digital Input	DI	32	C1S05-X1,X2	JB-601 Field Signals	ACTIVE
06	1756-IB32	32-Point 24VDC Sink/Source Digital Input	DI	32	C1S06-X1,X2	JB-601 Field Signals & CA1 Spares	ACTIVE
07	1756-OB32	32-Point 24VDC Source Digital Output	DO	32	C1S07-X1,X2	JB-401 Solenoid Valves & DO	ACTIVE
08	1756-OB32	32-Point 24VDC Source Digital Output	DO	32	C1S08-X1,X2	JB-601 Solenoids & CA1 Spares	ACTIVE
09	1756-IF16	16-Point High Resolution Analog Input	AI	16	C1S09-X1	JB-401 Analog Transmitters (4-20mA)	ACTIVE
10	1756-IF16	16-Point High Resolution Analog Input	AI	16	C1S10-X1	JB-601 Analog Transmitters (4-20mA)	ACTIVE
11	1756-N2	Slot Filler Plate (Empty Slot)	EMPTY	-	-	Chassis Spare Expansion Slot	SPARE (AVAILABLE)
12	1756-N2	Slot Filler Plate (Empty Slot)	EMPTY	-	-	Chassis Spare Expansion Slot	SPARE (AVAILABLE)
13	1756-N2	Slot Filler Plate (Empty Slot)	EMPTY	-	-	Chassis Spare Expansion Slot	SPARE (AVAILABLE)

PANEL M1 INSTALLATION SPECIFICATIONS & FIELD CONNECTIONS	
- ENCLOSURE SIZE: 800 mm (W) x 2000 mm (H) x 800 mm (D) + 100 mm plinth base. Single door.	
- FIELD DESTINATIONS: Connects to field junction boxes: JB-401, JB-601, CA1.	
- POWER INFEEED: Dual redundant 24VDC feeder lines from Panel M1 distribution bus.	
- NETWORK ARCHITECTURE: Dual-ring EtherNet/IP Device Level Ring (DLR) connection.	
- CABLING RULES: All analog inputs wired with individually shielded twisted pairs (LiY-CY TP).	
- SHIELD GROUNDING: Cable screens grounded at panel entry copper earth bar only (single-point earthing).	

INGREDION (THAILAND) CO., LTD. KALASIN STARCH PLANT - JET COOKER PROJECT				AEC INDUSTRIAL ENGINEERING SYSTEMS INTEGRATION & AUTOMATION	
PANEL M1 - SUBPANEL MOUNTING PLAN & COMPONENT SCHEDULE MAIN CONTROL CABINET CA1 / MOTOR CONTROL PANELS M1..M4				DOC NO: CA1-DWG-PL-003 REV: 3.6	DATE: 2026-09-07
SCALE: 1:8	DRAWN: AEC-ENG		STATUS: APPROVED		SHEET: 3 / 7
PROJECT: JET COOKER	CHECKED: LEAD-PE				

A
B
C
D
E
F