

A


B

C

D

E

F

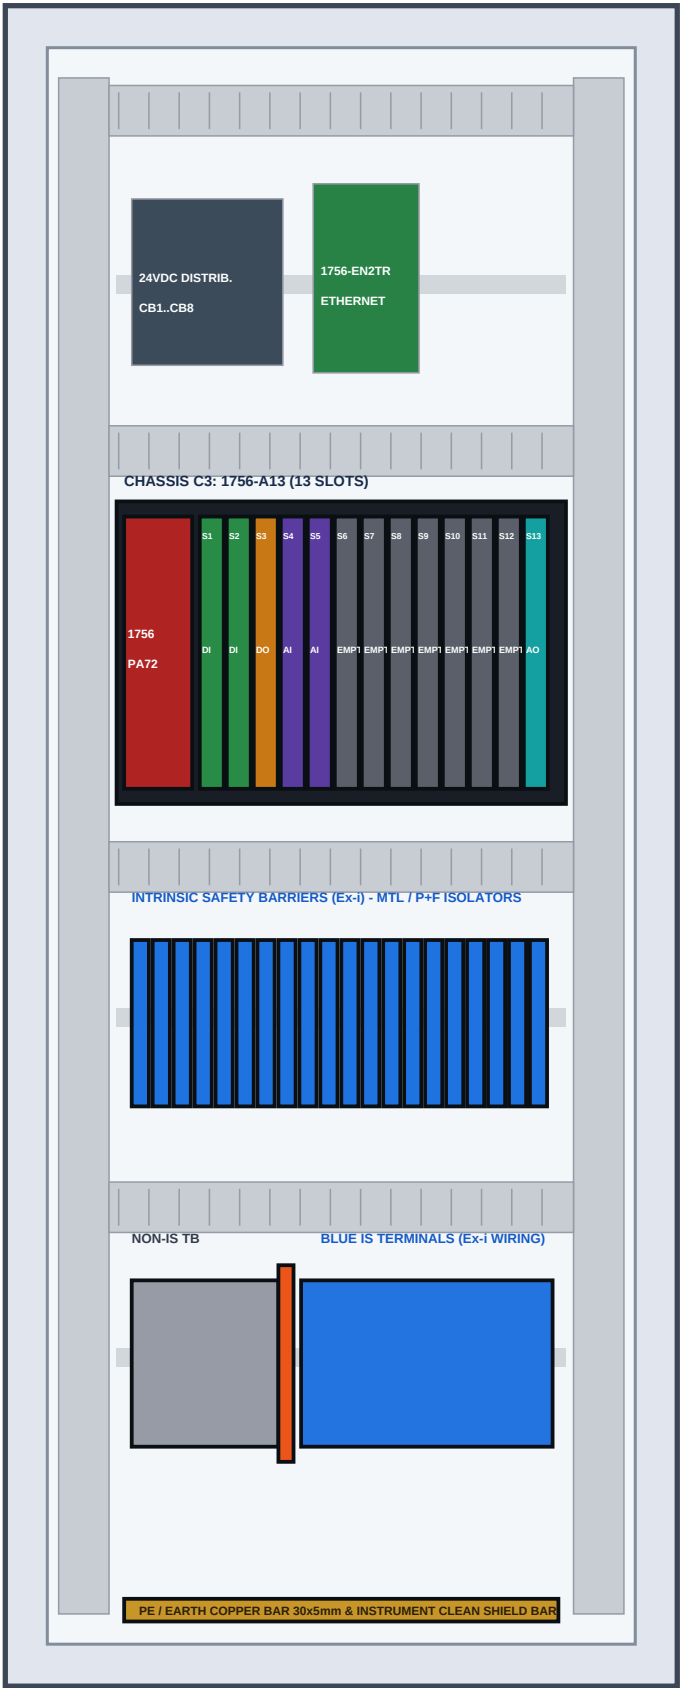

Panel M3 - Rack C3 Hardware Allocation & Field Terminal Schedule							
Slot	Module Catalog	Description / Module Function	I/O Type	Channels	Terminal Strip	Connected Junction Boxes / Signals	Status
PS	1756-PA72	ControlLogix 85-265V AC Power Supply (72W @ 60C)	POWER	120/230VAC	Internal Rack	Chassis Backplane Power	ACTIVE (RED)
01	1756-IB32	32-Point 24VDC Sink/Source Digital Input	DI	32	C3S01-X1,X2	IS-JB-603 & IS-JB-618 Ex-i DI	ACTIVE (IS)
02	1756-IB32	32-Point 24VDC Sink/Source Digital Input	DI	32	C3S02-X1,X2	IS-JB-618 & JB-618 Field DI	ACTIVE
03	1756-OB32	32-Point 24VDC Source Digital Output	DO	32	C3S03-X1,X2	JB-618 Packing Tower 8th Flr DO	ACTIVE
04	1756-IF16	16-Point High Resolution Analog Input	AI	16	C3S04-X1	IS-JB-603 Ex-i Transmitters (AI)	ACTIVE (IS)
05	1756-IF16	16-Point High Resolution Analog Input	AI	16	C3S05-X1	IS-JB-618 & JB-618 Transmitters	ACTIVE (IS)
06	1756-N2	Slot Filler Plate (Empty Slot)	EMPTY	-	-	Chassis Spare Expansion Slot	SPARE (AVAILABLE)
07	1756-N2	Slot Filler Plate (Empty Slot)	EMPTY	-	-	Chassis Spare Expansion Slot	SPARE (AVAILABLE)
08	1756-N2	Slot Filler Plate (Empty Slot)	EMPTY	-	-	Chassis Spare Expansion Slot	SPARE (AVAILABLE)
09	1756-N2	Slot Filler Plate (Empty Slot)	EMPTY	-	-	Chassis Spare Expansion Slot	SPARE (AVAILABLE)
10	1756-N2	Slot Filler Plate (Empty Slot)	EMPTY	-	-	Chassis Spare Expansion Slot	SPARE (AVAILABLE)
11	1756-N2	Slot Filler Plate (Empty Slot)	EMPTY	-	-	Chassis Spare Expansion Slot	SPARE (AVAILABLE)
12	1756-N2	Slot Filler Plate (Empty Slot)	EMPTY	-	-	Chassis Spare Expansion Slot	SPARE (AVAILABLE)
13	1756-OF8	8-Point High Resolution Analog Output	AO	8	C3S13-X1	Control Valves / Speed References	ACTIVE

Panel M3 Installation Specifications & Field Connections	
- ENCLOSURE SIZE: 800 mm (W) x 2000 mm (H) x 800 mm (D) + 100 mm plinth base. Single door.	
- FIELD DESTINATIONS: Connects to field junction boxes: IS-JB-603, IS-JB-618, JB-618.	
- POWER INFEEED: Dual redundant 24VDC feeder lines from Panel M1 distribution bus.	
- NETWORK ARCHITECTURE: Dual-ring EtherNet/IP Device Level Ring (DLR) connection.	
- CABLING RULES: All analog inputs wired with individually shielded twisted pairs (LiY-CY TP).	
- SHIELD GROUNDING: Cable screens grounded at panel entry copper earth bar only (single-point earthing).	

INGREDION (THAILAND) CO., LTD. KALASIN STARCH PLANT - JET COOKER PROJECT				AEC INDUSTRIAL ENGINEERING SYSTEMS INTEGRATION & AUTOMATION	
PANEL M3 - SUBPANEL MOUNTING PLAN & COMPONENT SCHEDULE MAIN CONTROL CABINET CA1 / MOTOR CONTROL PANELS M1..M4				DOC NO: CA1-DWG-PL-005 REV: 3.6	DATE: 2026-09-07
SCALE: 1:8	DRAWN: AEC-ENG		STATUS: APPROVED		SHEET: 5 / 7
PROJECT: JET COOKER	CHECKED: LEAD-PE				

A

B

C

D

E

F