


TEMPLATE TYP-16: PRESSURE SWITCH

TYPICAL TAGS: PSH-60201 / PSL-60201

SERVICE: High / Low Pressure Safety Trip Interlock | PLC I/O: 1756-IB32 (24V DC Digital Input)


SECTION A: PROCESS PIPING & MECHANICAL HOOK-UP

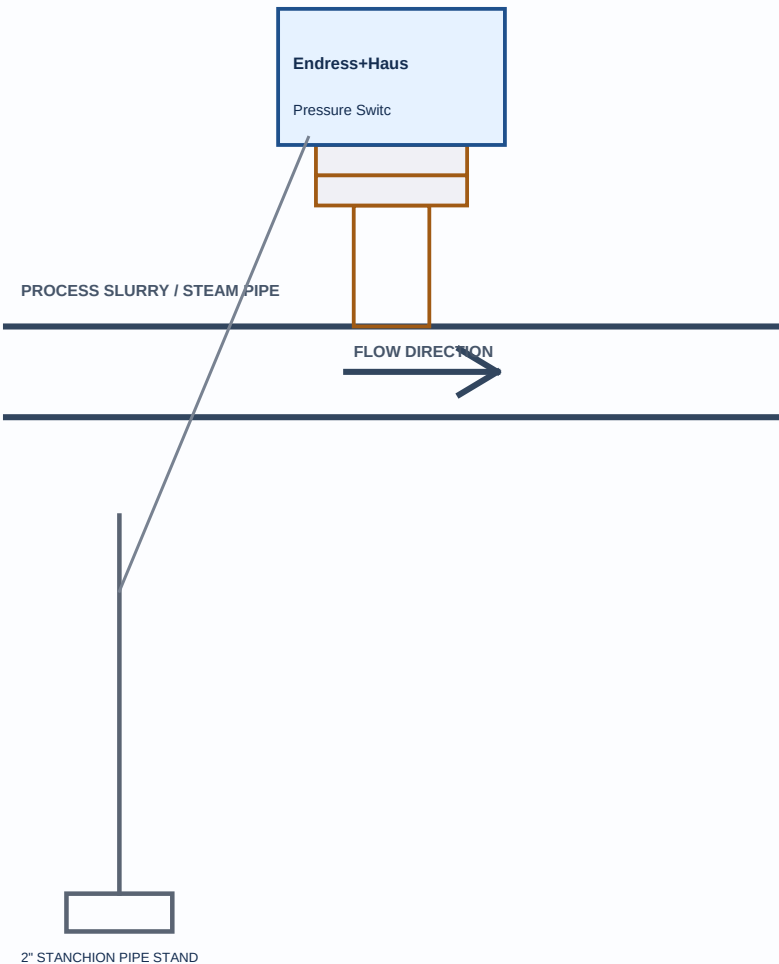

MECHANICAL HOOK-UP SPECIFICATION

Process Connection:	1/2" NPT Male Threaded / Tri..
Mounting Type:	Direct Flanged / 2" Pipe Stand
Enclosure Rating:	IP65 / IP67 Stainless Steel ..
Hazardous Class:	General Industrial Zone (Opt..
Process Medium:	Starch Slurry / Saturated St..
Ambient Temp Range:	-20°C to +60°C Operating

SECTION B: ELECTRICAL LOOP WIRING SCHEMATIC (FIELD TO PLC)

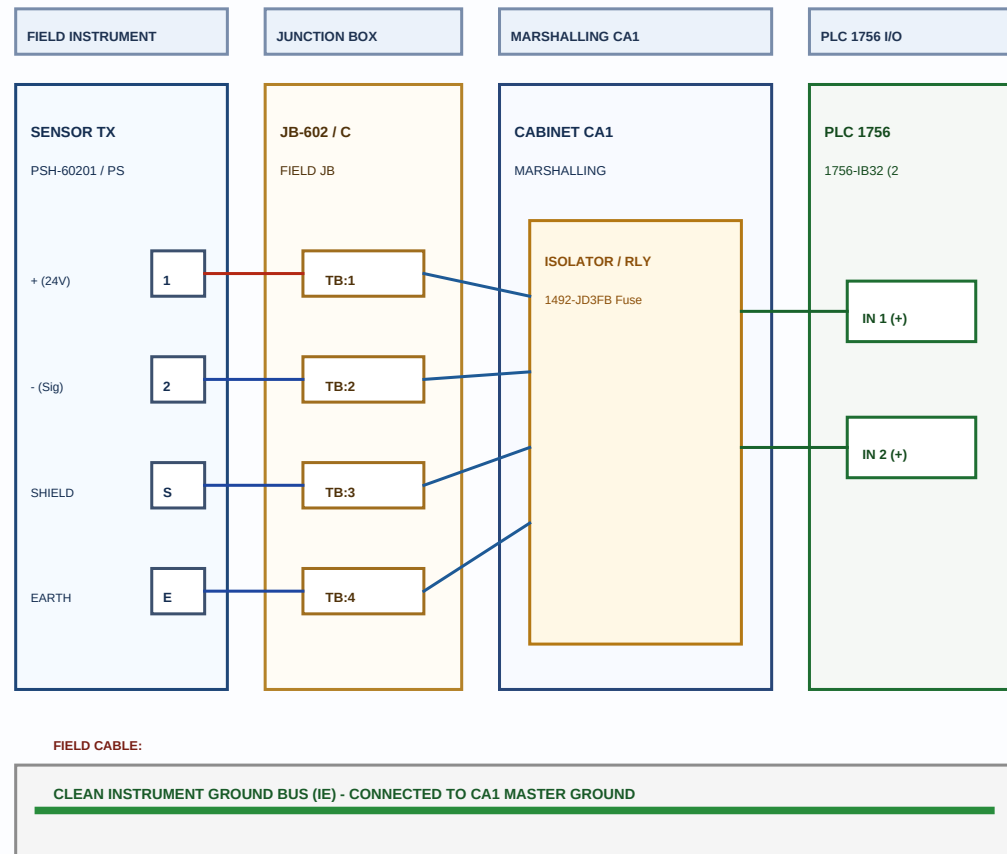

ELECTRICAL & SIGNAL LOOP SPECIFICATIONS

Signal Protocol:	DI: Trip Contact (Open on Alarm)
Power Supply:	24V DC (10-30V DC, 20mA)
Field Cable Type:	3Cx1.5mm² Shielded Instrumentation Cable
Destination JB:	JB-602 / CA1 Marshalling
Marshalling Cabinet:	CA1 / Master Control Panel (Bay M1..M4)
Barrier / Isolation:	1492-JD3FB Fuse Protection Terminal
PLC Module:	1756-IB32 (24V DC Digital Input)

SECTION C: BILL OF MATERIALS (BOM) & NOTES

MANUFACTURER: ENDRESS+HAUSER

MODEL: Ceraphant PTC31B (Ceramic Sensor Diaphragm)

SERVICE: High / Low Pressure Safety Trip Interlock

ITEM	MATERIAL / COMPONENT DESCRIPTION	SPEC / MODEL	QTY
1	Ceraphant PTC31B Pressure Swit E+H Ceramic Cell, LED Display		1 EA
2	2-Valve Isolation Manifold 1/2 SS316 Block & Bleed Valve		1 EA
3	M12 4-Pin Field Wireable Conne IP67 Female M12 Connector		1 EA
4	Cable Gland M16x1.5 Brass Nickel-plated Cable Gland		1 EA
5	Impulse Adapter 1/2" NPT x 1/2 Swagelok SS316 Tube Fitting		1 EA

ENGINEERING INSTALLATION NOTES

- Program switch point and reset hysteresis via front push-buttons and LED display.
- Configure output as Normally Closed (NC) fail-safe: circuit de-energizes on overpressure or power loss.
- Provide block-and-bleed valve for routine verification with field calibrator.

INGREDION (THAILAND) CO., LTD.
KALASIN STARCH PLANT - JET COOKER PROJECTAEC INDUSTRIAL ENGINEERING
SYSTEMS INTEGRATION & AUTOMATIONELECTRONIC PRESSURE SWITCH HOOK-UP & LOOP DIAGRAM
INSTRUMENT HOOK-UP & TYPICAL LOOP DIAGRAMDWG NO: KAL-JC-TYP-016
REV: 3.6 DATE: 2026-09-08DRAWN: AEC-ENG
CHECKED: LEAD-PESTATUS: APPROVED
SCALE: N.T.S.PROJECT NO:
R5THS00138-JCSHEET NO:
18 / 25