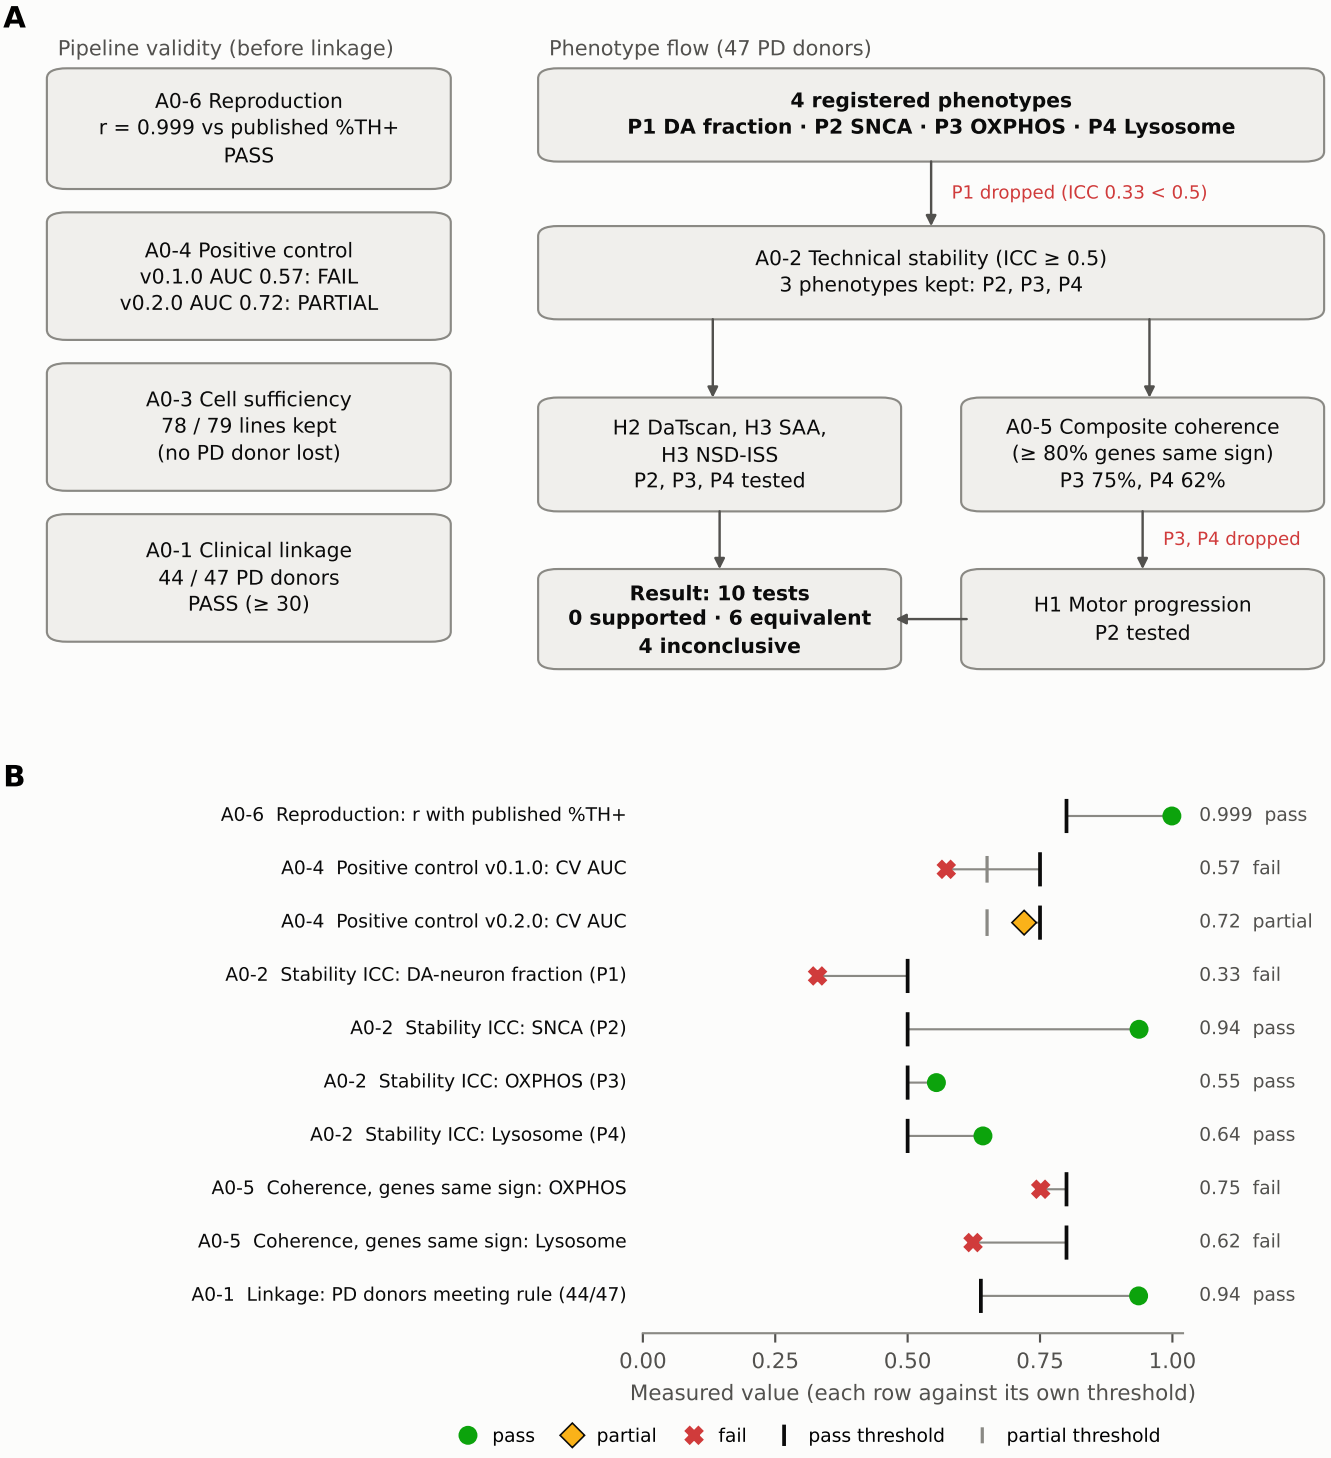
A
Pipeline validity (before linkage)
A0-6 Reproduction
r = 0.999 vs published %TH+
PASS
A0-4 Positive control
v0.1.0 AUC 0.57: FAIL
v0.2.0 AUC 0.72: PARTIAL
A0-3 Cell sufficiency
78 / 79 lines kept
(no PD donor lost)
A0-1 Clinical linkage
44 / 47 PD donors
PASS (≥ 30)
Phenotype flow (47 PD donors)
4 registered phenotypes
P1 DA fraction · P2 SNCA · P3 OXPHOS · P4 Lysosome
P1 dropped (ICC 0.33 < 0.5)
A0-2 Technical stability (ICC ≥ 0.5)
3 phenotypes kept: P2, P3, P4
H2 DaTscan, H3 SAA,
H3 NSD-ISS
P2, P3, P4 tested
A0-5 Composite coherence
(≥ 80% genes same sign)
P3 75%, P4 62%
P3, P4 dropped
Result: 10 tests
0 supported · 6 equivalent
4 inconclusive
H1 Motor progression
P2 tested
B
A0-6 Reproduction: r with published %TH+
0.999 pass
A0-4 Positive control v0.1.0: CV AUC
0.57 fail
A0-4 Positive control v0.2.0: CV AUC
0.72 partial
A0-2 Stability ICC: DA-neuron fraction (P1)
0.33 fail
A0-2 Stability ICC: SNCA (P2)
0.94 pass
A0-2 Stability ICC: OXPHOS (P3)
0.55 pass
A0-2 Stability ICC: Lysosome (P4)
0.64 pass
A0-5 Coherence, genes same sign: OXPHOS
0.75 fail
A0-5 Coherence, genes same sign: Lysosome
0.62 fail
A0-1 Linkage: PD donors meeting rule (44/47)
0.94 pass
0.00
0.25
0.50
0.75
1.00
Measured value (each row against its own threshold)
pass
partial
fail
pass threshold
partial threshold