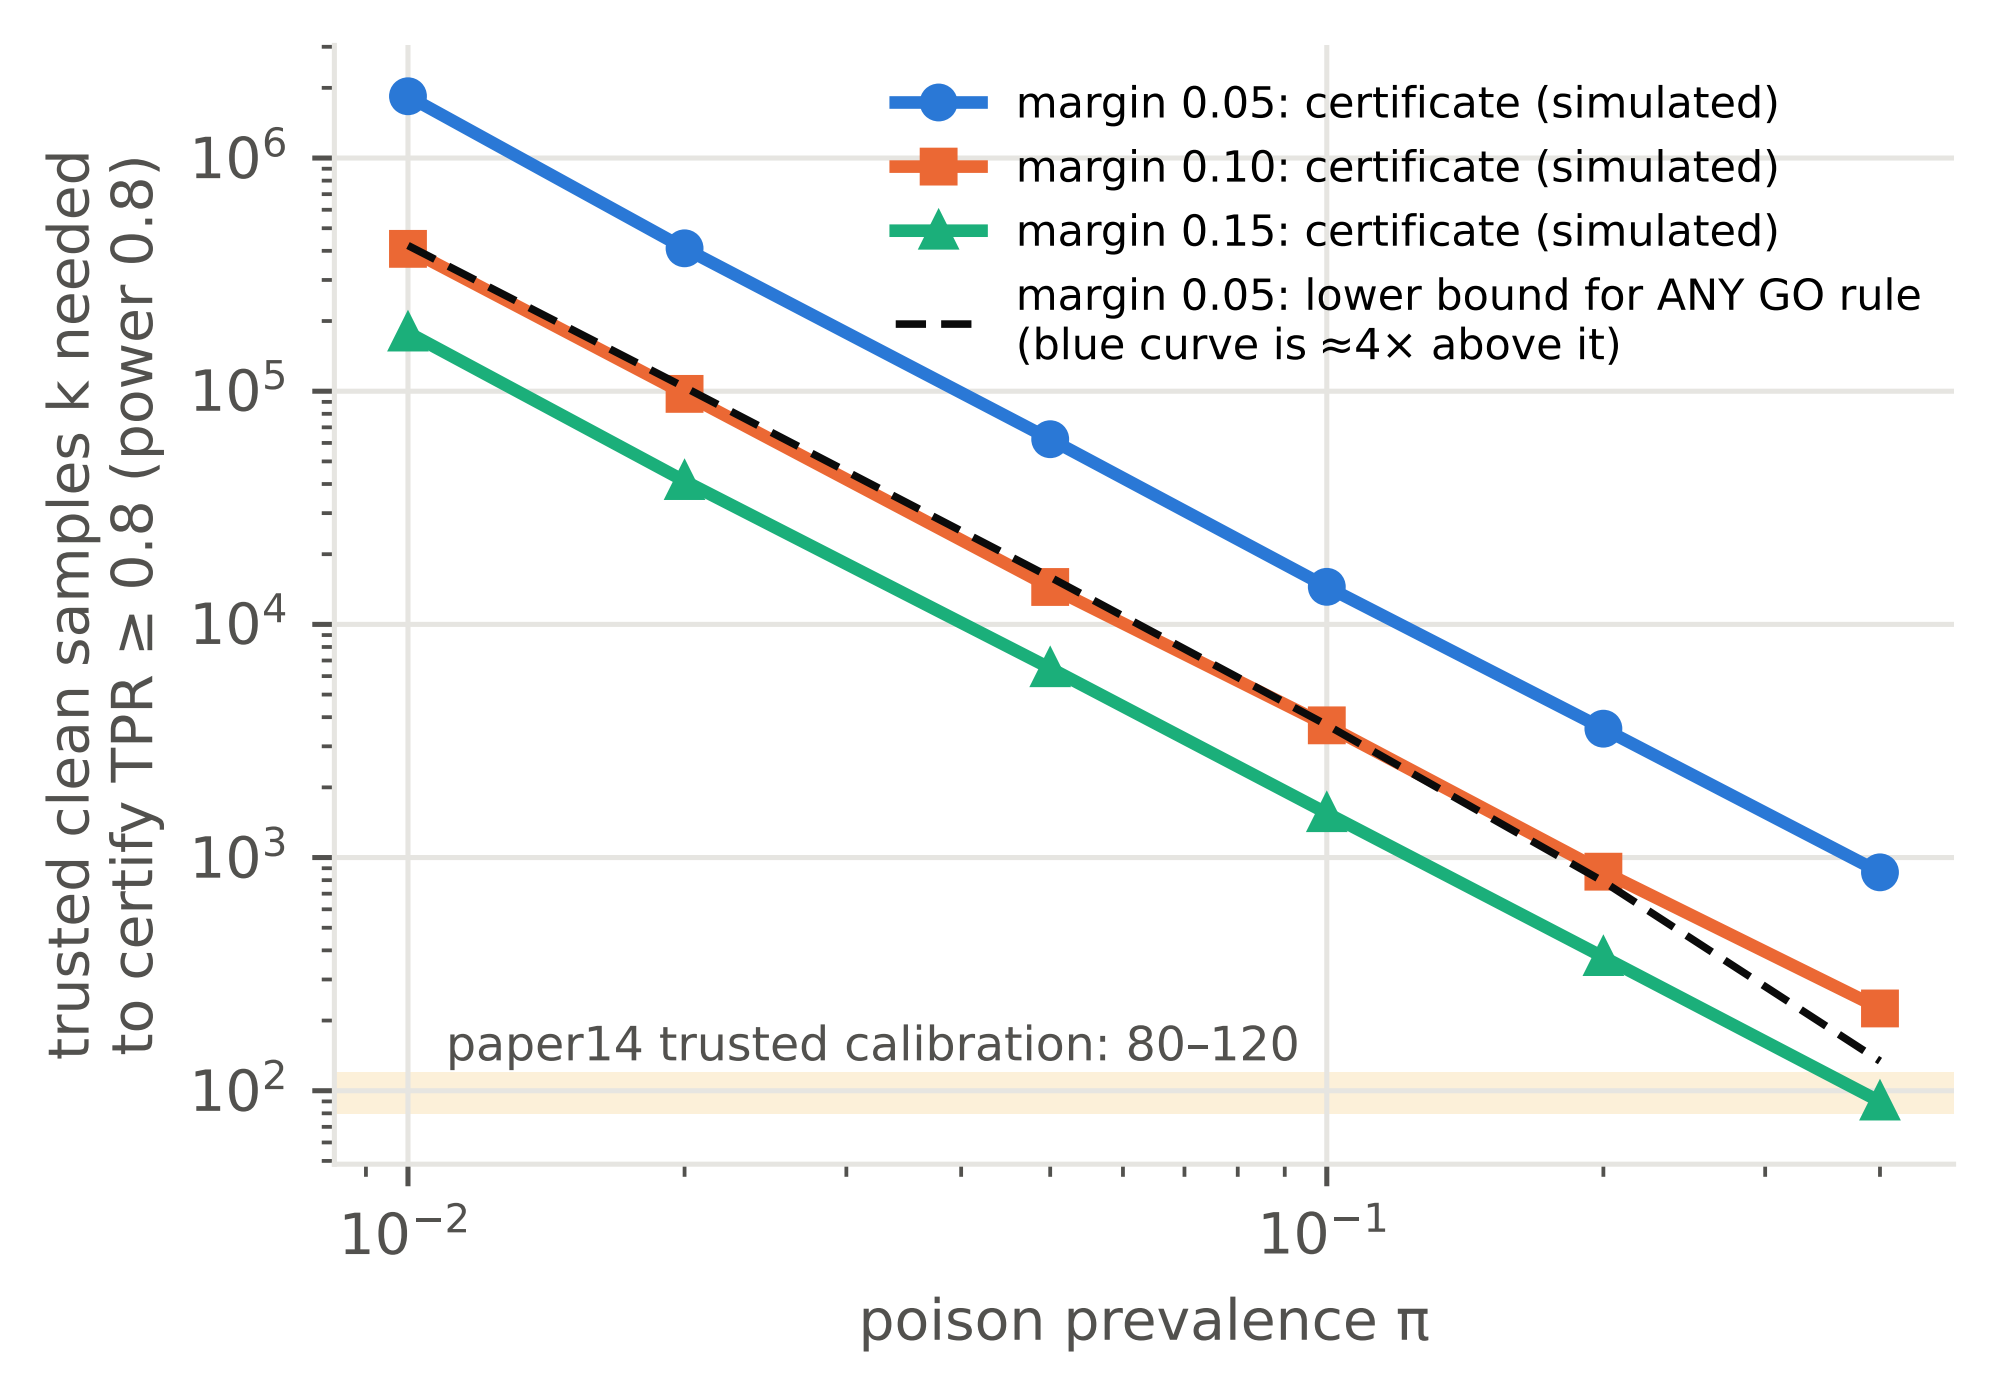
margin 0.05: certificate (simulated)
margin 0.10: certificate (simulated)
margin 0.15: certificate (simulated)
margin 0.05: lower bound for ANY GO rule
(blue curve is ≈4× above it)
paper14 trusted calibration: 80–120
trusted clean samples k needed
to certify TPR ≥ 0.8 (power 0.8)
10^6
10^5
10^4
10^3
10^2
10^{-2}
10^{-1}
poison prevalence π