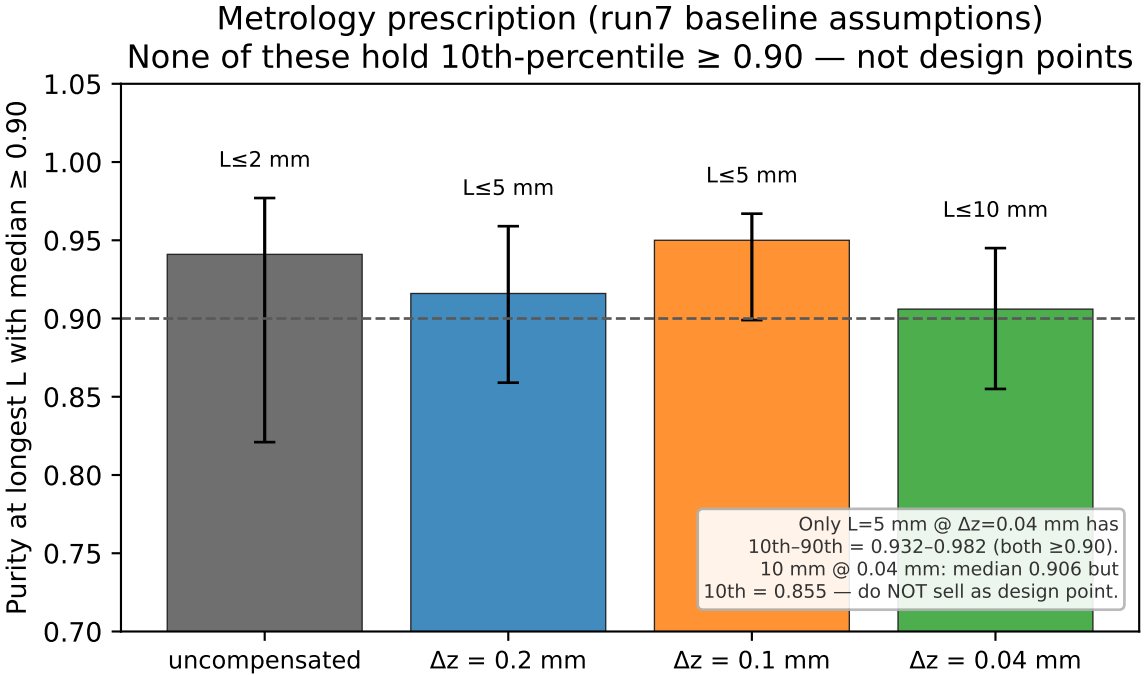
Metrology prescription (run7 baseline assumptions)
None of these hold 10th-percentile ≥ 0.90 — not design points
Purity at longest L with median ≥ 0.90
1.05
1.00
0.95
0.90
0.85
0.80
0.75
0.70
L≤2 mm
L≤5 mm
L≤5 mm
L≤10 mm
Only L=5 mm @ Δz=0.04 mm has
10th–90th = 0.932–0.982 (both ≥0.90).
10 mm @ 0.04 mm: median 0.906 but
10th = 0.855 — do NOT sell as design point.
uncompensated
Δz = 0.2 mm
Δz = 0.1 mm
Δz = 0.04 mm