ZNF749: allele−specific read alignments across stimulation

Variant chr19:57435555:G>C (isoLASER 0−based); tested part chr19:57438101−57438456:+ (0−based, half−open). Yellow: tested part.

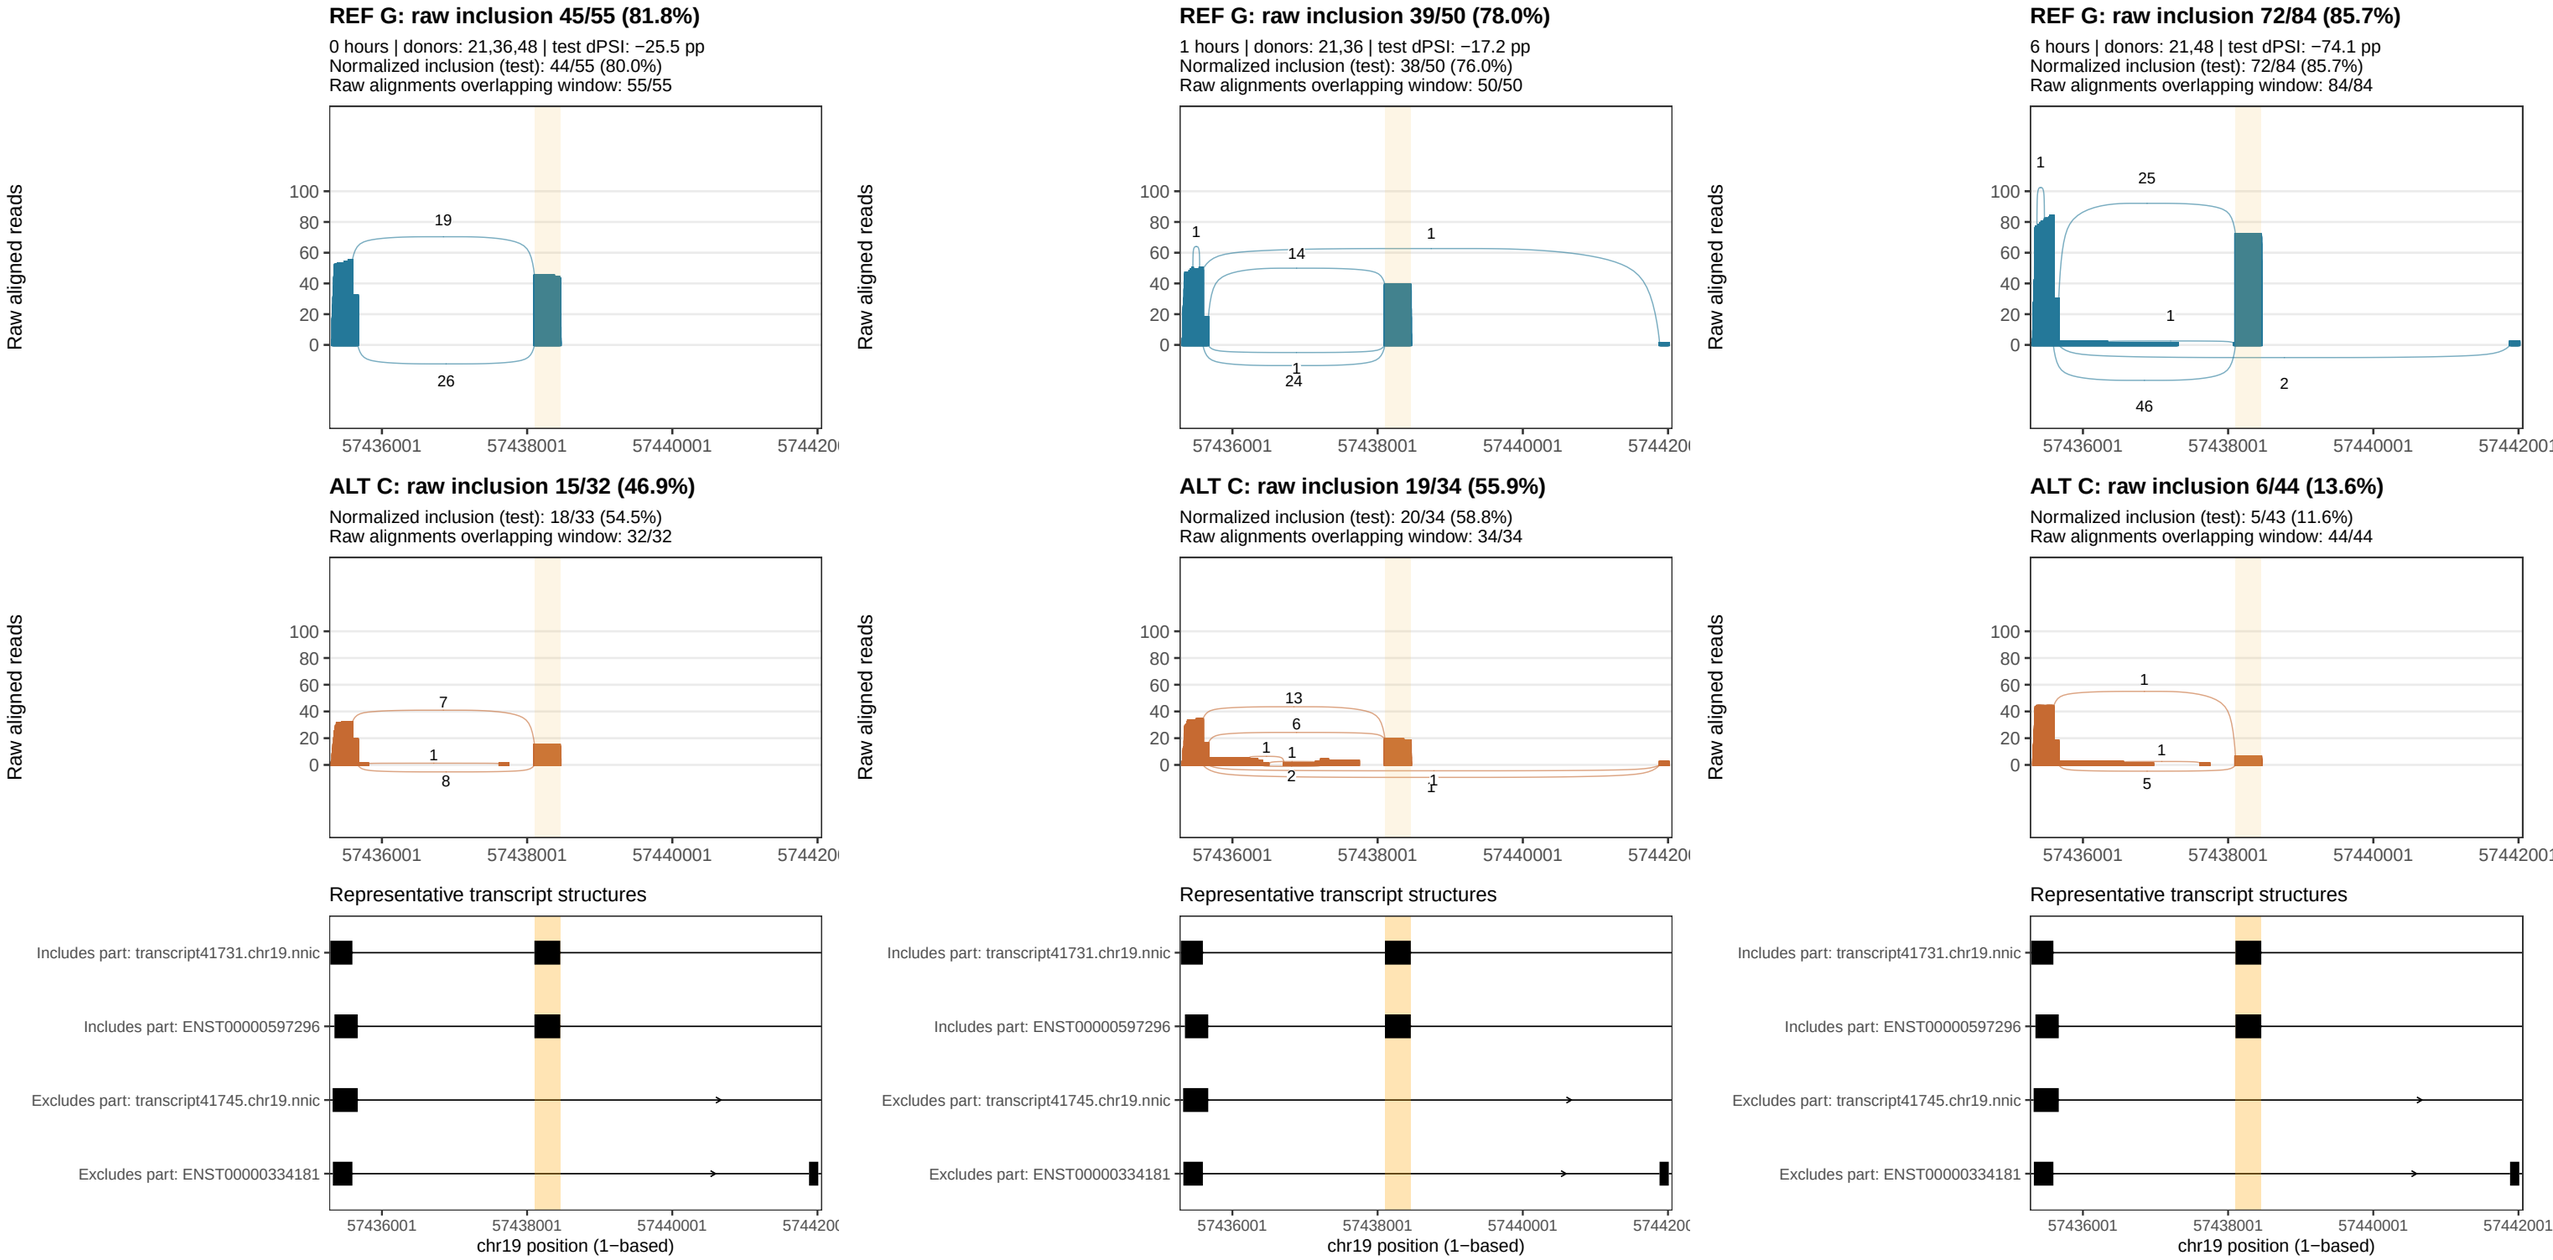

Coverage and arc labels are raw read counts; all six tracks share a y scale. Arcs: every junction with >=1 read.
Raw inclusion describes recorded reads. Normalized inclusion is from rescaled, rounded donor tables used for AMI and dPSI.
Inclusion uses transcript assignment; a read may not reach the tested part. Normalized counts are not additional sequenced reads.