KPNA2: allele−specific read alignments across stimulation

Variant chr17:68035783:T>C (isoLASER 0−based); tested part chr17:68042999−68043099:+ (0−based, half−open). Yellow: tested part.

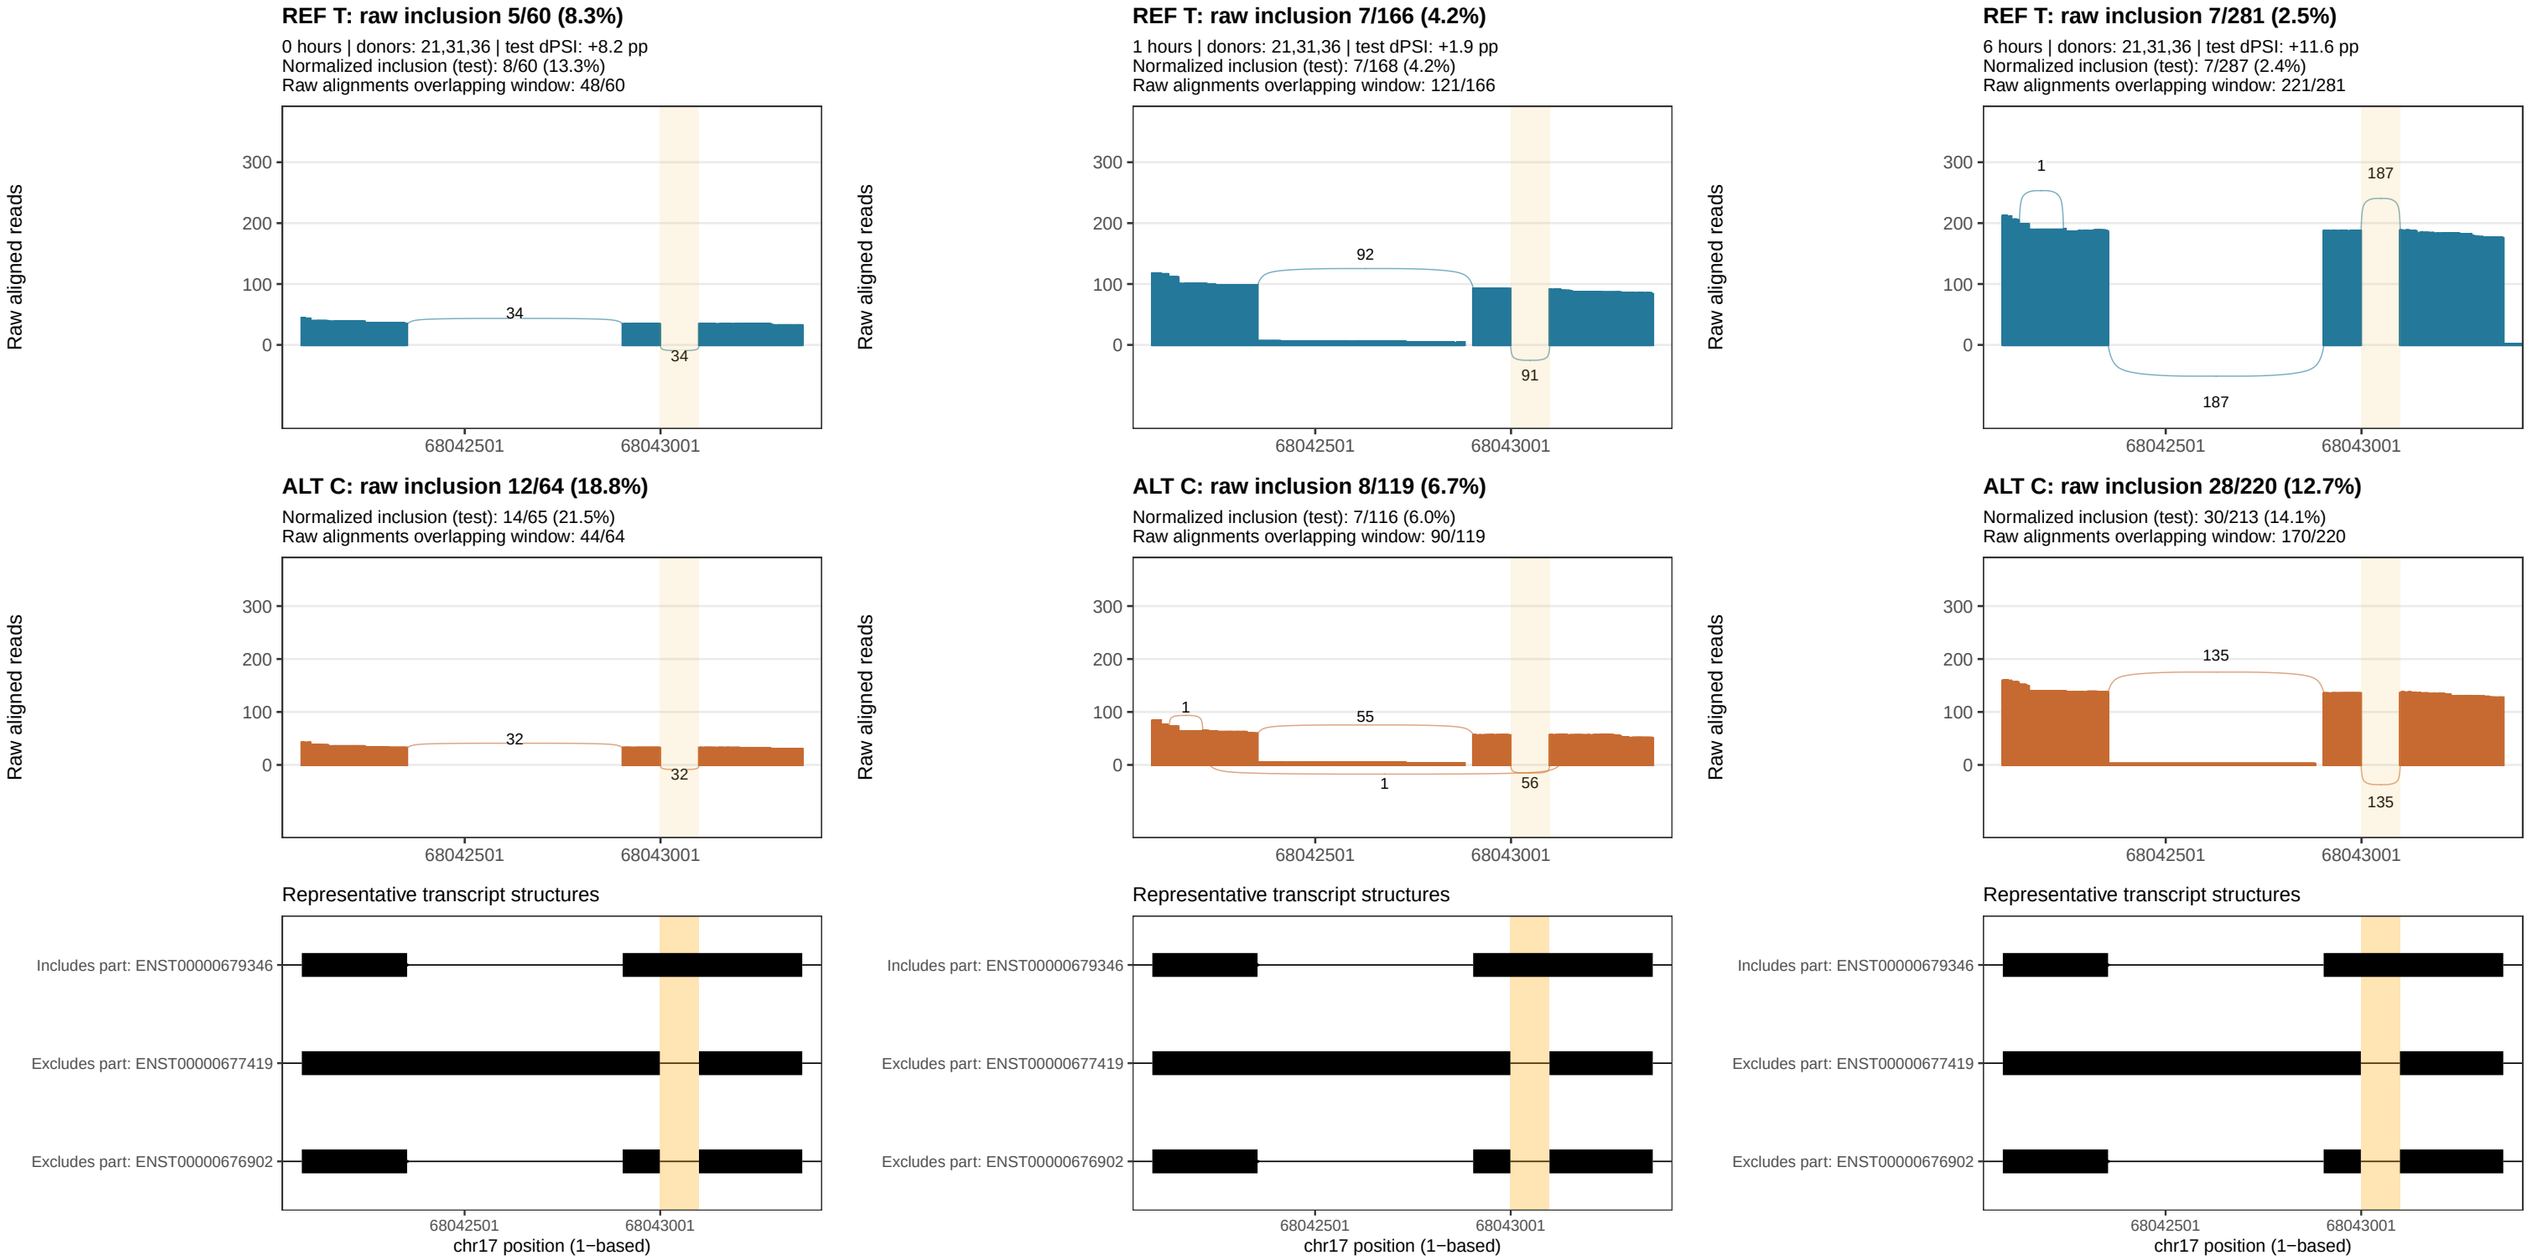

Coverage and arc labels are raw read counts; all six tracks share a y scale. Arcs: every junction with >=1 read.
Raw inclusion describes recorded reads. Normalized inclusion is from rescaled, rounded donor tables used for AMI and dPSI.
Inclusion uses transcript assignment; a read may not reach the tested part. Normalized counts are not additional sequenced reads.