# PPA2: allele−specific read alignments across stimulation

Variant chr4:105396271:C>G (isoLASER 0−based); tested part chr4:105437949−105437976:− (0−based, half−open). Yellow: tested part.

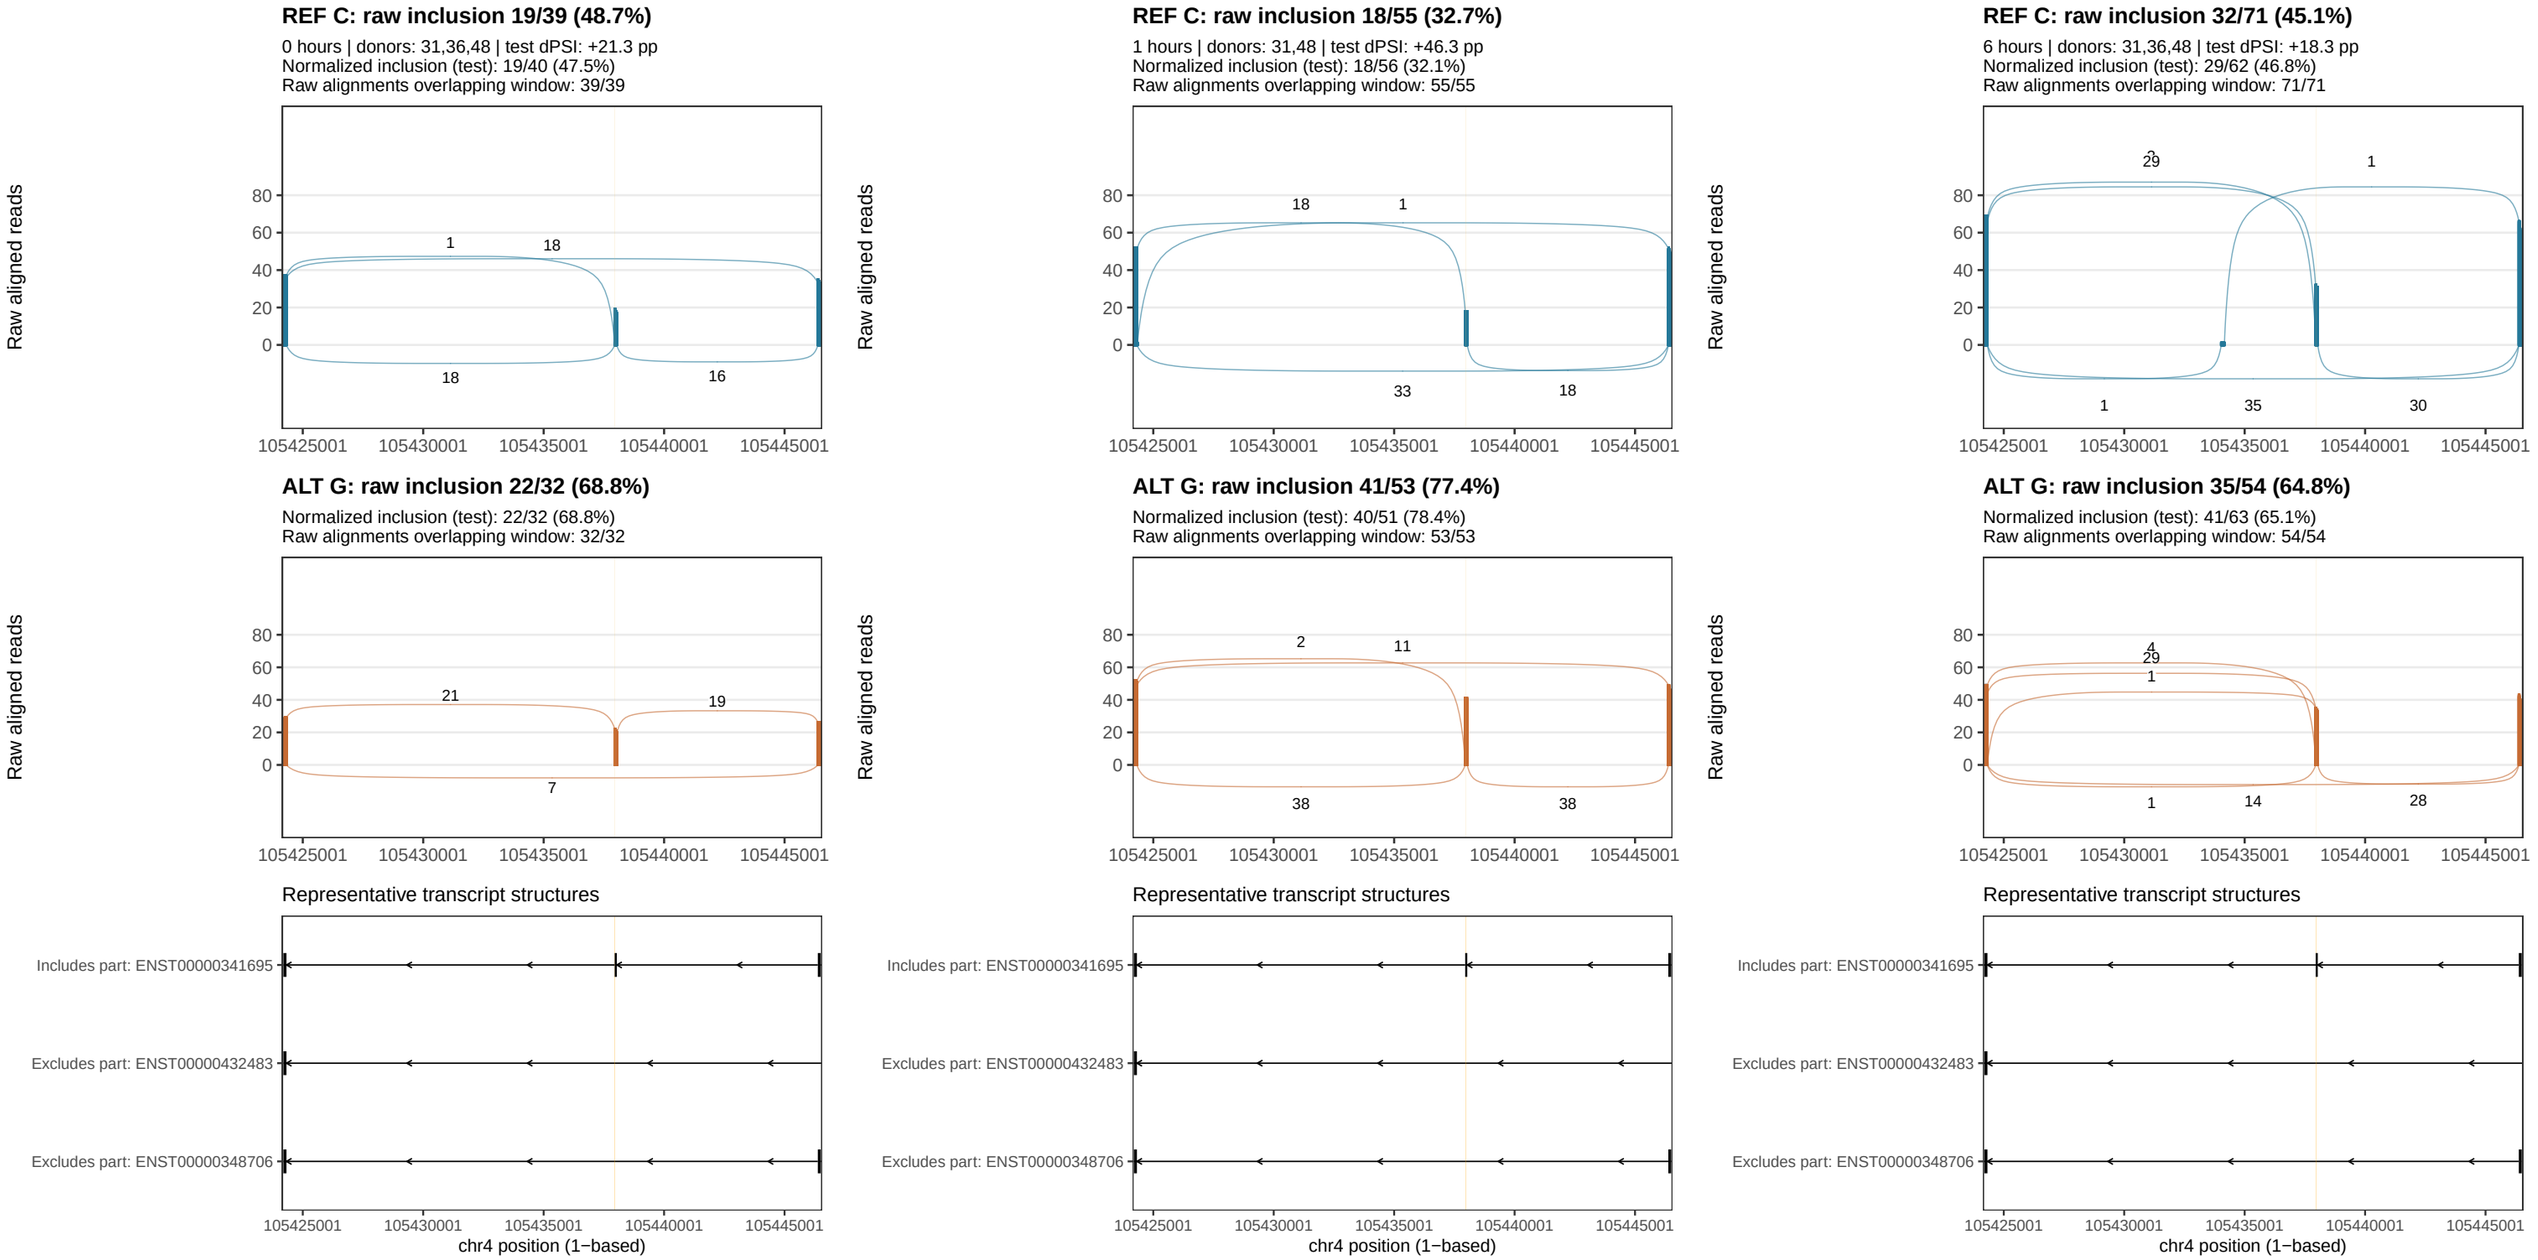


Coverage and arc labels are raw read counts; all six tracks share a y scale. Arcs: every junction with >=1 read.
Raw inclusion describes recorded reads. Normalized inclusion is from rescaled, rounded donor tables used for AMI and dPSI.
Inclusion is each read's own alignment: >= 10 aligned bases in the part, or a junction spanning it. Normalized counts are not additional sequenced reads.