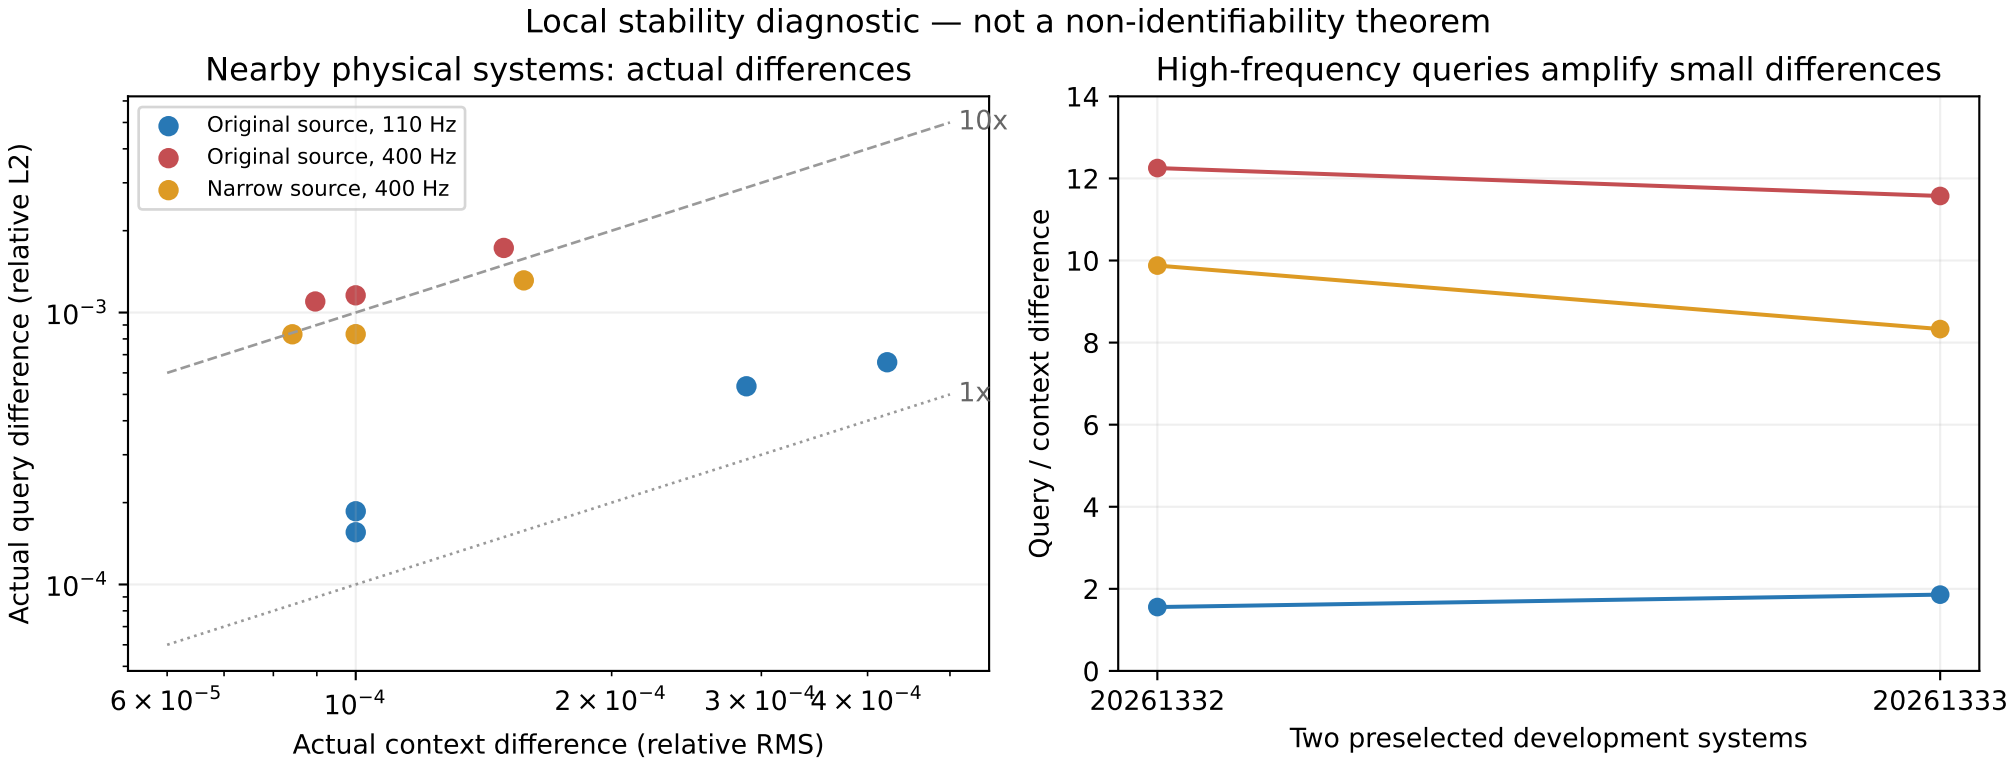
Local stability diagnostic — not a non-identifiability theorem
Nearby physical systems: actual differences
Original source, 110 Hz
Original source, 400 Hz
Narrow source, 400 Hz
10x
1x
Actual query difference (relative L2)
10^{-3}
10^{-4}
6×10^{-5}
10^{-4}
2×10^{-4}
3×10^{-4}
4×10^{-4}
Actual context difference (relative RMS)
High-frequency queries amplify small differences
Query / context difference
0
2
4
6
8
10
12
14
20261332
20261333
Two preselected development systems