



NO. VERIFIKASI: JKKP/2025/01-05/T-01/00545
VERIFICATION NO.
TARIKH: 08/05/2025
DATE

APPROVED

This document has been examined and given the status as shown in the Design Appraisal Document (DAD) number below:

DAD Number: SDAC/2490271-07

Date: 28 October 2024 Initials: WL
Office: Shanghai Design Appraisal Cent

LRQA Verification Limited

A member of the LRQA Group Limited

焊缝系数一览表 TABLE E

Type of weld 焊缝类型	Joint efficiency 焊缝系数E
A	0.85
Head 封头	0.85
B	0.85

技术条件及数据 TECHNICAL SPECIFICATION & DATA

规范CODE:ASME SECT.VIII DIV.1 2023 EDITION

ASME Certification Mark with "U" designator

NO

NB Registration NB注册

NO

操作 Operating	Pressure MPa	0.8	设计 Design	Pressure MPa	0.84
	Temperature °C	80		Temperature °C	100

最低设计金属温度 Minimum design metal temperature (MDMT) at MAWP	-18°C at 0.84 MPa	最高允许工作压力 (MAWP)	0.84 MPa at 100 °C
--	-------------------	--------------------	--------------------

腐蚀裕量 Corrosion allowance	mm	1.0	液压试验压力 Hydrostatic test pressure	1.1 MPa at 5~48° C
-----------------------------	----	-----	--	-----------------------

焊接接头系数E Joint efficiency, welding E	See Table E	介质名称及性质 Medium/Nature	空气/非致死 Air/Non-lethal
--	----------------	--------------------------	--------------------------

全容积 Gross volume	m³	25.0	特殊工况 Special service	无 No
---------------------	----	------	-------------------------	---------

设备空重 Empty weight	kg	4785	焊后热处理 PWHT	豁免Exemption Table UCS-56-1 Note (b)
----------------------	----	------	---------------	--

焊接方法 Welding Process	See welding map	冲击试验 Impact test	豁免Exemption UC-20(f), UCS-66(c) Fig. UCS-66 General Notes(c)
-------------------------	-----------------------	---------------------	---

无损检测要求 NDE requirement	Spot RT as per UW-52		
---------------------------	----------------------	--	--

油漆要求 Painting requirement	见合同 See Order	设计使用寿命 Design life	10年 10 Years
------------------------------	------------------	-----------------------	-----------------

管口表 TABLE OF NOZZLE

MARK 符号	RATING 等级	STANDARD 标准	SIZE 规格	SERVICE 用途	EXTEND LENGTH 外伸长度	INTO LENGTH 内伸长度
N1	Class 150	ASME B16.5-2020	SO 200-150 RF	Air outlet 出口	See Fig. 见图	/
N2	Class 150	ASME B16.5-2020	SO 80-150 RF	Safety valve port 安全阀口	See Fig. 见图	/
N3	/	/	M20×1.5	Pressure gauge 压力表口	30	/
N4	Class 150	ASME B16.5-2020	SO 450-150 RF	Manhole 人孔	See Fig. 见图	/
N5	Class 150	ASME B16.5-2020	SO 200-150 RF	Air inlet 进气口	See Fig. 见图	/
N6	/	/	R 3/4"	Drain 排污口	38	0

NOTES:


- Dimension tolerance of the receiver shall meet the requirement of "Dimension Tolerances of Pressure Vessel" (QCP-TK-08 Rev.0).
- The difference between the maximum and minimum inside diameters of shell shall not exceed 25mm. The amount of the wrong side of the longitudinal seam shall not be greater than 3mm, and the amount of the wrong side of the ring seam shall not be greater than 3mm. Reinforcement of longitudinal weld shall not greater than 2.5mm and 4mm for circumferential weld.
- Unmentioned fillet weld sizes are 0.7*emin where emin refers to the item with minimum thickness.
- Flange bolt holes to straddle normal centerlines.
- Drain port N1 to be flush with the inner surface of head.
- Exposed inside edges shall be chamfered or rounded.
- The nozzle orientation is subject to the top view.

注:

- 容器的尺寸公差需满足《压力容器尺寸公差规定》(QCP-TK-08 Rev.0)的要求。
- 筒体最大及最小内径之差不超过25mm, 纵缝的错变量不得大于3mm, 环缝的错变量不得大于3mm。纵焊缝余高不得大于2.5mm, 环焊缝余高不得大于4mm。
- 未注角焊缝尺寸为相焊件较薄者的0.7倍。
- 法兰螺栓孔均跨中分布。
- 排污口N6需打磨至与封头内表面齐平。
- 内部裸露的边缘应倒角或倒圆。
- 管口方位以俯视图为准。


法兰焊脚高尺寸表 TABLE A

Nozzle 管口	Pipe thk. 接管壁厚tn	Fillet size 角焊缝尺寸h
N1, N5	10.31	15.2
N2	7.62	10.7
N4	12	16.8

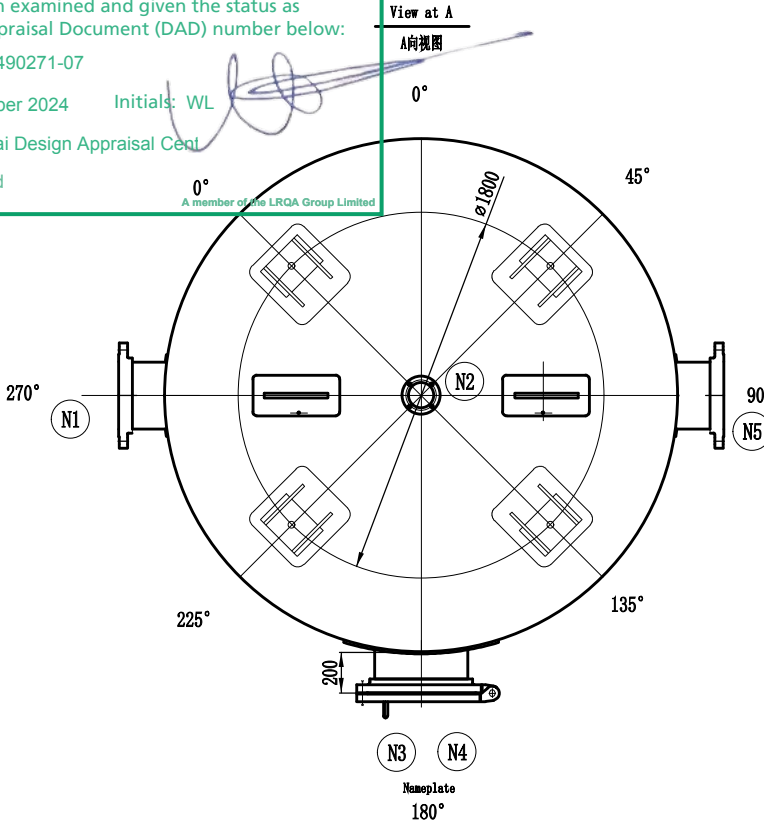


Longitudinal, Circumferential welds

纵环焊缝焊接视图

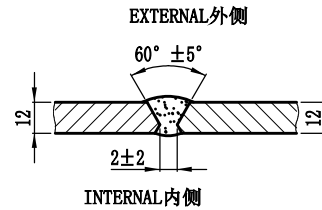


Welding detail for nozzle N6

接管N6焊接视图

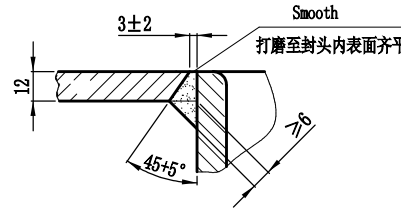


Welding detail for flange to pipe

法兰与接管焊接视图




Welding detail for nozzles without reinforcement

无补强圈接管焊接视图

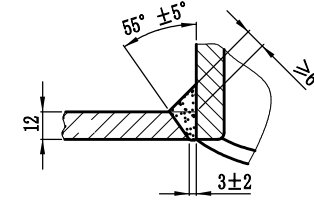


Welding detail for nozzle with reinforcements N4

有补强圈接管焊接视图N4

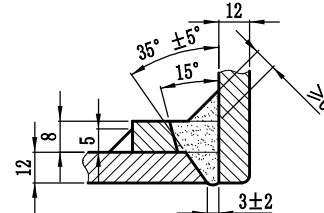

Welding detail for nozzle with reinforcements N1


有补强圈接管焊接视图N1, N5

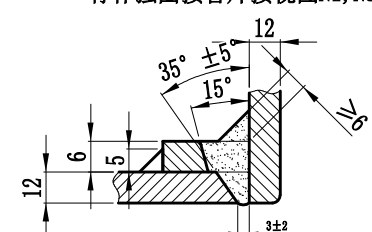

15	TKTY02-02	C	Screw joint 螺纹接头 R 3/4"	1	SA-105M	0.17
----	-----------	---	-------------------------	---	---------	------

14	TK24324-04	A	Reinforced pad 补强圈 (DN450)	1	SA-516M Gr. 485	16.9	borrow 借用
13	TK24324-03	A	Manhole 人孔	1	Assembly 组合件	188.4	borrow 借用
12	TK24323-05	A	Nameplate 铭牌	1	S30408 (GB24511)	0.5	
11	TKTY06-05	C	Nameplate support (Vertical) 铭牌支架 (立式)	1	SA/GB713 Q345R	0.5	H=25
10		/	Pipe 接管 88.9*7.62, L=107	2	SA-106M Gr. B	1.6	3.2
9	ASME B16.5-2020	/	Flange 法兰 SO 80-150 RF	1	SA-105M	4.0	
8	TK24323-04	A	Lifting lug 吊耳	2	Assembly 组合件	8.4	16.8
7		/	Pipe 接管 219.1*10.31, L=160	2	SA-106M Gr. B	8.9	17.8
6	ASME B16.5-2020	/	Flange 法兰 SO 200-150 RF	2	SA-105M	12.9	25.8
5	TK24323-03	A	Reinforced pad 补强圈 (DN200)	2	SA-516M Gr. 485	3.5	
4	TKTY03-01	B	Pressure gauge joint 压力表接头 M20×1.5	1	SA-105M	0.33	
3		/	Shell 筒体 ID=2500, T=12, L=4200	1	SA-516M Gr. 485	3152	
2	TK24323-02	A	2:1 ellipsoidal head 椭圆封头	2	SA-516M Gr. 485	665.9	1331.8
1	TK24323-01	A	Support 支座	4	Assembly 组合件	63.5	254

序号 No.	图号 DWG NO.	版本号 Rev No.	名称 Name	数量 QTY.	材料 Material	单件重量 Single Weight	总计重量 total Weight	备注 Remark
			Air receiver 储气罐 (C-25.0/0.8)					浙江泰克压力容器有限公司 Zhejiang Tank Pressure Vessel Co., Ltd.
版本 Rev.	注释 Comment	签名 Signature	日期 Date	重量 Weight	4785kg	比例 Scale	1:12	
Design by		Date		Drawing NO.:	TK24323	Rev. A		Customer:
Approved by		Date						

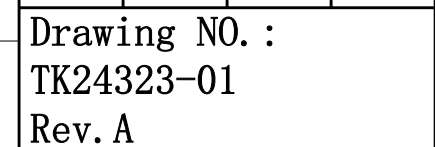




others



JABATAN KESELAMATAN DAN KESIHATAN PEKERJAAN
DEPARTMENT OF OCCUPATIONAL SAFETY AND HEALTH



NO. VERIFIKASI: JKKP/2025/01-05/T-01/00545
VERIFICATION NO.
TARIKH: 08/05/2025
DATE

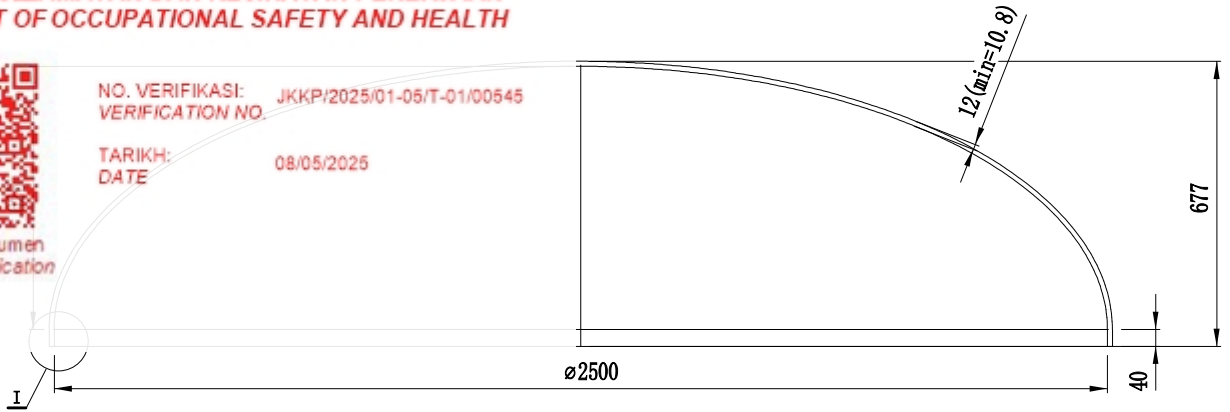

APPROVED

LRQA

This document has been examined and given the status as shown in the Design Appraisal Document (DAD) number below:

DAD Number: SDAC/2490271-07


Date: 28 October 2024 Initials: WL

Office: Shanghai Design Appraisal Cent

LRQA Verification Limited

A member of the LRQA Group Limited

LRQA007 11.2021

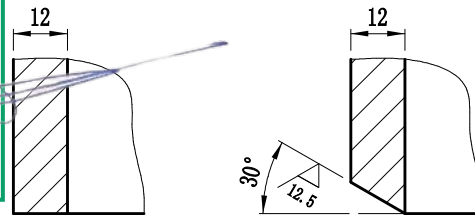

NOTES:

- Code 规范: ASME VIII-1, 2023 ED, No stamp;
- MAWP 最高允许工作压力: 0.84 MPa at 100°C;
- MDMT 最低金属设计温度: -18°C at 0.84 MPa;
- Corrosion allowance 腐蚀裕量: 1.0 mm;
- Material 材料: SA-516M Gr. 485;
- NDE: Spot RT as per UW-52; 无损检测: 局部RT;
- Impact test: Exemption (UCS-66); 冲击试验: 豁免 (UCS-66);
- Heat treatment after forming: Exemption (UCS-56). 成形后热处理: 豁免 (UCS-56);
- The minimum thickness of ellipsoidal head after forming shall be 10.8mm.
封头成型后最小厚度为10.8 mm.
- As per UG-81, the inner surface of a ellipsoidal head shall not deviate outside of the specified shape by more than 1.25%D nor inside the specified shape by more than 5/8% of D. The skirts of heads shall be sufficiently true to round so that the difference between the maximum and minimum inside diameters shall not exceed 1% of the nominal diameter.
根据UG-81, 椭圆形封头的内表面与规定形状(样板)的向外偏差不得大于1.25%D(31.25mm), 且与规定形状的向内偏差不得大于5/8%D(15.625mm)。封头的直边应该有足够的圆度, 使最大及最小内径之差不超过公称直径的1%。
- Other size requirement refer to GB/T25198-2023.
其他尺寸要求参照GB/T25198-2023。
- The head groove of each vessel shall be one flat groove and one outer slope according to Detail I.
每台容器的封头坡口按照详图I, 平坡口和外坡口各一件。

Detail I (详图 I)

				2:1 ellipsoidal head 2:1椭圆封头				浙江泰克压力容器有限公司 Zhejiang Tank Pressure Vessel Co., Ltd.	
版本 Rev.	注释 Comment	签名 Signature	日期 Date	重量 Weight	665.9kg	比例 Scale	1:25		
Design by		Date		Drawing NO. : TK24323-02 Rev. A					
Approved by		Date							




JABATAN KESELAMATAN DAN KESIHATAN PEKERJAAN
DEPARTMENT OF OCCUPATIONAL SAFETY AND HEALTH





Verifikasi Dokumen
Document Verification

NO. VERIFIKASI: JKKP/2025/01-05/T-01/00545
VERIFICATION NO.

TARIKH: 08/05/2025
DATE



I

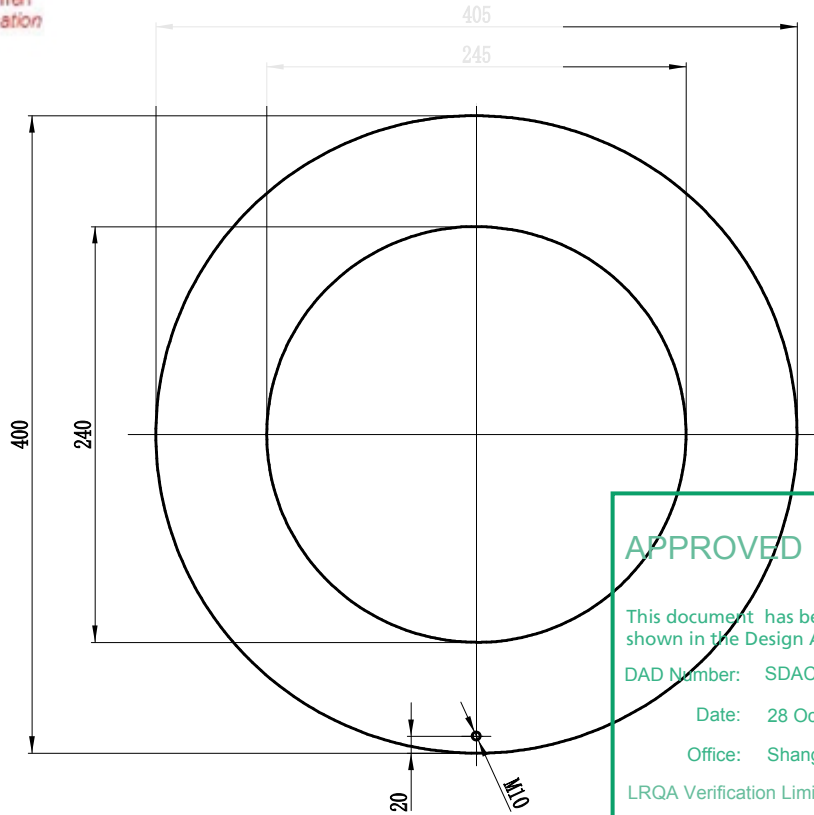

APPROVED

LRQA

This document has been examined and given the status as shown in the Design Appraisal Document (DAD) number below:

DAD Number: SDAC/2490271-07

Date: 28 October 2024 Initials: WJ

Office: Shanghai Design Appraisal Cent

LRQA Verification Limited

A member of the LRQA Group Limited

LRQA007 11.2021

Developed pattern
展开图

Notes:

1. Material材料: SA-516M Gr. 485.

2. Splicing is not allowed unless the provisions given below are satisfied.

补强圈允许拼接, 但是要满足下列规定:

(1) Individual segments are joined by full penetration butt welds and shall be ground flush;
各个分块部分都由全焊透对接焊缝连接, 并且焊缝磨平;

(2) Each segment of the reinforcing element shall have a vent hole as required by UG-37(g).
每个分块都要按照UG-37(g)的要求具有一个信号孔。

(3) Each butt weld is radiographed or is oriented at least 45 deg from the longitudinal axis of the cylinder.

拼焊焊缝作射线检测或焊缝的布置由圆筒的纵轴起至少为45°。

				Reinforcement pad 补强圈 DN200				浙江泰克压力容器有限公司 Zhejiang Tank Pressure Vessel Co., Ltd.	
版本 Rev.	注释 Comment	签名 Signature	日期Date						
Design by		Date		重量 Weight	3.5kg	比例 Scale	1:1	Customer:	
Approved by		Date		Drawing NO. : TK24323-03 Rev. A					





JABATAN KESELAMATAN DAN KESIHATAN PEKERJAAN
DEPARTMENT OF OCCUPATIONAL SAFETY AND HEALTH



Verifikasi Dokumen
Document Verification

NO. VERIFIKASI:
VERIFICATION NO. JKKP/2025/01-05/T-01/00545
TARIKH:
DATE 08/05/2025

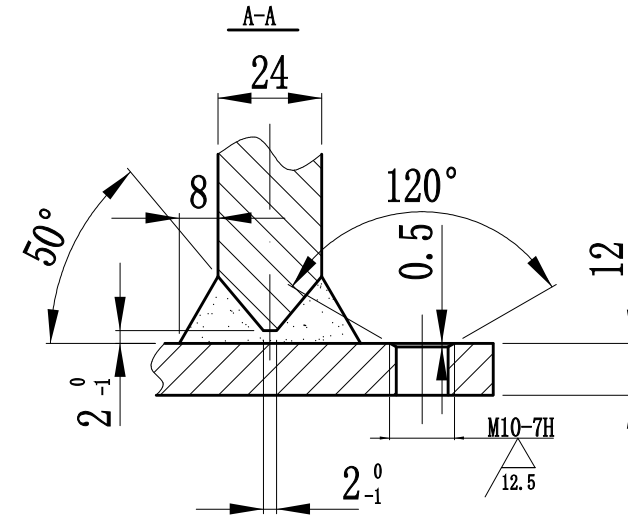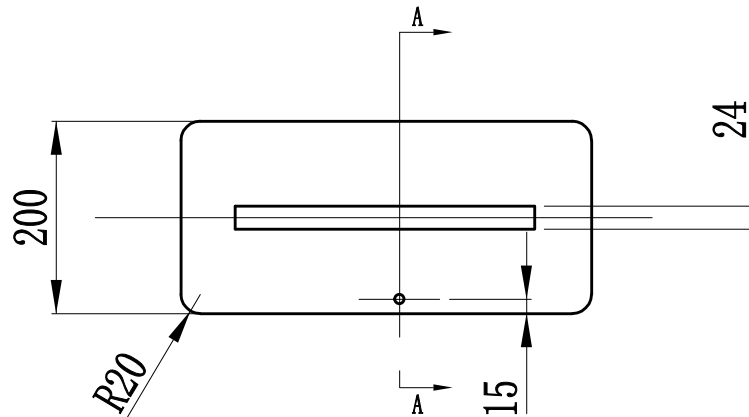

RETAINED FOR INFORMATION

As referred to in the Design Appraisal Document
(DAD) number below:

DAD Number: SDAC/2490271-07

Date: 28 October 2024

Initials: WL

Office: Shanghai Design Appraisal Centre

LRQA Verification Limited

A member of the LRQA Group Limited

LRQA

NOTES:

- Backing material:SA-516M Gr.485.Lug material:SA/GB713 Q345R.
垫板材料:SA-516M Gr.485。吊耳材料: SA/GB713 Q345R。
- The backing plate shall fit the outer wall of the vessel.
垫板应与容器外壁贴合。
- After the assembly and welding of the lug, all parts shall be flat without warping.
吊耳组焊完毕后,各部件应平整,不得翘曲。

				Lifting lug 吊耳				浙江泰克压力容器有限公司 Zhejiang Tank Pressure Vessel Co., Ltd.	
Rev.	Comment	Signature	Date						
Design by		Date		重量 Weight	8.4kg	比例 Scale	1:10		
Approved by		Date		Drawing NO.: TK24323-04 Rev. A				Customer:	

JABATAN KESELAMATAN DAN KESIHATAN PEKERJAAN
DEPARTMENT OF OCCUPATIONAL SAFETY AND HEALTH



Verifikasi Dokumen
Document Verification

NO. VERIFIKASI:
VERIFICATION NO.

JKKP/2025/01-05/T-01/00545 China

TARIKH:
DATE

08/05/2025

CODE:ASME SECT. VIII DIV. 1 2023 EDITION

EQUIPMENT NAME

Air receiver

VOLUME(V) (m³)

25

PRODUCT NO.

TK24323-XXX

WEIGHT(Kg)

4785

TEST DATE

XXXX/XX/XX

YEAR BUILT

XXXX

DESIGN PRESSURE (PS) (MPa)

0.84

MIN/MAX ALLOWABLE TEMPERATURE (TS) (°C)

-18/100

HYDRO. TEST PRESSURE (PT) (MPa)

1.1

RETAINED FOR INFORMATION

As referred to in the Design Appraisal Document
(DAD) number below:

DAD Number: SDAC/2490271-07

Date: 28 October 2024

Initials: WL

Office: Shanghai Design Appraisal Centre

LRQA Verification Limited

A member of the LRQA Group Limited

LRQA002 11.2021

NOTES:

1. Material材料::S30408(GB24511-2009);
2. One piece for each vessel. 每台1件.
3. The required markings on a nameplate shall be in characters not less than $\frac{5}{32}$ in. (4mm) high, and characters shall be either indented or raised at least 0.004 in. (0.10mm) and shall be legible and readable. 铭牌上所需的各种标志, 可采用高度不小于 $\frac{5}{32}$ in. (4mm) 的字符来标志, 标志字符应凹进或凸起至0.004in. (0.10mm), 并且明显易读。

				Nameplate 铭牌				浙江泰克压力容器有限公司 Zhejiang Tank Pressure Vessel Co., Ltd.	
版本 Rev.	注释 Comment		签名 Signature						
Design by			Date		重量 Weight	1.0	比例 Scale	1:1	Customer:
Approved by			Date		Drawing NO. : TK24323-05 Rev. A				




JABATAN KESELAMATAN DAN KESIHATAN PEKERJAAN
DEPARTMENT OF OCCUPATIONAL SAFETY AND HEALTH





Verifikasi Dokumen
Document Verification

NO. VERIFIKASI: JKPP/2025/01-05/T-01/00545
VERIFICATION NO.

TARIKH: 08/05/2025
DATE



I

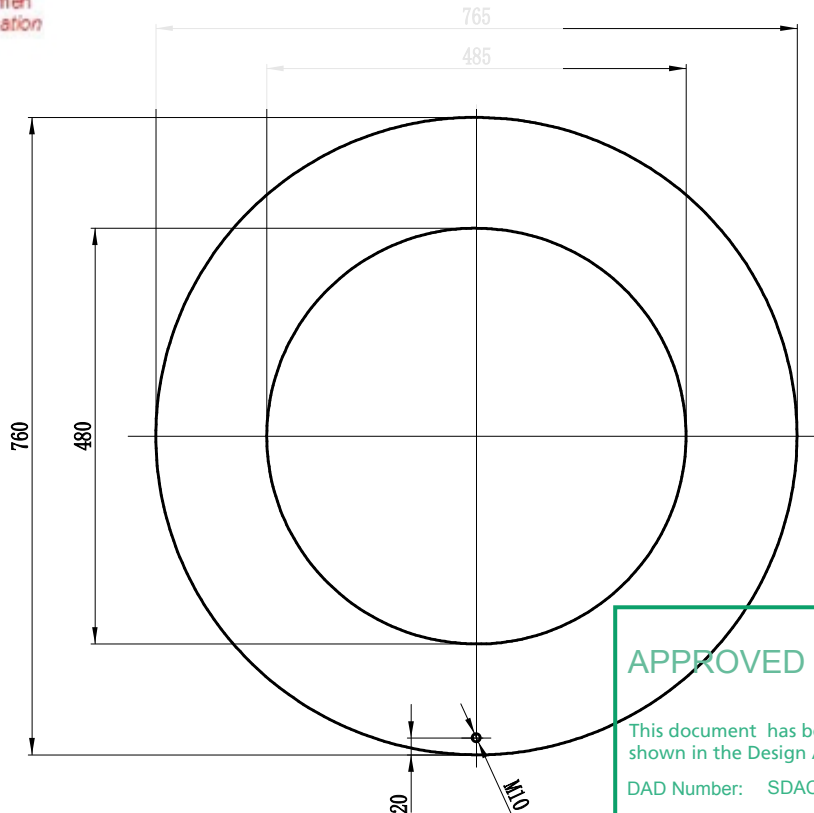

Developed pattern
展开图

APPROVED

LRQA

This document has been examined and given the status as shown in the Design Appraisal Document (DAD) number below:

DAD Number: SDAC/2490271-07

Date: 28 October 2024 Initials: W

Office: Shanghai Design Appraisal Cent

LRQA Verification Limited

A member of the LRQA Group Limited

LRQA007 11.2021

Notes:

1. Material材料: SA-516M Gr. 485.

2. Splicing is not allowed unless the provisions given below are satisfied.

补强圈允许拼接,但是要满足下列规定:

(1) Individual segments are joined by full penetration butt welds and shall be ground flush;
各个分块部分都由全焊透对接焊缝连接,并且焊缝磨平;

(2) Each segment of the reinforcing element shall have a vent hole as required by UG-37(g).
每个分块都要按照UG-37(g)的要求具有一个信号孔。

(3) Each butt weld is radiographed or is oriented at least 45 deg from the longitudinal axis of the cylinder.

拼焊焊缝作射线检测或焊缝的布置由圆筒的纵轴起至少为45°。

				Reinforcement pad 补强圈 DN450				浙江泰克压力容器有限公司 Zhejiang Tank Pressure Vessel Co., Ltd.			
版本 Rev.	注释 Comment			签名 Signature	日期 Date						
Design by				Date		重量 Weight	16.9kg	比例 Scale	1:1		
Approved by				Date		Drawing NO.: TK24326-06 Rev. A				Customer:	

4

5

6

7

120

70

41.6

3

2

240

ø457 X 12

JABATAN KESELAMATAN DAN KESIHATAN PEKERJAAN

DEPARTMENT OF OCCUPATIONAL SAFETY AND HEALTH

VERIFIKASI DOKUMEN

DOCUMENT VERIFICATION

NO. VERIFIKASI: JKKP/2025/01-05/T-01/00545

TARIKH: 08/05/2025

APPROVED

LRQA

This document has been examined and given the status as shown in the Design Appraisal Document (DAD) number below:

DAD Number: SDAC/2490271-07

Date: 28 October 2024 Initials: WL

Office: Shanghai Design Appraisal Cent

LRQA Verification Limited

A member of the LRQA Group Limited

Welding detail for flange to pipe

法兰与接管焊接视图

≥16.8

6

7

12

≥16.8

NOTES:

- Types and dimension for welding joint shall meet the requirements of ASME VIII-1;the size of fillets per thickness of thinner plate welded.
焊接接头型式及尺寸除图中注明外,按ASME VIII-1中规定;角焊缝的焊脚尺寸按较薄板的厚度。
- Others technical requirements see the Assembly Drawing.
其余要求见装配图。
- Material for manhole blind is SA/GB713 Q345R shall be normalized.
人孔盖板材料SA/GB713 Q345R必须为正火板。

15	TK24324-03-06	Handle 把手 ø20	1	SA-105M		0.7	
14	GB/T91-2000	Pin 销 6.3×30	2	Q215	/	/	
13	TK24324-03-05	Cover lug 盖轴耳II	1	SA/GB713 Q345R		0.7	
12	TK24324-03-04	Flange lug 法兰轴耳II	1	SA/GB713 Q345R		0.6	
11	TK24324-03-03	Flange lug 法兰轴耳I	1	SA/GB713 Q345R		0.6	
10	TK24324-03-02	Cover lug 盖轴耳I	1	SA/GB713 Q345R		0.7	
9	GB/T95-2002	Plain Washer 平垫圈 24	2	100HV	/	/	
8	TK24324-03-01	Shaft pin 轴销	1	20 (GB/T699)		1.3	
7	ASME B18.22.1	Plain Washer 平垫圈 NPS 1-1/8	16	100HV	0.05	0.8	Latest edition
6	ASME B18.2.2	Nut 螺母 1-1/8-8UN-2B	16	SA-194M-2H	0.09	1.44	Latest edition
5	ASME B18.2.1	Bolt 螺栓 1-1/8-8UN-2A,L=135	16	SA-193M-B7	0.18	2.88	Latest edition
4		Gasket 垫片 ø548×ø458,T=3	1	Elastomers with cotton fabric insertion 含有棉纤维的橡胶		/	
3	ASME B16.5-2020	Blind 法兰盖 BL 450-150 RF	1	SA/GB713 Q345R		98.5	
2	ASME B16.5-2020	Flange 法兰 SO 450-150 RF	1	SA-105M		49.5	
1		Pipe 接管 ø457×12,L=233	1	SA-516M Gr.485		30.7	
序号 No.	标准号 Standard	名称 Name	数量 QTY.	材料 Material	单件 Single 重量 Weight	总计 total Kg	备注 Remark
				Manhole 人孔 (DN450)	浙江泰克压力容器有限公司 Zhejiang Tank Pressure Vessel Co., Ltd.		
Rev.	Comment	Signature	Date				
Design by		Date		重量 Weight	188.4kg	比例 Scale	1:10
Approved by		Date		Drawing NO. : TK24324-03 Rev. A	Customer:		




JABATAN KESELAMATAN DAN KESIHATAN PEKERJAAN
DEPARTMENT OF OCCUPATIONAL SAFETY AND HEALTH



Verifikasi Dokumen
Document Verification

NO. VERIFIKASI: JKKP/2025/01-05/T-01/00545
VERIFICATION NO.
TARIKH: 08/05/2025
DATE

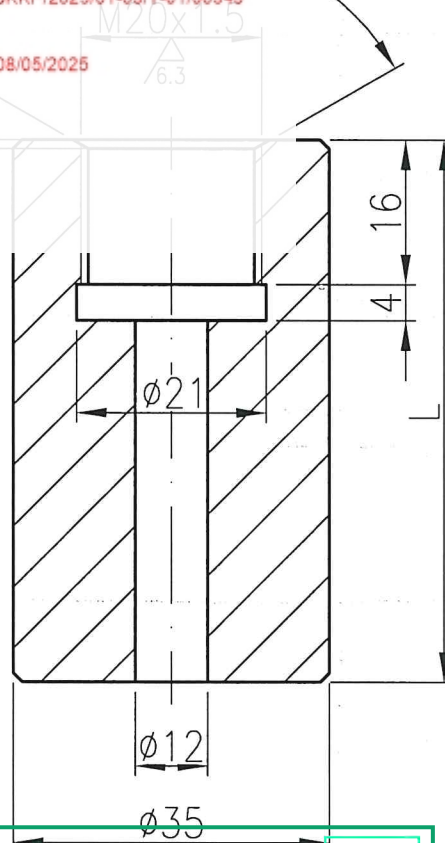

APPROVED

LRQA

This document has been examined and given the status as shown in the Design Appraisal Document (DAD) number below:

DAD Number: SDAC/2490271-07

Date: 28 October 2024 Initials: WL

Office: Shanghai Design Appraisal Cent

LRQA Verification Limited

A member of the LRQA Group Limited

LRQA007 11.2021

others: 12.5/

NOTES:

1. Material: See assembly dwg or purchase note.

材料: 见装配图明细表或采购订单。

2. Material marking should be in accordance with following requirements

(a) Manufacturer's Name or Trademark; (b) Drawing number; (c) Size; (d) Material specification and designation; (e) Heat number;

材料标记需满足以下要求:

(a) 制造厂的名称或商标; (b) 图号; (c) 规格; (d) 材料标准号和牌号; (e) 炉号;

3. Unless noted, otherwise processing surface tolerance shall be as per GB/T1804-2000 Grade m;

除注明外, 未注公差按GB/T1804-2000的m级;

4. End edges shall be chamfered or rounded.

端部边缘应倒角或圆角。

5. Undeclared chamfer is 1X45° ;

未注倒角为1X45° 。

ASME

02	80	0.6	
01	50	0.33	
XX	L (mm)	Weight重量(kg)	备注Remark

				Pressure gauge joint 压力表接头 (M20X1.5)			浙江泰克压力容器有限公司 Zhejiang Tank Pressure Vessel Co., Ltd..	
Rev.	Comment	Signature	Date	重量 Weight	/	比例 Scale	/	
Design by	李明	Date	2022.8.23	Drawing NO. : TKTY03-XX			Customer:	
Approved by	吕明	Date	2022.8.23	Rev. B				




JABATAN KESELAMATAN DAN KESIHATAN PEKERJAAN
DEPARTMENT OF OCCUPATIONAL SAFETY AND HEALTH



Verifikasi Dokumen
Document Verification

NO. VERIFIKASI:
VERIFICATION NO. JKKP/2025/01-05/T-01/00545

TARIKH:
DATE 08/05/2025

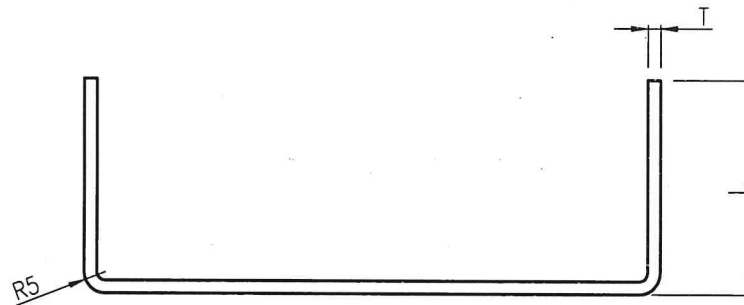

NOTES:

1. Material: as per drawing.

材料: 见图纸。

RETAINED FOR INFORMATION

LRQA

As referred to in the Design Appraisal Document
(DAD) number below:

DAD Number: SDAC/2490271-07

Date: 28 October 2024

Initials: WL

Office: Shanghai Design Appraisal Centre

LRQA Verification Limited

A member of the LRQA Group Limited

LRQA002 11.2021

12	3	150	SA-240M 304	1.0
11		120		0.83
10		70		0.6
09		25		0.45
08	4	150	SA/GB713 Q345R	1.28
07		120		1.1
06		70		0.8
05		25		0.6
04	2	150	Q235-B	0.64
03		120		0.55
02		70		0.4
01		25		0.3
XX	T (mm)	L (mm)	Material材料	Weight重量 (kg)

				Nameplate supprot (Vertical) 铭牌支架 (立式)				浙江泰克压力容器有限公司 Zhejiang Tank Pressure Vessel Co., Ltd.	
Rev.	Comment		Signature	Date					
Design by	田家明		Date	2023.11.17		重量 Weight	/kg	比例 Scale	1:2
Approved by	田家明		Date	2023.11.17		Drawing NO.: TKTY06-XX Rev. C			Customer:




JABATAN KESELAMATAN DAN KESIHATAN PEKERJAAN
DEPARTMENT OF OCCUPATIONAL SAFETY AND HEALTH



Verifikasi Dokumen
Document Verification

NO. VERIFIKASI:
VERIFICATION NO. JKKP/2025/01-05/T-01/00545

TARIKH:
DATE 08/05/2025

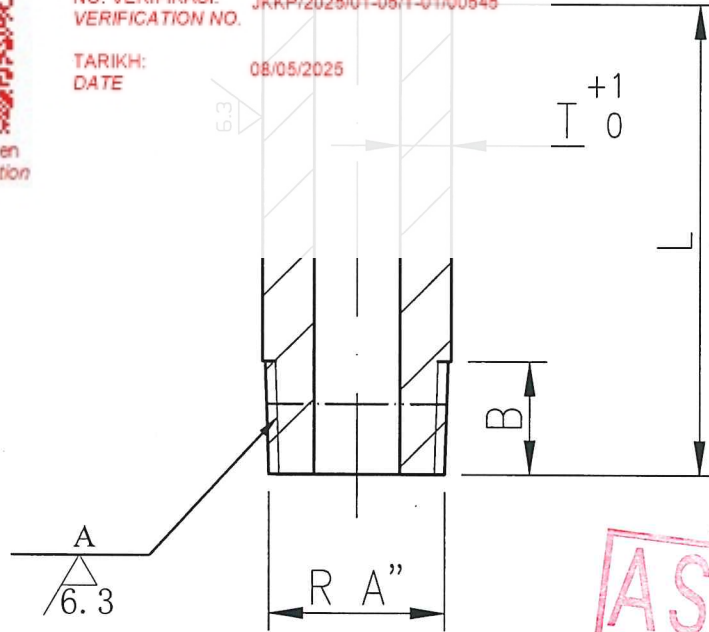

ASME

NOTES:

1. Material: See assembly dwg or purchase note.

材料: 见装配图明细表或采购订单。

2. Material marking should be in accordance with following requirements
(a) Manufacturer's Name or Trademark; (b) Drawing number; (c) Size; (d) Material specification and designation; (e) Heat number;

材料标记需满足以下要求:

(a) 制造厂的名称或商标; (b) 图号; (c) 规格; (d) 材料标准号和牌号; (e) 炉号;
3. Unless noted, otherwise processing surface tolerance shall be as per GB/T1804-2000 Grade m;

除注明外, 未注公差按GB/T1804-2000的m级;

4. End edges shall be chamfered or rounded.
端部边缘应倒角或圆角。

5. Undeclared chamfer is 1X45°;
未注倒角为1X45°。

APPROVED

LRQA

This document has been examined and given the status as shown in the Design Appraisal Document (DAD) number below:

DAD Number: SDAC/2490271-07

Date: 28 October 2024 Initials: WL

Office: Shanghai Design Appraisal Cent

LRQA Verification Limited

A member of the LRQA Group Limited

LRQA007 11.2021

others: 6.3/

16	3"	33.3	9.5	89	80	1.02	
15	2-1/2"	30.2	8	76		0.74	
14	2"	25.7	9.15	60.3		0.58	
13	1-1/2"	21.4	8.15	48.3		0.40	
12	1-1/4"	21.4	6.1	42.2		0.24	
11	1"	19.1	6.7	33.4		0.37	
10	3/4"	16.3	6.35	26.7		0.27	
09	1/2"	15	5.65	21.3		0.21	
08	3"	33.3	9.5	89	50	0.93	
07	2-1/2"	30.2	8	76		0.67	
06	2"	25.7	9.15	60.3		0.58	
05	1-1/2"	21.4	8.15	48.3		0.40	
04	1-1/4"	21.4	6.1	42.2		0.27	
03	1"	19.1	6.7	33.4		0.23	
02	3/4"	16.3	6.35	26.7		0.17	
01	1/2"	15	5.65	21.3		0.13	
XX	A	B (mm)	T (mm)	D (mm)	L (mm)	重量weight (kg)	备注Remark

				Screwed joint (R) 插入式Rp外螺纹接头				浙江泰克压力容器有限公司 Zhejiang Tank Pressure Vessel Co., Ltd.			
Rev.		Comment		Signature		Date					
Design by		田家欢		Date		2023.11.7					
				重量 Weight		/		比例 Scale		/	
Drawing NO. :				TKTY02-XX		Rev. C		Customer:			
Approved by		田家欢		Date		2023.11.7					