


13	WTCY200-60-07	Idler wheel	1	Component			
12	WTCY200-60-06(09)	Saddle DN3600-S	1	Component			
11	ASME B36.10-2022	Nozzle O.D.168.3×10.97	1	SA-106 Gr.B			L=220
10	ASME B36.10-2022	Nozzle O.D.168.3×10.97	2	SA-106 Gr.B			L=210
9	ASME B16.5-2020	Flange DN50 Class50 SDR11	2	SA-105			
8	WTCY200-60-05	Secondary air preheater drain pipe	1	Component			
7	WTCY200-60-04	Gland leakage pipe	1	Component			
6	WTCY200-60-03	Nameplate	1	Component			
5		Pad 200×200×8	28	SA-516 Gr.70			
4	WTCY200-60-02	Manhole DN500	3	Component			
3		Shell I.D.3600×16	1	SA-516 Gr.70			
2	WTCY200-60-01	Pump return port	3	Component			
1	TFQB-11-01	Head EHA3600×16	2	SA-516 Gr.70			
序号 NO.	图号或标准号 DRAWING NO. OR STD. NO.	名称 PARTS NAME	数量 QTY	材料 MAT'L	单 SINGLE	总 TOTAL	备注 REMARKS
					重量 MASS(kg)		
序号 No.	说明 DESCRIPTION	设计 PRCD	校核 CHKD	审核 APPR	批准 AUTHD	日期 DATE	
		张伟	符明	郭志元		2024.10.28	
本图纸为青岛同方环境工程设备有限公司财产，未经本公司许可不得转给第三者或复制。 This drawing is the property of QINGDAO TONGFANG THERMOELECTRIC EQUIPMENT CO.,LTD Unauthorized disclosure to any third party or duplication is not permitted.							
 青岛同方环境工程设备有限公司 QINGDAO TONGFANG ENVIRONMENT ENGINEERING EQUIPMENT CO.,LTD.		净质量 kg NET MASS	盛水质量 kg MASS OF FULL WATER	操作质量 kg OPERATING MASS			
项目 PROJECT	Renewable energy power station in Selangor, Malaysia		设计阶段 DES. STAGE		Confirmation drawing		
装置/工区 UNIT & WORK AREA	Phase II		图 名 DRAWING NAME		内置旋膜除氧器 Built-In Rotary Film Deaerator NZXM200-60-00		
青岛 REV	版次 0	比例 SCALE	1:22	张共 2	张 OF		

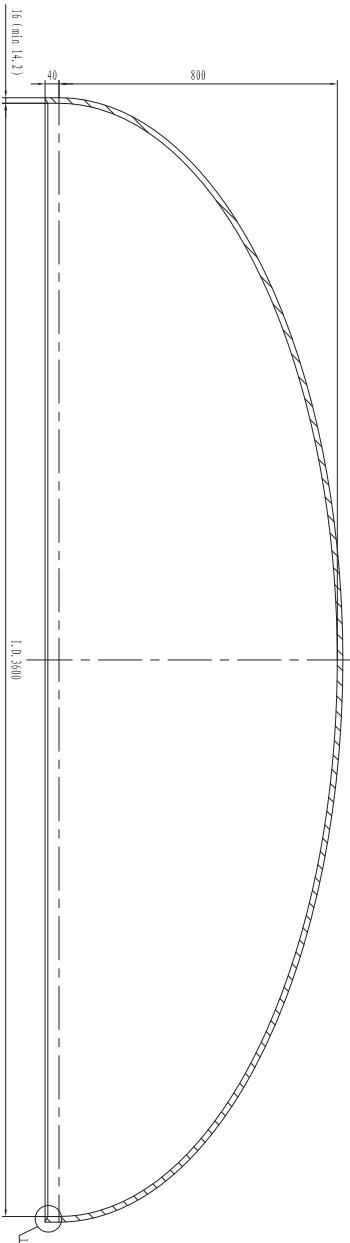


APPROVED

This document has been examined and given the status as shown in the Design Appraisal Document (DAD) number below:
DAD Number: SDA02490271-13
Date: 18 November 2024 Initials: WL
Office: Shanghai Design Appraisal Cent
LRQA Verification Limited
UNDA007 11 2021

LRQA

技术要求:

- Technical Requirement
- 1、封头为2: 1标准椭圆封头;
The head is 2: 1 standard elliptical head,
 - 2、成型后的最小厚度应不小于14.2mm;
Min thickness after forming shall be no less than 14.2mm;
 - 3、焊后焊缝按照 UW-11 (b) & UW-52做RT局部检测;
RT spot inspection shall be performed for all welding seams according to UW-11 (b) & UW-52
 - 4、封头的制造要求应符合 ASME 第VIII卷第一册2023版中UG-79和UG-81规定;
The head shall conform to UG-79 and UG-81 (a) of ASME VIII DIV 1 2023 Edition;
 - 5、封头冷成型;
For head--cold formed.

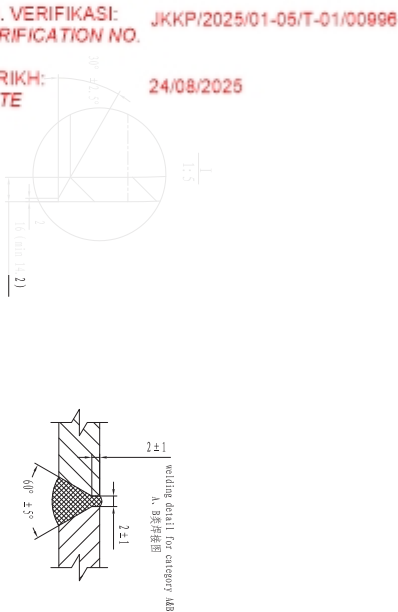

JABATAN KESELAMATAN DAN KESIHATAN PEKERJAAN
DEPARTMENT OF OCCUPATIONAL SAFETY AND HEALTH



青岛同方环境工程有限公司 QINGDAO TONGFANG ENVIRONMENT ENGINEERING EQUIPMENT CO., LTD.				项目名称 PROJECT NAME		项目描述 PROJECT DESCRIPTION	
设计 DESIGN	审核 CHECK	日期 DATE	批准 APPROVE	椭圆封头/Head EHA3600 × 16		设计阶段 DESIGN PHASE	
设计 DESIGN	审核 CHECK	日期 DATE	批准 APPROVE	零件图Part drawing		图号 DRAWING NO.	
设计 DESIGN	审核 CHECK	日期 DATE	批准 APPROVE	比例 SCALE		版本 VERSION	
设计 DESIGN	审核 CHECK	日期 DATE	批准 APPROVE	比例 SCALE		版本 VERSION	
设计 DESIGN	审核 CHECK	日期 DATE	批准 APPROVE	比例 SCALE		版本 VERSION	
设计 DESIGN	审核 CHECK	日期 DATE	批准 APPROVE	比例 SCALE		版本 VERSION	
设计 DESIGN	审核 CHECK	日期 DATE	批准 APPROVE	比例 SCALE		版本 VERSION	
设计 DESIGN	审核 CHECK	日期 DATE	批准 APPROVE	比例 SCALE		版本 VERSION	
设计 DESIGN	审核 CHECK	日期 DATE	批准 APPROVE	比例 SCALE		版本 VERSION	



JABATAN KESELAMATAN DAN KESIHATAN PEKERJAAN
DEPARTMENT OF OCCUPATIONAL SAFETY AND HEALTH




Verifikasi Dokumen
Document Verification

NO. VERIFIKASI: JKKP/2025/01-05/T-01/00996
VERIFICATION NO.

TARIKH: 24/08/2025
DATE

其余 $\frac{25}{\nabla}$

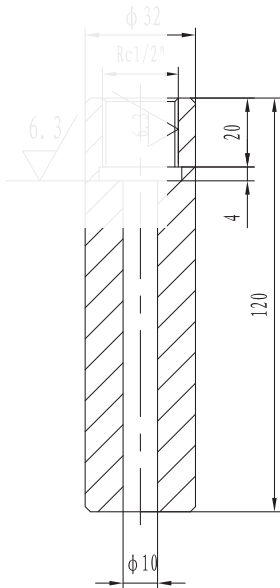

APPROVED

LRQA

This document has been examined and given the status as shown in the Design Appraisal Document (DAD) number below:

DAD Number: SDAC/2490271-13

Date: 18 November 2024 Initials: WL

Office: Shanghai Design Appraisal Cent

LRQA Verification Limited

A member of the LRQA Group Limited

技术要求

Technical requirements

1. 螺纹表面不允许有裂纹、碰伤和毛刺;

No cracks, bruises or burrs are allowed on the thread surface;

2. 密封面不得有刻线、刮伤和凹穴等缺陷。

Seal surface shall not have lines, scratches and pits and other defects

材料/Materials: SA-105

普通件登记

描 图

校 描

旧底图总号



青岛同方环境工程设备有限公司
QINGDAO TONGFANG ENVIRONMENT ENGINEERING EQUIPMENT.CO.LTD.

项目名称
PROJECT NAME
Renewable energy station in Selangor, Malaysia

签 字

职 责
RESPONSIBILITY

签 名
SIGNATURE

日 期
DATE

压力表座/Pressure gauge seat

设计阶段
DESIGN PHASE

审核中/Subject to review and approval

日 期

校 核
PROOFREAD

审 核
AUDIT

批 准
APPROVAL

零件图Part drawing

图 号
DRAWING No.

TFT02-2

比 例
proportion

1:2

重 量
WEIGHT

0.5

版 次
EDITION

Rev. 0

第 张

共 张





JABATAN KESELAMATAN DAN KESIHATAN PEKERJAAN
DEPARTMENT OF OCCUPATIONAL SAFETY AND HEALTH


其余^{12.5}✓



Verifikasi Dokumen
Document Verification

NO. VERIFIKASI: JKKP/2025/01-05/T-01/00996
VERIFICATION NO.

TARIKH: 24/08/2025
DATE

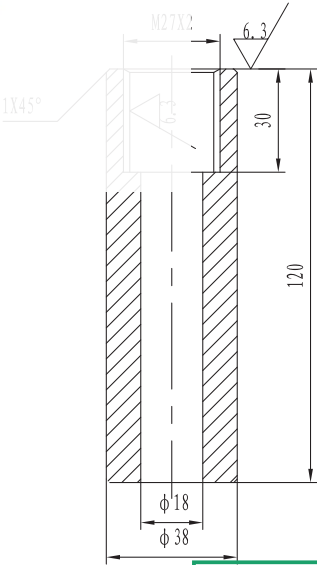

APPROVED

LRQA

This document has been examined and given the status as shown in the Design Appraisal Document (DAD) number below:

DAD Number: SDAC/2490271-13

Date: 18 November 2024 Initials: WL

Office: Shanghai Design Appraisal Cent

LRQA Verification Limited

A member of the LRQA Group Limited

技术要求

Technical requirements

1. 螺纹表面不允许有裂纹、碰伤和毛刺;
No cracks, bruises or burrs are allowed on the thread surface;
2. 密封面不得有刻线、刮伤和凹穴等缺陷。
Seal surface shall not have lines, scratches and pits and other defects

材料/Materials: SA-105

普通件登记

描 图

校 描

旧底图总号



青岛同方环境工程设备有限公司
QINGDAO TONGFANG ENVIRONMENT ENGINEERING EQUIPMENT.CO.LTD.

项目名称
PROJECT NAME
Renewable energy station in Selangor, Malaysia

签 字

职 责
RESPONSIBILITY

签 名
SIGNATURE

日 期
DATE

电阻温度计插座
A resistance thermometer socket
零件图Part drawing

设计阶段
DESIGN PHASE
审核中/Subject to review and approval

图 号
DRAWING No.
TFT04-2

日 期

审 核
AUDIT

批 准
APPROVAL

比 例
proportion
1:2
重 量
WEIGHT
0.5
第 张
共 张

版 次
EDITION
Rev. 0


JABATAN KESELAMATAN DAN KESIHATAN PEKERJAAN
DEPARTMENT OF OCCUPATIONAL SAFETY AND HEALTH



Verifikasi Dokumen
Document Verification

NO. VERIFIKASI: JKKP/2025/01-05/T-01/00996
VERIFICATION NO.

TARIKH: 24/08/2025
DATE

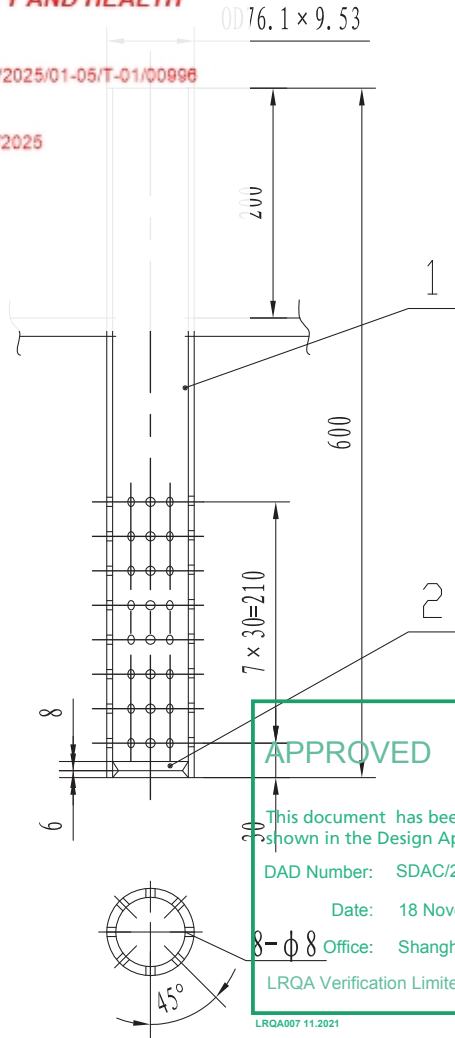

APPROVED

LRQA

This document has been examined and given the status as shown in the Design Appraisal Document (DAD) number below:

DAD Number: SDAC/2490271-13

Date: 18 November 2024 Initials: WL

Office: Shanghai Design Appraisal Cent

LRQA Verification Limited

A member of the LRQA Group Limited


LRQA007 11.2021

普通件登记

描 图	2		堵板/Blind plate $\phi 55 \times 8$	1	Q235B	0.15	0.15	
校 描	1	ASME B36.10	多孔管/porous tube $OD 76.1 \times 9.53$	1	SA106 Gr.B	9.37	9.37	L=600
旧底图总号	No.	Codename	Name	Quantity	Naterials	Single Weight	Totes	Notes
签 字	青島同方环境工程设备有限公司 QINGDAO TONGFANG THERMOELECTRIC EQUIPMENT CO.,LTD					项目名称 PROJECT NAME	Renewable energy station in Selangor, Malaysia	
日 期	职 责 RESPONSIBILITY	签 名 SIGNATURE	日 期 DATE	水泵再循环管 Pump recirculation line 部件图/Part diagram		设计阶段 DESIGN PHASE	审核中/Subject to review and approval	
	设计 DESIGN					图 号 DRAWING No.	WTCY200-60-01	
	校 核 PROOFREAD					版 次 EDITION	Rev. 0	
	标准 STANDARDIZED							
	审 核 AUDIT			比 例 proportion	1: 6	重 量 WEIGHT	10	
	批 准 APPROVAL			第 张		共 张		



TARIKH: 24/08/2025
DATE

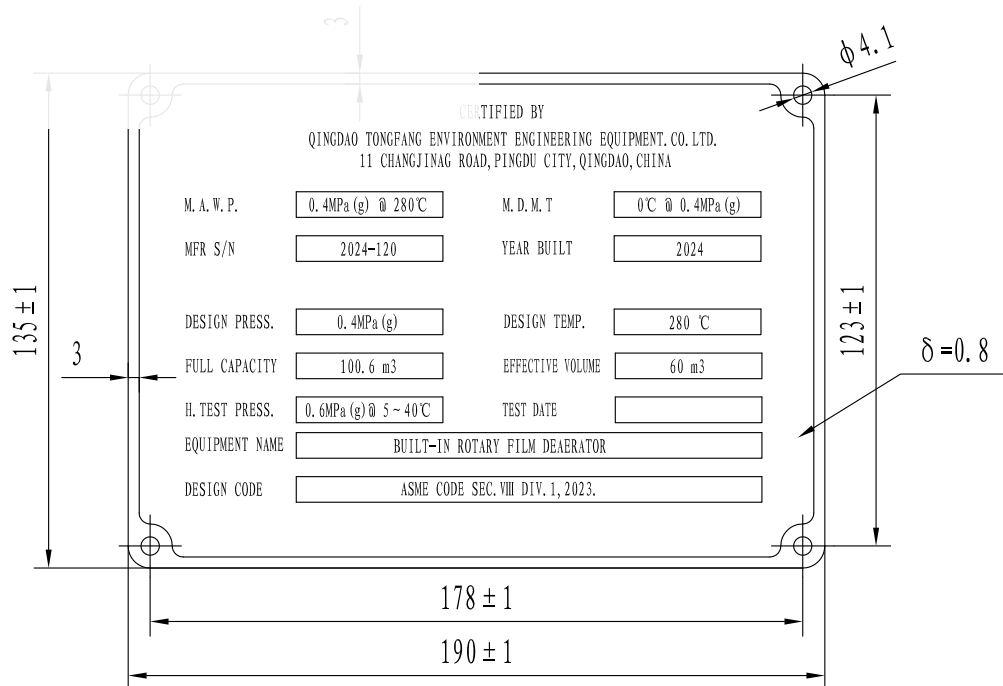

A

A member of the LRQA Group Limited



I ROA002 11 202-

日期



青島同方環境工程設備有限公司
QINGDAO TONGFANG ENVIRONMENT ENGINEERING EQUIPMENT. CO. LTD.

项目名称	Renewable energy station in Selangor, Malaysia
PROJECT NAME	

设计阶段 DESIGN PHASE	审核中/Subject to review and approval
----------------------	------------------------------------

图 号	WTCY200-60-03
DRAWING No.	

版 次 EDITION	Rev. 0
----------------	--------

铭牌/Nameplate

零件图/Part drawings

比 例 proportion	1:2	重 量 WEIGHT	
第 张		共 张	

1

2





JABATAN KESELAMATAN DAN KESIHATAN PEKERJAAN
DEPARTMENT OF OCCUPATIONAL SAFETY AND HEALTH



Verifikasi Dokumen
Document Verification

NO. VERIFIKASI: JKKP/2025/01-05/T-01/00996
VERIFICATION NO.

TARIKH: 24/08/2025
DATE

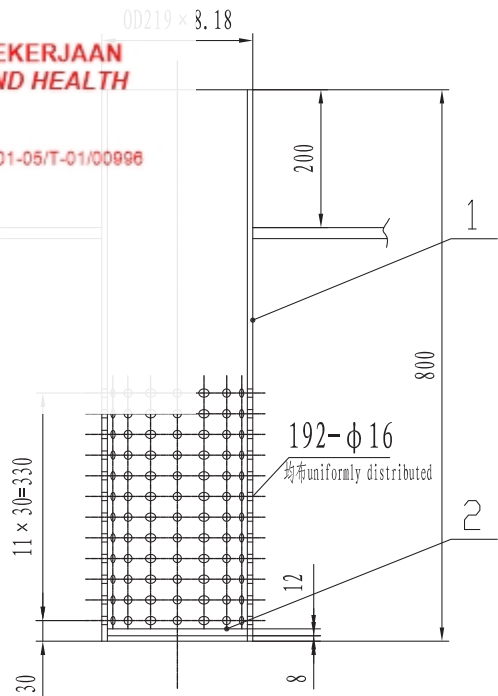

APPROVED

LRQA

This document has been examined and given the status as shown in the Design Appraisal Document (DAD) number below:

DAD Number: SDAC/2490271-13

Date: 18 November 2024 Initials: WL

Office: Shanghai Design Appraisal Cent

LRQA Verification Limited

A member of the LRQA Group Limited

LRQA007 11.2021

技术要求

Technical requirements

钻孔完毕, 将铁屑清理干净;

After drilling, clean the iron filings;

普通件登记

描 图	2	本图/This drawing	堵板/φ 201 × 12	1	Q345R	3	3	
校 描	1	ASME B36.10-2022	多孔管/Pipe 0. D219.1 × 8.18	1	SA-106 Gr. B	25.52	25.52	
	NO.	Code name	Name	Quantity	Materials	Single Weight	Total Weight	Notes
旧底图总号	 青岛同方环境工程设备有限公司 QINGDAO TONGFANG ENVIRONMENT ENGINEERING EQUIPMENT. CO. LTD.					项目名称 PROJECT NAME	Renewable energy station in Selangor, Malaysia	
签 字	职 责 RESPONSIBILITY	签 名 SIGNATURE	日 期 DATE	汽封漏汽多孔管/Gland leakape pipe		设计阶段 DESIGN PHASE	审核中/Subject to review and approval	
	设 计 DESIGN					图 号 DRAWING No.	WTCY200-60-04	
日 期	校 核 PROOFREAD			零件图Part drawing		版 次 EDITION	Rev. 0	
	标 准 化 STANDARDIZED							
	审 核 AUDIT			比 例 proportion	1:10	重 量 WEIGHT	29	
	批 准 APPROVAL			第 张		共 张		




JABATAN KESELAMATAN DAN KESIHATAN PEKERJAAN
DEPARTMENT OF OCCUPATIONAL SAFETY AND HEALTH



Verifikasi Dokumen
Document Verification

NO. VERIFIKASI: JKKP/2025/01-05/T-01/00996
VERIFICATION NO.

TARIKH: 24/08/2025
DATE

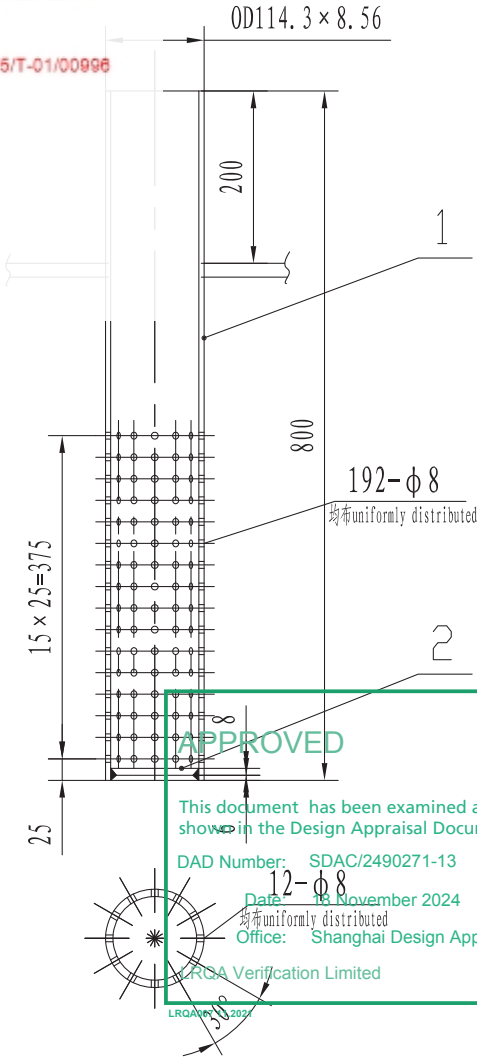

This document has been examined and given the status as shown in the Design Appraisal Document (DAD) number below:

DAD Number: SDAC/2490271-13

Date: 18 November 2024 Initials: WL

Office: Shanghai Design Appraisal Cent

LRQA Verification Limited

A member of the LRQA Group Limited

普通件登记

描 图	2		堵板Blind plateφ96×8	1	Q345R	0.2	0.2	
校 描	1	ASME B36.10M	多孔管porous tubeOD114.3×8.18	1	SA-106 Gr. B	17.2	17.2	
旧底图总号	NO.	Code name	Name	Quantity	Materials	Single	Total	Notes
签 字		职 责 RESPONSIBILITY	签 名 SIGNATURE	日 期 DATE	二级空预器疏水多孔管 Secondary air preheater drain Pipe 零件图Part drawing			
日 期		设计 DESIGN						
		校核 PROOFREAD						
		标准化 STANDARDIZED						
		审核 AUDIT			比 例 proportion	1:8	重 量 WEIGHT	17
		批准 APPROVAL			第 张		共 张	
青 岛 同 方 环 境 工 程 设 备 有 限 公 司 QINGDAO TONGFANG ENVIRONMENT ENGINEERING EQUIPMENT.CO.LTD.					项 目 名 称 PROJECT NAME	Renewable energy station in Selangor, Malaysia		
					设 计 阶 段 DESIGN PHASE	审核中/Subject to review and approval		
					图 号 DRAWING No.	WTCY200-60-05		
					版 次 EDITION	Rev. 0		

技术要求

Technical requirements

- 1、焊接可采用电弧焊或气体保护焊（使用药芯焊丝除外），焊材应按照工艺要求选用；
Welding can be done by arc welding or Gas metal arc welding (except flux-cored wire), the welding materials should be selected according to the process requirements;
- 2、支座本体采用双面连续角焊，焊缝高度按板厚度约0.4~0.6倍，且不小于5mm；
The support body adopts double-sided continuous fillet welding, the weld waist height is 0.4~0.6 times of the thickness of the thin plate, and is not less than 5mm;
- 3、支座所有零件周边粗糙度为R3.0µm；
The peripheral roughness of all parts is R3.0 µm
- 4、支座组焊完毕，各部件应平整，不得翘曲；
After welding, all parts should be flat and not warp.

RETAINED FOR INFORMATION

LRQA

As referred to in the Design Appraisal Document (DAD) number below:

DAD Number: SDAC/2490271-13



Date: 18 November 2024

Initials: WL

Office: Shanghai Design Appraisal Centre

LRQA Verification Limited

A member of the LRQA Group Limited

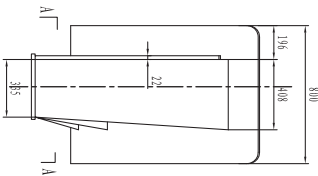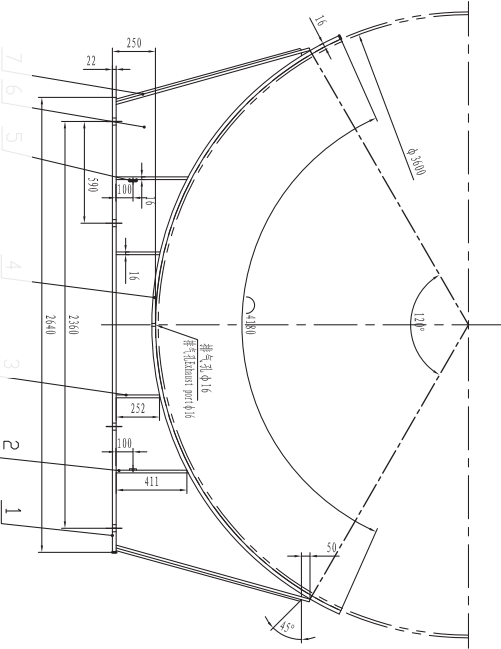

JABATAN KESELAMATAN DAN KESIHATAN PEKERJAAN
DEPARTMENT OF OCCUPATIONAL SAFETY AND HEALTH





Verifikasi Dokumen
Document Verification

NO. VERIFIKASI: JKKP/2025/01-05/T-01/00996
VERIFICATION NO.

TARIKH: 24/08/2025
DATE

件尺寸图
Small drawing of the item
Drawing No.

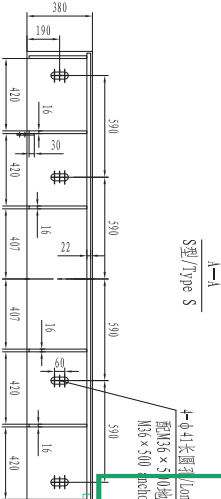
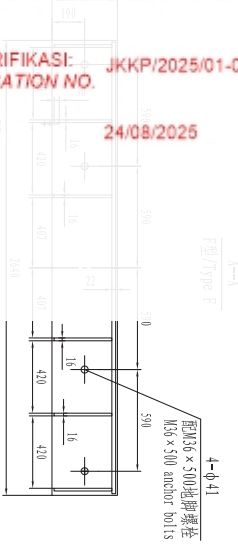


Revision History			
No.	Code name	Name	Quantity
1	本图/This drawing	底板/Bottom Plate	1
2	本图/This drawing	侧板/Side Plate	2
3	本图/This drawing	耳板/Ear Plate	1
4	本图/This drawing	耳板/Ear Plate	2
5	本图/This drawing	耳板/Ear Plate	2
6	本图/This drawing	耳板/Ear Plate	2
7	本图/This drawing	耳板/Ear Plate	2

Material Specification			
No.	Code name	Name	Quantity
1	本图/This drawing	底板/Bottom Plate	1
2	本图/This drawing	侧板/Side Plate	2
3	本图/This drawing	耳板/Ear Plate	1
4	本图/This drawing	耳板/Ear Plate	2
5	本图/This drawing	耳板/Ear Plate	2
6	本图/This drawing	耳板/Ear Plate	2
7	本图/This drawing	耳板/Ear Plate	2

Weight Calculation			
No.	Code name	Name	Quantity
1	本图/This drawing	底板/Bottom Plate	1
2	本图/This drawing	侧板/Side Plate	2
3	本图/This drawing	耳板/Ear Plate	1
4	本图/This drawing	耳板/Ear Plate	2
5	本图/This drawing	耳板/Ear Plate	2
6	本图/This drawing	耳板/Ear Plate	2
7	本图/This drawing	耳板/Ear Plate	2

Drawing Information			
No.	Code name	Name	Quantity
1	本图/This drawing	底板/Bottom Plate	1
2	本图/This drawing	侧板/Side Plate	2
3	本图/This drawing	耳板/Ear Plate	1
4	本图/This drawing	耳板/Ear Plate	2
5	本图/This drawing	耳板/Ear Plate	2
6	本图/This drawing	耳板/Ear Plate	2
7	本图/This drawing	耳板/Ear Plate	2

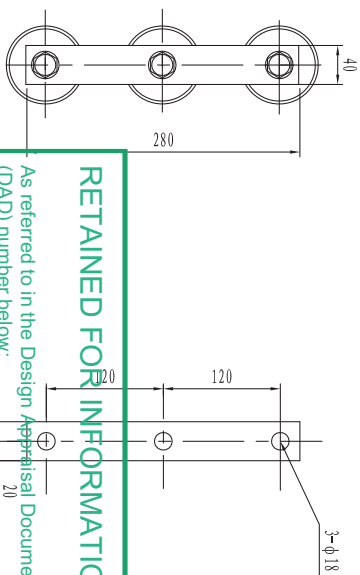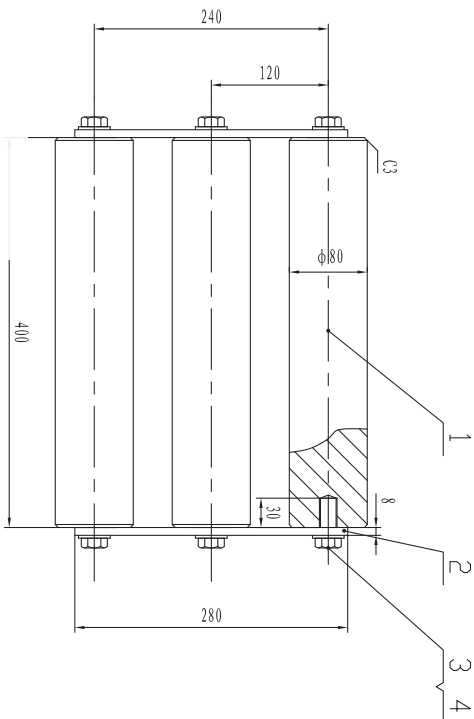

Serial number 2 size drawing

12
RETAINED FOR INFORMATION

As referred to in the Design Appraisal Document (DAD) number below:

DAD Number: SDAC/2490271-13

Date: 18 November 2024

Initials: WL

Office: Shanghai Design Appraisal Centre

LRQA Verification Limited

4	ASME B18.2.2-2022	紫銅 Heavy duty nuts 2 1/2in	6	A	meghan 94in 2in LRBQ-031001 Limited	
3	ASME B18.2.1-2021	紫銅 Stud 2 1/2in 1 1/2in	6		SA-193M-B7	0.1 0.6
2		连接板 Connecting Plate	2		Q235B	1 2
1		圓鋼/ Round steel Ø80	3		Q235A	15.8 47.4
NO.	Code name	Name	Quantity	Materials		Notes
					Single Weight Total Weight	

Technical requirements

來要木技

图中螺栓的拧紧程度以用手能转动滚子为准。

NO. VERIFIKASI: JKPP/2025/01-05/T-01/00996
VERIFICATION NO.

TARIKH: 24/08/2025
DATE





JABATAN KESELAMATAN DAN KESIHATAN PEKERJAAN
DEPARTMENT OF OCCUPATIONAL SAFETY AND HEALTH



Verifikasi Dokumen
Document Verification

				项目名称 Invertible energy station in Sanghai, Malaysia	
QINGDAO TONGFANG ENVIRONMENT ENGINEERING EQUIPMENT CO., LTD.					
设计 DESIGN	设计 DESIGN	签名 SIGNATURE	日期 DATE		
审核 CHECK	审核 CHECK				
标准化 STANDARD	标准化 STANDARD				
审核 AUDIT	审核 AUDIT				
批准 APPROVAL	批准 APPROVAL				
零件图 Part drawing					
比例 PROPORTION		1:5		重量 WEIGHT	50
第 张		共 张			
图号 DRAWING No.				设计阶段 DESIGN PHASE	
WTCY200-60-07				审核/Confirm to review and approve	
版次 EDITION				Rev. 0	

80-09-007XJ3LM

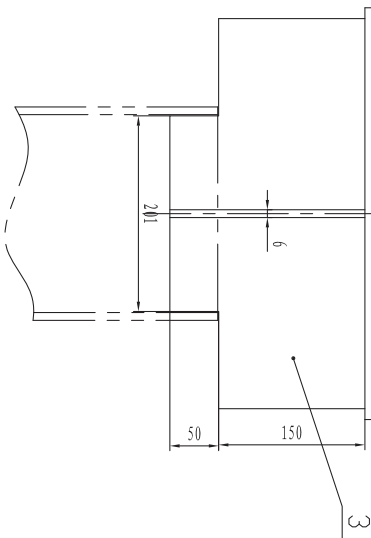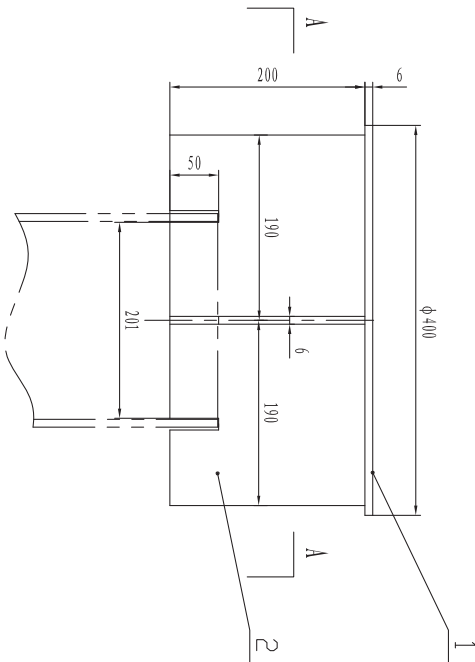

技术要求

Technical requirements

所有焊缝应双面满焊，焊脚高度按较薄件厚度。
All welds shall be fully welded on both sides,
The height of welding feet is according to the thickness of thinner parts



JABATAN KESELAMATAN DAN KESIHATAN PEKERJAAN
DEPARTMENT OF OCCUPATIONAL SAFETY AND HEALTH



NO. VERIFIKASI: JKKP/2025/01-05/T-01/00996
VERIFICATION NO.

TARIKH: 24/08/2025
DATE

Verifikasi Dokumen
Document Verification

Issue 1 (2025)

Office: Shanghai Design Appraisal Centre
LRQA Verification Limited

A member of the LRQA Group Limited

RETAINED FOR INFORMATION

As referenced
to in the Design Appraisal Document
(DAD) number below:

DAD Number: SPAC2490271-13

Date: 13 November 2024

Initials: WL

LRQA



青岛同方环境工程设备有限公司
QINDAO TONGFANG ENVIRONMENT ENGINEERING EQUIPMENT CO., LTD.

防涡流挡板/Anti-swirl baffle

零件图Part drawing

图号
DRAWING No.

WTCV200-60-08

NO.	Code name	Name	quantity	Materials	Weight		Notes
					Single	Total	
3		挡水板Waterproof panel 110*4	2	S30408	1.65	3.3	
2		挡水板Waterproof panel 110*4	2	S30408	1.8	3.6	
1		盖板Cover plate 400*6	1	S30408	6	6	

RESPONSIBILITY	签名 SIGNATURE	日期 DATE	项目名称 PROJECT NAME	设计阶段 DESIGN PHASE	审核中/Subject to review and approval
设计 DESIGN			可拆卸能量站 in Singapore, Malaysia		
校核 CHECKED					
审核 AUDIT					
批准 APPROVAL					

签字
日期