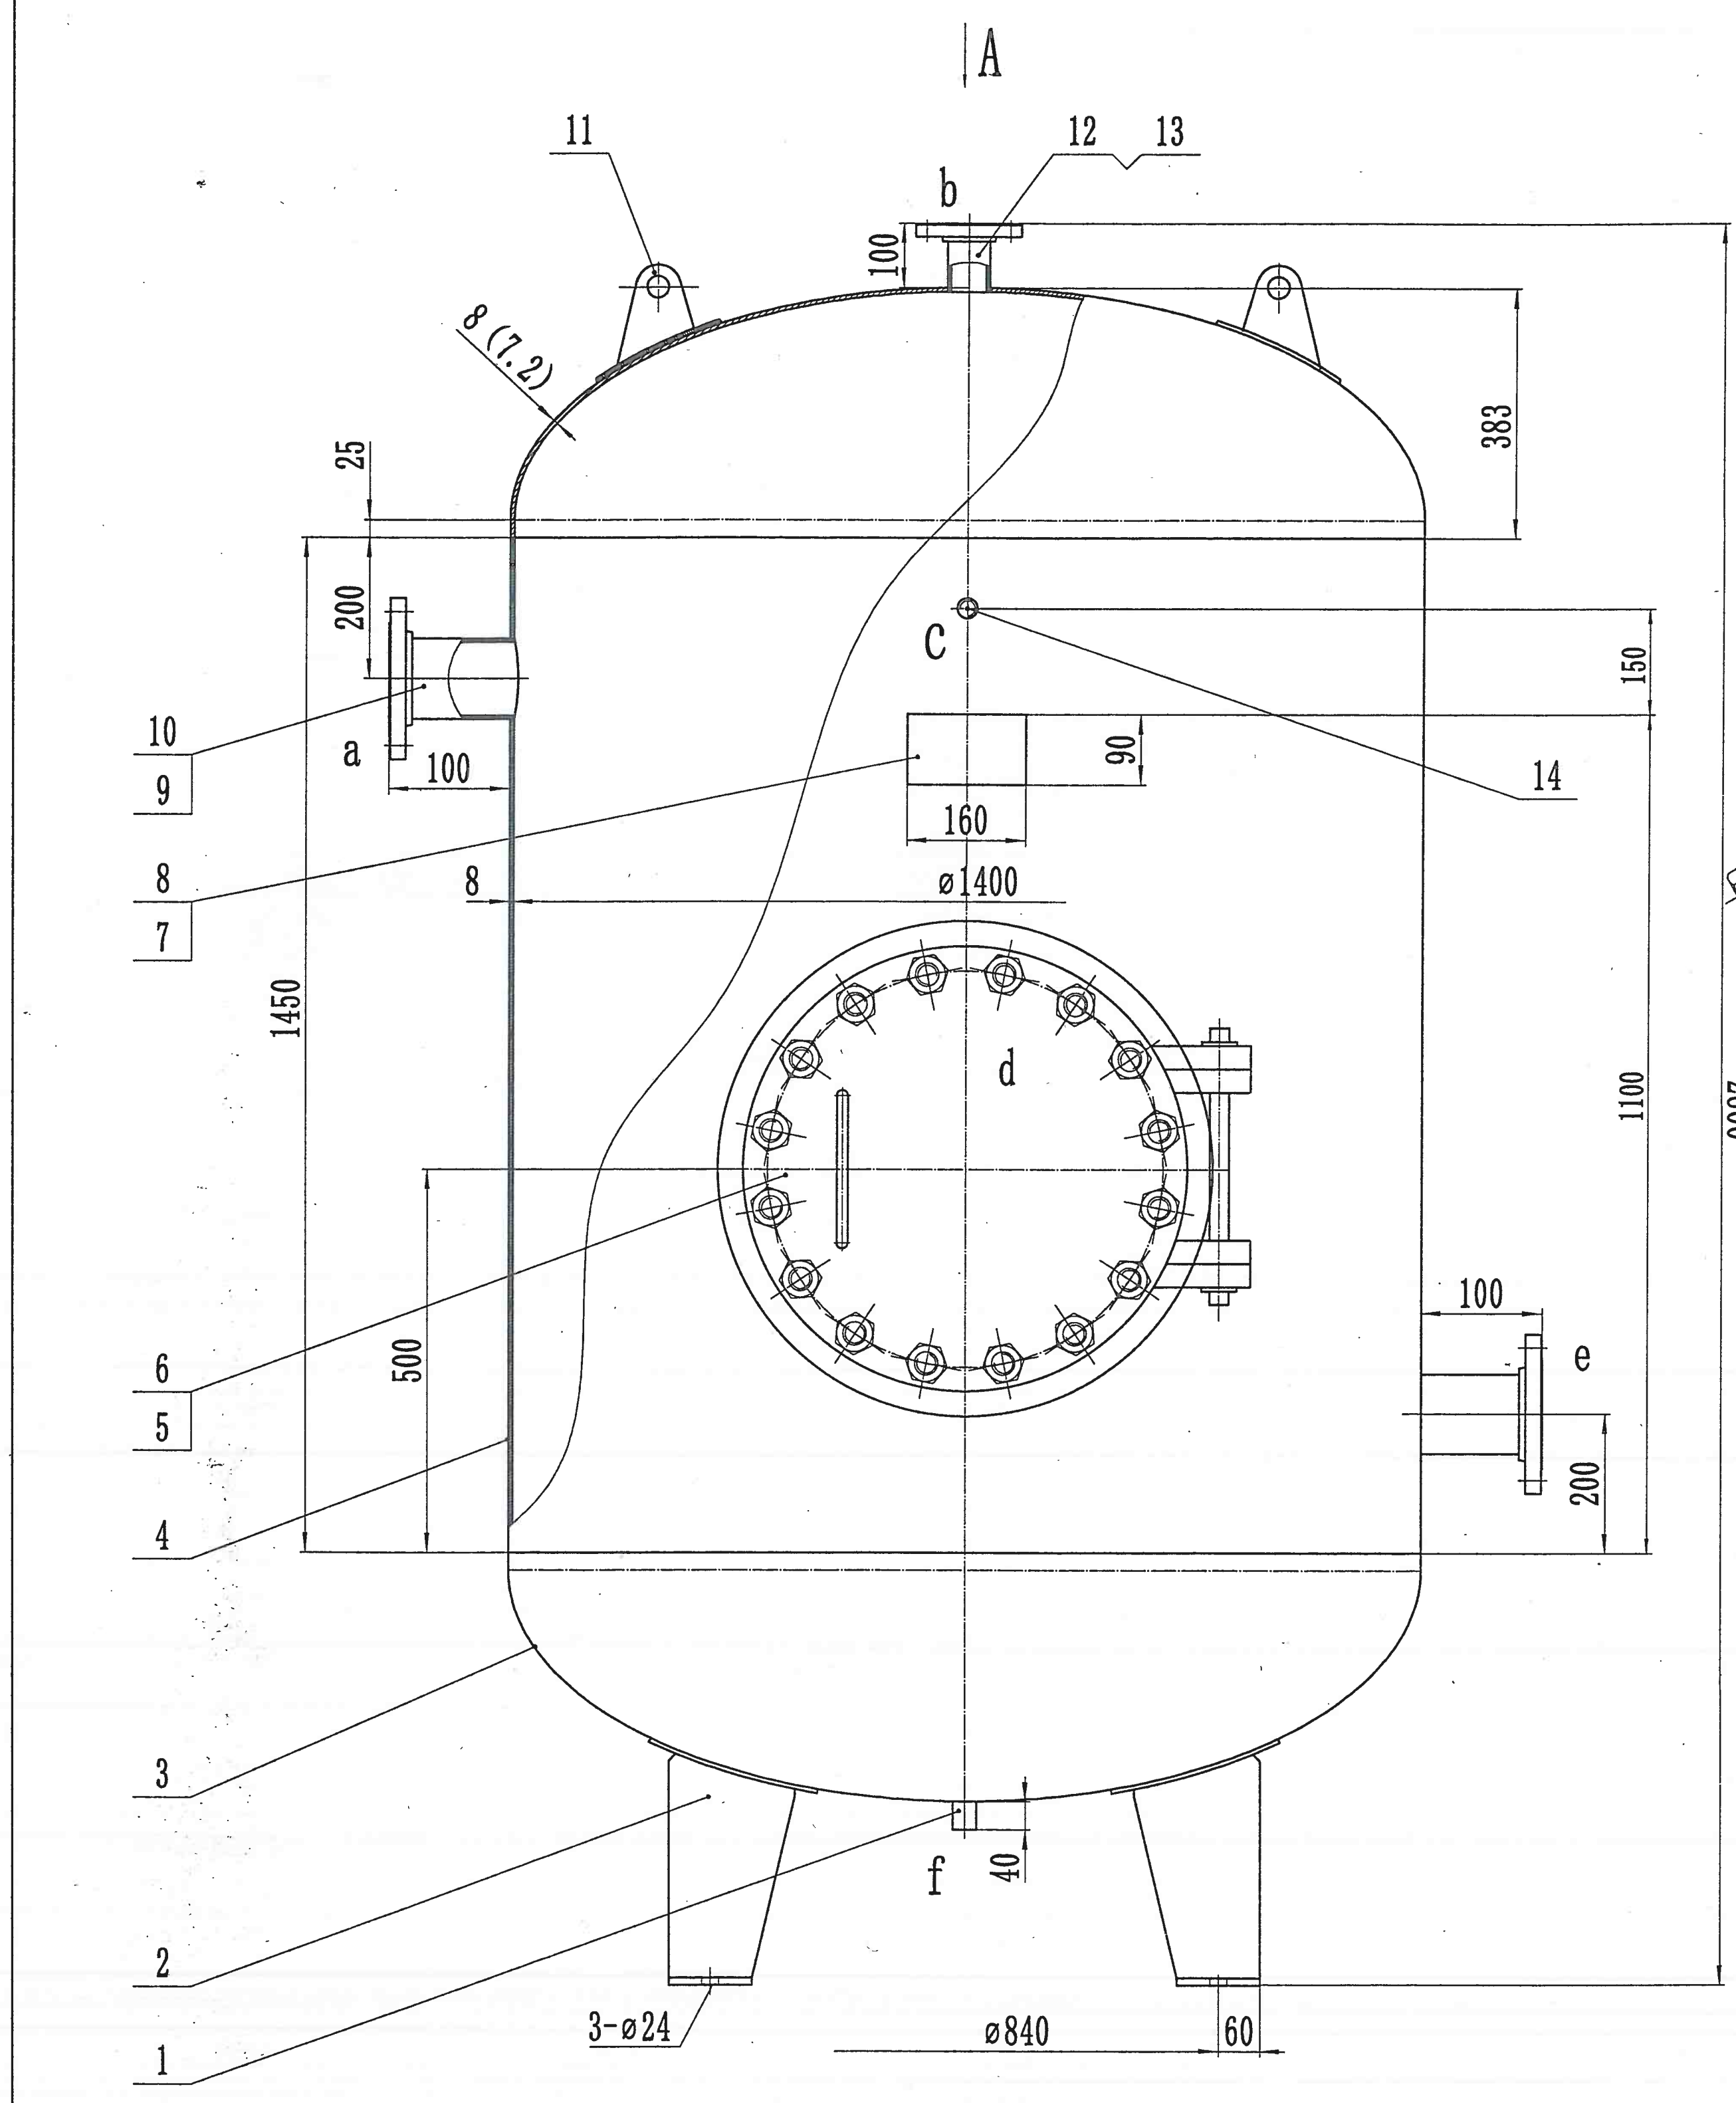

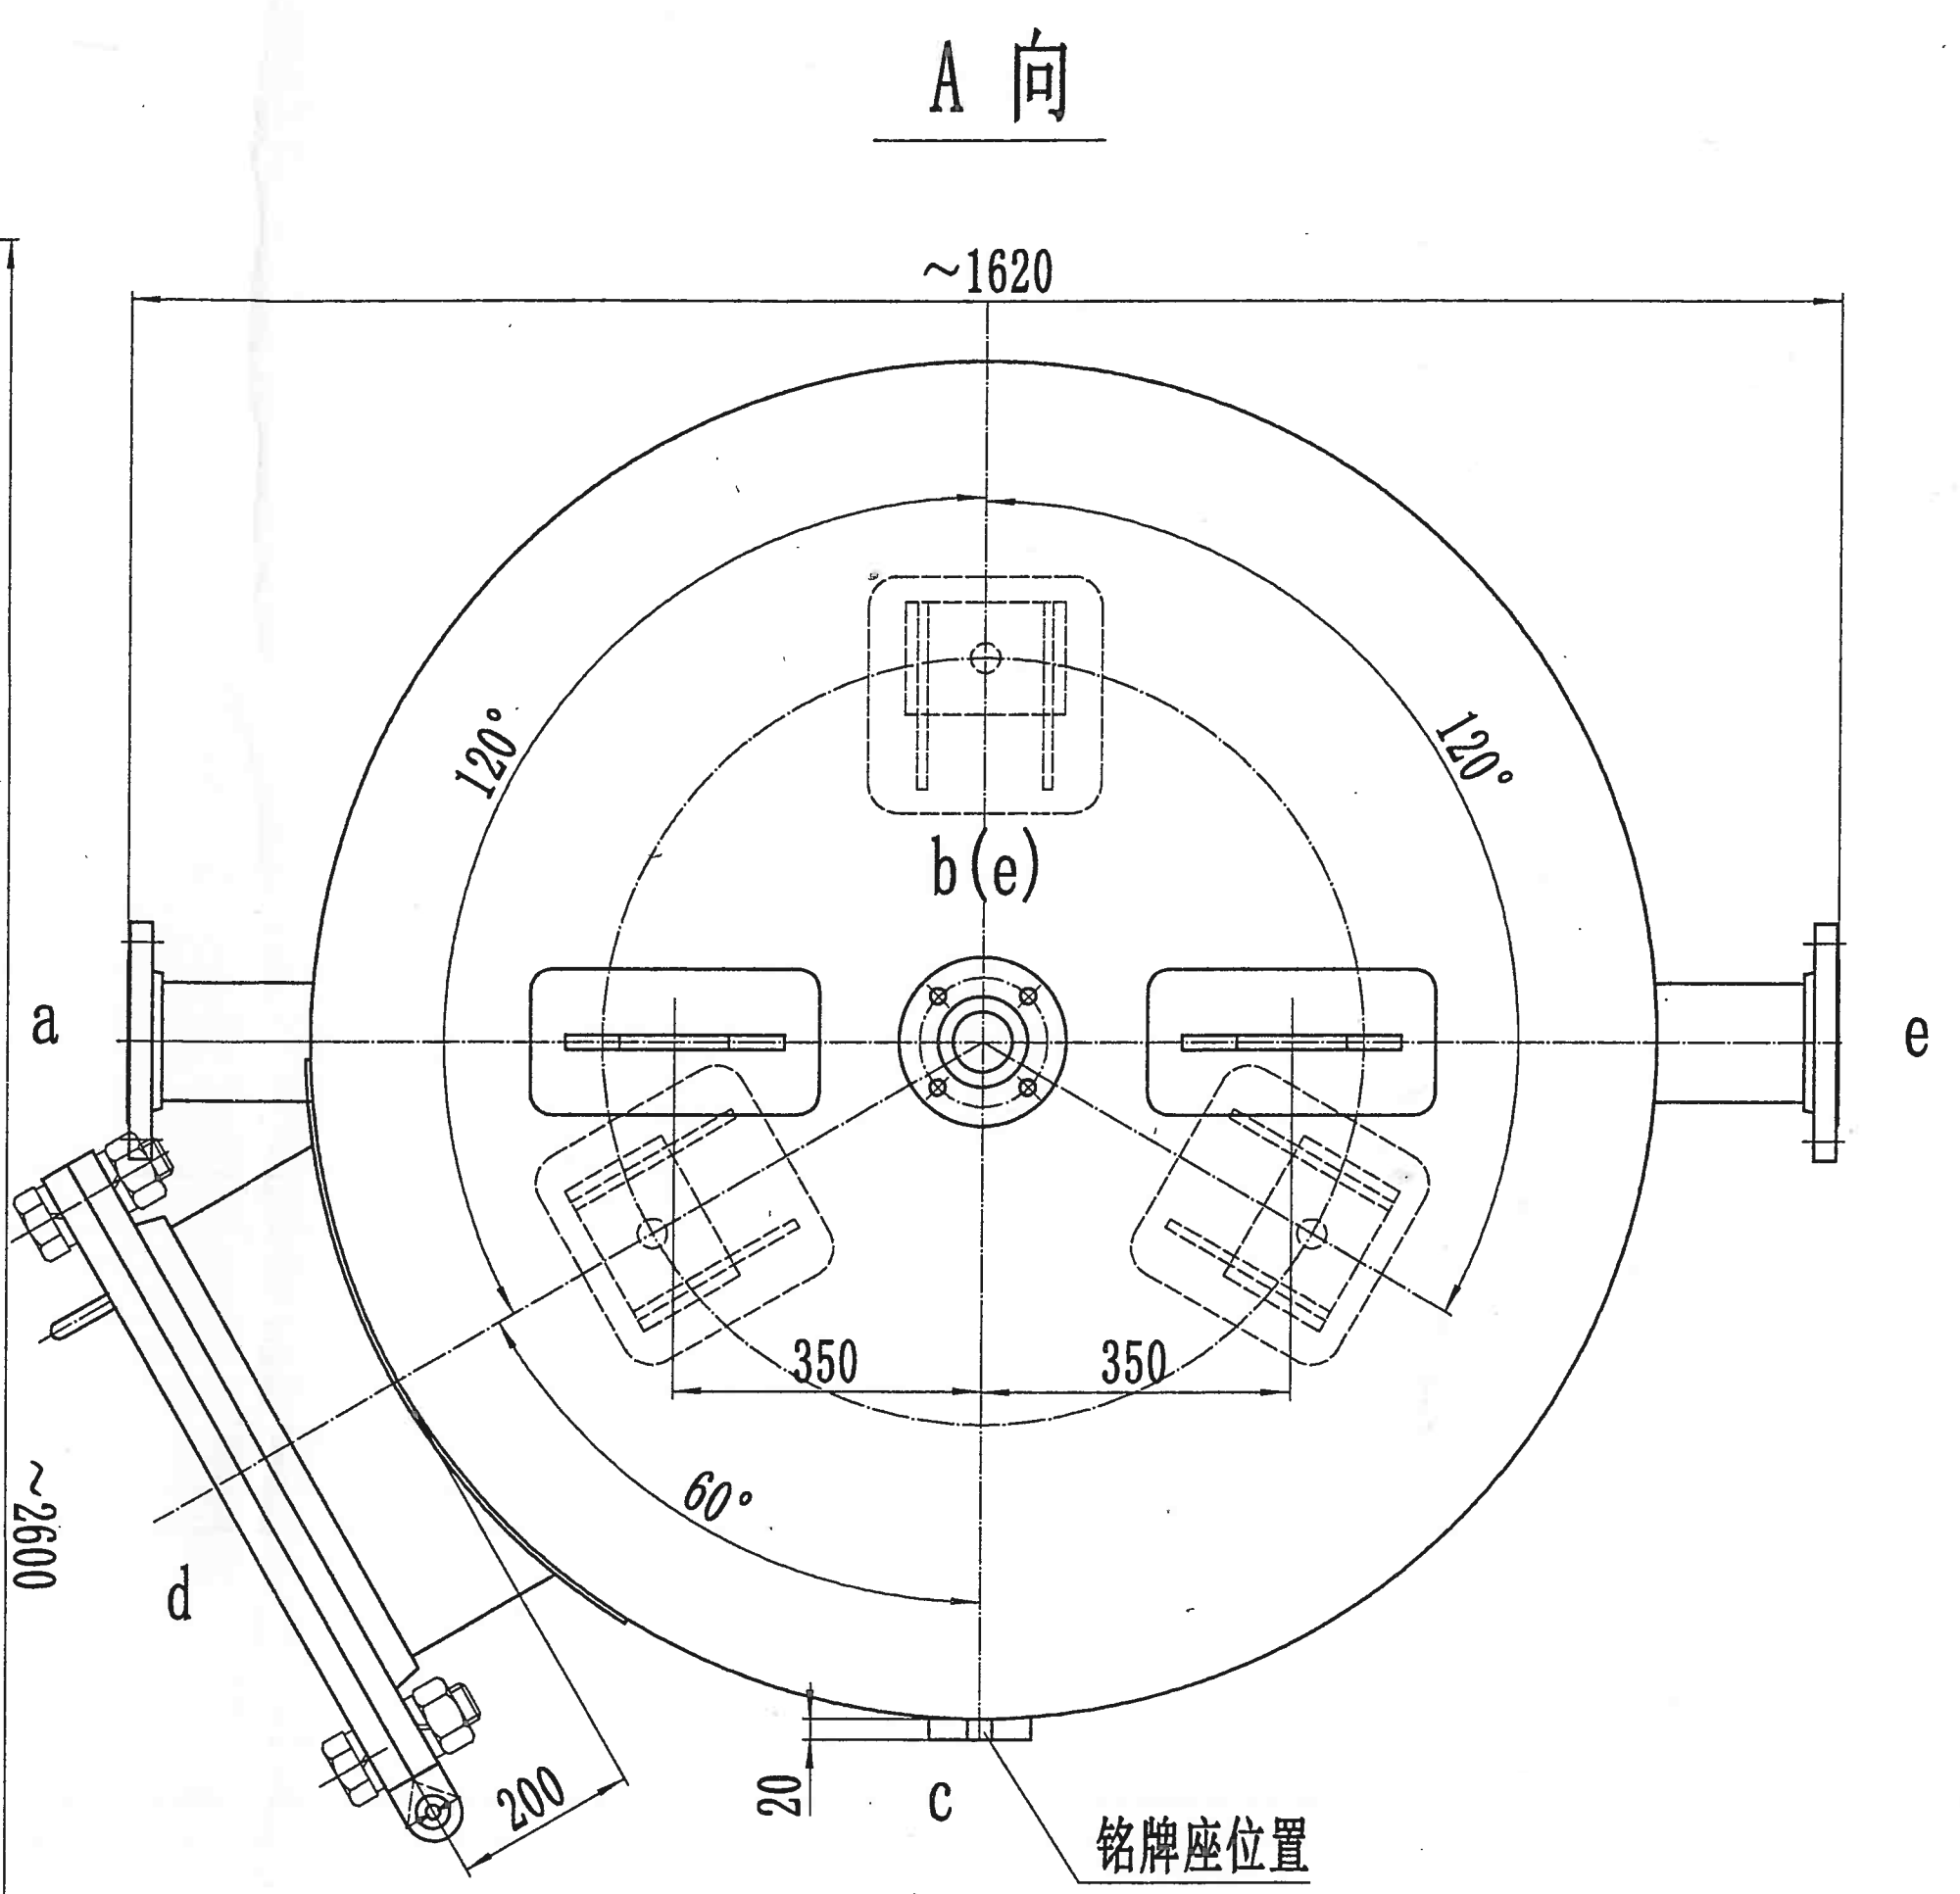

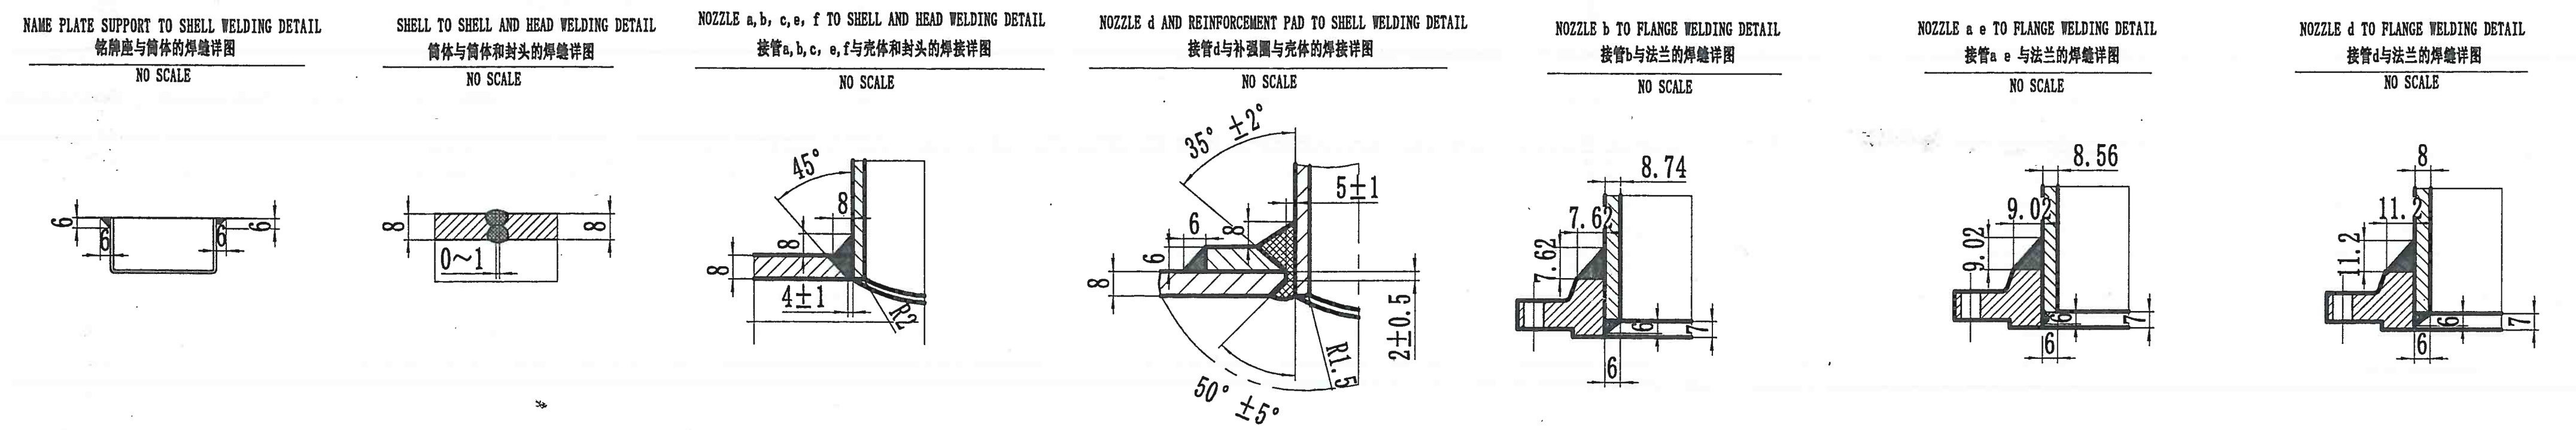

技术特性表 TECHNICAL FEATURES

设计压力DESIGN PRESS. MPa	0.84	设计温度DESIGN TEMP.	℃	100
最大允许工作压力MAWP MPa			℃	0
操作压力OPERATING PRESS. MPa			℃	80
水压试验压力HYDR. TEST PRESS. MPa				压缩空气COMPRESSED AIR
气压试验压力PNEU. TEST PRESS. MPa			m³	3
腐蚀裕量 CORR. ALLOW. mm			Kg	~990
焊接接头系数JOINT EFFICIENCY	A 0.85 / B 0.85	充水重FULL WATER	Kg	~3900
保温层INSUL. 材料MATERIAL / 厚度THICKNESS		射线探伤RADIOGRAPHY		局部SPOT PER UW-52
规范钢印CERTIFICATION MARK STAMP	ASME U			不要NO
介质特性MEDIUM NATURE	非致死NON-LETHAL	主要受压元件材料MATERIAL OF MAIN COMPRESSIVE PARTS		SA-516M Gr.485
水压试压最低金属温度MIN. HYDR TEST METAL TEMP. ℃	5	冲击试验IMPACT TEST		
消除应力热处理PWHT	不要NO			
表面清理等级CLEANING CLASS	见技术要求(本图) SPECIFICATION(THIS DWG.)	油漆PAINTING		见技术要求(本图) SPECIFICATION(THIS DWG.)
设计规范DESIGN CODE	ASME CODE SECTION Ⅷ.DIV.1, 2023 EDITION			

技术要求TECHNICAL SPECIFICATION

1. 所有受压部件的对接焊缝应采用全熔透焊缝，并应采用焊缝识别卡（JIC）上指定的WPS施焊；
All butt welds of pressure parts shall be full penetration weld using the applicable WPS specified in Joint Identification Card(JIC).
2. 管口、支座和铭牌的方位按本图；
The orientation for the nozzle ,support and name plate shall be as per this drawing.
3. 除图中注明外，角焊缝的焊脚高度按所连接件中较薄者的厚度，图中注明的焊角尺寸为最小值。
The leg of fillet weld shall equal to the thickness of thinner parts except otherwise specified in drawing.The leg size on this drawing is the minimum value.
4. 压力试验合格后，内部清理干净外表面整体除锈，除锈等级达到SA2.5级，合格后涂防锈底漆、面漆各一遍；
The internal surface of the tank should be cleaned after hydrostatic test.Coat Antirust Primer and finish paint one time afer passing test.The grade of rust cleaning reached SA2.5.
5. 除另外注明外，本图所有尺寸均为毫米，未注公差遵循GB/T19804-2005中C等级的要求；
Unless otherwise specified,all dimensions are in millimeters,the fabrication tolerance shall conform to the grade C level of GB/T19804-2005.
6. 法兰螺栓孔跨中心布置。
The flange bolt holes shall straddle equipment centre line and be equal spaced.

管 口 表LIST OF NOZZLE

代号SYMBOL	数量QTY	法兰标准FLANGE STD.	公称尺寸SIZE	级别CLASS	密封面SEALING	类型TYPE	接管NOZZLE	用途SERVICE
a	1	ASME B16.5-2013	DN100	150#	RF	SO	ø114.3×8.56	出气口OUTLET
b	1	ASME B16.5-2013	DN50	150#	RF	SO	ø60.3×8.74	安全阀口 Safety valve
c	1		M20×1.5				ø35×7.5	压力表口 Pressure gauge
d	1	ASME B16.5-2013	DN450	150#	RF	SO	ø457×8	检查孔 Access Opening
e	1	ASME B16.5-2013	DN100	150#	RF	SO	ø114.3×8.56	进气口INLET
f	1		$R\frac{3}{4}$				ø28×7	排污口DRAIN

JABATAN KESELAMATAN DAN KESIHATAN PEKERJAAN
DEPARTMENT OF OCCUPATIONAL SAFETY AND HEALTH
Verifikasi Dokumen
Document Verification
NO. VERIFIKASI: JKKP/202501-05/T-01/00920
VERIFICATION NO
TARIKH: 05/08/2025
DATE

SGS WITNESSED☐ REVIEWED☑
AI Yufeng Zhang
AIA-065 NB17472
2024.10.9

序号	图号或标准号	名称及规格	数量	材料	单件重(Kg)	总计重(Kg)	备注
14	HKA0286-08	压力表口NOZZLE FOR PRESSURE GAGUE M20X1.5	1	SA-105M		0.2	
13	ASME B36.10M	接管NOZZLE OD60.3X8.74	1	SA-106M Gr.B		1.4	L=120
12	ASME B16.5-2020	法兰FLANGE DN50 CL150 SO/RF	1	SA-105M		2.2	
11	HKA0286-07	吊耳LIFTING LUGS	2	SA-516M Gr.485	4.4	8.8	
10	ASME B36.10M	接管NOZZLE OD114.3X8.56	2	SA-106M Gr.B	1.6	3.2	L=120
9	ASME B16.5-2020	法兰FLANGE DN00 CL150 SO/RF	2	SA-105M	5.63	11.3	
8	HKAT-00	铭牌Nameplate	1	COMPONENT		1.0	
7	HKAT-01	铭牌座NAMEPLATE SUPPORT	1	SA-516M Gr.485		1.0	
6	HKA0286-06	补强圈REINFORCEMENT PAD OD750X6	1	SA-516M Gr.485		13.1	
5	HKA0286-05	人孔MAN HOLE	1	COMPONENT		225.05	
4	HKA0286-04	筒体SHELL ID1400 δ=8	1	SA-516M Gr.485		402.8	L=1450
3	HKA0286-03	2:1椭圆封头ELLIPSOIDAL HEAD ID1400X8(7.2)	2	SA-516M Gr.485	137.7	275.4	
2	HKA0286-02	支承式支座BRACKET SUPPORT	3	COMPONENT	13.5	40.5	
1	HKA0286-01	排污口Drain outlet$R\frac{3}{4}$	1	SA-105M		0.4	

压缩空气储罐 COMPRESSED AIR TANK		ID1400×2600	HKA0286/REV.0
设计Design	日期Date 2024.10.8	青岛海空信合工程有限公司	
批准Approved	日期Date 2024.10.8	QINGDAO HAIKONG XINHE ENGINEERING CO., LTD.	

借(通)用件登记	
旧底图总号	
底图总号	
签字	
日期	
档案员	日期